


GENERAL NOTES:

- CONTRACTOR TO COORDINATE WITH FACILITY WHEN WORKING AROUND OR ABOVE THE RIDE COMPONENTS, AND PROVIDE ALL NECESSARY MEASURES TO PROTECT THESE COMPONENTS PER THE REQUIREMENTS OF THE FACILITY.
- UPON COMPLETION, SYSTEM SHALL BE TESTED FOR PROPER OPERATION.

MECHANICAL CONSTRUCTION NOTES:

- PROVIDE NEW EXHAUST FAN AND ASSOCIATED DUCTWORK AS SCHEDULED. (INSTALL EF-1 ABOVE CEILING AT 11' 9-1/2" AFF. COORDINATE ELECTRICAL POWER AND WIRING WITH ELECTRICAL DRAWINGS.)
- PROVIDE NEW RAIN RESISTANT LOUVER AS SCHEDULED. (INSTALL LV-1 AT 11' 9-1/2" AFF) REFER TO INSTALLATION DETAIL ON DVC-M-61.

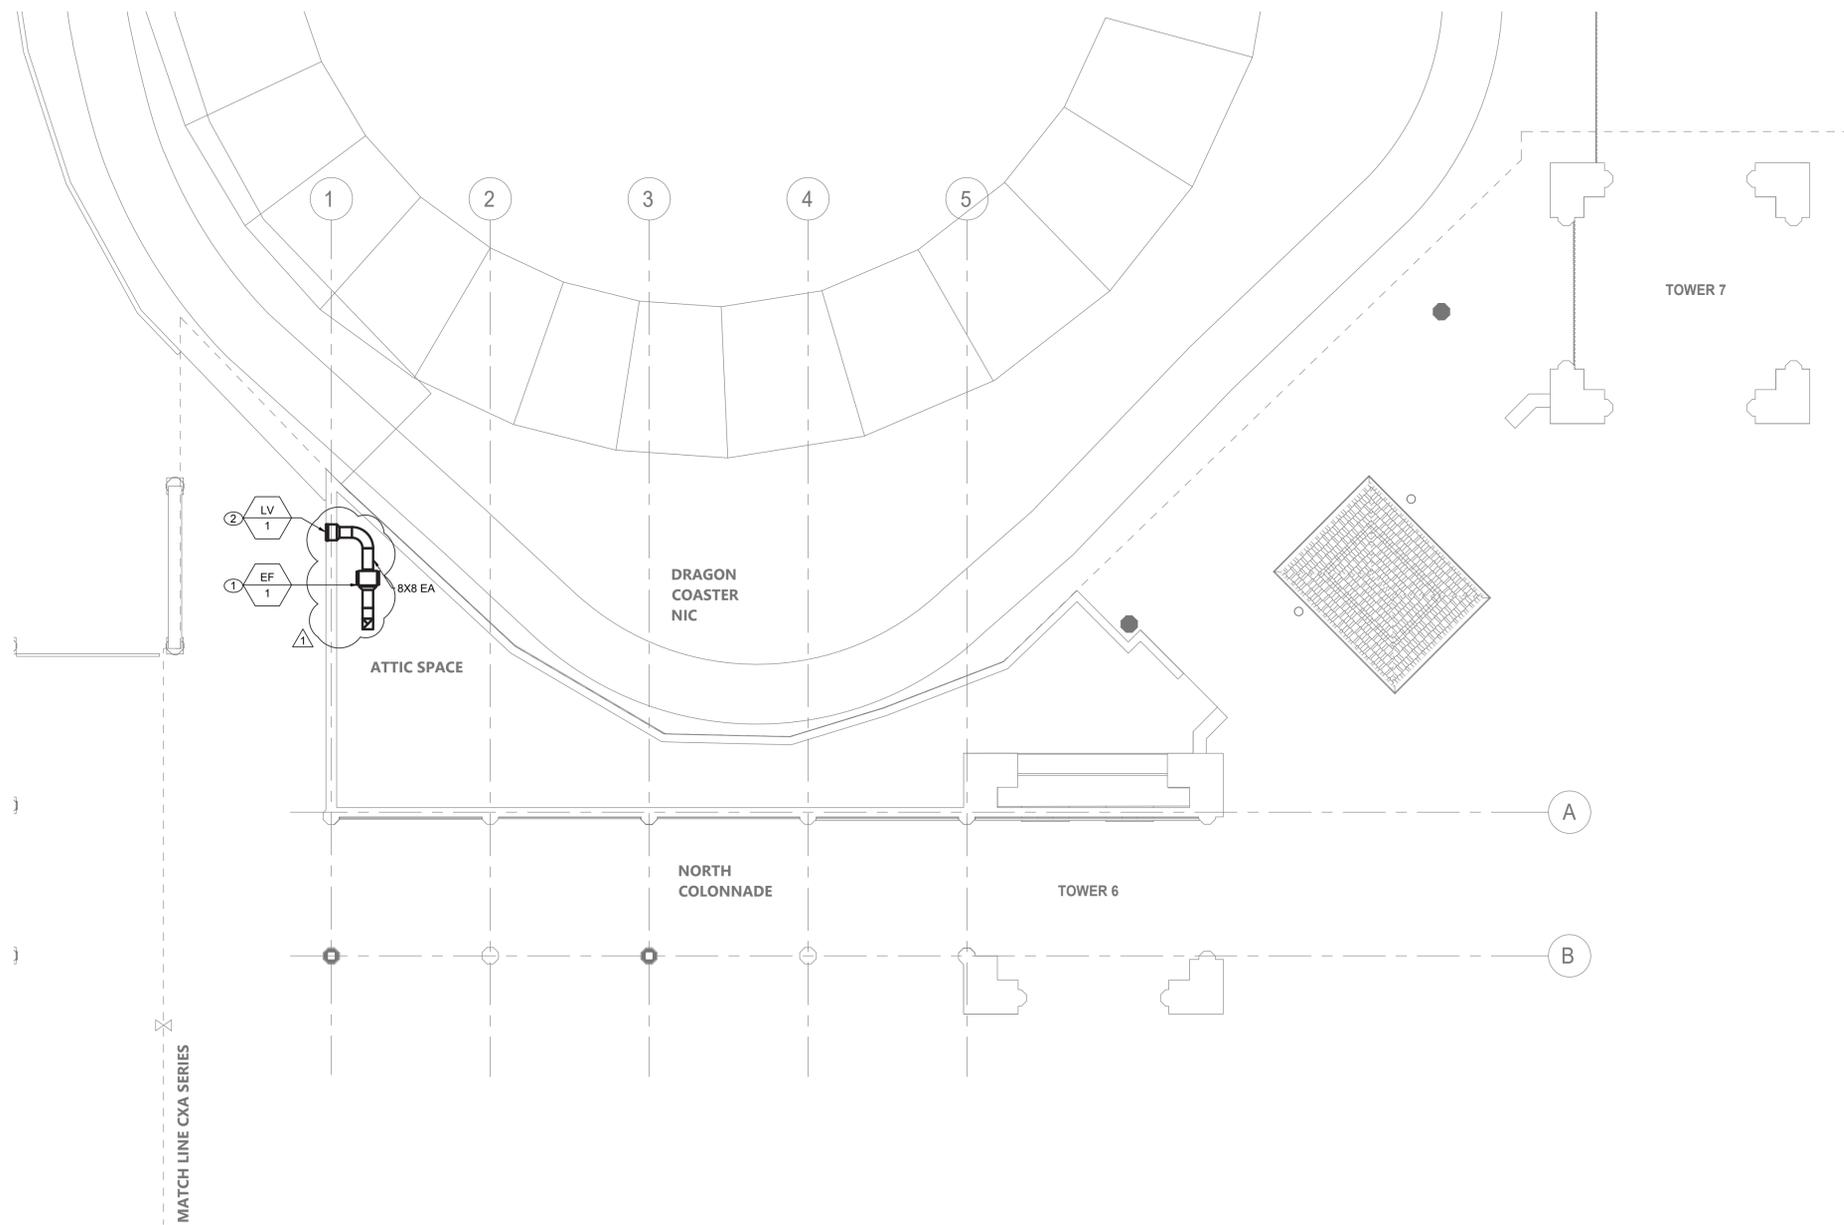

MECHANICAL ATTIC CONSTRUCTION PLAN
SCALE: 3/16" = 1'-0"

CONSULTANT INFORMATION

LiRo Engineers, Inc.
A LiRo Group Company
Syosset, N.Y. 516-214-8157(T)



REVISION NUMBER	DATE	MADE BY	APP'D BY	REVISION
1	09/21/22			BID ADDENDUM #3

RECORD DRAWING CERTIFICATION

AS BUILT - CHANGES AS NOTED AS BUILT - NO CHANGES

CONTRACTOR		PROJECT COORDINATOR	
NAME _____	NAME _____	NAME _____	NAME _____
SIGNATURE _____	SIGNATURE _____	SIGNATURE _____	SIGNATURE _____
TITLE _____	TITLE _____	TITLE _____	TITLE _____
DATE _____	DATE _____	DATE _____	DATE _____

WESTCHESTER COUNTY, NEW YORK
DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
DIVISION OF ENGINEERING

**INFRASTRUCTURE REHABILITATION - PHASE 3
PLAYLAND PARK, RYE, NEW YORK
DRAGON COASTER VENDORS
MECHANICAL ATTIC CONSTRUCTION PLAN**

CONTRACT NUMBER 22-523	SHEET NUMBER DCV-M-22
DWG NO. 472 of 664	
SCALE: AS INDICATED	
DATE: 08/23/2022	
DPW FILE NUMBER 1-118-M-1221-1	REV. NO. 1