


INTERIOR WALL PARTITION CONSTRUCTION TYPES:

NOTE: ALL INTERIOR WALL PARTITIONS ARE TYPE  UNLESS NOTED OTHERWISE.

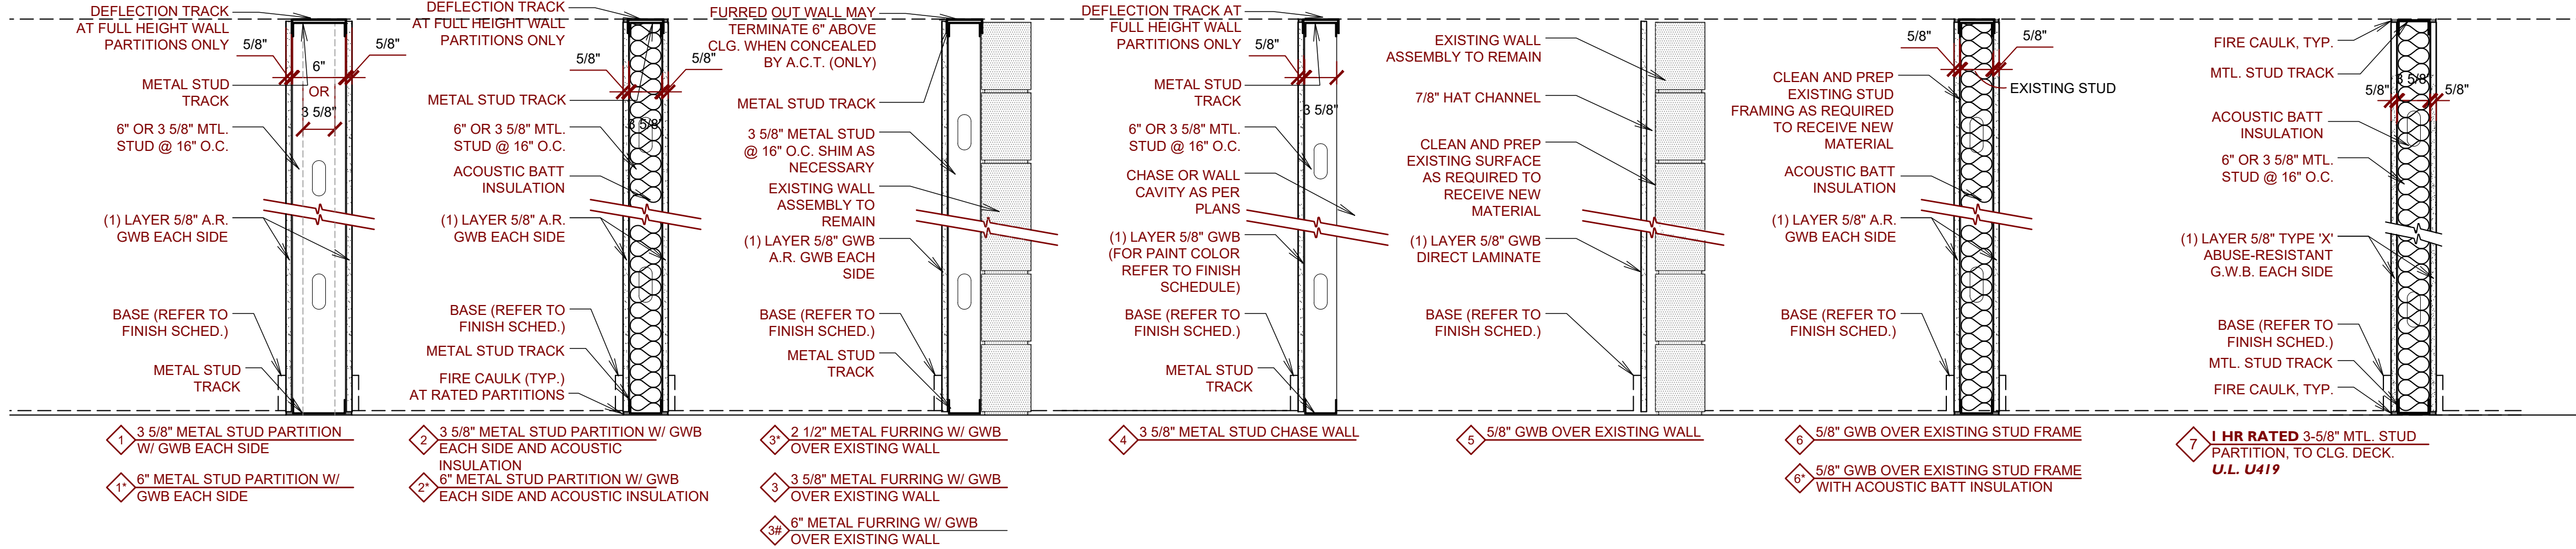

PARTITION GENERAL NOTES:

1. PROVIDE MTL. CORNER BEAD @ ALL OUTSIDE CORNERS.
2. PROVIDE FIRE CAULK &/OR FIRE STOPPING @ ALL PENETRATIONS THRU RATED CONSTRUCTION.
3. PROVIDE FIRE CAULK ALONG PERIMETER OF ALL RATED PARTITIONS.
4. AT GWB WALLS ABUTTING CONSTRUCTION OF DISSIMILAR CONSTRUCTION, PROVIDE 1" BEAD FOR GWB & CAULK JOINT BETWEEN BEAD & DISSIMILAR CONSTRUCTION.
5. AT GWB WALLS ABUTTING EXPOSED STRUCTURE, PROVIDE 1" WIDE x THICKNESS OF GWB PAINTED METAL REVEAL (CAULK AS REQ'D).
6. CAULK AROUND COUNTERS AND PLUMBING FIXTURES.
7. REFER TO ROOM FINISH SCHEDULE (FOR ALL FLOOR, WALL, & CEILING FINISH DESCRIPTIONS).
8. ALL PARTITIONS (INCLUDING STUDS AND GWB) SHALL EXTEND FROM FLOOR SLAB TO UNDERSIDE OF DECK.
9. PROVIDE CORNER GUARDS @ ALL OUTSIDE CORNERS.
10. G.W.B. SHALL BE IMPACT RESISTANT G.W.B. (EXCEPT IN CLOSETS OR WHERE NOTED).
11. PROVIDE WATER-RESISTANT G.W.B. AND TILE BACKER BOARD FOR ALL WALLS SCHEDULED TO RECEIVE WALL TILE, AS PER THE SPECIFICATIONS.
12. PROVIDE C.M.U. WITH BULL-NOSE EDGE FOR ALL OUTSIDE CORNERS OF C.M.U. INTERIOR WALLS.
13. PROVIDE CONTROL JOINTS.
14. PROVIDE BRIDGING IN STEEL STUD WALLS AS REQ'D BY MANUFACTURER BASED ON HEIGHT OF PARTITION.
15. PROVIDE STEEL STUDS OF REQUIRED GAUGE (STRENGTH) BASED ON HEIGHTS OF PARTITIONS: ALL NON-BEARING INTERIOR PARTITIONS UP TO 14' SHALL HAVE MINIMUM 20 GA. STEEL STUDS UP TO 20' SHALL BE MIN. 20 GA. STL STUDS, UNLESS NOTED AS HEAVIER GA.
16. ALL SINGLE WYTHE CMU WALLS SHALL BE PROVIDED WITH INTEGRAL WATER REPELLENT AND WATER REPELLENT SHALL BE ADDED TO THE MORTAR MIX.

SIGN NOTES:

1. ACCESSIBILITY SIGNAGE REQUIRED BY CODE SHALL BE OF SIMILAR STYLE AND FINISH TO TYP. SIGN SHOWN WITH AN ADDITIONAL 6"x 6" PANEL ABOVE THE ROOM NAME CONTAINING THE INTERNATIONAL SYMBOL FOR THE INDICATED INFORMATION.
2. BRAILLE AND TACTILE INFORMATION TO MEET ALL ADA REQUIREMENTS.
3. LETTERING STYLE TO BE SANS SERIF, MIN. 3/4" HEIGHT, FONT TO BE CHOSEN BY OWNER TO COORDINATE WITH EXISTING SIGNAGE.
4. CONTRACTOR SHALL PROVIDE A SHOP DRAWING SUBMITTAL WITH LAYOUT OF ALL SIGNAGE FOR REVIEW AND APPROVAL.

