




PLUMBING FIXTURE SCHEDULE																		
1. ALL FIXTURES AND TRIM TO BE LEAD FREE. 2. ALL HANDICAP FIXTURES TO BE INSTALLED ADA COMPLIANT WITH OFFSET WASTE WHERE REQUIRED AND INCLUDING UNDERFIXTURE PROTECTIVE KIT. 3. REFER TO SPECIFICATION FOR ADDITIONAL FIXTURE REQUIREMENTS AND ALTERNATE MFR'S. 4. ALL TRIM TO BE CHROME PLATED CAST BRASS. 5. LAVATORIES IN PUBLIC TOILETS TO BE FURNISHED WITH GRID STRAINERS. FIXTURES IN PRIVATE TOILETS AND LOCKER ROOMS SHALL BE FURNISHED WITH POP-UP DRAINS. 6. TRAPS FOR LAV/SINKS SHALL BE SEMI-CAST BRASS/17 GAUGE WASTE 1 1/4"x1 1/2" OR 1 1/2" DEPENDING ON FIXTURE OUTLET. 7. ALL FIXTURES TO BE FURNISHED WITH INDIVIDUAL FIXTURE STOP VALVES IN PUBLIC AREAS VALVES SHALL BE LOOSE KEY TYPE. 8. ALL WALL HUNG FIXTURES TO BE PROVIDED WITH SUITABLE FLOOR MOUNTED SUPPORTS. 9. WALL HUNG WATER CLOSETS SHALL BE PROVIDED WITH COMBINATION CARRIER WITH HORIZONTAL OR VERTICAL FITTING TO SUIT PIPING ARRANGEMENT. 10. VENTS NOTED ARE FOR INDIVIDUAL FIXTURE VENTS ONLY. 11. WATER CLOSETS LOCATED IN PUBLIC AREAS SHALL BE PROVIDED WITH OPEN FRONT SEATS.																		
SYMBOL	DESCRIPTION	BASIS OF DESIGN (APPROVED MFR'S ARE LISTED IN SPECIFICATIONS)						COLOR/ FINISH	FLOW (GPM)	MAP	ROUGH IN				FIXTURE UNITS			NOTES
		MANUFACTURER	MODEL NO.	FAUCET OR FLUSH VALVE	CARRIER OR SUPPORT	SENSOR OPERATED					CW	HW	SAN	SHV	CW	HW	DFU	
LAV/ LAV HC	LAVATORY HANDICAPPED	KOHLER	PINOR K-2035	SLOAN ETF-600	WALL MOUNTED	HARDWIRED	WHITE	0.5 GPM	-	1/2"	1/2"	1 1/4"	1 1/4"	-	-	-	VITREOUS CHINA, ADA COMPLIANT, BELOW DECK THERMOSTATIC MIXING VALVE, POLISHED CHROME FINISH, MULTI-LAMINAR SPRAY, INFARED SENSOR.	
WC/ WC HC	WATER CLOSET HANDICAPPED	KOHLER	HIGHLINE K-3658	FLUSH TANK	FLOOR MOUNTED	-	WHITE	1.28	-	1/2"	-	4"	2"	-	-	-	VITREOUS CHINA, COMFORT HEIGHT ELONGATED BOWL, CLASS FIVE FLUSHING SYSTEM, POLISHED CHROME TRIP LEVER, WATERSENSE LABELED, ADA COMPLIANT, PROVIDE TOILET SEAT.	
UR/ UR HC	URINAL HANDICAPPED	KOHLER	BARCON K-4991-ET	SLOAN ROYAL 180 ESS	WALL MOUNTED	HARDWIRED	WHITE	1.0 GPF	-	3/4"	-	2"	2"	-	-	-	VITREOUS CHINA, LOW CONSUMPTION, FLUSHING RIM, INTEGRAL STRAINER, WASHOUT FLUSH ACTION, ADA COMPLIANT (REFER TO ARCHITECTURAL PLANS FOR MOUNTING HEIGHT).	
CTL/ CTL HC	COUNTER-TOP LAVATORY	KOHLER	BACHATA K-2608-SU	SLOAN ETF-600	UNDERMOUNT	HARDWIRED	STAINLESS STEEL	0.5 GPM	-	1/2"	1/2"	1 1/4"	1 1/4"	-	-	-	STAINLESS STEEL, ADA COMPLIANT, BELOW DECK THERMOSTATIC MIXING VALVE, POLISHED CHROME FINISH, MULTI-LAMINAR SPRAY, INFARED SENSOR.	
FD	FLOOR DRAIN	J.R. SMITH	2010	-	FLOOR MOUNTED	-	-	-	-	-	-	2",3",4"	2"	-	-	-	PROVIDE TRAP PRIMER, REFER TO SPEC SECTION 22.13.00 FOR MORE INFORMATION.	
RD	ROOF DRAIN	J.R. SMITH	1010	-	ROOF MOUNTED	-	-	-	-	-	-	4"	-	-	-	-	LOW PROFILE DOME.	
SK	SINK	ELKAY	LUSTERONE LRAD372260	DELTA 100-OST	DROP-IN	-	STAINLESS STEEL	1.5 GPM	-	1/2"	1/2"	1 1/2"	1 1/2"	-	-	-	37"x22"x8", 18 GAUGE 304 STAINLESS STEEL, DOUBLE BOWL, REAR CENTER DRAIN, ADA COMPLIANT.	
SK-1	EXAM ROOM SINK	KOHLER	PENNINGTON K-2196	SLOAN ETF-600	COUNTER-TOP	-	WHITE	0.5 GPM	-	1/2"	1/2"	1 1/4"	1 1/4"	-	-	-	VITREOUS CHINA, ADA COMPLIANT, BELOW DECK THERMOSTATIC MIXING VALVE, POLISHED CHROME FINISH, MULTI-LAMINAR SPRAY, INFARED SENSOR.	
SK-2	SINK	ELKAY	LUSTERONE LRAD252240	DELTA 100-OST	DROP-IN	-	STAINLESS STEEL	1.5 GPM	-	1/2"	1/2"	1 1/2"	1 1/2"	-	-	-	25"x22"x4", 18 GAUGE 304 STAINLESS STEEL, SINGLE BOWL, REAR CENTER DRAIN, SINGLE LEVER FAUCET, ADA COMPLIANT.	
EW	ELECTRIC WATER COOLER	ELKAY	EZSTLWSLK	-	WALL MOUNTED	-	LIGHT GRAY	8 GPH	-	1/2"	-	1 1/4"	1 1/4"	-	-	-	8"-LEVEL WATER COOLER, ELKAY EZH2O BOTTLE FILLING STATION, FLEXIGUARD SAFETY BUBBLER, 115 V, 60 HZ, 6A, ADA COMPLIANT.	
MR	MOP RECEPTOR	FIAT	MSB2424	FIAT S30AA	FLOOR MOUNTED	-	MOLDED STONE	-	-	1/2"	1/2"	3"	2"	-	-	-		


PLUMBING SYMBOLS AND ABBREVIATIONS				
— W —	WATER SERVICE		WH	WALL HYDRANT
— — —	DOM. COLD WATER		HB	HOSE BIBB
— — — —	DOM. HOT WATER		FD	FLOOR DRAIN
— — — — —	DOM. HOT WATER RETURN		RD	ROOF DRAIN
— — — — —	SOIL, WASTE		DD	DECK DRAIN
— — — — —	VENT		OD	OVERFLOW DRAIN
— — — — —	STORM		AD	AREA DRAIN
— G —	GAS		RWC	RAIN WATER CONDUCTOR
VTR	VENT THRU ROOF		DS	DOWNSPOUT
CO	CLEAN OUT		MH	MAN HOLE
DWR	DOMESTIC WATER RISERS		(N)	NEW
GW	GAS WATER HEATER		(E)	EXISTING
EW	ELECT. WATER HEATER			NEW CONNECTION TO EXISTING
FU	FIXTURE UNIT			EXISTING TO REMAIN
S & VST	SOIL & VENT STACK		(R)	DISCONNECT AND REMOVE
W & VST	WASTE & VENT STACK			
I.E.	INVERT ELEVATION			
SF	SQUARE FEET			

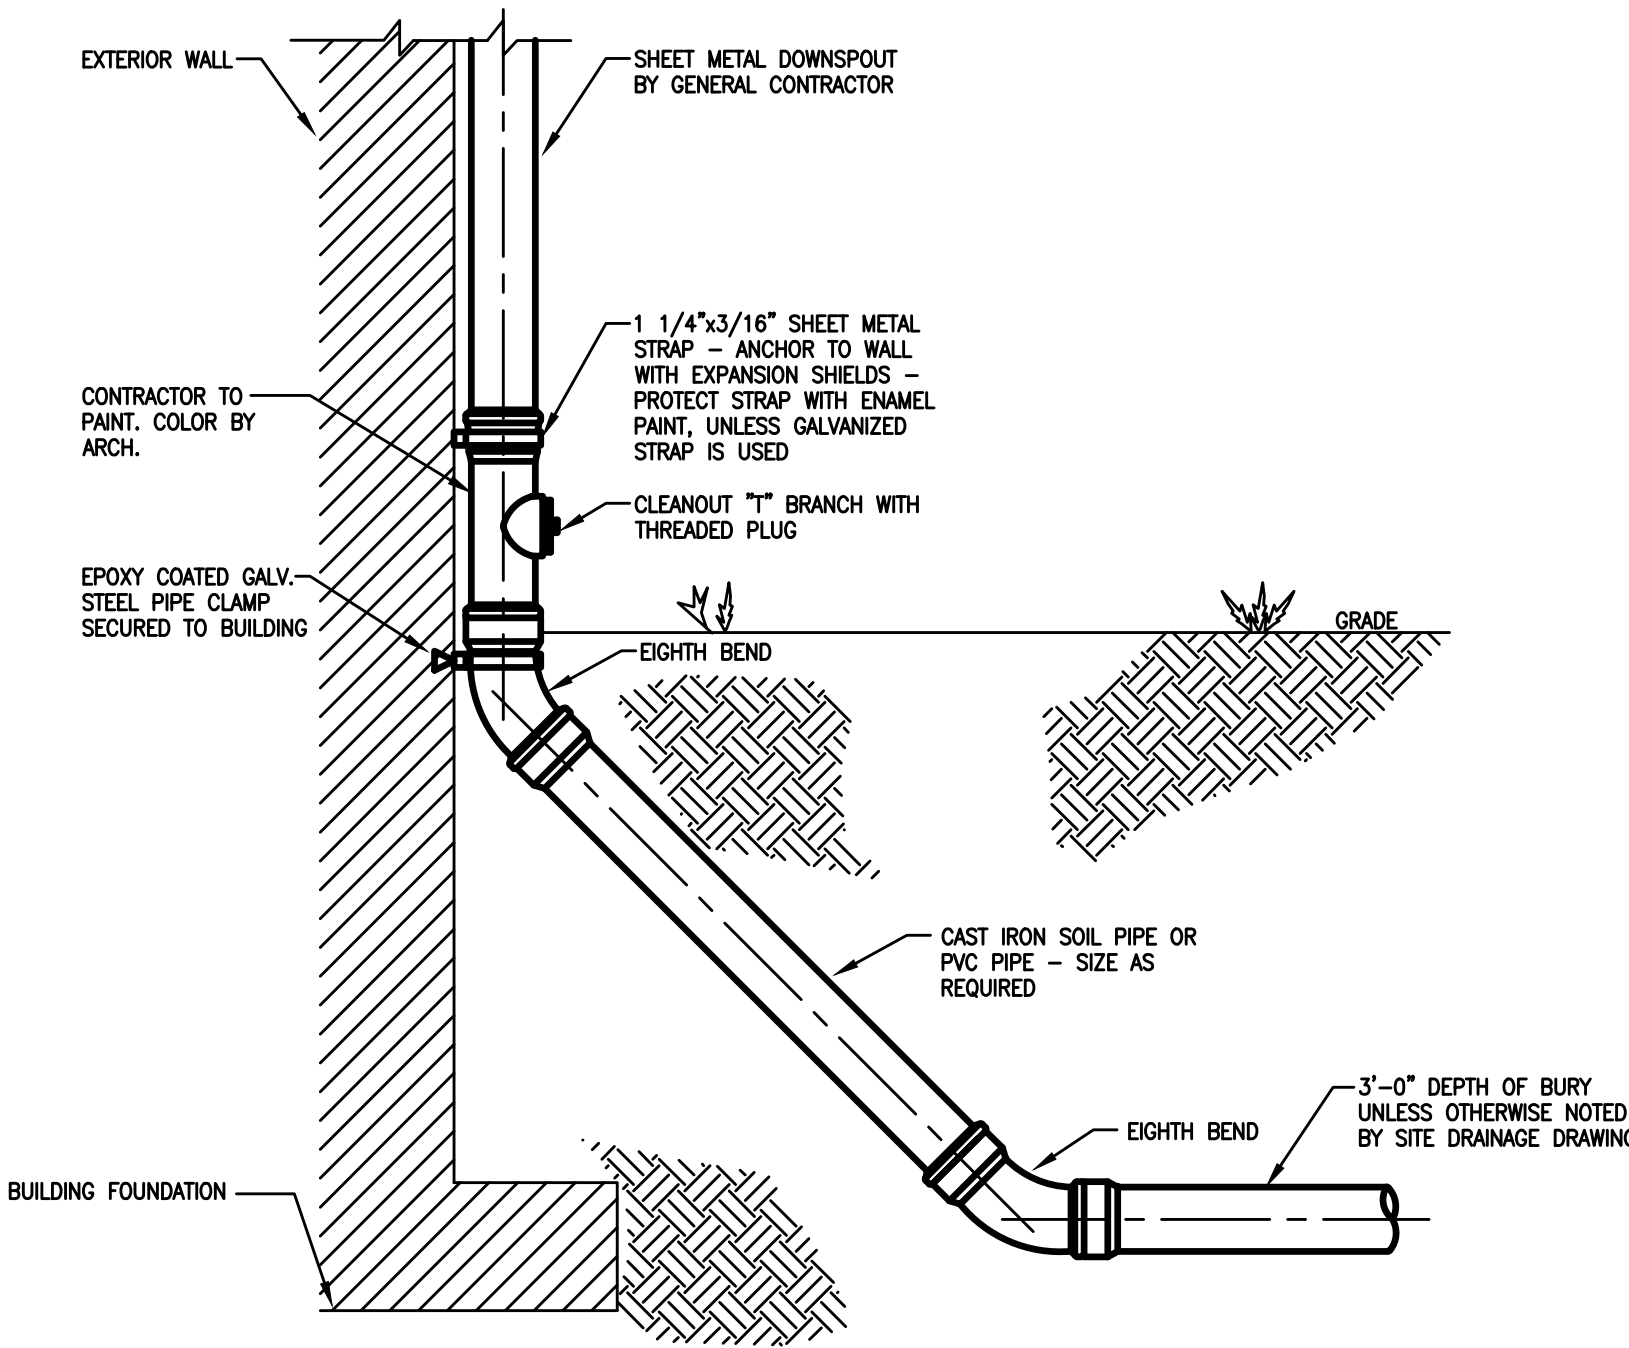


Downspout Detail
SCALE: NONE

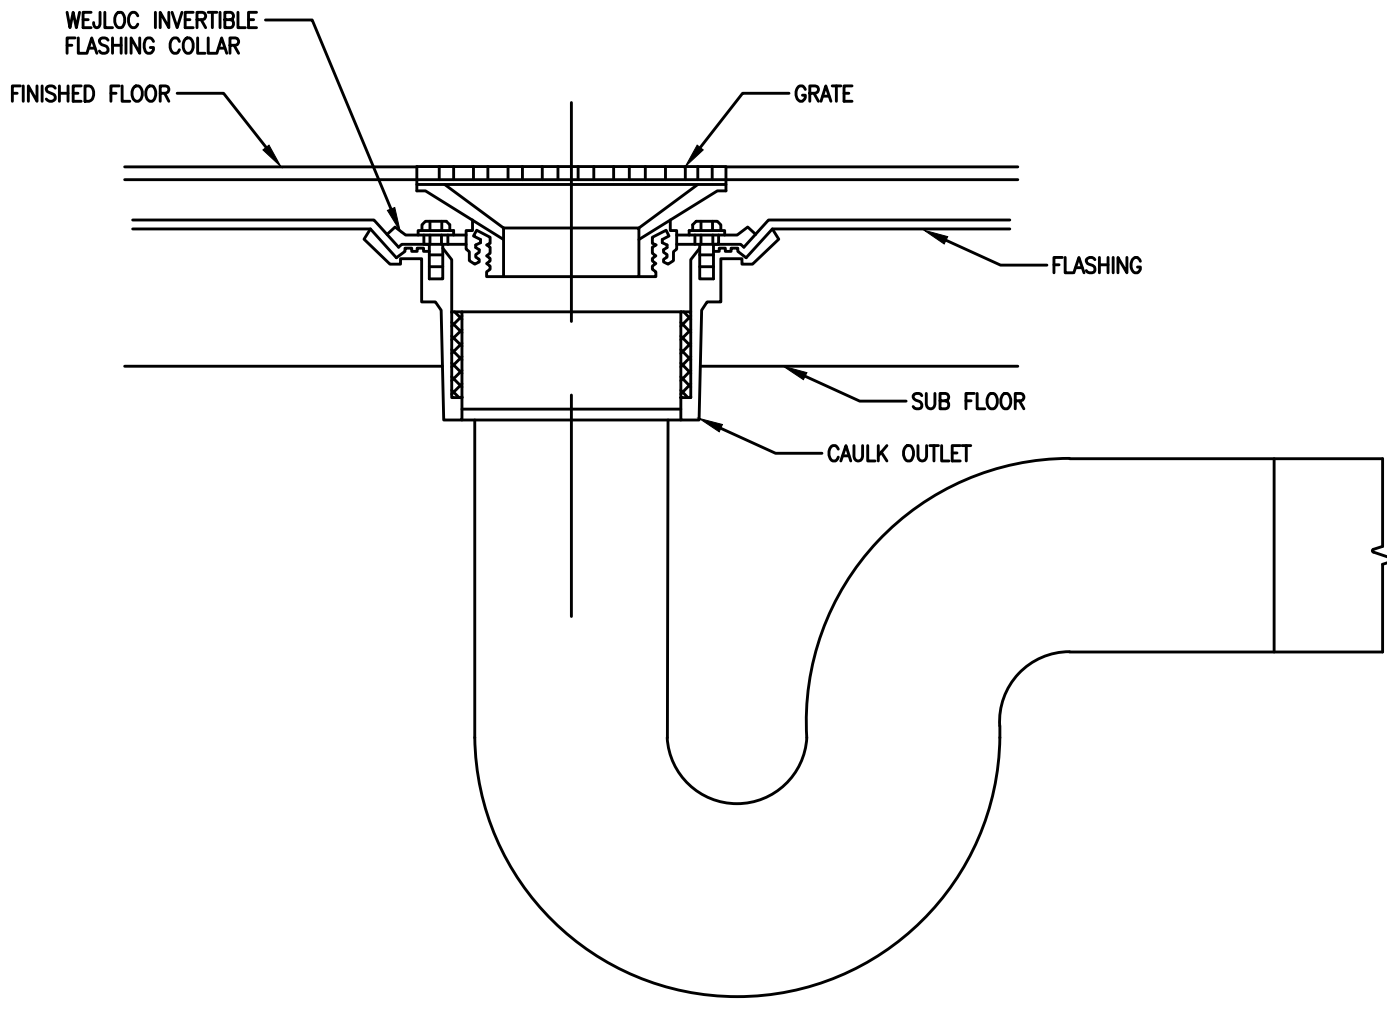


Floor Drain Detail
SCALE: NONE

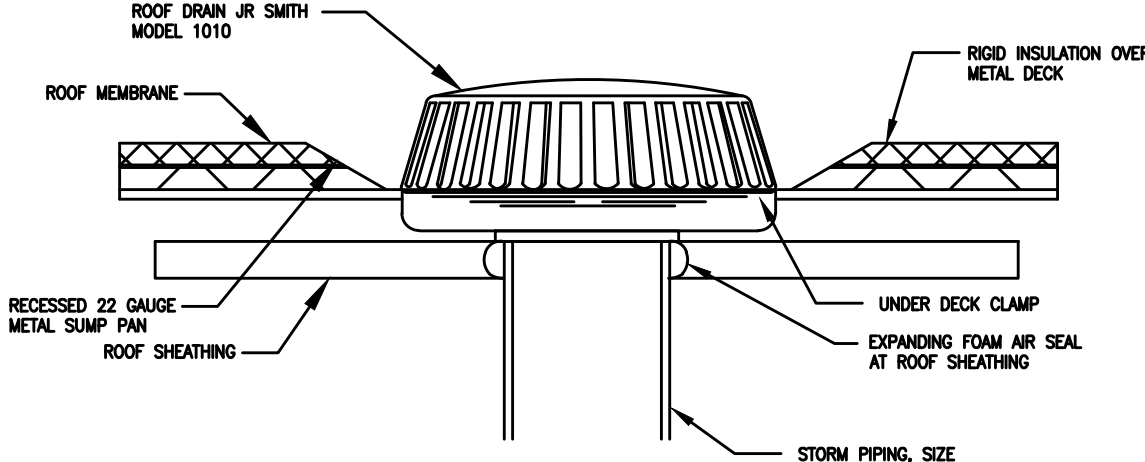


Roof Drain Detail
SCALE: NONE

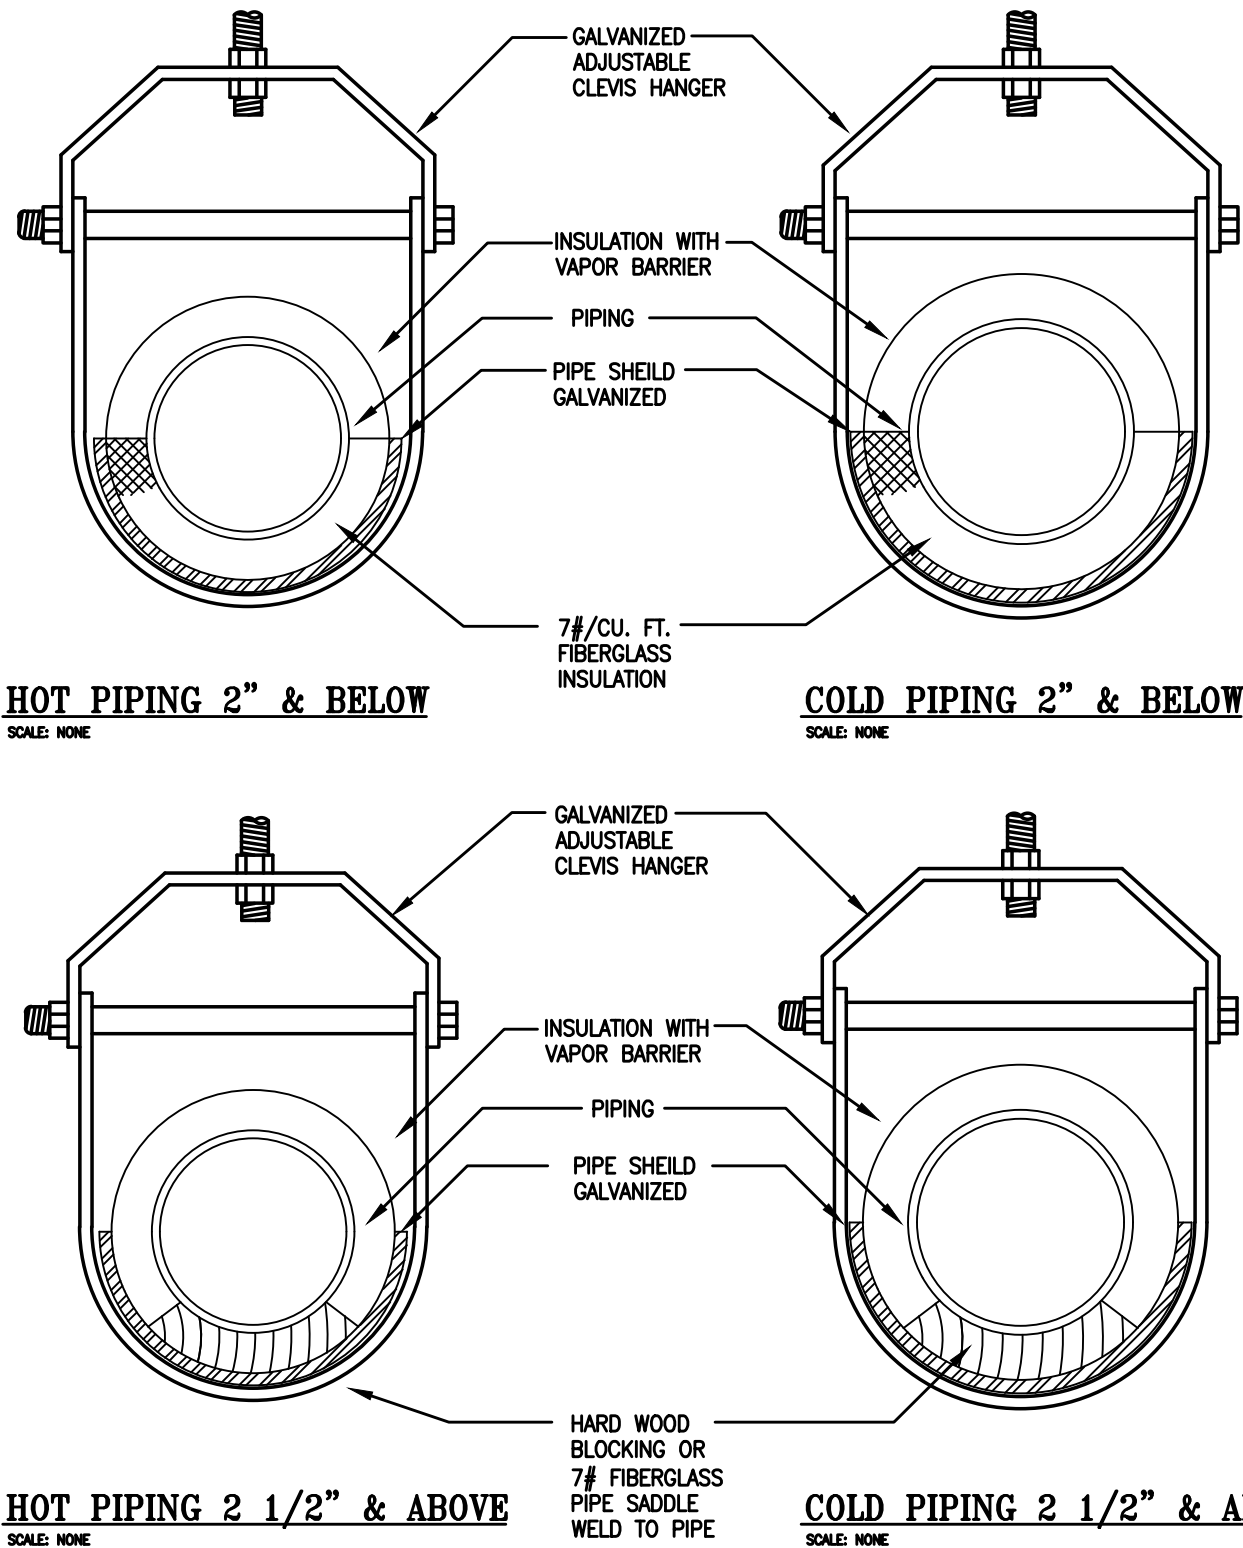

Pipe Hanger Details
SCALE: NONE

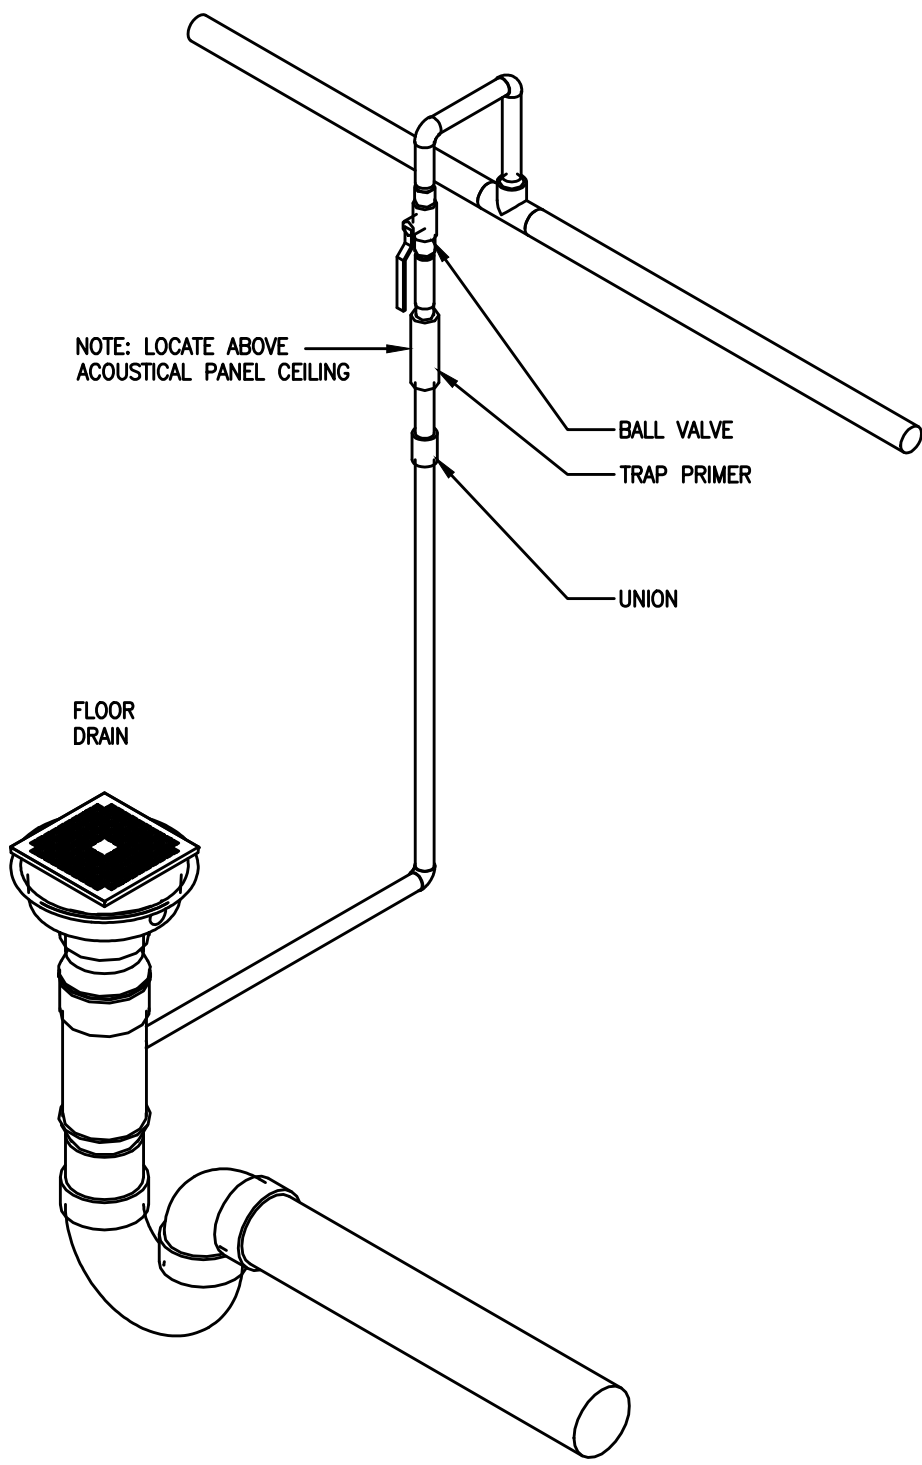

Trap Primer Detail (TP-1)
SCALE: NONE

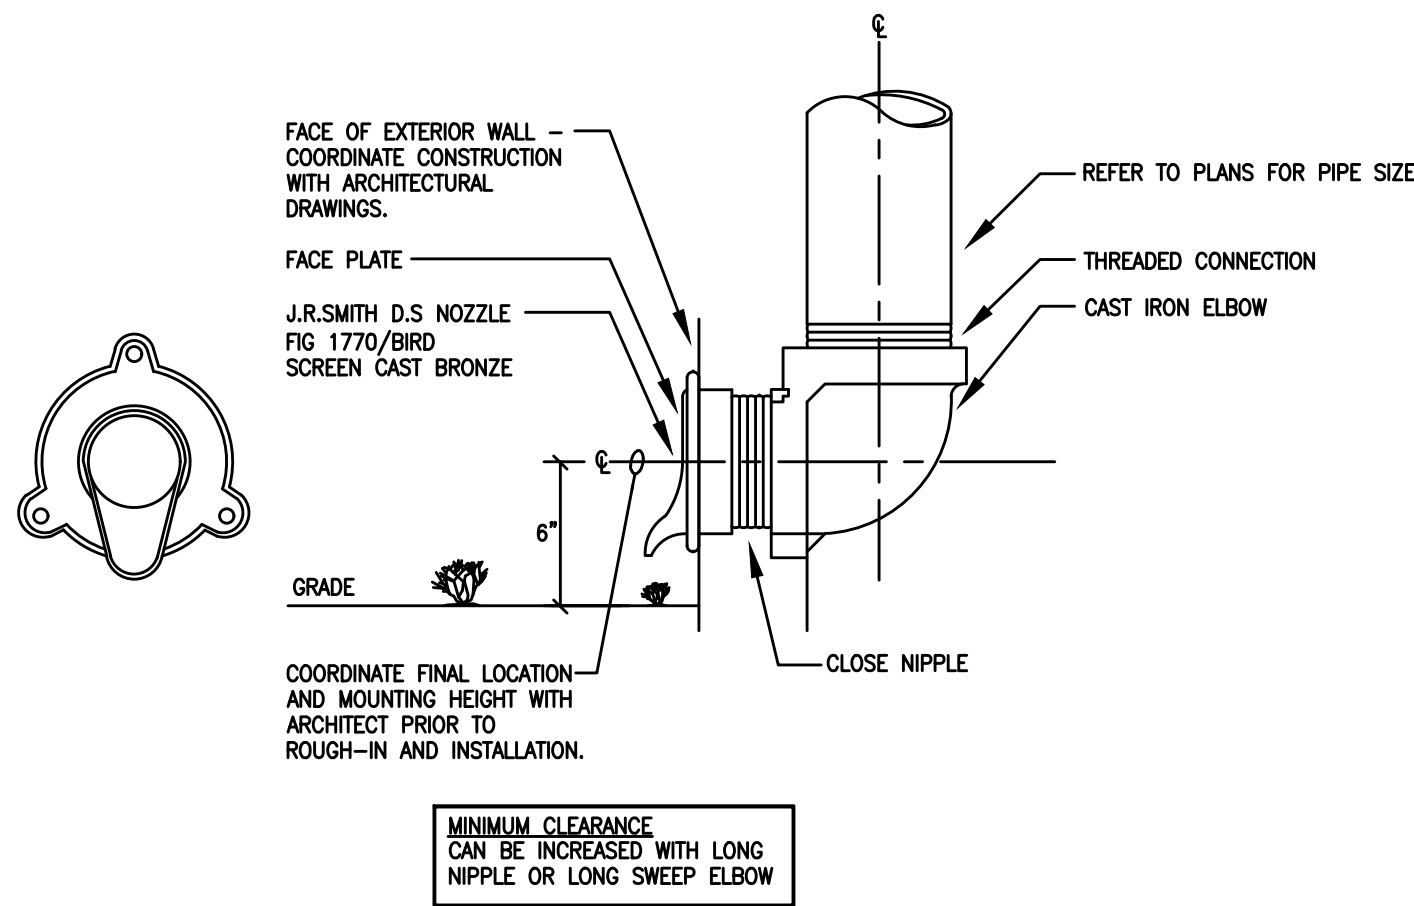

Overflow Discharge Nozzle Detail
SCALE: NONE
NOTE: CONTRACTOR TO REFER TO DRAWINGS AND SPECIFICATIONS FOR PIPING MATERIALS.

THE DELIVERY OF THIS DRAWING SHOULD NOT BE CONSTRUED TO PROVIDE AN EXPRESS WARRANTY OR GUARANTEE TO ANYONE THAT ALL THE DIMENSIONS AND DETAILS ARE EXACT OR TO INDICATE THAT THE USE OF THIS DRAWING IMPLIES THE REVIEW AND APPROVAL BY THE DESIGN PROFESSIONAL OF ANY FUTURE USE. ANY USE OF THIS INFORMATION WITHOUT THE WRITTEN APPROVAL BY THE DESIGN PROFESSIONAL IS AT THE SOLE RISK AND LIABILITY OF THE USER. THE DESIGN PROFESSIONAL RESERVES THE RIGHT TO REMOVE OUR PROFESSIONAL SEAL AND/OR TITLE BLOCK.

NOTICE
THE SCHEDULES AND DRAWINGS REPRESENT ONLY CERTAIN REQUIREMENTS OF THE PROJECT. THERE ARE ADDITIONAL REQUIREMENTS IN THE SPECIFICATIONS BOOKLET WHICH THE CONTRACTOR IS BOUND TO PROVIDE. A SUPPLIER OR CONTRACTOR'S PRICING, WHICH IS BASED ONLY ON DRAWINGS OR SCHEDULES, MAY LEAVE IMPORTANT COSTS UNACCOUNTED FOR WHICH WILL ULTIMATELY BE THE CONTRACTOR OR SUPPLIER'S RESPONSIBILITY TO PROVIDE.