KEYED NOTES

1	PHOTOELECTRIC SMOKE DETECTOR FOR ELEVATOR RECALL.
2	MOUNT DEVICE 4'-0" AFF, TYPICAL FOR ALL STORAGE UNIT CORRIDOR RECEPTACLES.
3	PROVIDE RECEPTACLE WITH VERTICAL SELF-CLOSING COVERS WITH LOCK HASPS, ALL KEYED ALIKE, TYPICAL FOR ALL STORAGE UNIT CORRIDOR RECEPTACLES.
4	COORDINATE THE LOCATION OF ALL ELEVATOR PIT AND SHAFT LIGHTING, RECEPTACLES, EQUIPMENT, ETC. WITH ARCHITECT, ELEVATOR MANUFACTURER AND EQUIPMENT PROVIDED
5	PROVIDE 240V, 2P, 60A NON-FUSED DISCONNECT SWITCH.
6	PROVIDE 600V, 3P, 60A, NON-FUSED DISCONNECT FOR ELEVATOR. COORDINATE LOCATION AND REQUIREMENTS WITH ELEVATOR AND EQUIPMENT PROVIDED.
7	PROVIDE MANUAL MOTOR STARTER WITH PROPER THERMAL ELEMENT INSTALLED.

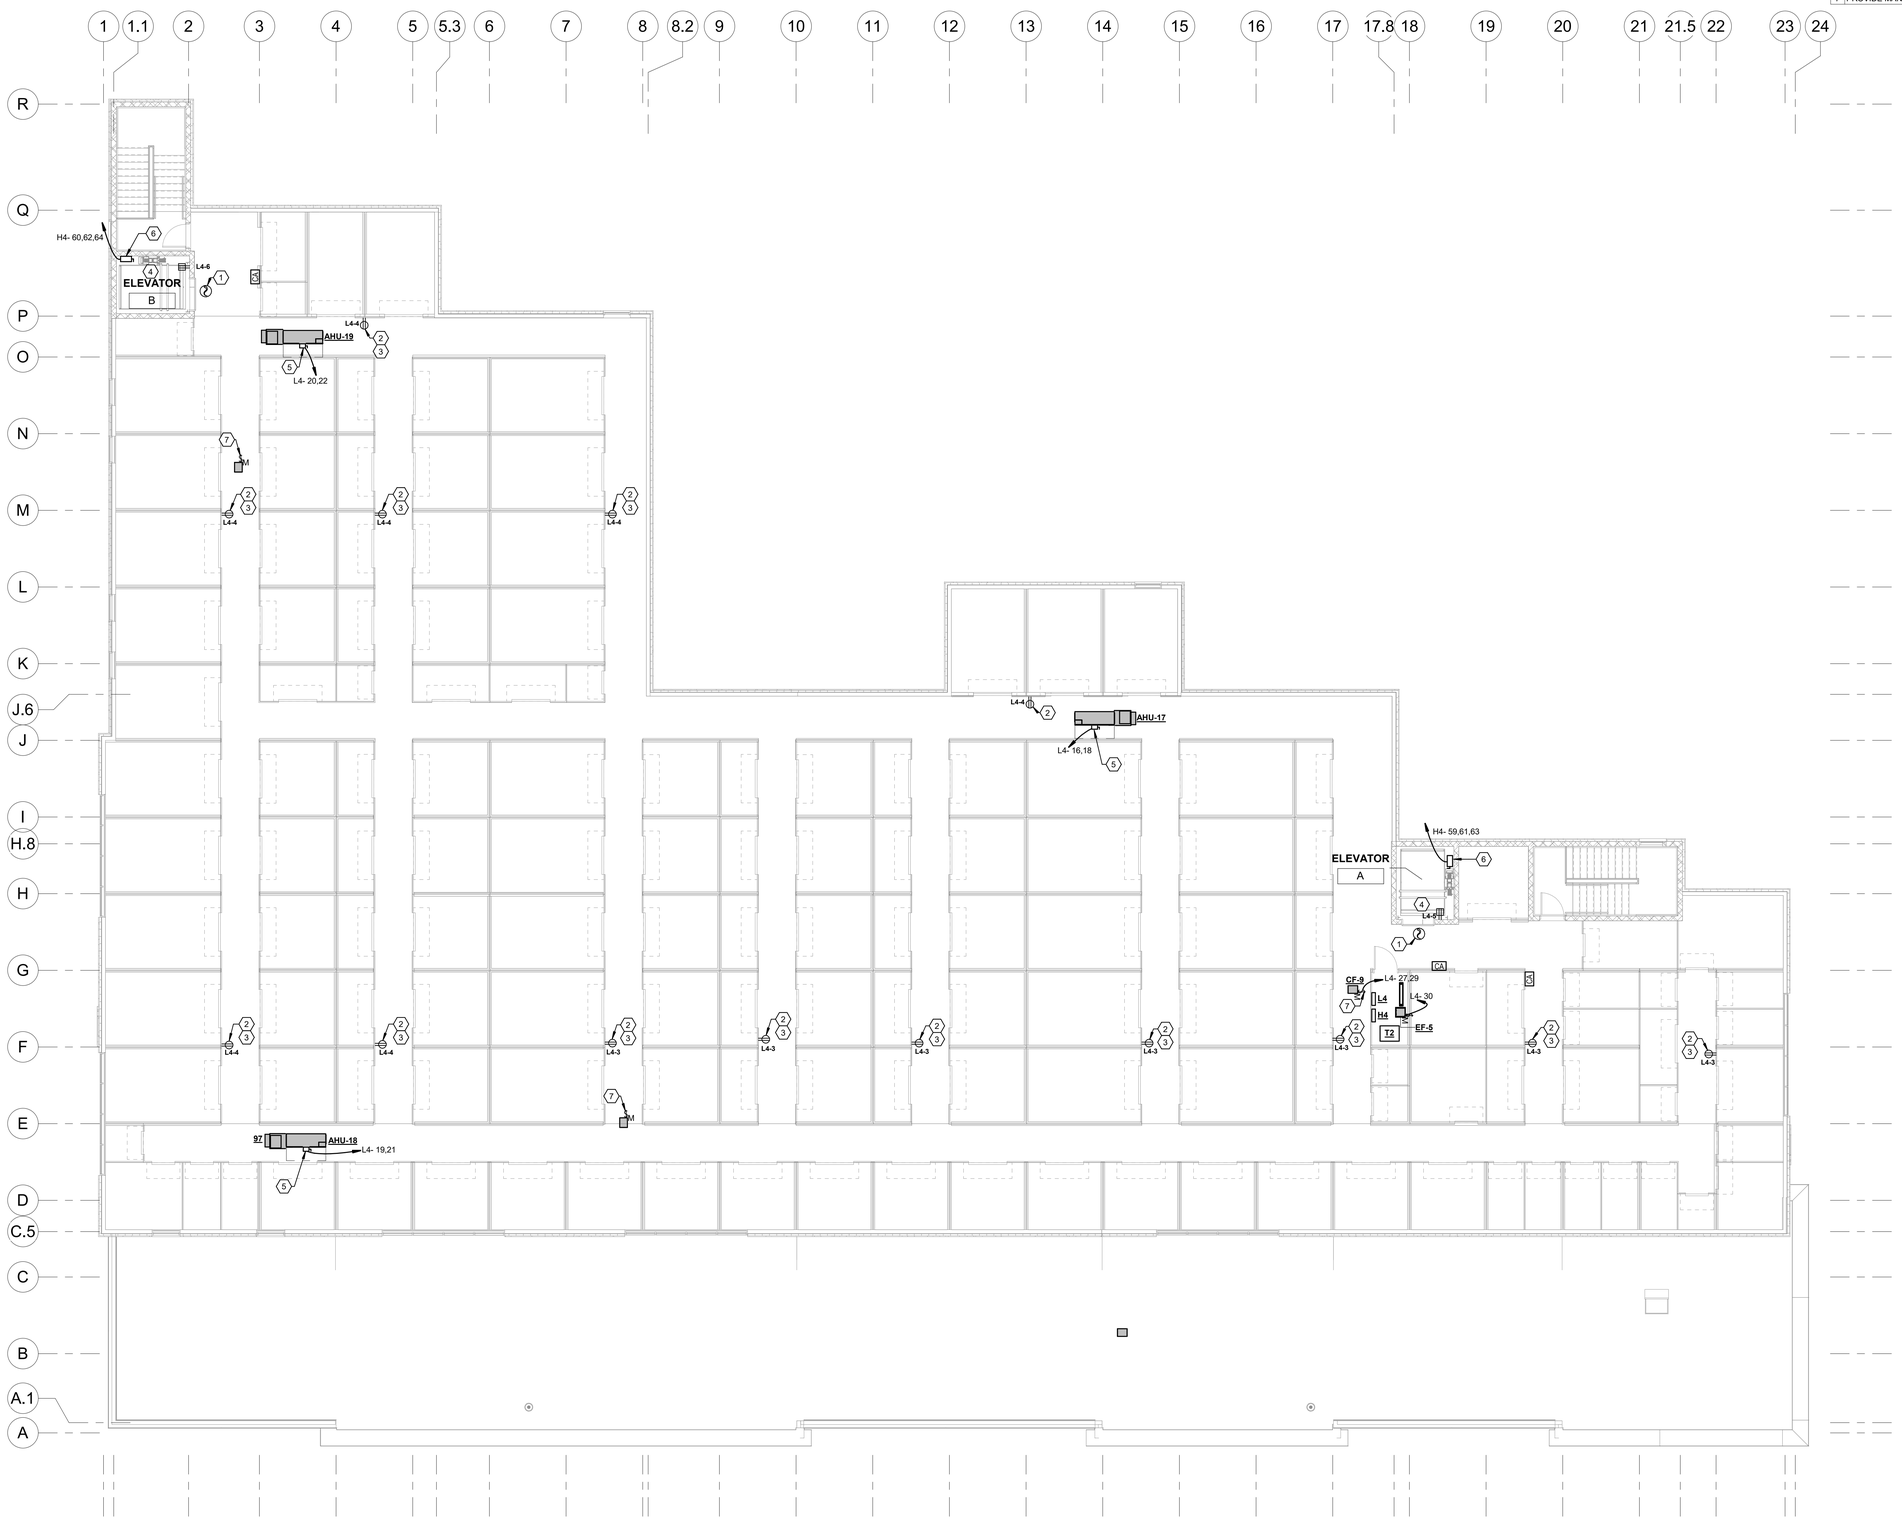

1 ELECTRICAL POWER PLAN - FOURTH FLOOR

1/8" = 1'-0"

WARNING: it is a violation of the NYS Education Law Article 145 for any person to alter this document in anyway, unless they are acting under the direction of a Professional Engineer

ISSUED FOR PERMIT

REVISIONS		
No.	Date	Description

CONSULTANT:

KCI TECHNOLOGIES
ENGINEERS PLANNERS SCIENTISTS CONSTRUCTION MANAGERS
5001 LOUISE DRIVE, SUITE 201
MECHANICSBURG, PA 17055
PHONE: 717-691-1340
www.kci.com

SAAarchitects
Client centered • Smart solutions
600 North Hartley Street, Suite 150
York, PA 17404
T - 717.843.3200 F - 717.699.0205
www.SAAarchitects.com

DRAWING TITLE:
ELECTRICAL POWER PLAN - FOURTH FLOOR
POUGHKEEPSIE NY STORAGE
DIAMOND POINT DEVELOPMENT
1998 SOUTH ROAD POUGHKEEPSIE, NEW YORK, 12601
DUTCHESS COUNTY

© 2020, SAAarchitects, Inc.

STATE OF NEW YORK
ASHLY S. STAPP
No. 105507
LICENSED PROFESSIONAL ENGINEER

FILE No.:	22-082
DATE:	7/1/2022
SCALE:	AS NOTED
DRAWN BY:	AMB
DRAWING No.:	E-204

7/1/2022 2:28:39 PM C:\SAAArchitects\Projects\Poughkeepsie NY Storage-MEP_R22_Aaron Vinson\E-204.rvt