ELECTRICAL GENERAL NOTES:

1. SEE SHEET E-001 FOR SYMBOL, ABBREVIATIONS, GENERAL NOTES AND NEMA RATING OF ENCLOSURES FOR EACH RESPECTIVE AREA.
2. CONTRACTOR SHALL FIELD COORDINATE ALL ELECTRICAL INSTALLATIONS WITH ALL DISIPLINES.
3. SEE LIGHT FIXTURE AND PANEL SCHEDULES ON SHEET E-602 FOR BRANCH CIRCUIT CONDUIT AND WIRING SIZES.
4. CONNECT EXIT SIGNS AND EMERGENCY BATTERY PACKS AT LIGHT FIXTURES TO LIGHT CIRCUIT SERVING AREA, AHEAD OF ANY LIGHTING CONTROL.
5. IN ACCORDANCE WITH NEC 358.26, THERE SHALL BE NO MORE THAN A TOTAL OF 360° OF BENDS IN A CONDUIT ROUTING BETWEEN PULL POINTS (BOXES AND ENCLOSURES).
6. HOMERUN FOR EXTERIOR WALL PACKS TO RUN THROUGH EXTERIOR LIGHTING CONTROL CONTACTOR. REFER TO DETAIL 7 ON SHEET E-502 FOR ADDITIONAL INFERMATION.

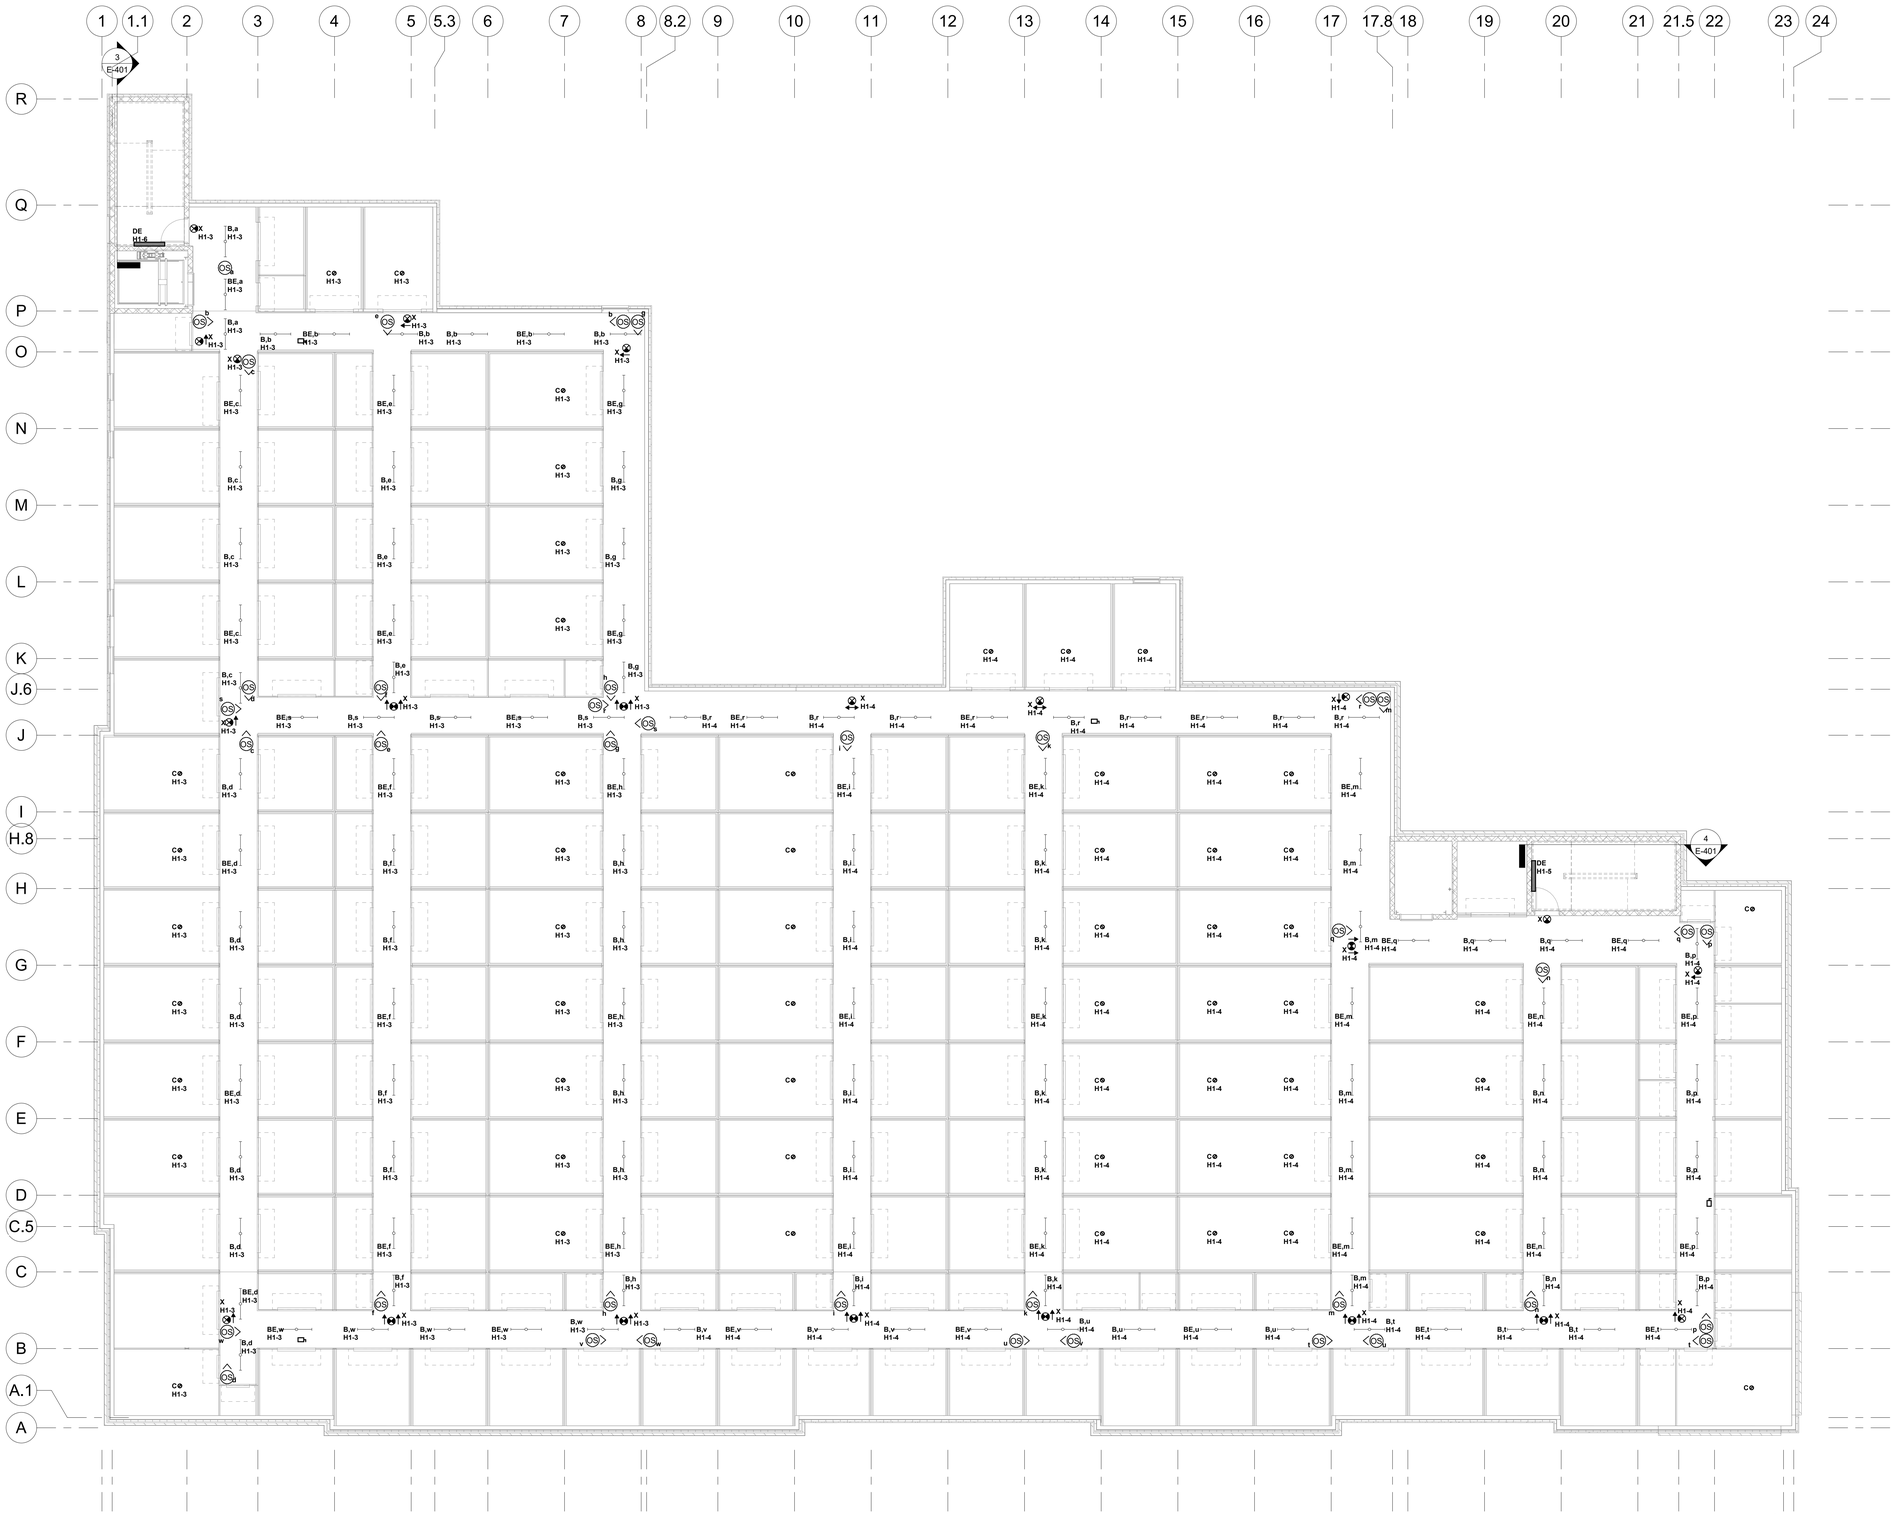

1 ELECTRICAL LIGHTING PLAN - SECOND FLOOR

1/8" = 1'-0"

0 4' 8' 16'
1/8" = 1'-0"

WARNING: it is a violation of the NYS Education Law Article 145 for any person to alter this document in anyway, unless they are acting under the direction of a Professional Engineer

ISSUED FOR PERMIT

REVISIONS		
No.	Date	Description

CONSULTANT:

KCI TECHNOLOGIES
ENGINEERS
PLANNERS
SCIENTISTS
CONSTRUCTION MANAGERS
3001 LOUISE DRIVE, SUITE 201
MECHANICSBURG, PA 17055
PHONE: 717-691-1340
www.kci.com

SAA architects
Client centered • Smart solutions
600 North Hartley Street, Suite 150
York, PA 17404
T - 717.843.3200 F - 717.699.0205
www.SAAarchitects.com

DRAWING TITLE:
ELECTRICAL LIGHTING PLAN - SECOND FLOOR

POUGHKEEPSIE NY STORAGE
DIAMOND POINT DEVELOPMENT
1998 SOUTH ROAD POUGHKEEPSIE, NEW YORK 12601
DUTCHESS COUNTY

© 2020, SAAarchitects, Inc.

STATE OF NEW YORK
ERIC V. STOLL
250-103957
LICENSED PROFESSIONAL ENGINEER

FILE No.:	22-082
DATE:	7/1/2022
SCALE:	AS NOTED
DRAWN BY:	AMB
DRAWING No.:	E-302

C:\SMDRive_Projects\Poughkeepsie NY Storage-MEP_R22_Aaron\Ford\E-302.rvt
7/1/2022 2:58:07 PM