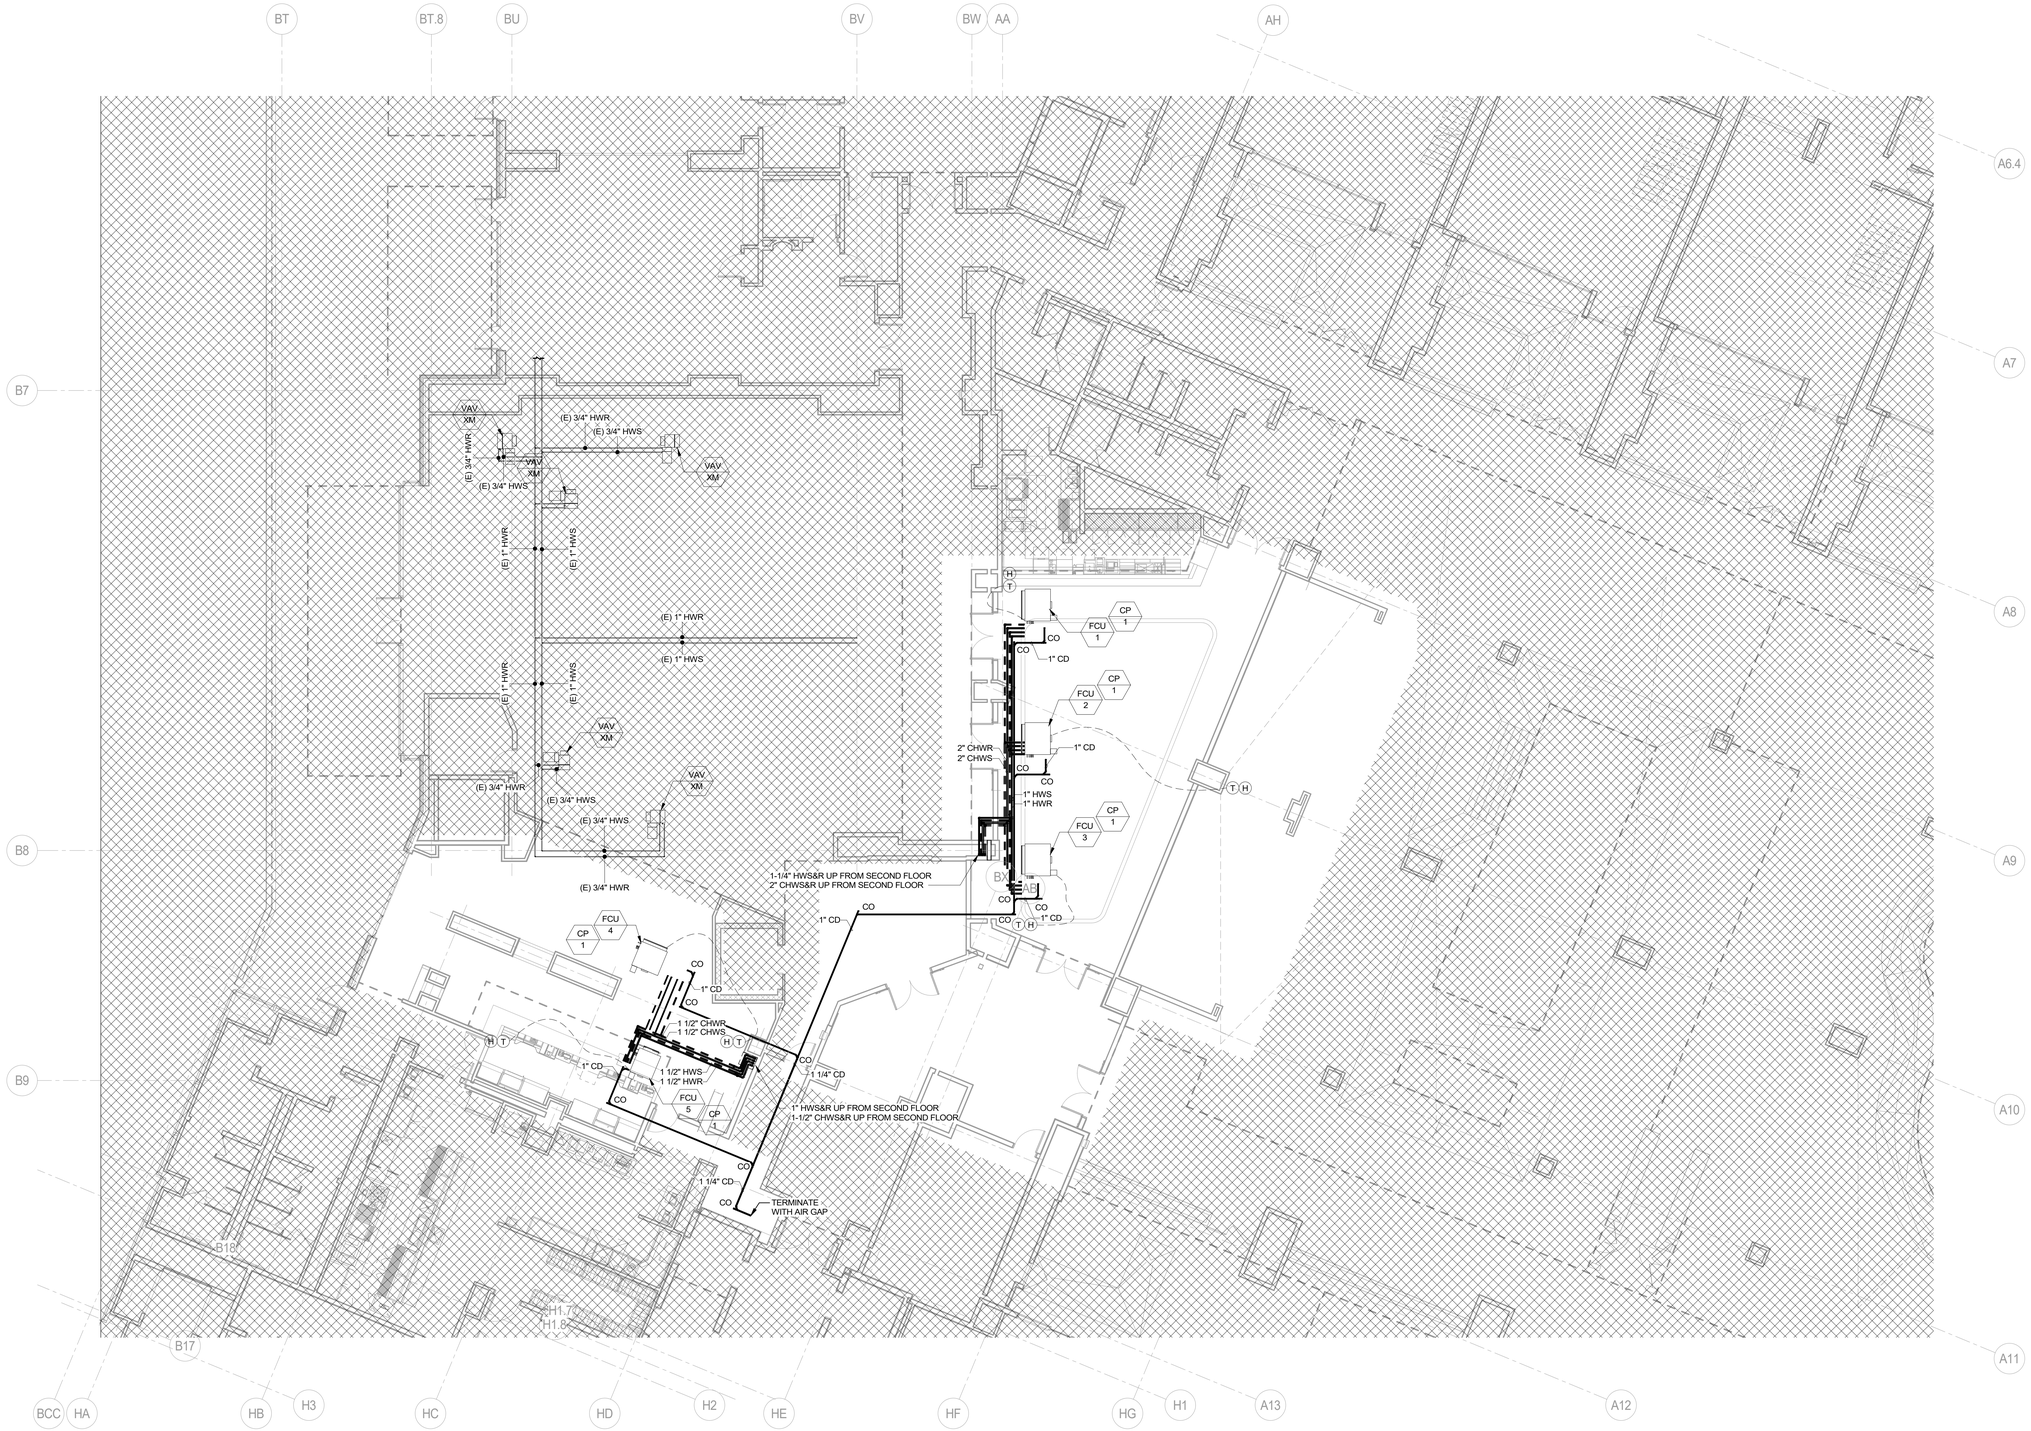

1 HVAC PIPING - THIRD FLOOR
1/8" = 1'-0"

GENERAL NOTES:

1. ALL THERMOSTATS LOCATED ON PERIMETER WALLS & COLUMNS SHALL BE PROVIDED WITH INSULATED BACKPLATES.
2. CONTRACTOR SHALL MAINTAIN BUILDING MANAGEMENT AIR QUALITY STANDARD DURING CONSTRUCTION.
3. COORDINATE ANY/ALL BASE BUILDING EQUIPMENT OR SYSTEM SHUTDOWN REQUIREMENTS WITH OWNER.

CROCKFORDS - RESORTS WORLD CATSKILLS

888 resorts World Dr
Monticello, NY 12701

JCJARCHITECTURE
120 HUYSHOPE AVENUE
SUITE 400
HARTFORD, CT 06106
860.247.9226

© 2021 JCJ Architecture

CONSULTANT:

VANDERWEIL
R.G. Vanderweil Engineers, LLP
274 Summer Street
Boston, MA 02210
617.423.7423 TEL
617.423.7401 FAX
vanderweil.com

BIDDING & CONSTRUCTION
07/06/2022

ISSUE	07/06/2022
JOB	30860.00
DRAWN	Author
SCALE	1/8" = 1'-0"

REVISIONS

PIPING THIRD FLOOR

M-10

DRAWING PRINTED FULL SIZE (100%) = 30"x42" DRAWING PRINTED HALF SIZE (50%) WILL FIT ON A SHEET 18"x24" WITH 1.5" OF EXTRA SPACE ON ALL FOUR SIDES. DRAWING PRINTED NEAR A THIRD SIZE (37.5%) = 11.25"x15.75" WILL FIT TIGHTLY ON 11"x17". INDIVIDUAL 1/2", 1/4", 1/8", 1/16" AND 1/32" VIEW SCALES WILL TRANSLATE BY MULTIPLYING THE DENOMINATOR BY 2 AND MAKING THE NUMERATOR 3. FOR EXAMPLE 1/8"=1'-0" FOR SCALES A1.30", 3/8", 3/16" AND 3/32" THE TRANSLATION IS CLOSE ENOUGH TO USE THE DENOMINATOR EQUIVALANT AND CHANGE THE NUMERATOR TO 1. EXAMPLE 3/4"=1'-0" AT 37.5% WILL BE NEAREST TO 1/4"=1'-0"

7/6/2022 5:52:56 PM