

**888 resorts World Dr
Monticello, NY 12701**

120 HUYSHOPE AVENUE
SUITE 400
HARTFORD, CT 06106
860.247.9226

© 2021 JCJ Architecture

CONSULTANT:

VANDERWEIL


R.G. Vanderweil Engineers, LLP : 617.423.7423 TEL
274 Summer Street : 617.423.7401 FAX
Boston, MA 02210 : vanderweil.com

BIDDING &
CONSTRUCTION
07/06/2022

| | |
|-----------|--------------|
| ISSUE | 07/06/2022 |
| JOB | 30860.00 |
| DRAWN | Author |
| SCALE | 1/8" = 1'-0" |
| REVISIONS | |

PIPING FIRST FLOOR

M-8

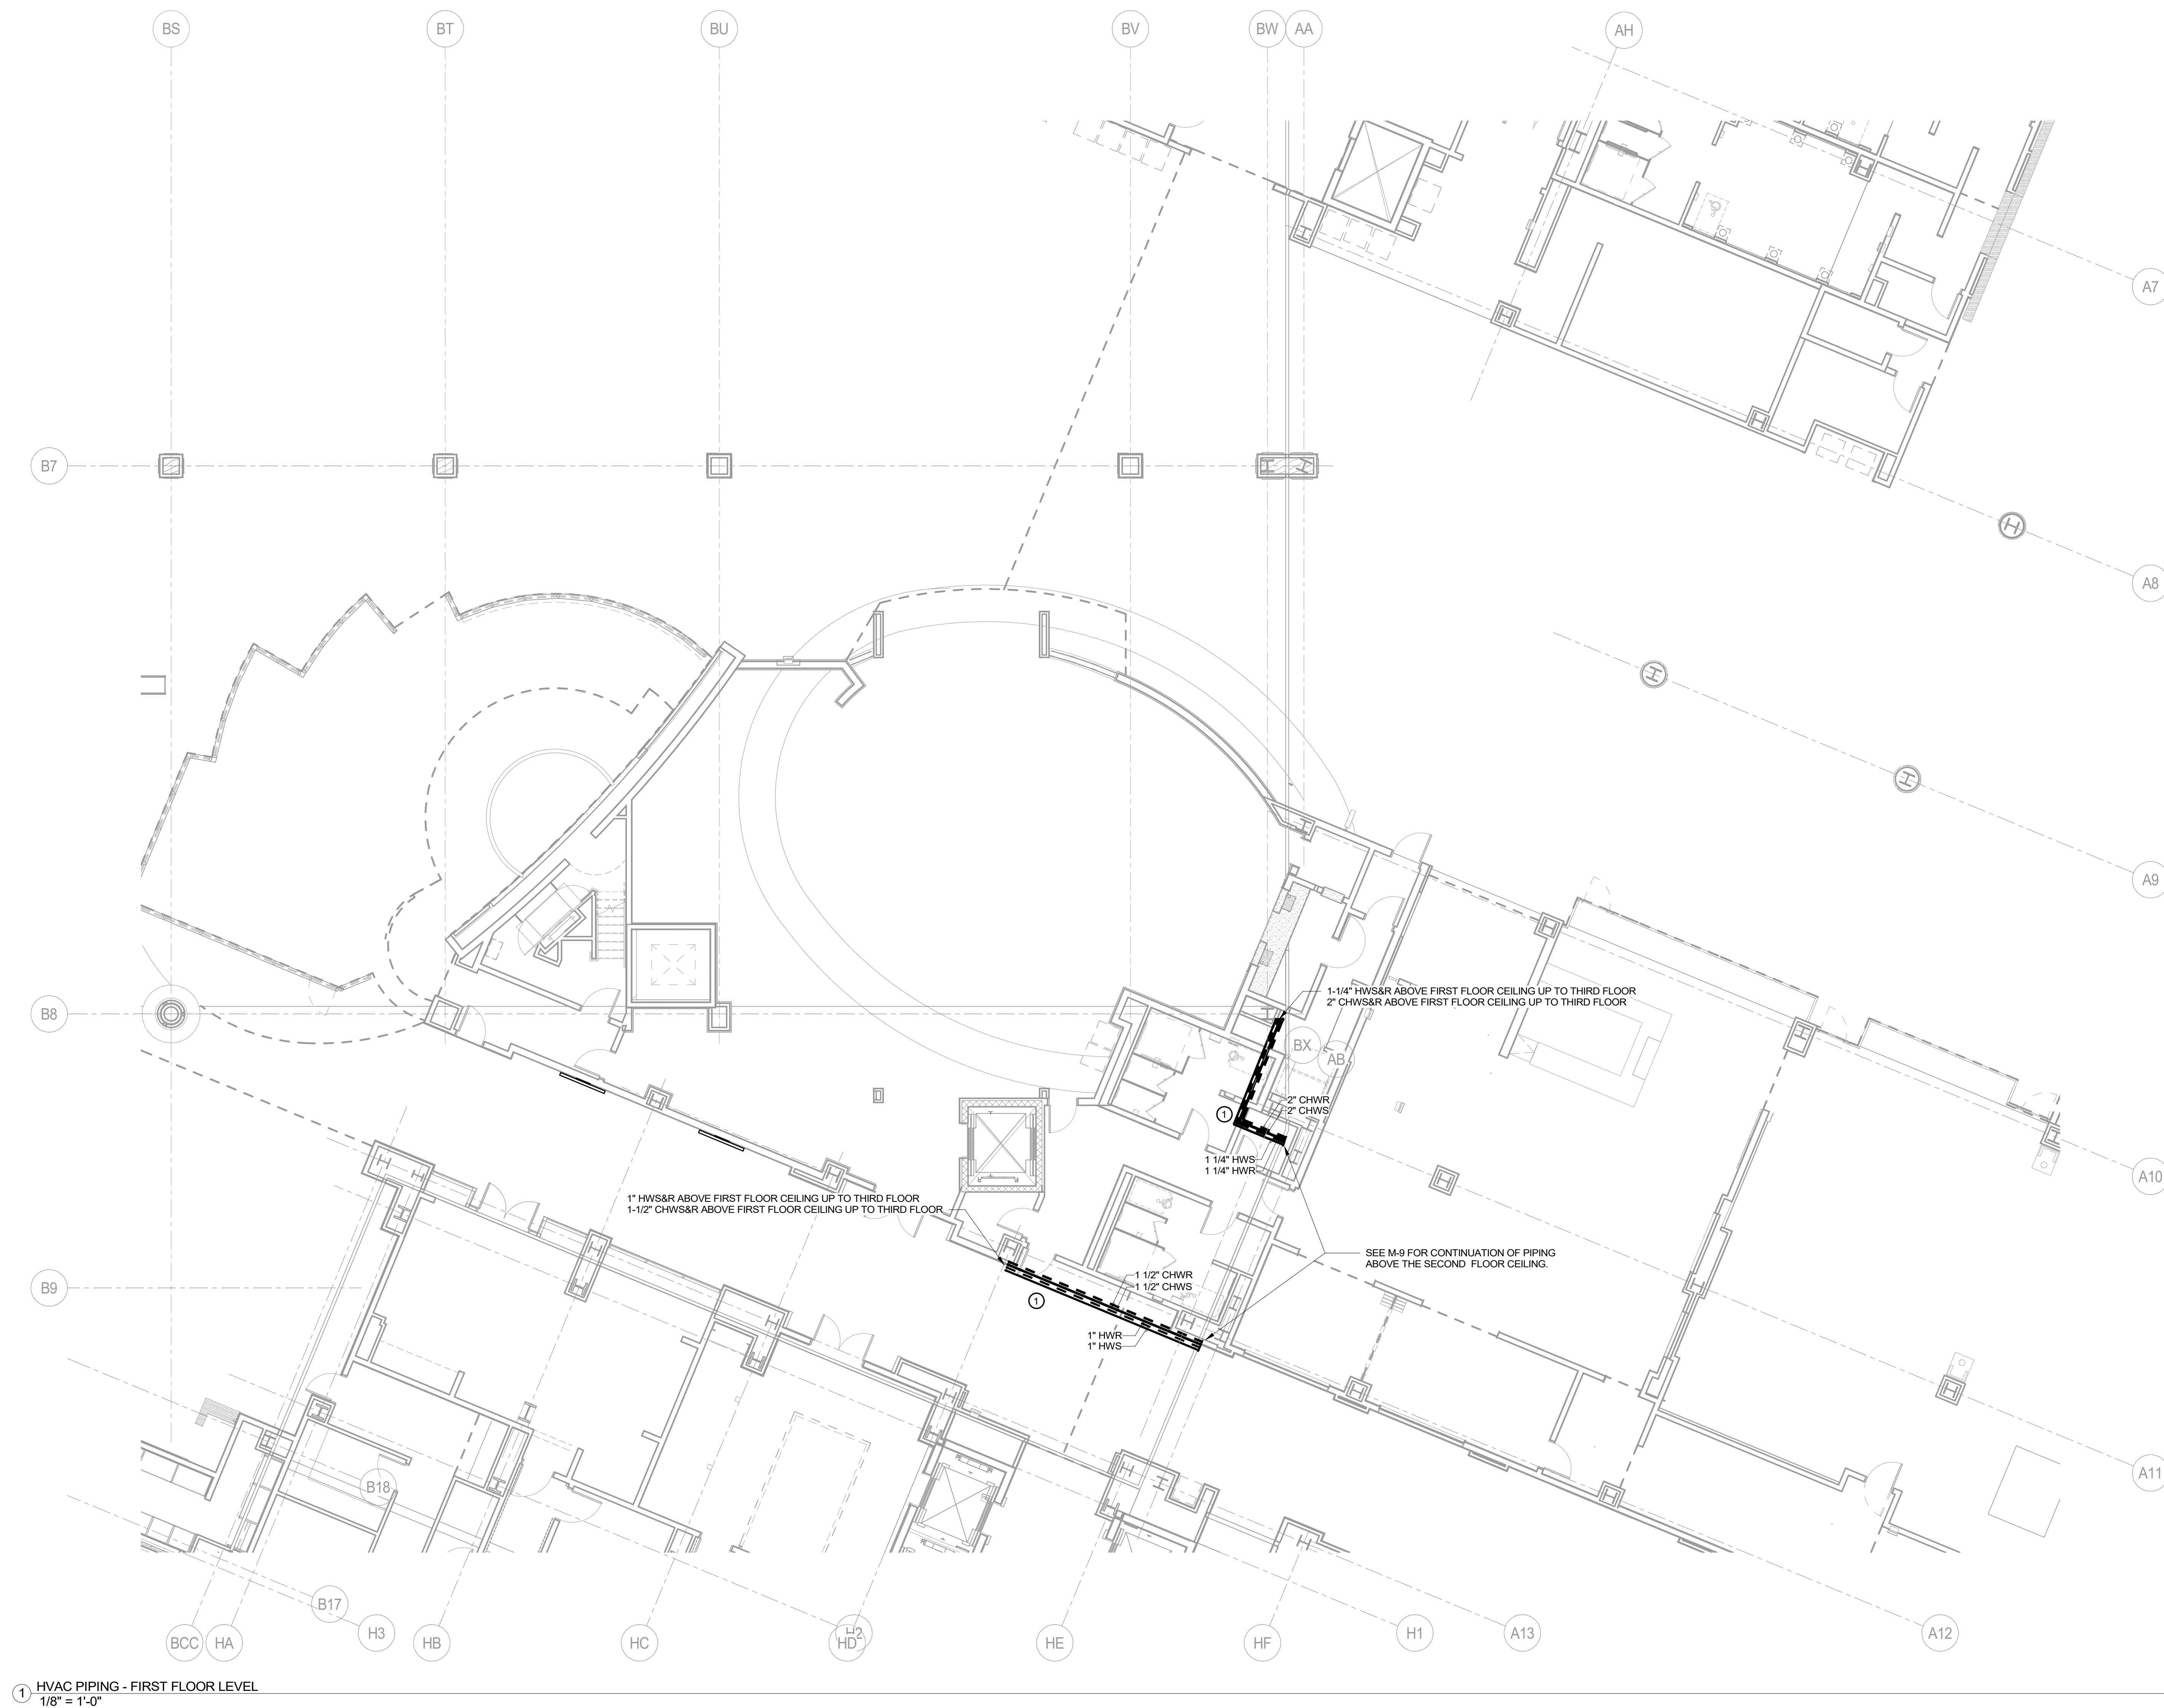

GENERAL NOTES:

1. ALL THERMOSTATS LOCATED ON PERIMETER WALLS & COLUMNS SHALL BE PROVIDED WITH INSULATED BACKPLATES.
2. CONTRACTOR SHALL MAINTAIN BUILDING MANAGEMENT AIR QUALITY STANDARD DURING CONSTRUCTION.
3. COORDINATE ANY/ALL BASE BUILDING EQUIPMENT OR SYSTEM SHUTDOWN REQUIREMENTS WITH OWNER.

KEY NOTES:

1. COORDINATE CEILING DEMO WITH ARCHITECTURAL RCP.