

777 Old Saw Mill River Road  
Tarrytown, NY 10591-6707  
T: 914.847.7400  
F: 914.847.7991  
www.regeneron.com

**Building #17**  
Campus Expansion Child  
Day-care Center

777 Old Saw Mill River Road  
Mount Pleasant, NY 10591

Project No. B17-DAYCARE

Architect

**Gensler**

1700 Broadway, Suite 400  
New York, NY 10019  
(212) 492-1400 Phone  
(212) 492-1472 Fax

Structural Engineer

Thornton Tomasetti  
120 Broadway, 15th Floor  
New York, NY 10271  
(917) 661-7800 Phone  
(917) 661-7801 Fax

MEP / IT / Security Engineer

Cosentini Associates  
498 Seventh Avenue  
New York, NY 10018  
(212) 615-3600 Phone  
(212) 615-3700 Fax


Civil Engineer

JMC  
120 Bedford Road  
Armonk, NY 10504  
(914) 273-5225 Phone  
(914) 273-2102 Fax

Landscape Architect

Langan  
21 Penn Plaza, 360 West 31st Street, 8th Floor  
New York, NY 10001  
(212) 479-5400 Phone  
(212) 479-5444 Fax

Key Plan



No. Date Description

0	06.20.2022	ISSUED FOR PERMIT
1	06.20.2022	100% CONSTRUCTION DOCUMENTS
2	07.01.2022	100% CONSTRUCTION DOCUMENTS-1

Plot Date: 07.01.2022


ALL DRAWINGS AND WRITTEN MATERIALS REPRESENTED ON THIS SHEET CONSTITUTE THE  
CORPORATE WORK AND ARE THE SOLE PROPERTY OF REGENERON PHARMACEUTICALS.  
THIS SHEET MAY NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART, NOR MAY ANY  
OF THE DRAWINGS OR WRITTEN MATERIALS BE REPRODUCED OR COPIED IN WHOLE OR IN PART,  
WITHOUT THE WRITTEN CONSENT OF REGENERON PHARMACEUTICALS. ANY REUSE OF  
ANY PART OF THIS SHEET WITHOUT THE WRITTEN CONSENT OF REGENERON PHARMACEUTICALS  
IS STRICTLY PROHIBITED. REGENERON PHARMACEUTICALS ASSUMES NO LIABILITY FOR ANY  
REUSE OF THIS SHEET WITHOUT THE WRITTEN CONSENT OF REGENERON PHARMACEUTICALS.  
REGENERON PHARMACEUTICALS ASSUMES NO LIABILITY FOR ANY REUSE OF THIS SHEET WITHOUT  
THE WRITTEN CONSENT OF REGENERON PHARMACEUTICALS.

Professional Seal and Signature

Vendor Name: COSENTINI  
Vendor Project No.: 210104  
Discipline: Fire Suppression Drawn By: DH  
**FIRE SUPPRESSION 1ST  
FLOOR PLAN**

Scale: 1/8" = 1'-0" Floor: 1ST

**FX-101**

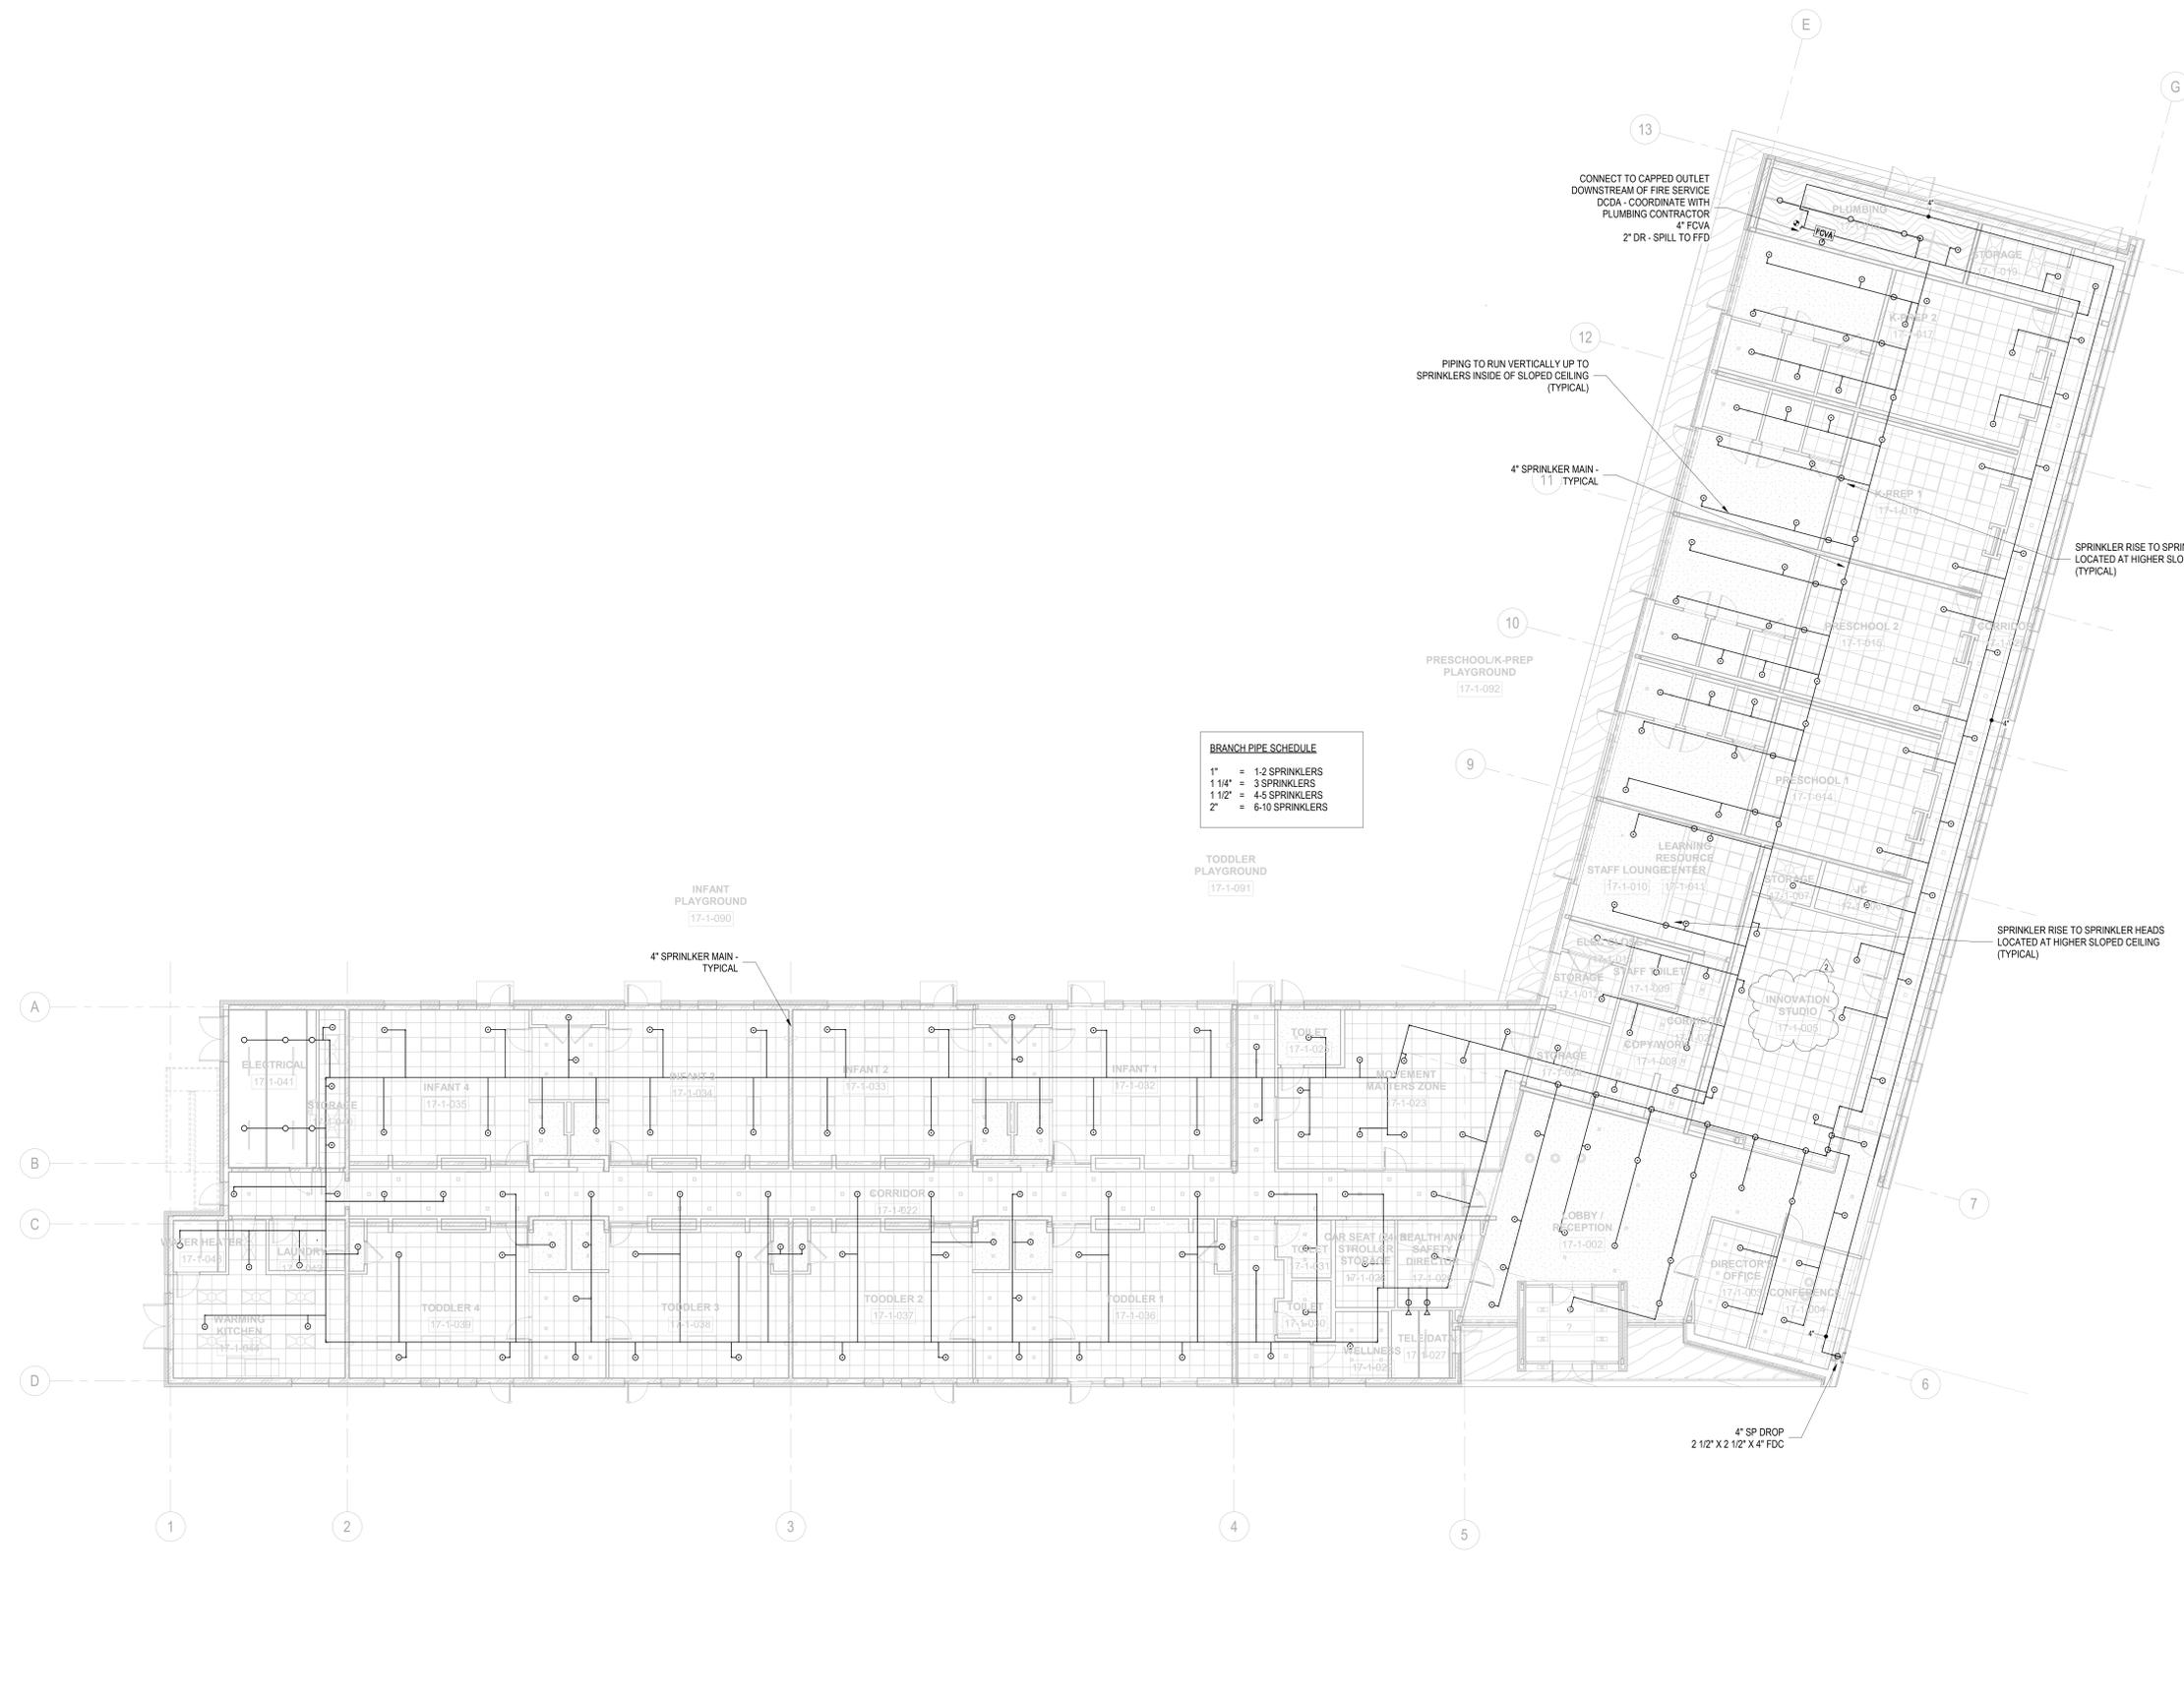

**BRANCH PIPE SCHEDULE**

1"	= 1-2 SPRINKLERS
1 1/4"	= 3 SPRINKLERS
1 1/2"	= 4-5 SPRINKLERS
2"	= 6-10 SPRINKLERS

1 LEVEL 1 FIRE PROTECTION RCP  
1/8" = 1'-0"

TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGMENT, THESE PLANS AND SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 ENERGY CONSERVATION CODE OF NYS

This plan is approved only for work indicated on the application specification sheet. All other matters shown are not to be relied upon, or to be considered as either being approved or in accordance with applicable codes.

Alterations or additions to this engineering document by an unlicensed person is a violation of Chapter 16, Title VIII, Article 145 § 7209.2 of the New York State Education Law.