

777 Old Saw Mill River Road  
Tarrytown, NY 10591-6707  
T: 914.847.7400  
F: 914.847.7991  
www.regeneron.com

Building #17  
Campus Expansion Child  
Day-care Center

899 Old Saw Mill River Road  
Mount Pleasant, NY 10591

Project No. B17-DAYCARE

Architect

**Gensler**

1700 Broadway, Suite 400  
New York, NY 10019  
(212) 492-1400 Phone  
(212) 492-1472 Fax

Structural Engineer

Thornton Tomasetti  
120 Broadway, 15th Floor  
New York, NY 10271  
(917) 661-7800 Phone  
(917) 661-7801 Fax

MEP / IT / Security Engineer

Cosentini Associates  
498 Seventh Avenue  
New York, NY 10018  
(212) 615-3600 Phone  
(212) 615-3700 Fax


Civil Engineer

JMC  
120 Bedford Road  
Armonk, NY 10504  
(914) 273-5225 Phone  
(914) 273-2102 Fax

Landscape Architect

Langan  
21 Penn Plaza, 360 West 31st Street, 8th Floor  
New York, NY 10001  
(212) 479-5400 Phone  
(212) 479-5444 Fax

Key Plan

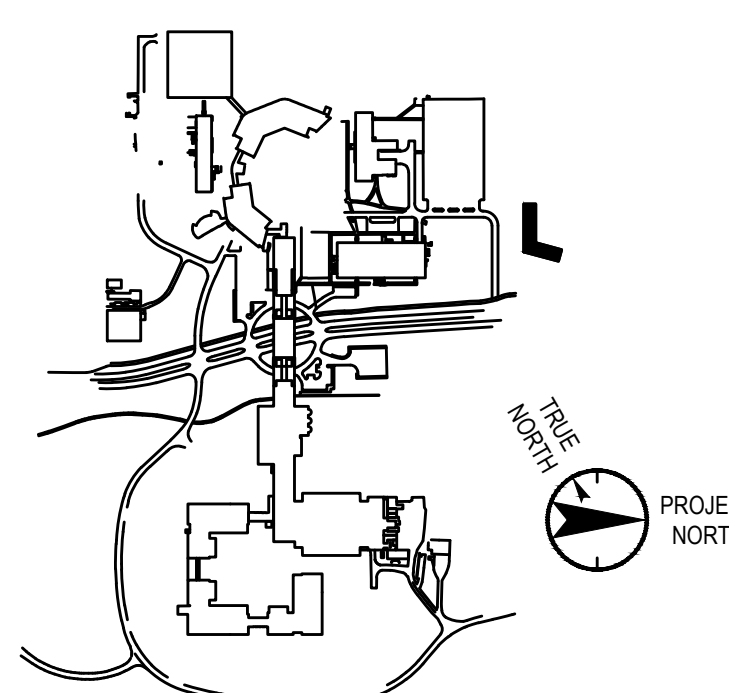

| No. | Date       | Description                   |
|-----|------------|-------------------------------|
| 0   | 05.20.2022 | ISSUED FOR PERMIT             |
| 1   | 06.20.2022 | 100% CONSTRUCTION DOCUMENTS   |
| 2   | 07.01.2022 | 100% CONSTRUCTION DOCUMENTS-1 |

Plot Date: 07.01.2022

ALL DRAWINGS AND WRITTEN MATERIALS REPRESENTED ON THIS SHEET CONSTITUTE THE COPYRIGHTED WORK AND ARE THE SOLE PROPERTY OF REGENERON PHARMACEUTICALS. THIS SHEET MAY NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART, NOR ANY PART OF THE DRAWING OR WRITTEN MATERIALS APPEARING HEREIN, BE REPRODUCED INTO ANOTHER WORK FOR ANY REASON WITHOUT THE WRITTEN CONSENT OF REGENERON PHARMACEUTICALS. THE PROJECT HAS BEEN REVIEWED BY THE PROJECT ENGINEER, REGENERON PHARMACEUTICALS, IF REGENERON NAMES OR AUTHORIZES RELEASE OF ANY SUCH DOCUMENTS OR INFORMATION PROVIDED TO DESIGN PROFESSIONALS OUTSIDE OF THE PROJECT WITHOUT THE EXPRESS WRITTEN CONSENT OF DESIGN PROFESSIONAL, REGENERON ASSUMES FULL RESPONSIBILITY FOR ANY AND ALL ISSUES INVOLVED IN SUCH RELEASE.

Professional Seal and Signature


Vendor Name: COSENTINI  
Vendor Project No.: 210104  
Discipline: Drawn By:

MECHANICAL  
VRF DIAGRAM  
SHEET 1

Scale: NTS Floor:


M-701

|            |                                                                                      |
|------------|--------------------------------------------------------------------------------------|
| Client     | USA                                                                                  |
| Project    | Daycare center                                                                       |
| Title      | Piping schematics<br>CU-R-1<br>Air cooled heat recovery<br>VRV-V-X-A<br>REYQ120XAYDA |
| Date       | 04/26/2022                                                                           |
| Drawing No |                                                                                      |

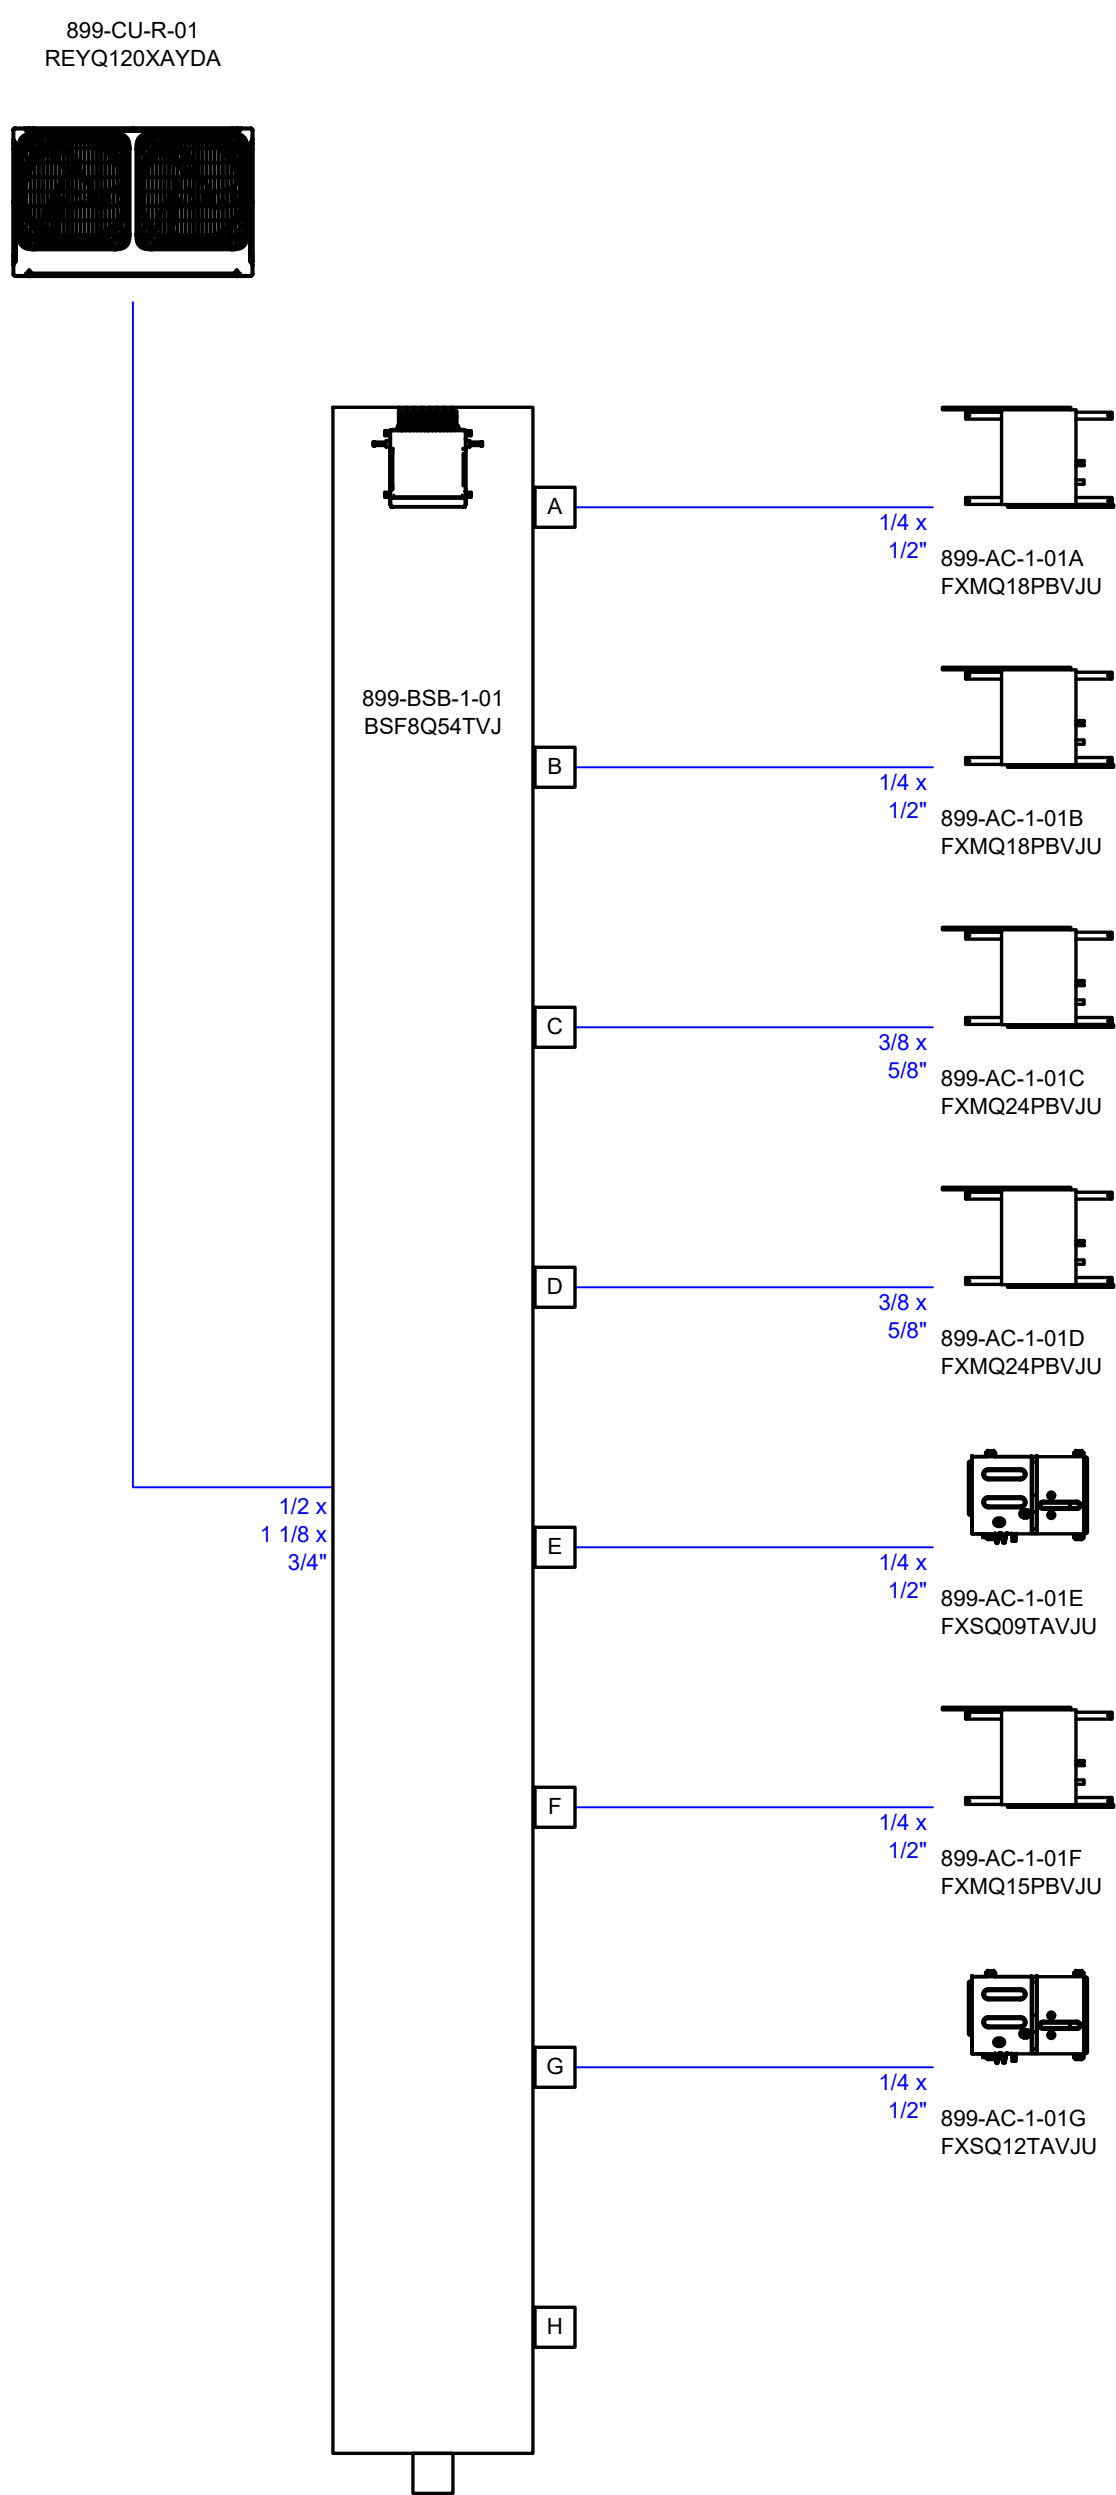


NOTE:  
FINAL REFRIGERANT SIZE TO BE CONFIRMED  
BY CONTRACTOR AND MANUFACTURER


|            |                                                                                      |
|------------|--------------------------------------------------------------------------------------|
| Client     | USA                                                                                  |
| Project    | Daycare center                                                                       |
| Title      | Wiring schematics<br>CU-R-1<br>Air cooled heat recovery<br>VRV-V-X-A<br>REYQ120XAYDA |
| Date       | 04/26/2022                                                                           |
| Drawing No |                                                                                      |

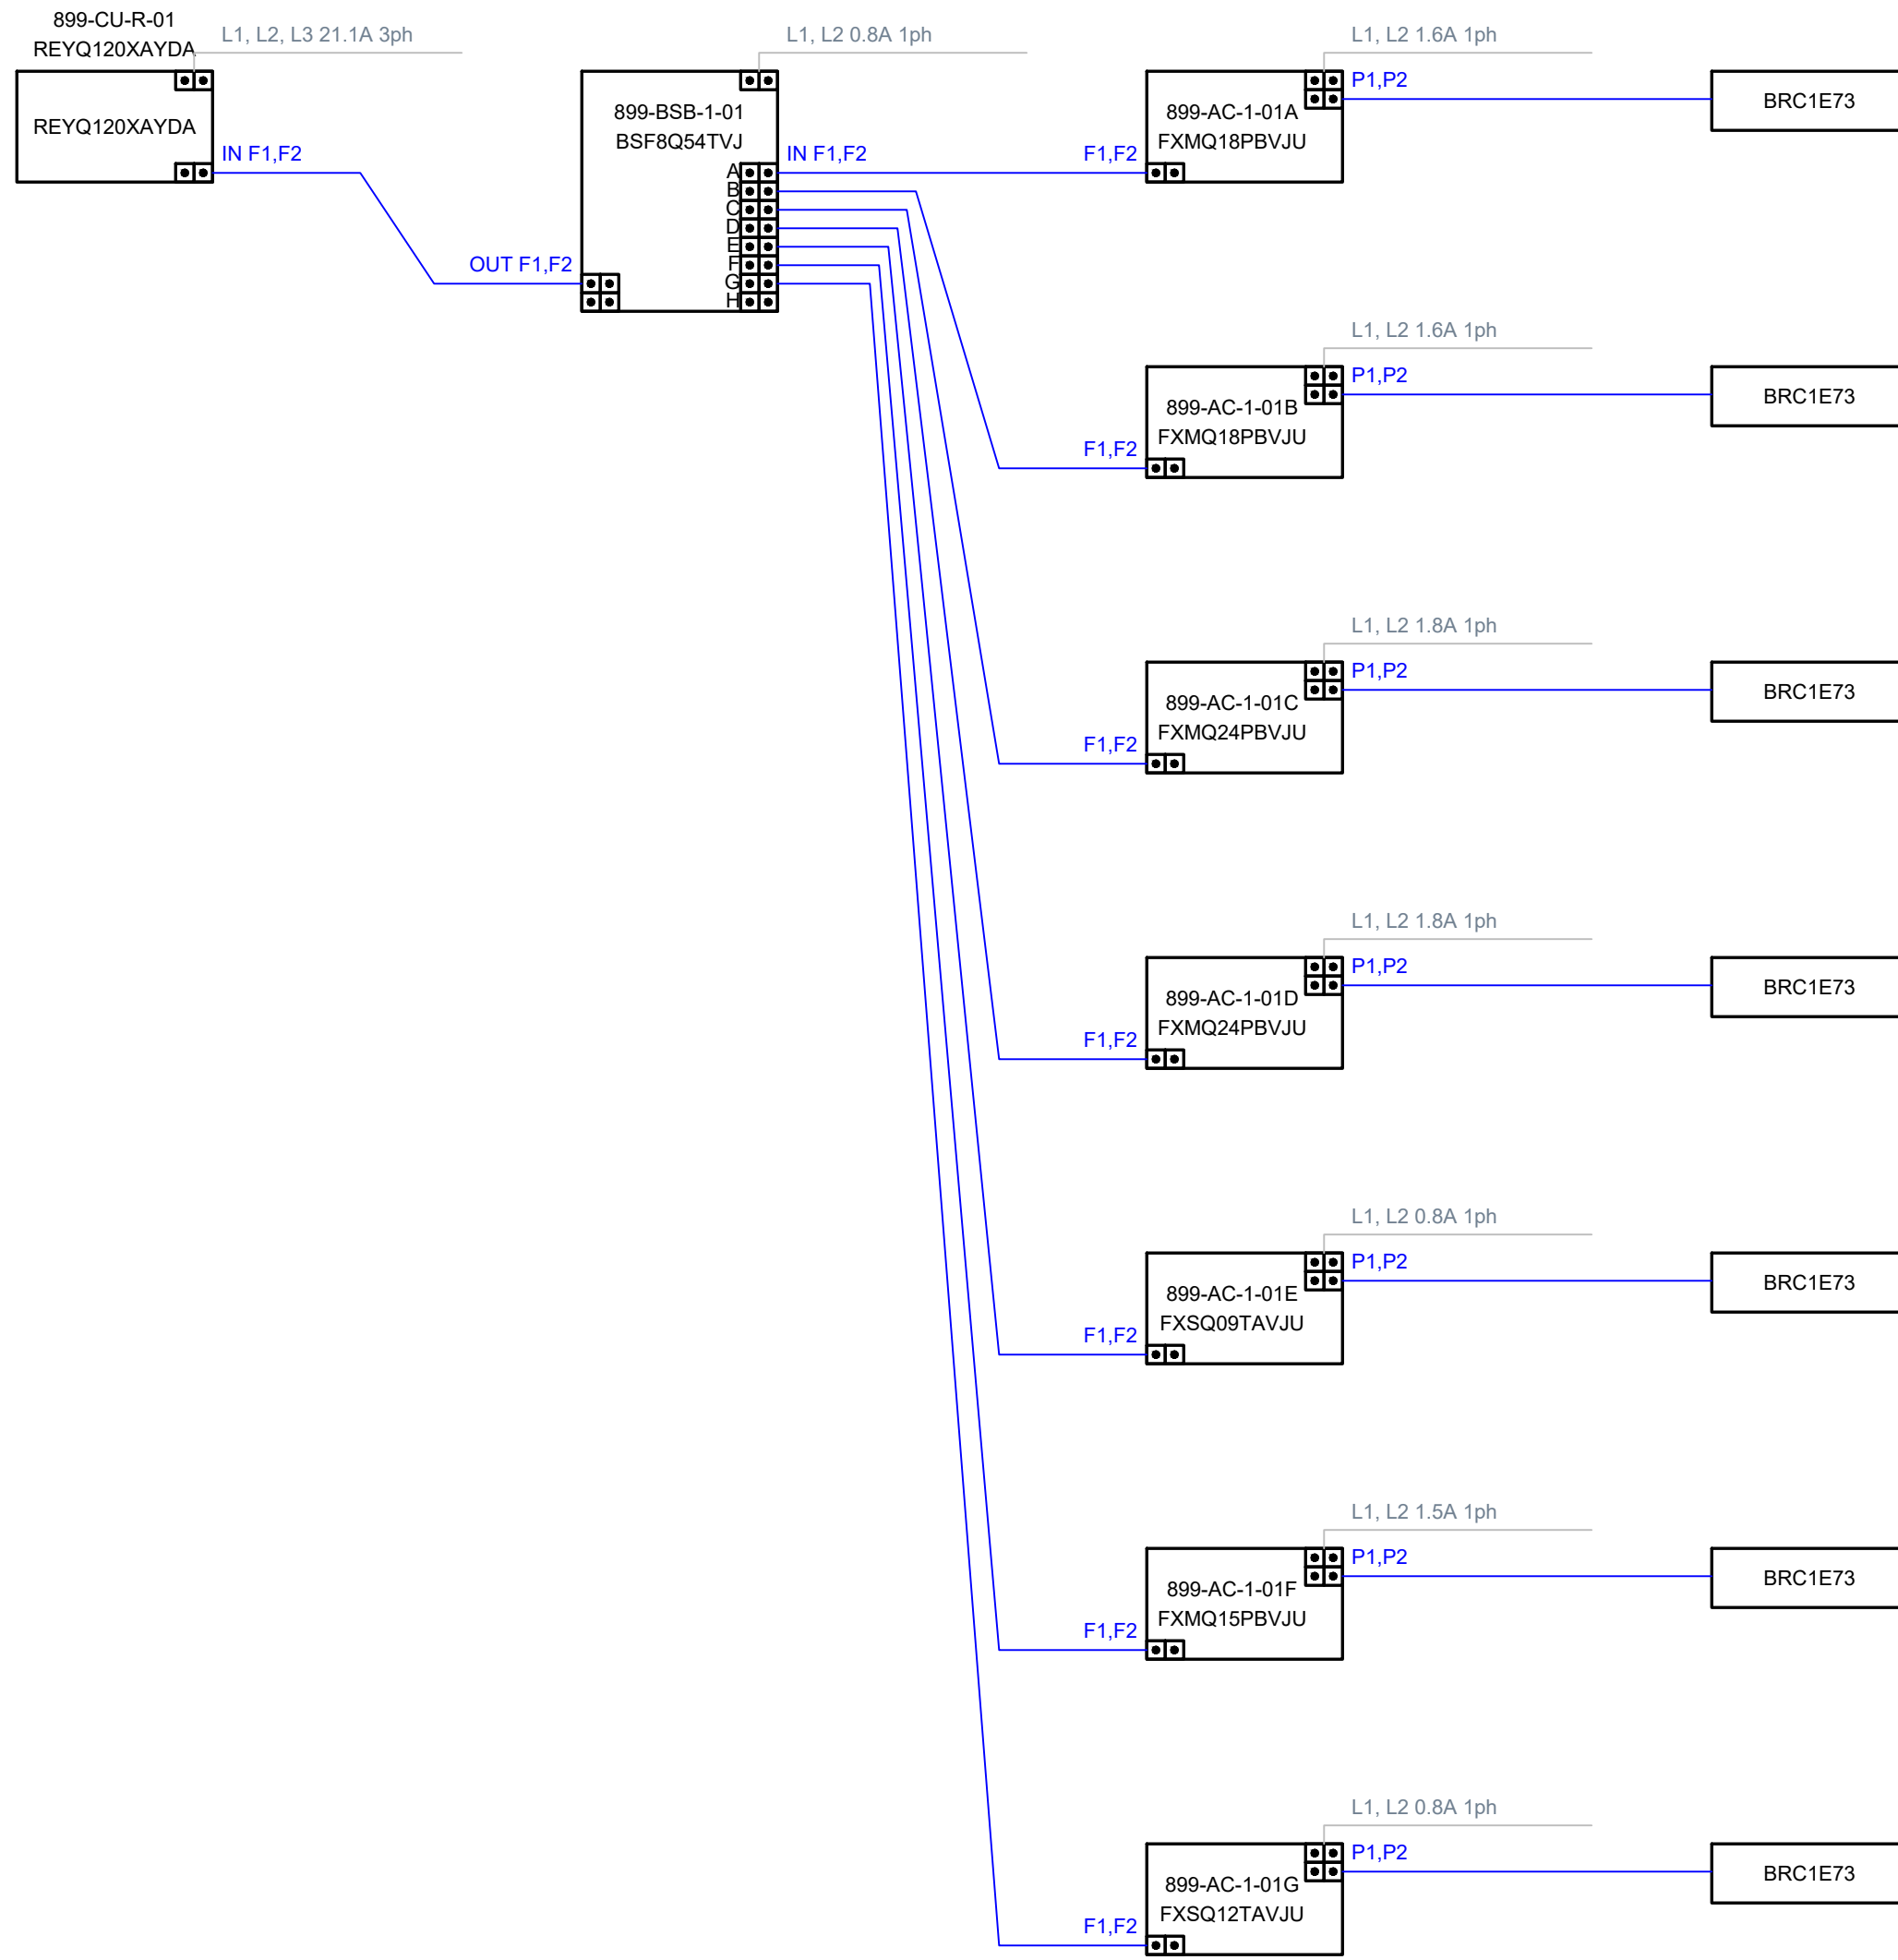

|            |                                                                                      |
|------------|--------------------------------------------------------------------------------------|
| Client     | USA                                                                                  |
| Project    | Daycare center                                                                       |
| Title      | Piping schematics<br>CU-R-2<br>Air cooled heat recovery<br>VRV-V-X-A<br>REYQ120XAYDA |
| Date       | 04/26/2022                                                                           |
| Drawing No |                                                                                      |

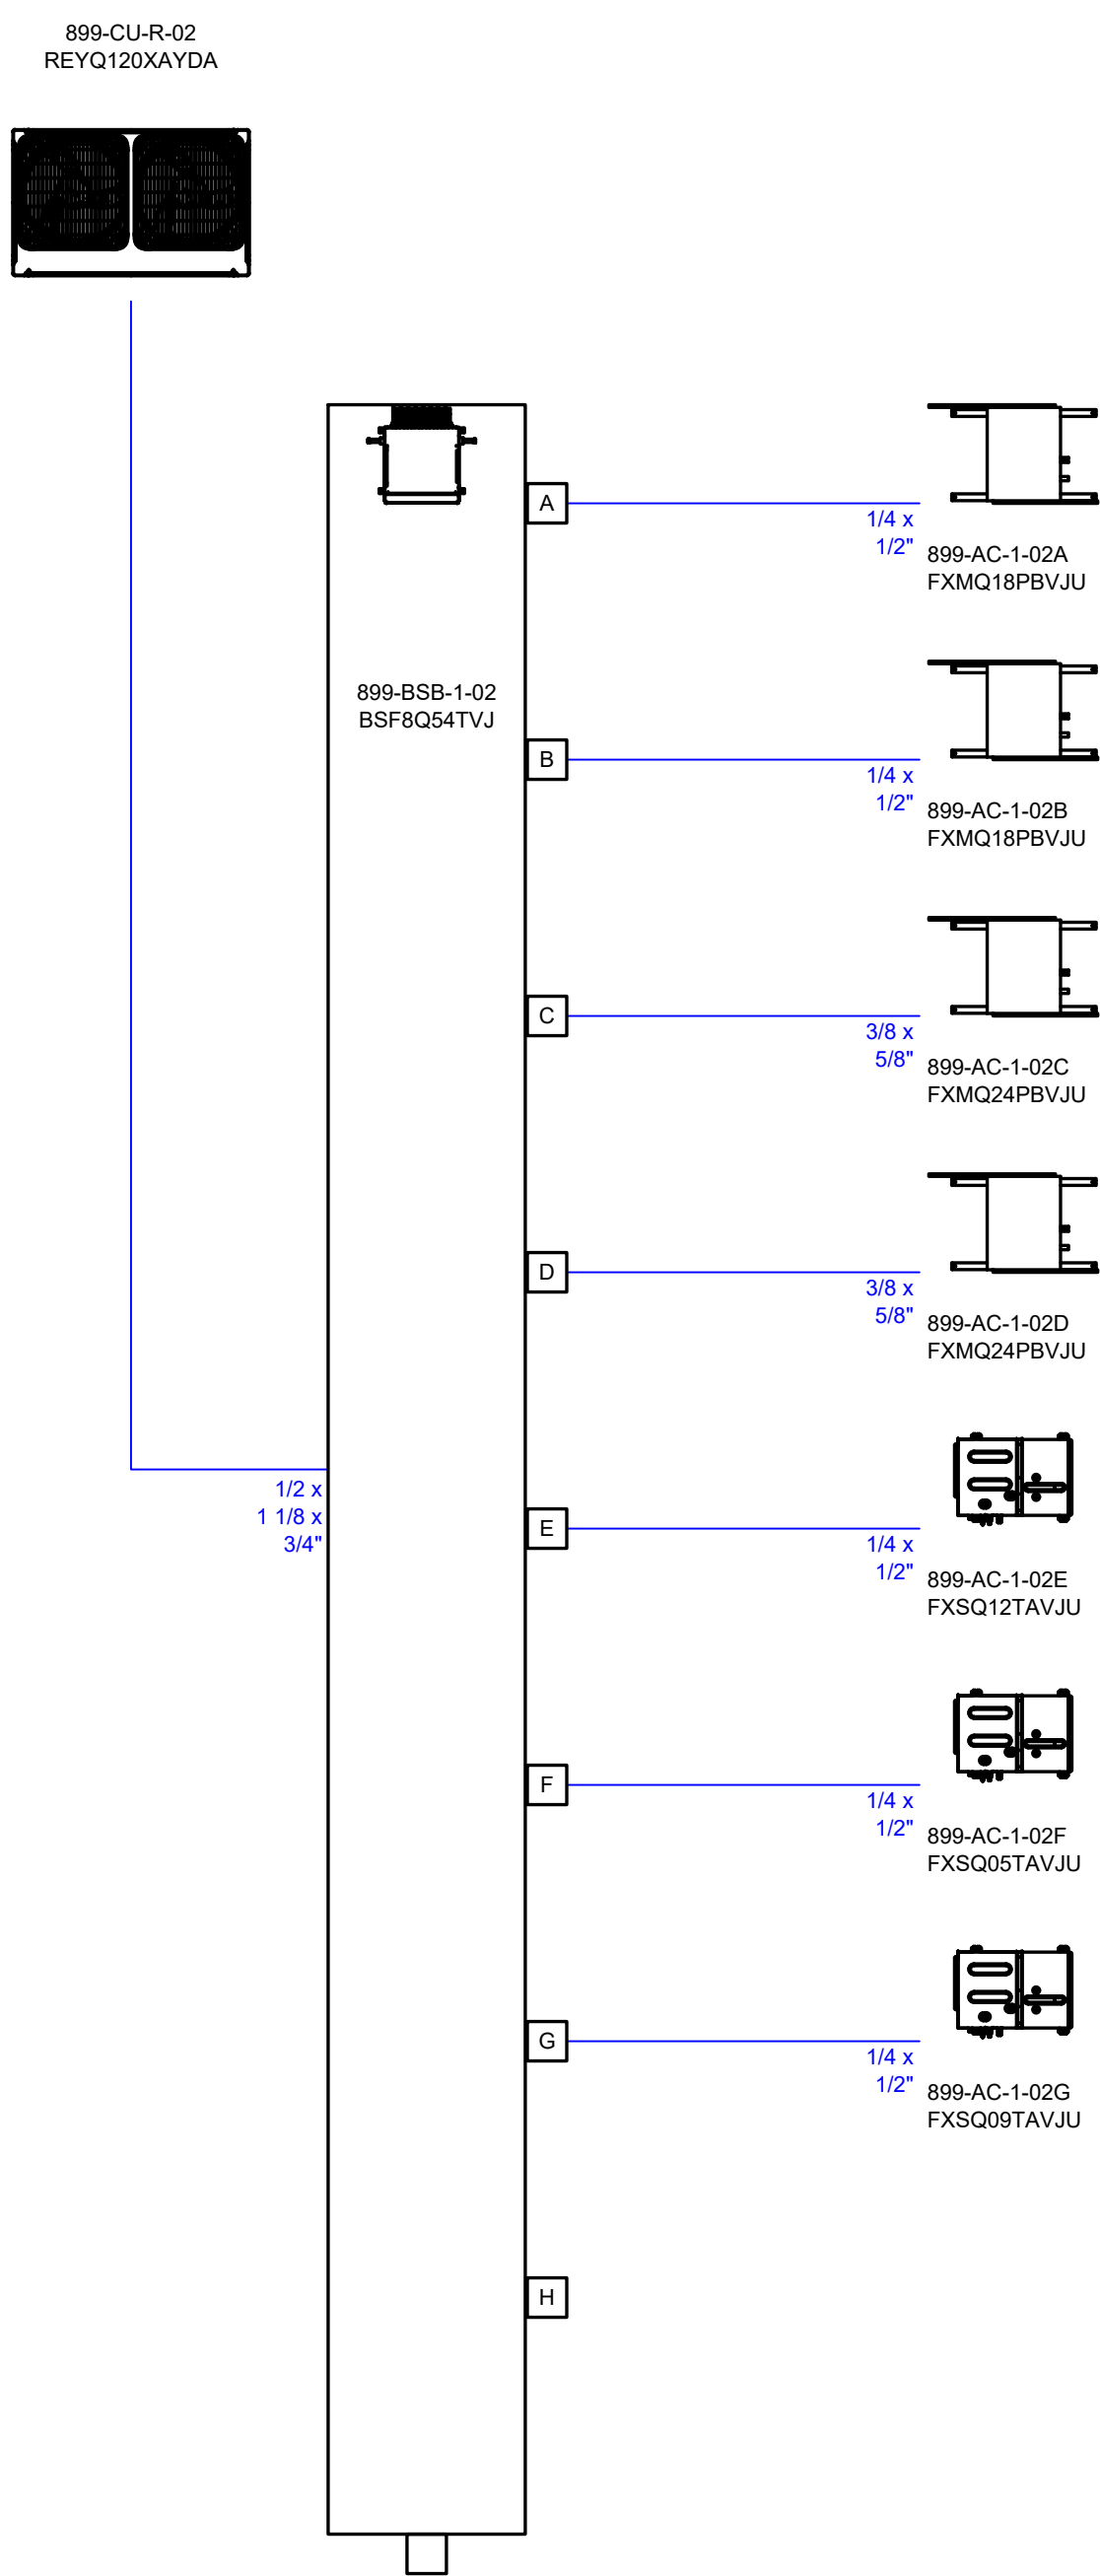

|            |                                                                                      |
|------------|--------------------------------------------------------------------------------------|
| Client     | USA                                                                                  |
| Project    | Daycare center                                                                       |
| Title      | Wiring schematics<br>CU-R-2<br>Air cooled heat recovery<br>VRV-V-X-A<br>REYQ120XAYDA |
| Date       | 04/26/2022                                                                           |
| Drawing No |                                                                                      |

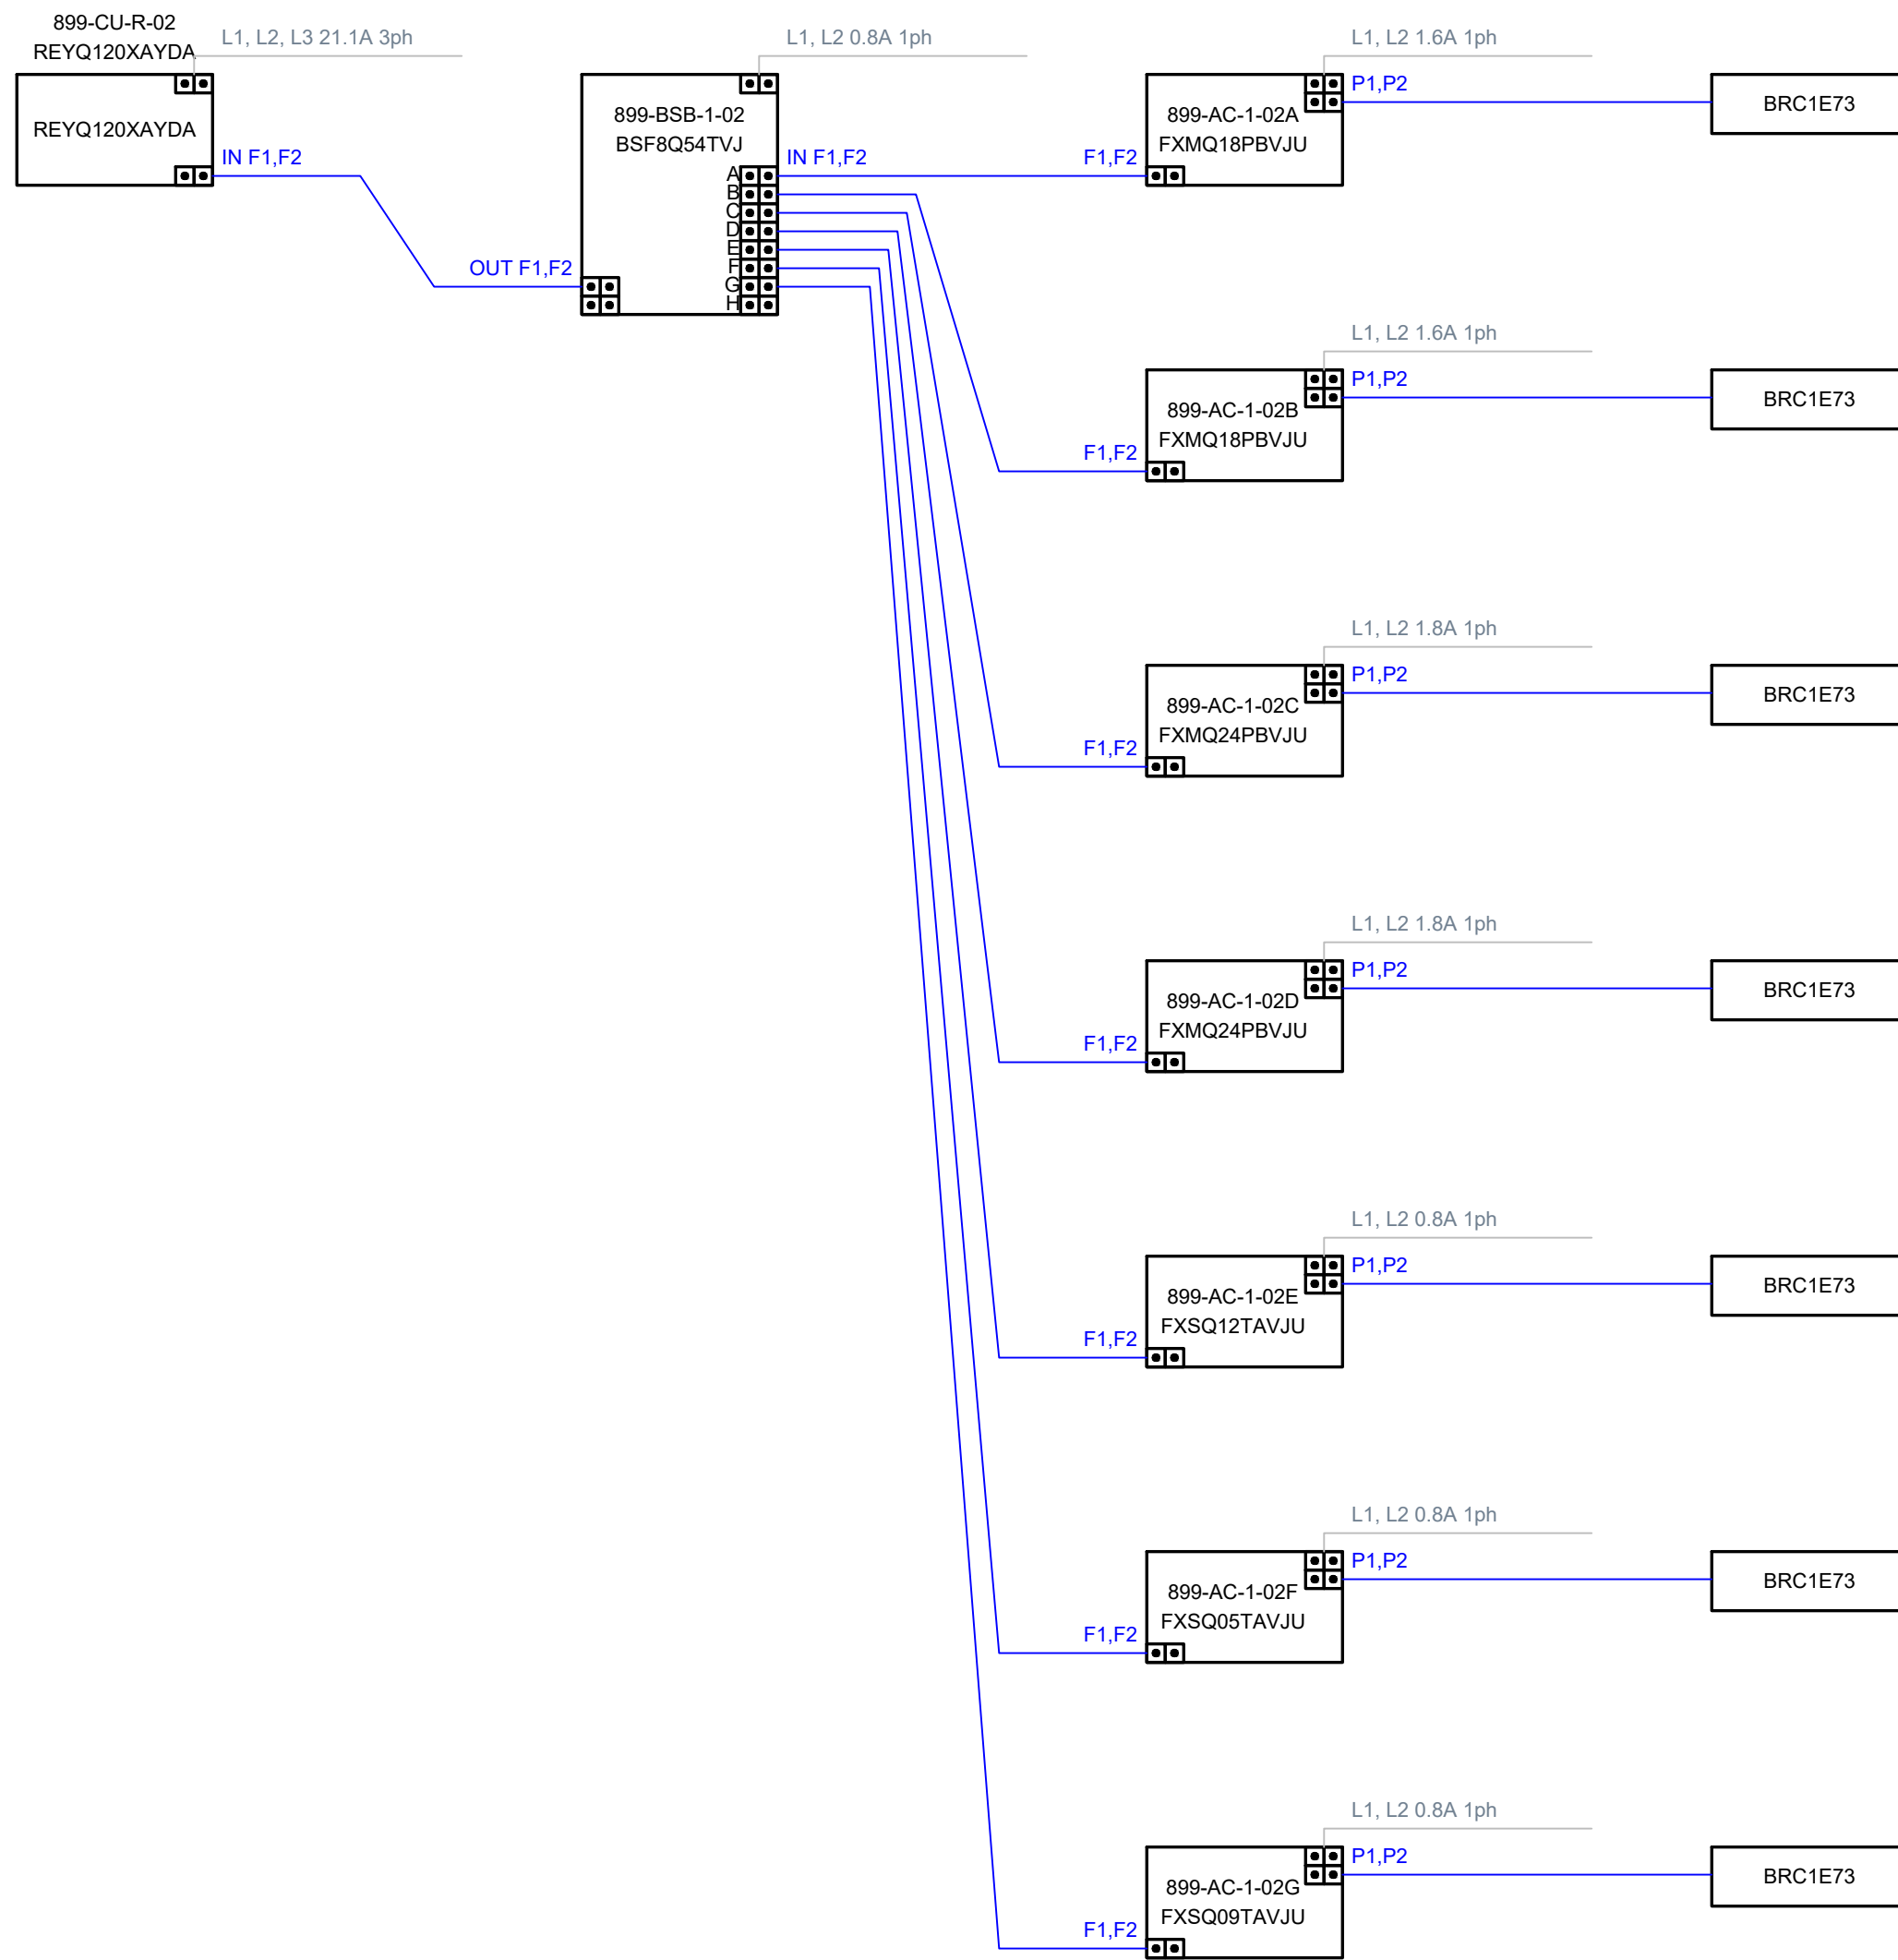

TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGMENT, THESE PLANS AND SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 ENERGY CONSERVATION CODE OF NYS

This plan is approved only for work indicated on the application specification sheet. All other matters shown are not to be relied upon, or to be considered as either being approved or in accordance with applicable codes.

Alterations or additions to this engineering document by an unlicensed person is a violation of Chapter 16, Title VIII, Article 145 § 7209.2 of the New York State Education Law.