

777 Old Saw Mill River Road  
Tarrytown, NY 10591-6707  
T: 914.847.7400  
F: 914.847.7991  
www.regeneron.com

**Building #17**  
**Campus Expansion Child Day-care Center**

777 Old Saw Mill River Road  
Mount Pleasant, NY 10591

Project No. B17-DAYCARE

**Architect**  
**GenSLer**  
1700 Broadway, Suite 400  
New York, NY 10019  
(212) 492-1400 Phone  
(212) 492-1472 Fax

**Structural Engineer**  
Thornton Tomasetti  
120 Broadway, 15th Floor  
New York, NY 10271  
(917) 661-7800 Phone  
(917) 661-7801 Fax


**MEP / IT / Security Engineer**  
Cosentini Associates  
498 Seventh Avenue  
New York, NY 10018  
(212) 615-3600 Phone  
(212) 615-3700 Fax

**Civil Engineer**  
JMC  
120 Bedford Road  
Armonk, NY 10504  
(914) 273-5225 Phone  
(914) 273-2102 Fax

**Landscape Architect**  
Langan  
21 Penn Plaza, 360 West 31st Street, 8th Floor  
New York, NY 10001  
(212) 479-5400 Phone  
(212) 479-5444 Fax


**LIGHTING NOTES:**

1. FOR SYMBOL LIST REFER TO DRAWING E-001.
2. FOR PANEL SCHEDULES REFER TO DRAWING E-600 AND E-601.
3. FOR LIGHTING FIXTURE SCHEDULES REFER TO DRAWING E-603.
4. FOR LIGHTING CONTROL ZONE SCHEDULES REFER TO DRAWING E-602.
5. FOR LEGEND OF EQUIPMENT SCHEDULE REFER TO DRAWING E-110.
6. FOR ONE-LINE DIAGRAM REFER TO DRAWING E-700.
7. COORDINATE FINAL LOCATIONS OF PLUMBING, SPRINKLER, MECHANICAL, AVIT, SECURITY, ETC. DEVICES WITH RESPECTIVE TRADES.
8. LIGHTING CONTROLS INSTALLED ON THE EXTERIOR OF THE BUILDING SHALL BE SUITABLE FOR WET LOCATION.
9. FOR EXTERIOR LIGHTING SITE PLAN REFER TO DRAWING E-051.
10. FOR LIGHTING CONTROLS WIRING DIAGRAM REFER TO DRAWING E-503 AND E-504.
11. FOR ROOF LIGHTING, REFER TO DRAWING E-111.
12. CONTRACTOR TO FURNISH & INSTALL MINIMUM #12 AWG FOR BRANCH CIRCUIT WIRING TO LIGHTING FIXTURES WHERE LIGHTING CIRCUIT ARE OVER 75' LONG. WIRE SHALL BE INCREASED FROM #12 TO #10 AWG UNLESS OTHERWISE INDICATED OR SPECIFIED.
13. CIRCUITING IS DIAGRAMMATIC, CONTRACTOR TO DETERMINE AVAILABLE CIRCUITS SEE SCHEDULE.
14. IN THE MAIN ELECTRICAL ROOM FURNISH & INSTALL WALL MOUNTED BATTERY PACK. CONNECT BATTERY PACKS AHEAD OF THE LIGHTING CONTROL SWITCH OR DEVICE SERVING THE AREA UNLESS OTHERWISE NOTED. EMERGENCY BATTERY PACKS SHALL BE FED VIA NEAREST UNSWITCHED LIGHTING CIRCUITRY. (TAP AHEAD OF LIGHTING CONTROL CIRCUIT OR HOT/LEG). POWER PACKS SHALL BE LOCATED IN ACCESSIBLE CEILING.
15. ALL LIGHTING SHALL BE WIRED TO PANEL AS NOTED. REFER TO RESPECTIVE FLOOR PANEL SCHEDULE.

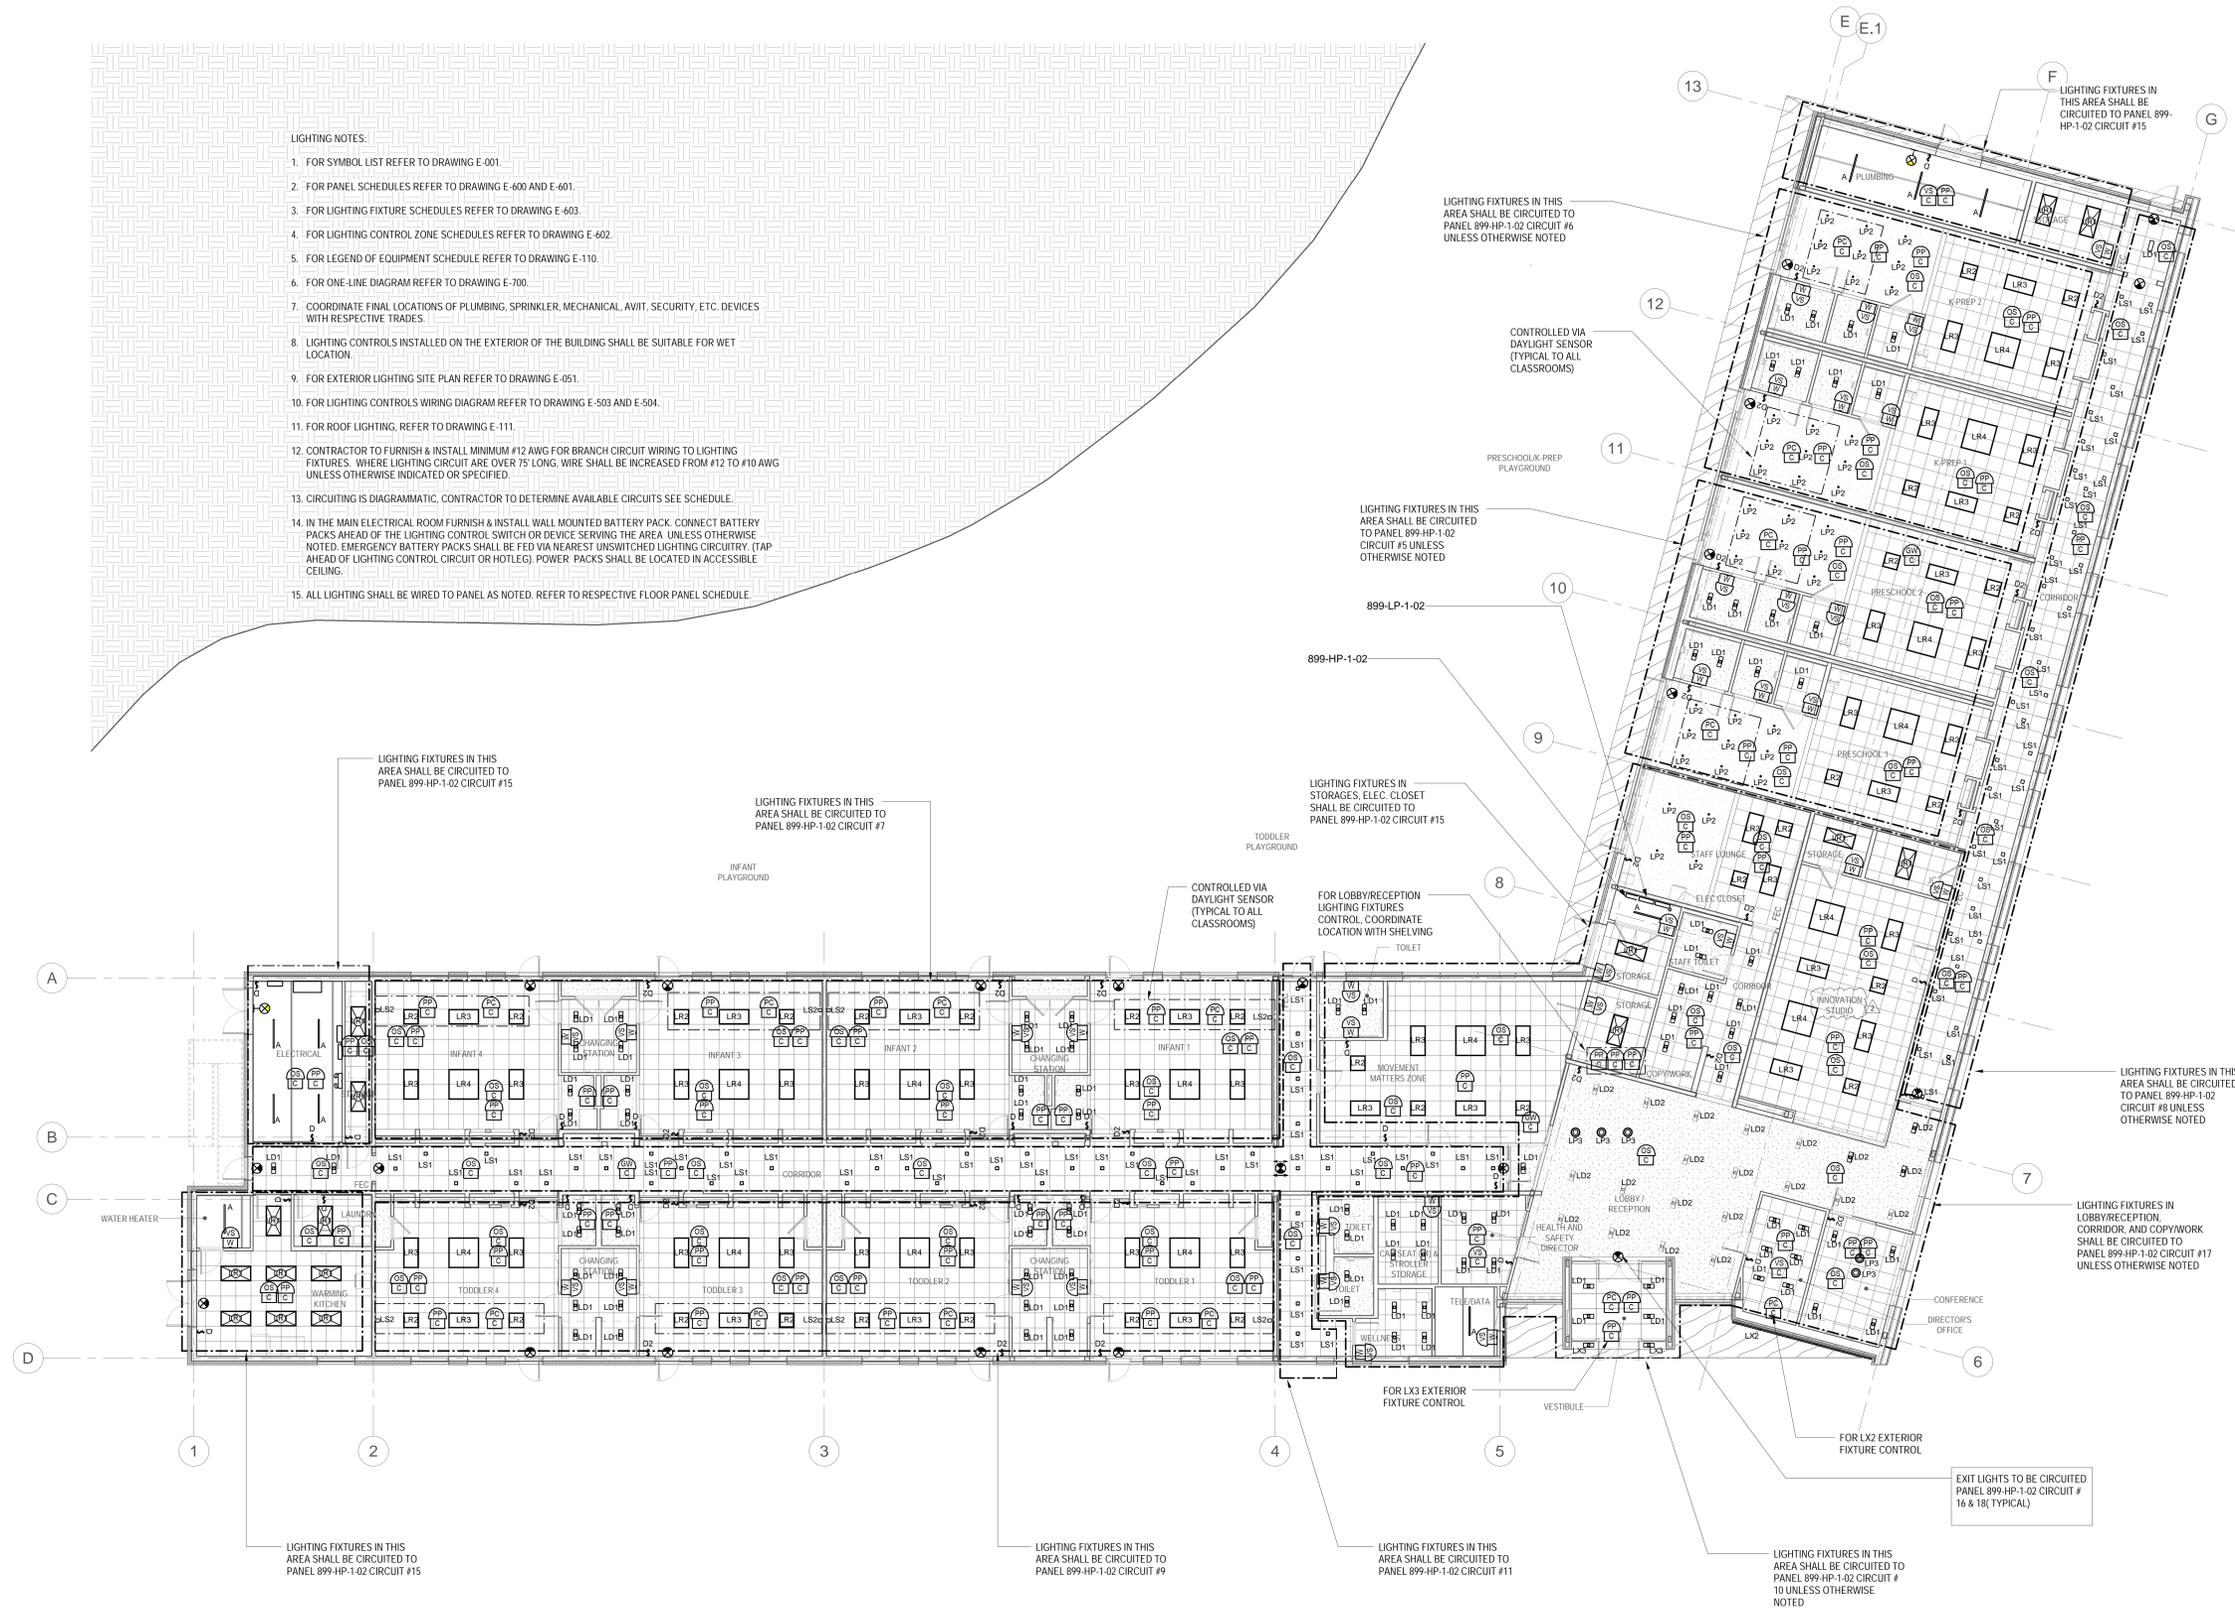

1 LEVEL 01 LIGHTING RCP  
1/8" = 1'-0"

**Key Plan**



No.	Date	Description
0	05.20.2022	ISSUED FOR PERMIT
1	06.20.2022	100% CONSTRUCTION DOCUMENTS
2	07.01.2022	100% CONSTRUCTION DOCUMENTS-1

**Plot Date:** 07.01.2022  
ALL DRAWINGS AND WRITTEN MATERIALS REPRESENTED ON THIS SHEET CONSTITUTE THE CONTRACT DOCUMENTS. THE USER HEREBY AGREES TO HOLD REGENERON PHARMACEUTICALS, INC. (REGENERON) HARMLESS FROM AND FOR ANY AND ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES, INCLUDING REASONABLE ATTORNEY'S FEES, THAT MAY BE INCURRED BY ANY PARTY AS A RESULT OF THE USER'S USE OF THIS SHEET. REGENERON PHARMACEUTICALS, INC. IS NOT RESPONSIBLE FOR ANY AND ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES, INCLUDING REASONABLE ATTORNEY'S FEES, THAT MAY BE INCURRED BY ANY PARTY AS A RESULT OF THE USER'S USE OF THIS SHEET. REGENERON PHARMACEUTICALS, INC. IS NOT RESPONSIBLE FOR ANY AND ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES, INCLUDING REASONABLE ATTORNEY'S FEES, THAT MAY BE INCURRED BY ANY PARTY AS A RESULT OF THE USER'S USE OF THIS SHEET.

**Professional Seal and Signature**

Vendor Name: COSENTINI  
Vendor Project No.: 210104  
Discipline: Electrical  
Drawn By: AI  
**ELECTRICAL LIGHTING PLAN - 1ST FLOOR**

Scale: 1/8" = 1'-0" Floor:

**E-150**

TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGMENT, THESE PLANS AND SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 ENERGY CONSERVATION CODE OF NYS

This plan is approved only for work indicated on the application specification sheet. All other matters shown are not to be relied upon, or to be considered as either being approved or in accordance with applicable codes.

Alterations or additions to this engineering document by an unlicensed person is a violation of Chapter 16, Title VIII, Article 145 § 7209.2 of the New York State Education Law.