

777 Old Saw Mill River Road
Tarrytown, NY 10591-6707
T: 914.847.7400
F: 914.847.7991
www.regeneron.com

Building #17
Campus Expansion Child
Day-care Center

777 Old Saw Mill River Road
Mount Pleasant, NY 10591

Project No. B17-DAYCARE

Architect

Gensler

1700 Broadway, Suite 400
New York, NY 10019
(212) 492-1400 Phone
(212) 492-1472 Fax

Structural Engineer

Thornton Tomasetti
120 Broadway, 15th Floor
New York, NY 10021
(917) 661-7800 Phone
(917) 661-7801 Fax

MEP / IT / Security Engineer

Cosentini Associates
498 Seventh Avenue
New York, NY 10018
(212) 615-3600 Phone
(212) 615-3700 Fax


Civil Engineer

JMC
120 Bedford Road
Armonk, NY 10504
(914) 273-5225 Phone
(914) 273-2102 Fax

Landscape Architect

Langan
21 Penn Plaza, 360 West 31st Street, 8th Floor
New York, NY 10001
(212) 479-5400 Phone
(212) 479-5444 Fax

Key Plan



| No. | Date | Description |
|-----|------------|-------------------------------|
| 0 | 06.20.2022 | 100% CONSTRUCTION DOCUMENTS |
| 1 | 07.01.2022 | 100% CONSTRUCTION DOCUMENTS-1 |

Plot Date: 07.01.2022


ALL DRAWINGS AND WRITTEN MATERIALS REPRESENTED ON THIS SHEET CONSTITUTE THE
COPYRIGHTED WORK AND ARE THE SOLE PROPERTY OF REGENERON PHARMACEUTICALS.
THIS SHEET MAY NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART, NOR MAY ANY
OF THE DRAWINGS OR WRITTEN MATERIALS BE REPRODUCED OR COPIED IN WHOLE OR IN PART,
ANOTHER WORK FOR ANY REASON WITHOUT THE WRITTEN CONSENT OF REGENERON
PHARMACEUTICALS. IF REGENERON MAKES OR AUTHORIZES REUSE OF ANY
SUCH DOCUMENTS OR INFORMATION PROVIDED BY REGENERON PHARMACEUTICALS FOR THE
PROJECT WITHOUT THE EXPRESS WRITTEN CONSENT OF DESIGN PROFESSIONAL,
REGENERON ASSUMES FULL RESPONSIBILITY FOR ANY AND ALL RISKS INVOLVED IN SUCH
REUSE.

Professional Seal and Signature

Vendor Name: COSENTINI
Vendor Project No.: 210104
Discipline: Drawn By: PG
TELECOM LEVEL 01 PLAN

Scale: 1/8" = 1'-0" Floor:

T-100

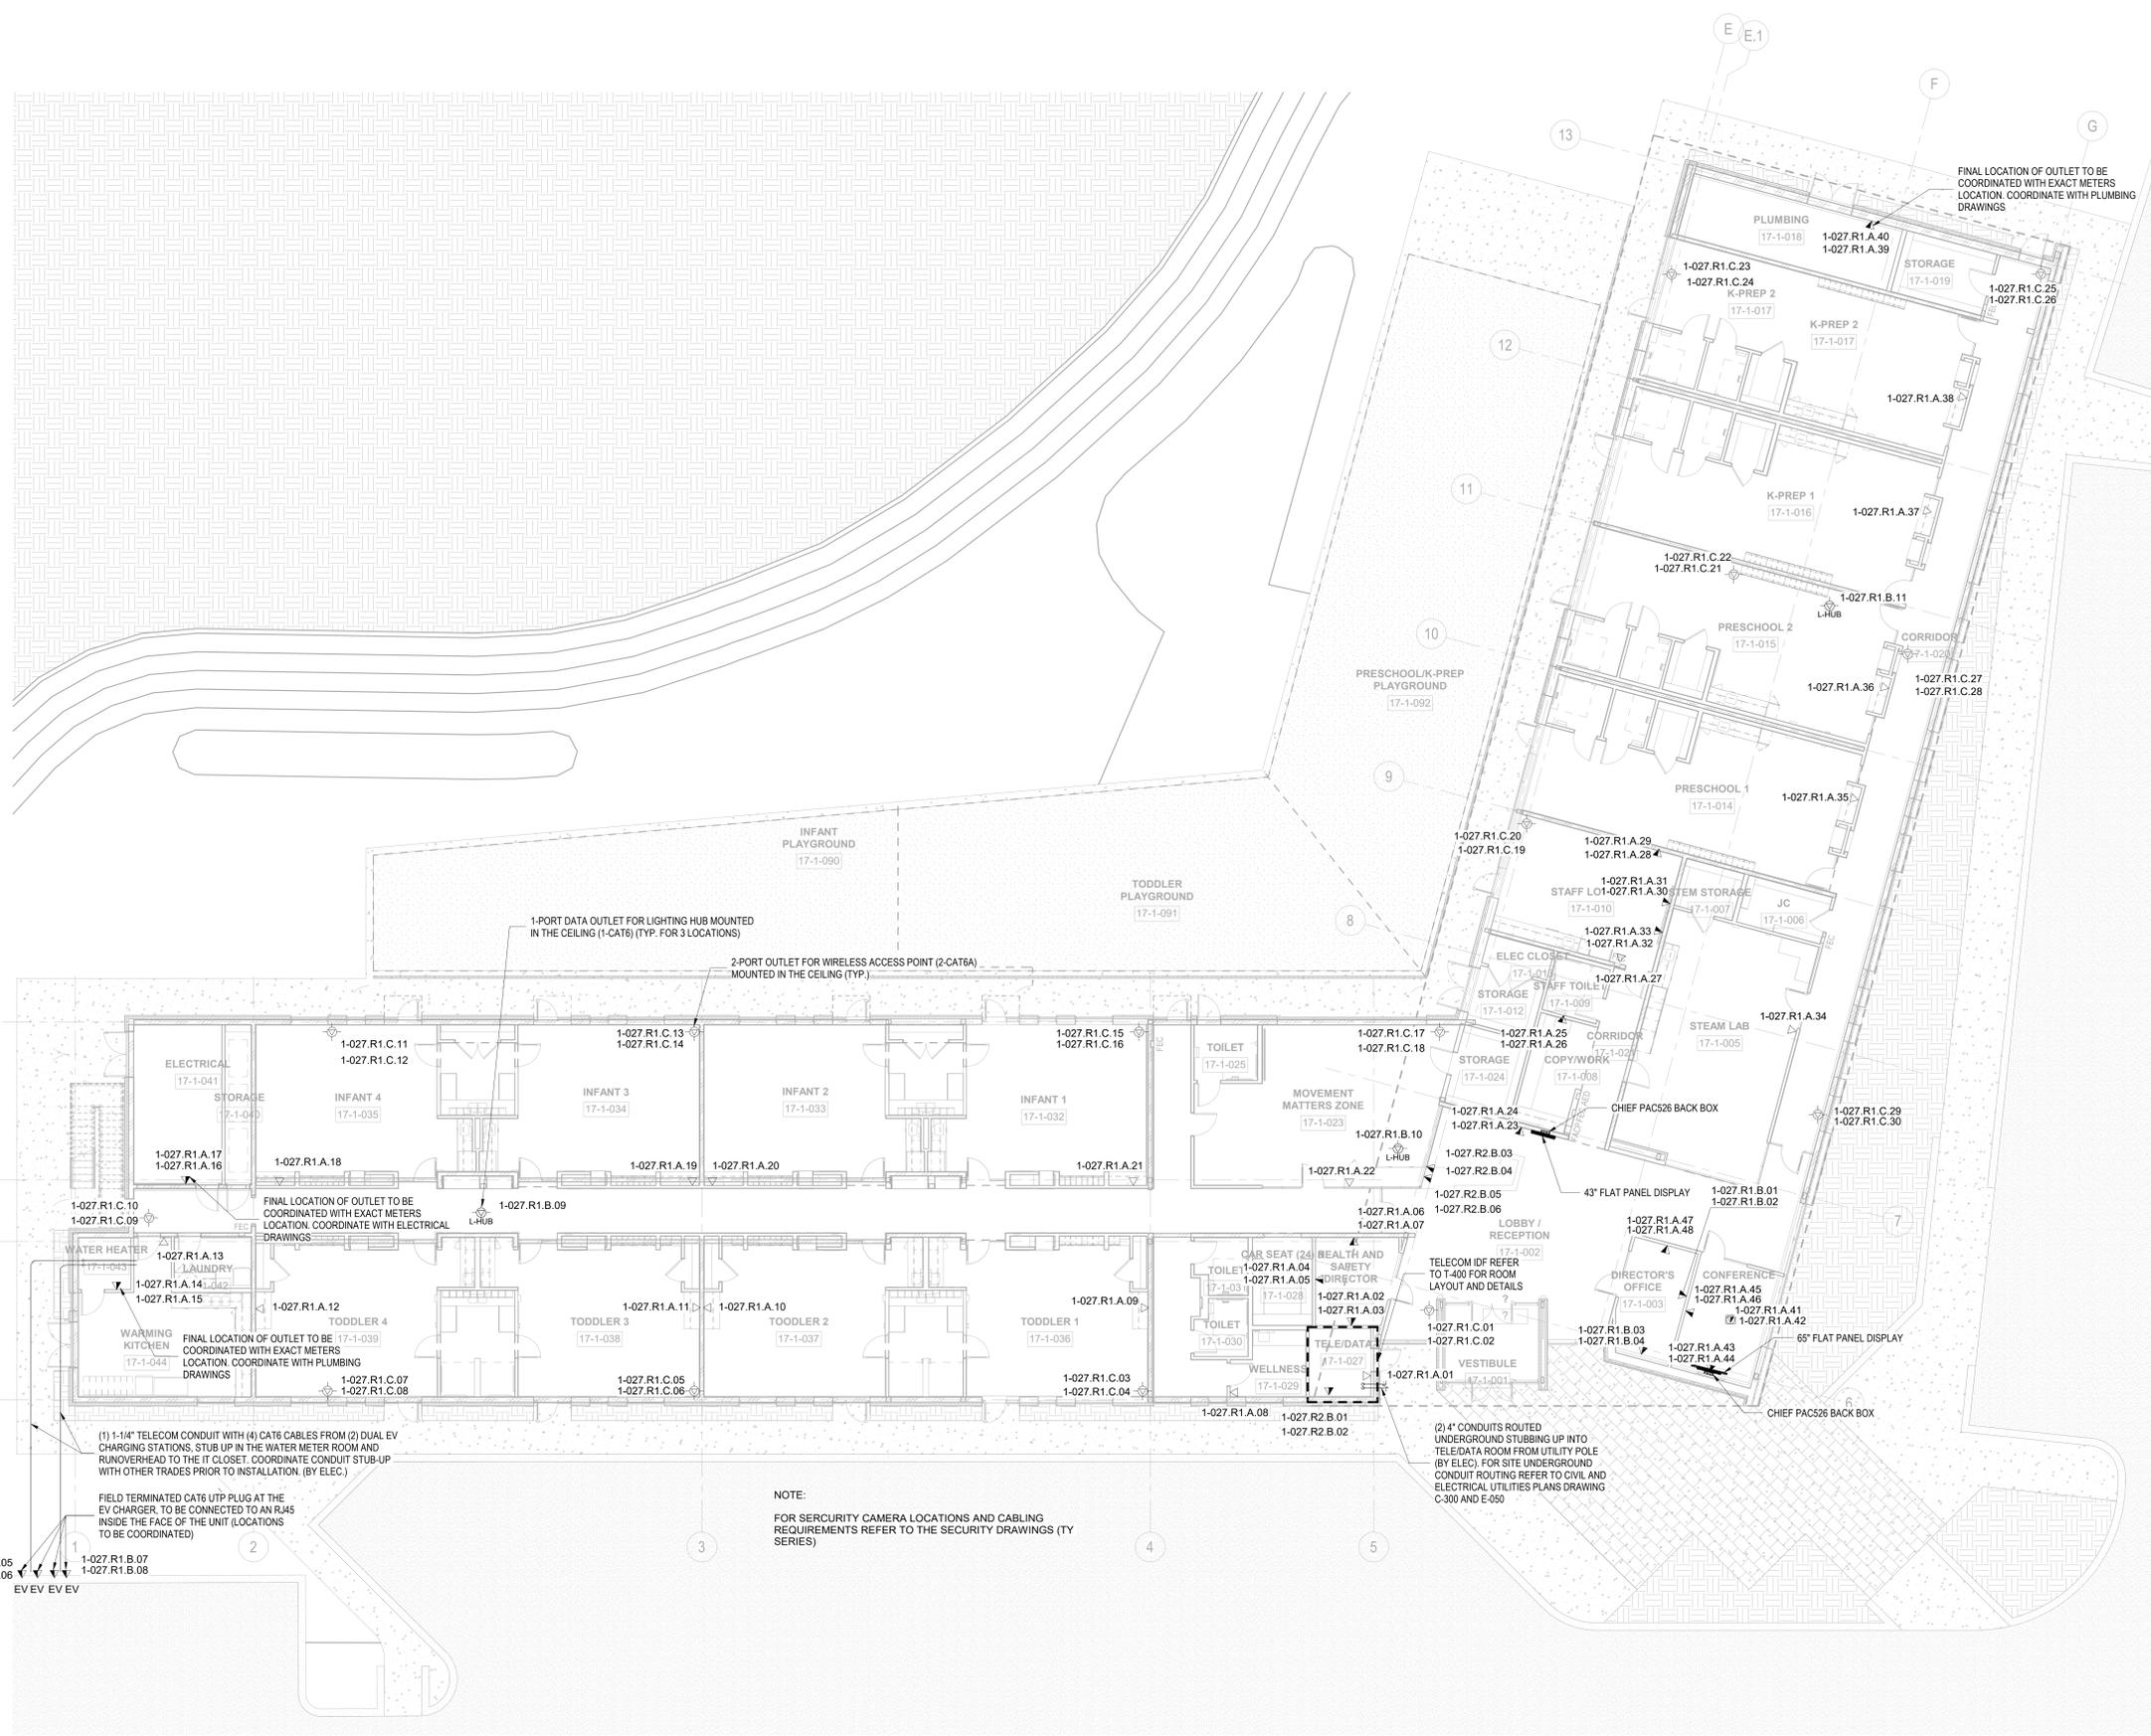

1-PORT DATA OUTLET FOR LIGHTING HUB MOUNTED IN THE CEILING (1-CAT6) (TYP. FOR 3 LOCATIONS)

2-PORT OUTLET FOR WIRELESS ACCESS POINT (2-CAT6A) MOUNTED IN THE CEILING (TYP.)

FINAL LOCATION OF OUTLET TO BE COORDINATED WITH EXACT METERS LOCATION. COORDINATE WITH ELECTRICAL DRAWINGS

FINAL LOCATION OF OUTLET TO BE COORDINATED WITH EXACT METERS LOCATION. COORDINATE WITH PLUMBING DRAWINGS

(1) 1-1/4" TELECOM CONDUIT WITH (4) CAT6 CABLES FROM (2) DUAL EV CHARGING STATIONS. STUB UP IN THE WATER METER ROOM AND RUN OVERHEAD TO THE IT CLOSET. COORDINATE CONDUIT STUB-UP WITH OTHER TRADES PRIOR TO INSTALLATION. (BY ELEC.)

FIELD TERMINATED CAT6 UTP PLUG AT THE EV CHARGER. TO BE CONNECTED TO AN RJ45 INSIDE THE FACE OF THE UNIT (LOCATIONS TO BE COORDINATED)

NOTE:
FOR SECURITY CAMERA LOCATIONS AND CABLING REQUIREMENTS REFER TO THE SECURITY DRAWINGS (TY SERIES)

(2) 4" CONDUITS ROUTED UNDERGROUND STUBBING UP INTO TELEIDATA ROOM FROM UTILITY POLE (BY ELEC). FOR SITE UNDERGROUND CONDUIT ROUTING REFER TO CIVIL AND ELECTRICAL UTILITIES PLANS DRAWING C-300 AND C-550

FILE: BMA-300-3000-3000-000 - Regeneron Day-Care Facility - Tarrytown-101010 - TDCX-Dryman, JT - 2020-10-10 PLOTTED ON: 11/17/21

TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGMENT, THESE PLANS AND SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 ENERGY CONSERVATION CODE OF NYS

This plan is approved only for work indicated on the application specifications sheet. All other matters shown are not to be relied upon, or to be considered as either being approved or in accordance with applicable codes.

Alterations or additions to this engineering document by an unlicensed person is a violation of Chapter 16, Title VIII, Article 145 § 7209.2 of the New York State Education Law.

© 11/17/21 REGENERON PHARMACEUTICALS, INC.