

777 Old Saw Mill River Road
Tarrytown, NY 10591-6707
T: 914.847.7400
F: 914.847.7991
www.regeneron.com

Building #17
Campus Expansion Child
Day-care Center

777 Old Saw Mill River Road
Mount Pleasant, NY 10591

Project No. B17-DAYCARE

Architect

Gensler

1700 Broadway, Suite 400
New York, NY 10019
(212) 492-1400 Phone
(212) 492-1472 Fax

Structural Engineer

Thornton Tomasetti
120 Broadway, 15th Floor
New York, NY 10271
(917) 661-7800 Phone
(917) 661-7801 Fax

MEP / IT / Security Engineer

Cosentini Associates
498 Seventh Avenue
New York, NY 10018
(212) 615-3600 Phone
(212) 615-3700 Fax


Civil Engineer

JMC
120 Bedford Road
Armonk, NY 10504
(914) 273-5225 Phone
(914) 273-2102 Fax

Landscape Architect

Langan
21 Penn Plaza, 360 West 31st Street, 8th Floor
New York, NY 10001
(212) 479-5400 Phone
(212) 479-5444 Fax

Key Plan



No.	Date	Description
0	06.20.2022	100% CONSTRUCTION DOCUMENTS
1	07.01.2022	100% CONSTRUCTION DOCUMENTS-1

Plot Date: 07.01.2022


ALL DRAWINGS AND WRITTEN MATERIALS REPRESENTED ON THIS SHEET CONSTITUTE THE COPYRIGHTED WORK AND ARE THE SOLE PROPERTY OF REGENERON PHARMACEUTICALS. THIS SHEET SHALL NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART, NOR MAY ANY OF THE DRAWINGS OR WRITTEN MATERIALS WITHIN BE REPRODUCED OR COPIED IN WHOLE OR IN PART FOR ANY REASON WITHOUT THE WRITTEN CONSENT OF REGENERON PHARMACEUTICALS. REGENERON PHARMACEUTICALS SHALL NOT BE HELD RESPONSIBLE FOR ANY REVISIONS OR CHANGES TO THIS SHEET OR ANY OTHER SHEETS OF THIS PROJECT. REGENERON PHARMACEUTICALS SHALL NOT BE HELD RESPONSIBLE FOR ANY REVISIONS OR CHANGES TO THIS SHEET OR ANY OTHER SHEETS OF THIS PROJECT. REGENERON PHARMACEUTICALS SHALL NOT BE HELD RESPONSIBLE FOR ANY REVISIONS OR CHANGES TO THIS SHEET OR ANY OTHER SHEETS OF THIS PROJECT.

Professional Seal and Signature

Vendor Name: COSENTINI
Vendor Project No.: 210104
Discipline: SECURITY Drawn By: PG
SECURITY LEVEL 01 PLAN

Scale: 1/8" = 1'-0" Floor:

TY-100

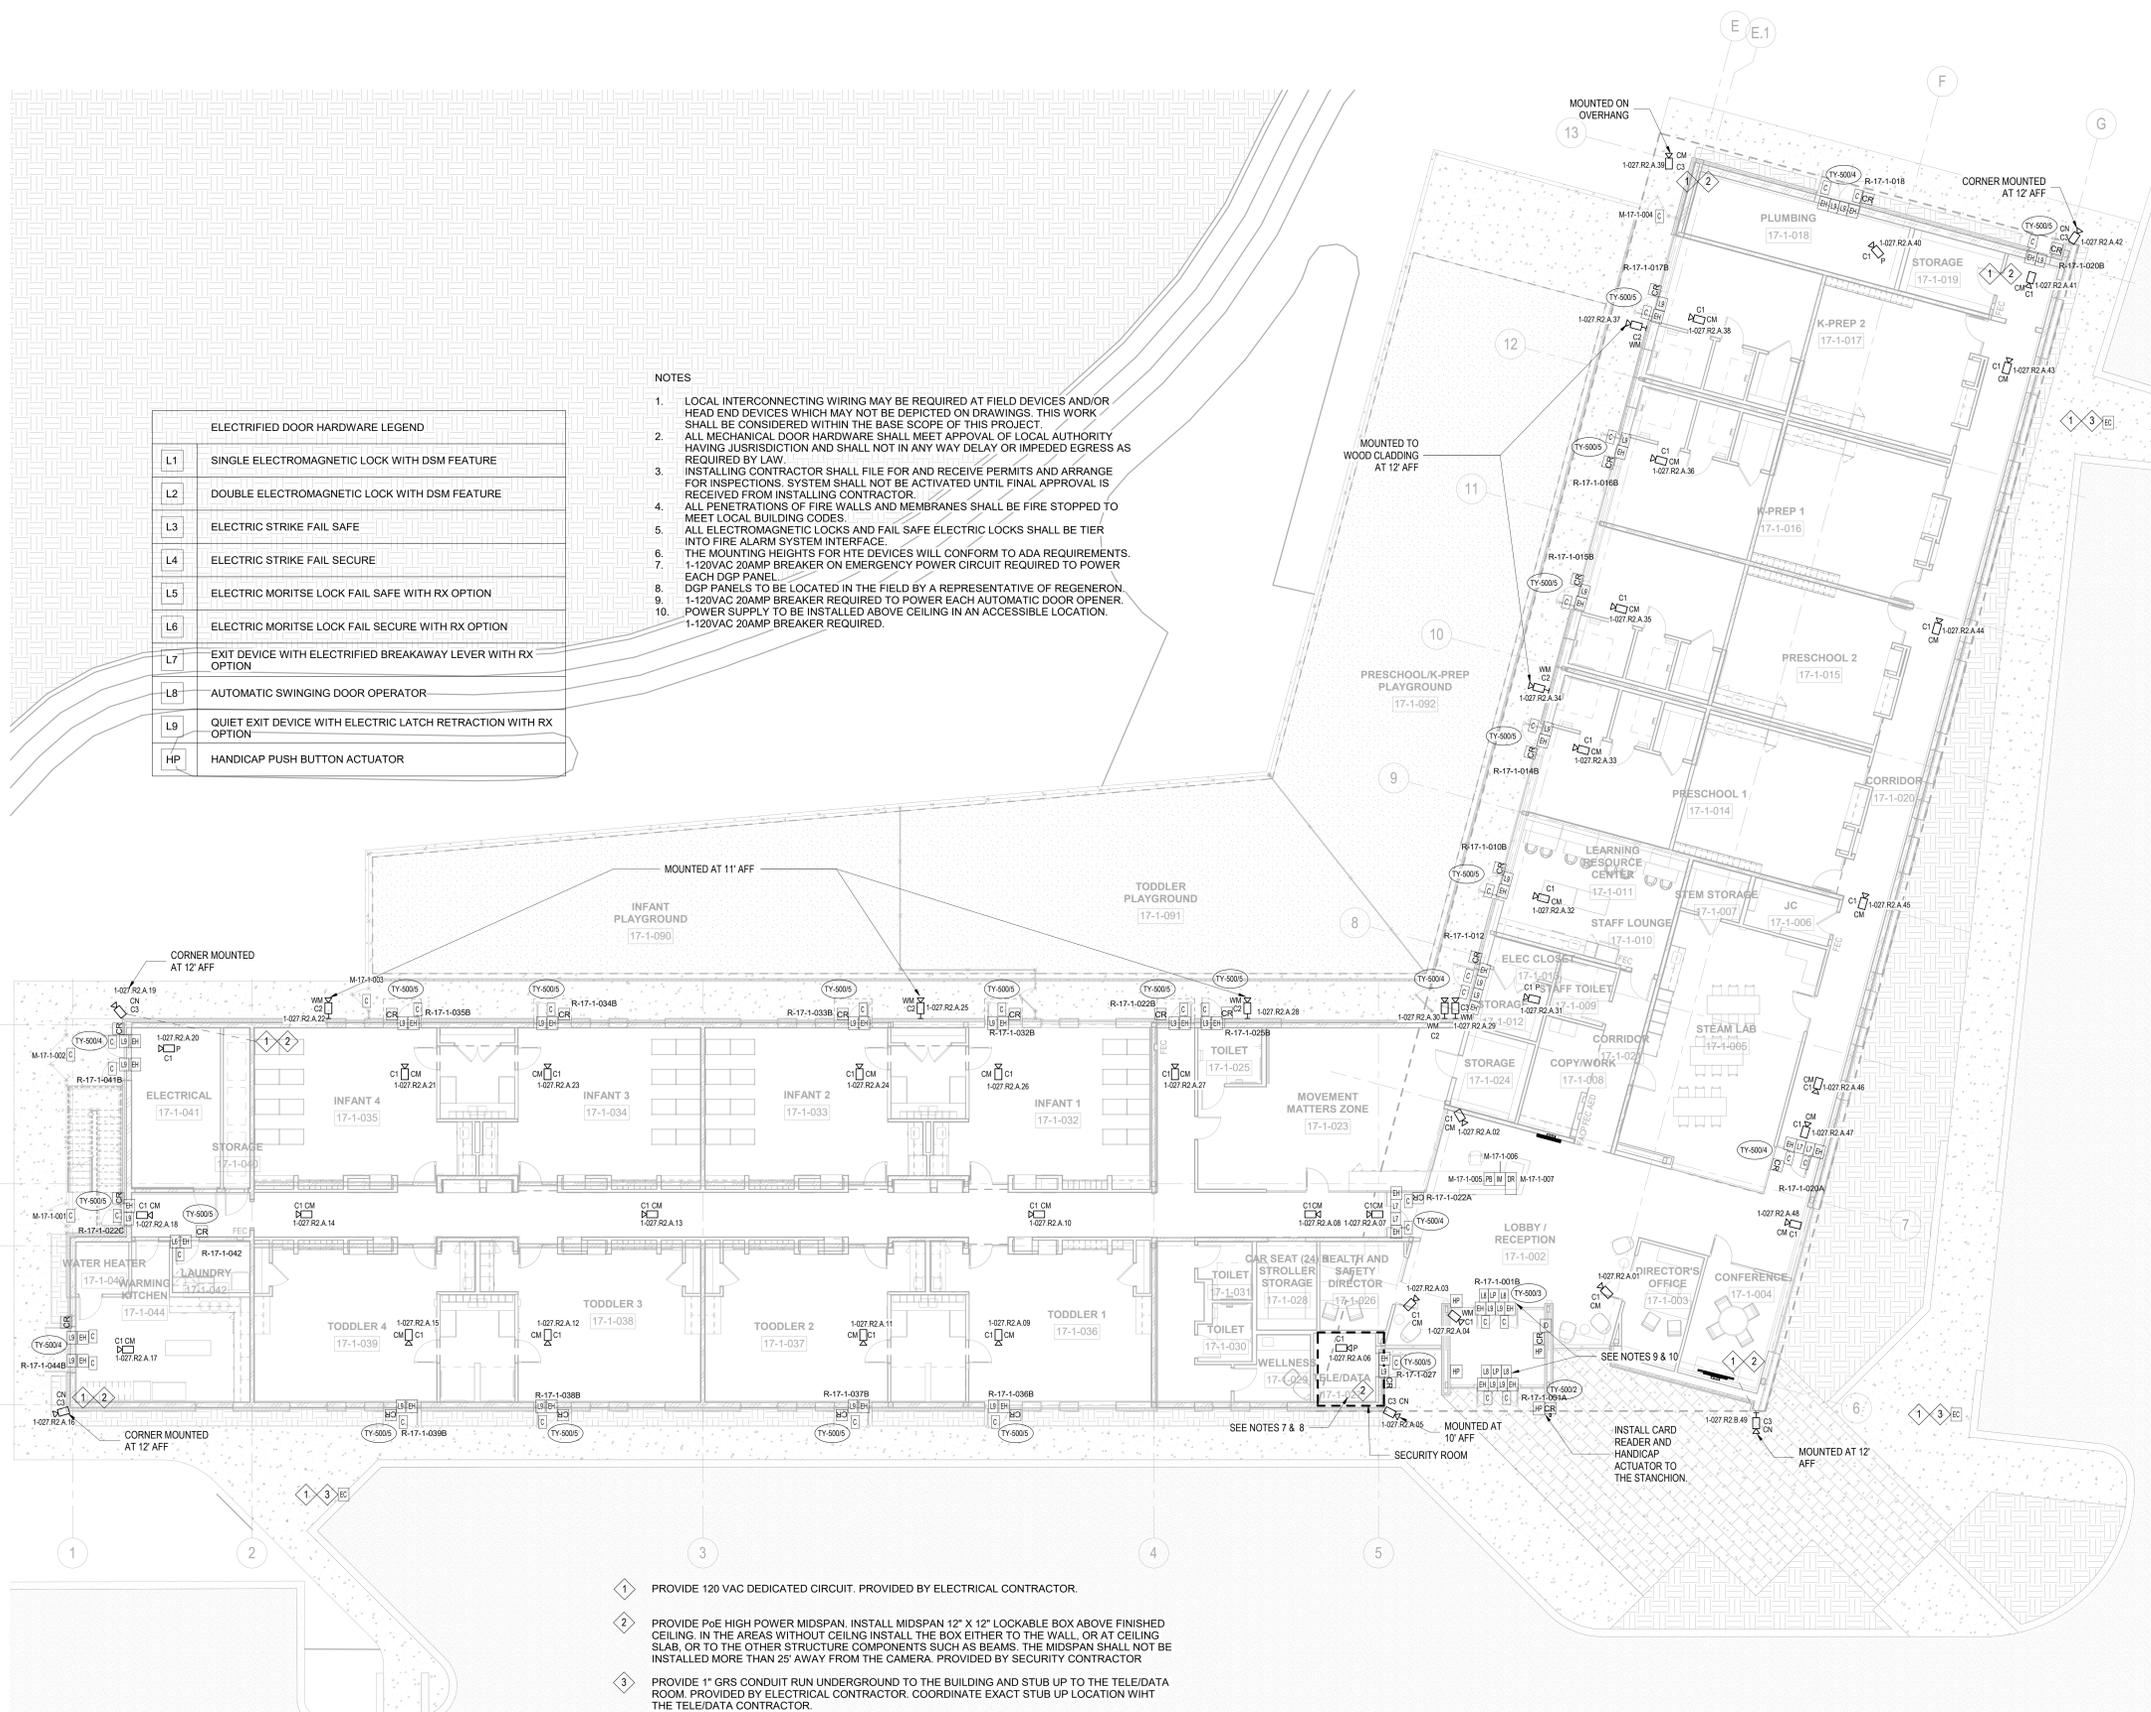

ELECTRIFIED DOOR HARDWARE LEGEND

L1	SINGLE ELECTROMAGNETIC LOCK WITH DSM FEATURE
L2	DOUBLE ELECTROMAGNETIC LOCK WITH DSM FEATURE
L3	ELECTRIC STRIKE FAIL SAFE
L4	ELECTRIC STRIKE FAIL SECURE
L5	ELECTRIC MORITSE LOCK FAIL SAFE WITH RX OPTION
L6	ELECTRIC MORITSE LOCK FAIL SECURE WITH RX OPTION
L7	EXIT DEVICE WITH ELECTRIFIED BREAKAWAY LEVER WITH RX OPTION
L8	AUTOMATIC SWINGING DOOR OPERATOR
L9	QUIET EXIT DEVICE WITH ELECTRIC LATCH RETRACTION WITH RX OPTION
HP	HANDICAP PUSH BUTTON ACTUATOR

- NOTES**
- LOCAL INTERCONNECTING WIRING MAY BE REQUIRED AT FIELD DEVICES AND/OR HEAD END DEVICES WHICH MAY NOT BE DEPICTED ON DRAWINGS. THIS WORK SHALL BE CONSIDERED WITHIN THE BASE SCOPE OF THIS PROJECT.
 - ALL MECHANICAL DOOR HARDWARE SHALL MEET APPROVAL OF LOCAL AUTHORITY HAVING JURISDICTION AND SHALL NOT IN ANY WAY DELAY OR IMPEDED EGRESS AS REQUIRED BY LAW.
 - INSTALLING CONTRACTOR SHALL FILE FOR AND RECEIVE PERMITS AND ARRANGE FOR INSPECTIONS. SYSTEM SHALL NOT BE ACTIVATED UNTIL FINAL APPROVAL IS RECEIVED FROM INSTALLING CONTRACTOR.
 - ALL PENETRATIONS OF FIRE WALLS AND MEMBRANES SHALL BE FIRE STOPPED TO MEET LOCAL BUILDING CODES.
 - ALL ELECTROMAGNETIC LOCKS AND FAIL SAFE ELECTRIC LOCKS SHALL BE TIED INTO FIRE ALARM SYSTEM INTERFACE.
 - THE MOUNTING HEIGHTS FOR HTE DEVICES WILL CONFORM TO ADA REQUIREMENTS.
 - 1-120VAC 20AMP BREAKER ON EMERGENCY POWER CIRCUIT REQUIRED TO POWER EACH DGP PANEL.
 - DGP PANELS TO BE LOCATED IN THE FIELD BY A REPRESENTATIVE OF REGENERON.
 - 1-120VAC 20AMP BREAKER REQUIRED TO POWER EACH AUTOMATIC DOOR OPENER. POWER SUPPLY TO BE INSTALLED ABOVE CEILING IN AN ACCESSIBLE LOCATION.
 - 1-120VAC 20AMP BREAKER REQUIRED.

- PROVIDE 120 VAC DEDICATED CIRCUIT. PROVIDED BY ELECTRICAL CONTRACTOR.
- PROVIDE P6E HIGH POWER MIDSPAN. INSTALL MIDSPAN 12" X 12" LOCKABLE BOX ABOVE FINISHED CEILING. IN THE AREAS WITHOUT CEILING INSTALL THE BOX EITHER TO THE WALL, OR AT CEILING SLAB, OR TO THE OTHER STRUCTURE COMPONENTS SUCH AS BEAMS. THE MIDSPAN SHALL NOT BE INSTALLED MORE THAN 25' AWAY FROM THE CAMERA. PROVIDED BY SECURITY CONTRACTOR.
- PROVIDE 1" GRS CONDUIT RUN UNDERGROUND TO THE BUILDING AND STUB UP TO THE TELE/DATA ROOM. PROVIDED BY ELECTRICAL CONTRACTOR. COORDINATE EXACT STUB UP LOCATION WITH THE TELE/DATA CONTRACTOR.

TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGMENT, THESE PLANS AND SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 ENERGY CONSERVATION CODE OF NYS

This plan is approved only for work indicated on the application specifications sheet. All other matters shown are not to be relied upon, or to be considered as either being approved or in accordance with applicable codes.

Alterations or additions to this engineering document by an unlicensed person is a violation of Chapter 16, Title VIII, Article 145 § 7209.2 of the New York State Education Law.