


12 INCH FROM WATER TREATMENT TO BUILDING A (VIEW A: SEE PLANS C-301 & C-302)


HORIZONTAL SCALE: 1" = 30'
VERTICAL SCALE: 1" = 10'

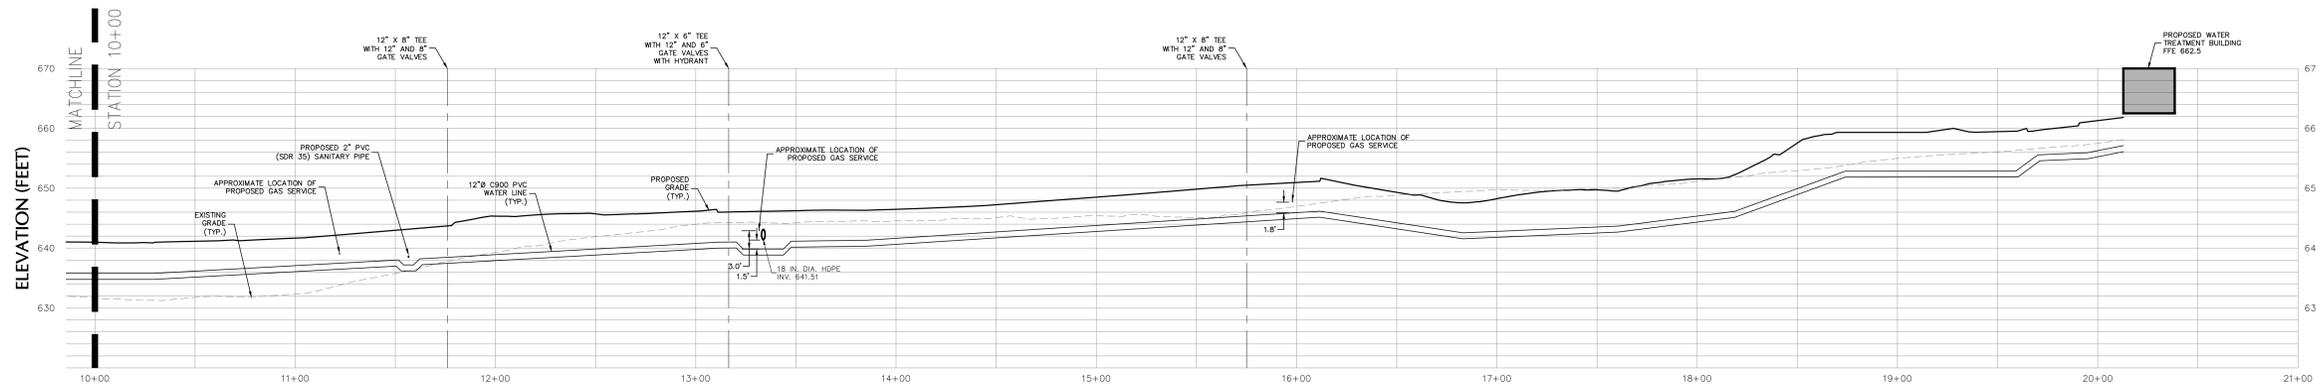

12 INCH FROM WATER TREATMENT TO BUILDING A (VIEW B: SEE PLAN C-302)

HORIZONTAL SCALE: 1" = 30'
VERTICAL SCALE: 1" = 10'

- NOTES:**
- UNLESS OTHERWISE SPECIFIED, PIPE FOR WATER SUPPLY AND DISTRIBUTION LINES SHALL BE POLYVINYL CHLORIDE PRESSURE PIPE (PVC-P), CLASS 235 PSI, OR 18" WITH PUSH-ON JOINTS IN ACCORDANCE WITH ANNA C-300 (BLUE BRUTE).
 - WATER MAIN SHALL HAVE A MINIMUM 18" CLEARANCE TO SANITARY SEWER AND DRAINAGE PIPES AND A MINIMUM 12" CLEARANCE TO ALL OTHER UTILITIES.



Date	Description	No.
10/14/2022	REV. FOR NYDEP SUBMISSION	3
03/25/2022	REV. PER TOWN COMMENTS	2
03/07/2022	REV. PER TOWN COMMENTS	1

WARNING: IT IS A VIOLATION OF THE NYS EDUCATION LAW ARTICLE 145 FOR ANY PERSON, UNLESS HE IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, LAND SURVEYOR OR GEOLOGIST, TO ALTER THIS ITEM IN ANY WAY.



LANGAN
Langan Engineering, Environmental, Surveying,
Landscape Architecture, and Geology, D.P.C.
One North Broadway, Suite 910
White Plains, NY 10601
T: 914.323.7400 F: 914.323.7401 www.langan.com

Project: **LINCOLN LOGISTICS BREWSTER**
TOWN OF SOUTHEAST
PUTNAM COUNTY NEW YORK

Drawing Title: **WATERLINE PROFILES (6 OF 9)**

Project No.: 190065201
Date: 1/28/2022
Drawn By: JMSK
Checked By: CZMF
Drawing No.: **C-315**
Sheet 34 of 97