

General Stair Notes

- A. REFER TO "GENERAL NOTES" ON KEY PLANS FOR ADDITIONAL INFORMATION.
- B. PROVIDE [HSS TUBE STRINGERS] [CHANNEL STRINGERS] AT ALL STAIRS, TYP UNO. PROVIDE 3/16" CLOSURE PLATES AT ALL EXPOSED END CONDITIONS, INCLUDING BUT NOT LIMITED TO: [CHANNEL STRINGERS] STAIR BASE, LANDING AND HEADER DETAILS AND AS DETAILED ON DWGS. CONTINUOUSLY WELD AND GRIND SMOOTH.
- C. PROVIDE CONTINUOUS STAIR SHAFT FIRE RATINGS AS INDICATED ON CC DWGS. COORDINATE EXACT LOCATIONS OF STRINGERS TO ALLOW FINISHED WALL SURFACE TO PASS BY FREE OF OBSTRUCTION.
- D. REFER TO FINISH DWGS FOR FLOOR FINISHES.
- E. REFER TO REFLECTED CEILING PLANS FOR ADDITIONAL INFORMATION AT STAIRS AND RAMPS.
- F. ALL STAIR STRINGERS SHALL RECEIVE CONTINUOUS 1/8" CLOSURE PLATE. FIELD INSTALL TIGHT TO STAIRWELL WALL, AND CONTINUOUSLY WELD AND GRIND SMOOTH. PAINT ACCENT COLOR, SAME COLOR AS STRINGER. SEE FINISH DWGS.
- G. PROVIDE 3-1/2" x 3-1/2" x 5/16" PAN STIFFENERS AT 3'-0" MAXIMUM OC, TYP. CENTER STIFFENERS ON LANDING AND EACH STAIR RUN, TYP UNO.
- H. PROVIDE CONTINUOUS GUARDRAIL AND HANDRAIL AT ALL LANDINGS OF STAIRS WITH OPEN CENTERS AS DETAILED ON DRAWINGS (DESIGN AND FINISH SHALL MATCH ADJACENT GUARDRAILS, TYP UNO). GUARDRAILS SHALL PREVENT PASSAGE OF 4" DIAMETER SPHERE.
- J. PROVIDE CONTINUOUS HANDRAILS AT ALL STAIR TYPES (BOTH OPEN OR SOLID CENTERS). EXTEND HANDRAILS ALONG OUTSIDE OF ALL STAIRS AS DIMENSIONED ON PLANS.
- K. RADIUS RETURN ALL HANDRAILS TO WITHIN 1/4" OF WALL OR ATTACH DIRECTLY TO GUARDRAIL POST, TYP UNO.
- L. PROVIDE STAIR ACCESSORIES, INCLUDING BUT NOT LIMITED TO: HANDRAIL WALL BRACKETS, PIPE COVER FLANGE, ETC. AS EQUIPPED FOR A COMPLETE AND FINISHED INSTALLATION. SEE SECTION 09500.
- M. EQUALLY SPACE WALL HANDRAIL BRACKETS AS DETAILED ON DRAWINGS, BUT NOT TO EXCEED 4'-0" MAXIMUM OC (MEASURED TO ANGLE OF HANDRAIL) UNO. AT WALL BRACKET LOCATIONS PROVIDE ADEQUATE SUPPORT FOR WALL-MOUNTED ITEMS AS DETAILED ON DRAWINGS (USE THE FOLLOWING UNO):
 - CMU WALLS: GROUT CORES SOLID (MINIMUM 2'-0" EACH LOCATION).
 - METAL STUD / CFPM FRAMED WALLS: PROVIDE WOOD BLOCKING SECURELY FASTENED TO EACH STUD (FIRE-TREATED AT FIRE-RATED WALLS).
- N. PAINT GUARDRAILS AND HANDRAILS ACCENT COLOR AS SELECTED BY ARCHITECT (COLOR TO BE ISSUED DURING CONSTRUCTION).

Room Finish Key


CWT1	CERAMIC WALL TILE TYPE 1
EP	EPOXY FLOORING - POURED
HPC	HIGH PERFORMANCE COATING
MCS	MOISTURE CONTROL SYSTEM
N	NO WORK REQUIRED
P	PAINT SURFACE(S) INCLUDING SOFFITS
QT	QUARRY TILE
RAF	RESILIENT ATHLETIC FLOORING
RF1	RUBBER FLOORING - TYPE 1
RS	RUBBER STAIR TREAD AND RISERS
RB	RUBBER BASE
VCT1	VINYL COMPOSITION TILE - TYPE 1
*	SEE REFLECTED CEILING PLAN
+	INDICATED CHANGE IN FLOOR FINISH

NOTE: ALL FINISHES LISTED MAY NOT BE REQUIRED FOR THIS PROJECT

RMB	
CLG*	WALL
FLR	BASE

FINISHES SHOWN IN ROOM FINISH BOX ARE FOR ALL WALLS AND ENTIRE FLOOR AND CEILING. REFER TO EACH ROOM FOR MORE INFORMATION.

REFER TO DRAWING FA820 FOR GENERAL FINISH NOTES.
REFER TO DRAWING FA820 FOR GENERAL CASEWORK NOTES.

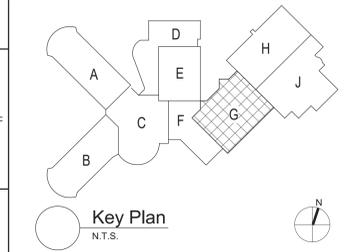

S.E.D. Control No. 13-02-00-01-0-020-012

1	9/7/23	BID ADDENDUM NO. 3
Rev. No.:	Date:	Description:



complex world | CLEAR SOLUTIONS

Tetra Tech Engineers, Architects & Landscape Architects, P.C.

BID SET



Beacon City School District
Beacon, New York

Reconstruction to:
Beacon High School

Enlarged Plans and Sections - Area G

Drawn By:	Date:	Drawing Number:
TLG	10/28/2022	
Project No.:	279180-22004	
	FA401	