Checked By:
 BJK

 Proj. #:
 62-08-03-04-0-010-014

 CSArch Proj. #:
 197-2201.01

KEY PLAN

AREA A GROUND FLOOR LIGHTING PLAN

CONSTRUCTION DOCUMENTS

2. WALL MOUNTED EXIT LIGHTING IN CORRIDORS IS EXISTING TO REMAIN WHERE SHOWN ON THE PLANS. CONTRACTOR SHALL ADJUST PLACEMENT OF EXISTING FIXTURES IF NEEDED TO ACCOMMODATE CEILING REPLACEMENT.

LIGHTING, WIRING, CONDUIT, JUNCTION BOXES, ETC.

General Notes:


ELECTRICAL NOTES:
AREAS INDICATED WITHIN DASHED LINES HAVE NEW CEILINGS. REINSTALL ALL STORED CEILING DEVICES INCLUDING FIRE ALARM, WIRELESS ACCESS POINTS, SPEAKERS, PROJECTORS, ETC. CONNECT TO EXISTING WIRING, EXTEND AS NECESSARY TO COMPLETE INSTALLATION.

PROVIDE NEW SWITCHES AND LIGHTING AS INDICATED. CONNECT TO EXISTING LIGHTING CIRCUITS IN EACH SPACE.

LIGHTING CONTROL SEQUENCE OF OPERATION - INSTRUCTIONAL SPACES VACANCY SENSOR(S) TO BE USED FOR AUTO-OFF OF ALL FIXTURES AFTER 30 MIN. TIME DELAY. DAYLIGHT SENSOR(S) TO ACTUATE PRESET DIMMING LEVEL FOR LIGHT FIXTURES DESIGNATED "DS" ON PLANS BASED ON DAYLIGHT AVAILABLE IN SPACE, WITH DIM-TO-OFF FUNCTIONALITY.

3 BUTTON WALL STATION: BUTTON 1: ON/OFF CONTROL OF ASSOCIATED FIXTURES BUTTON 2: DIM UP OF ASSOCIATED FIXTURES BUTTON 3: DIM DOWN OF ASSOCIATED FIXTURES

PROVIDE NEW LIGHT FIXTURES & LIGHTING CONTROLS IN CLASSROOMS 003, 005 & 007, INSTALLED IN EXISTING CEILING

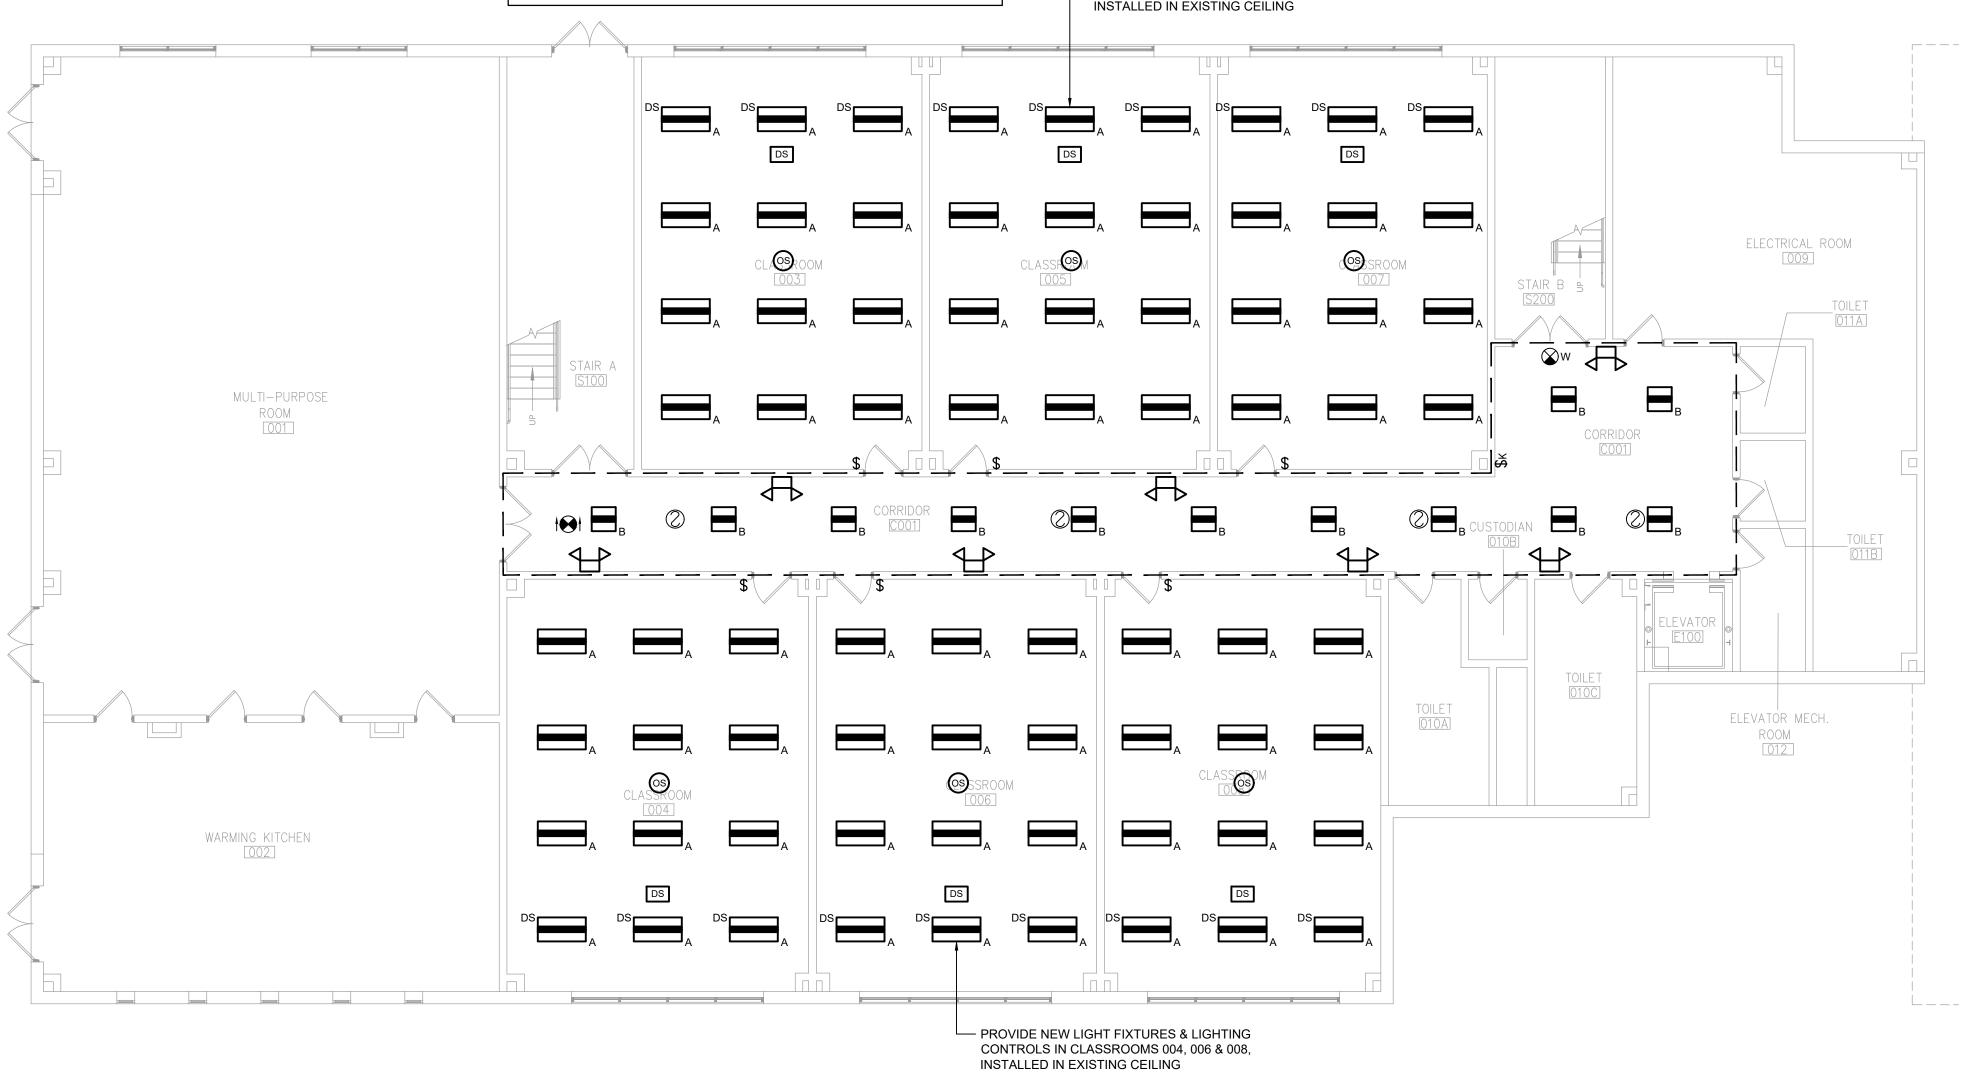

Area A Ground Floor Lighting Plan E201 Scale: 1/8" = 1'-0"