E-111 DRAWING NOTES

1 PROVIDE ONE (1) 4" CONDUIT FROM PAD MOUNTED TRANSFORMER (BY OTHERS). VERIFY EXACT LOCATION IN FIELD. STUB CONDUIT UP AT PANEL BOARD.

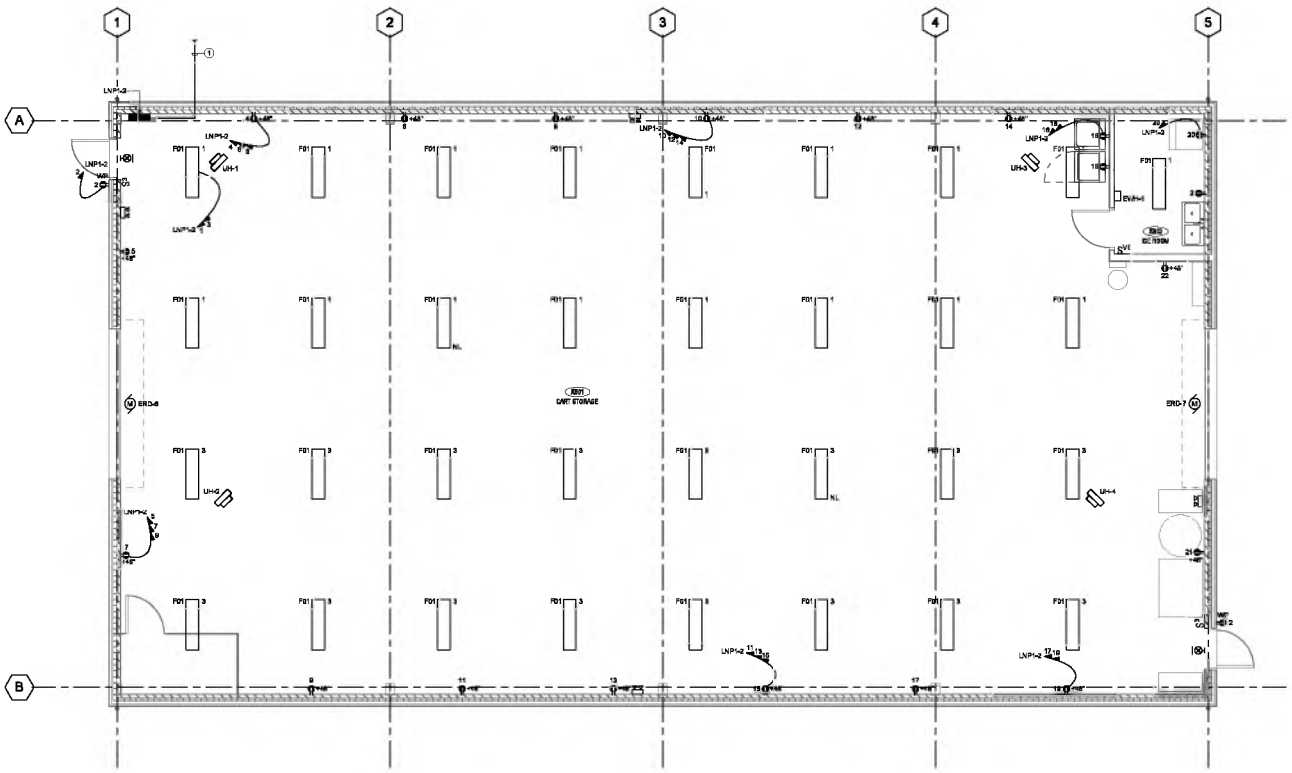

1 CART STORAGE BUILDING - FIRST FLOOR PLAN - ELECTRICAL
1/4" = 1'-0"

RW Monster Golf Cart Storage Building

94 CHALET ROAD
KAMELSHA LAKE, NY 12751

JCJARCHITECTURE
120 HUYSHOPE AVENUE
SUITE 400
HARTFORD, CT 06106
860.247.6223

©2019 JCJ Architecture

CONSULTANTS:

NOT FOR CONSTRUCTION

P.I.C. ____ L.D. ____
P.M. ____ P.A. ____

ISSUE 11/08/2019
JOB H18294.00 PHASE 14
DRAWN DSL
SCALE 1/4" = 1'-0"

REVISION #:

FIRST FLOOR PLAN - ELECTRICAL

E-110