SITE PLAN DRAWING NOTES

1. PAD MOUNTED 750 KVA TRANSFORMER. VERIFY EXACT LOCATION IN FIELD.
2. PROVIDE 1 MO (2) 4" CONDUITS IN DUCTBANK FROM TRANSFORMER LOCATION TO MAINTENANCE BUILDING. STUB CONDUITS UP AT EQUIPMENT MAINTENANCE ROOM XX14.

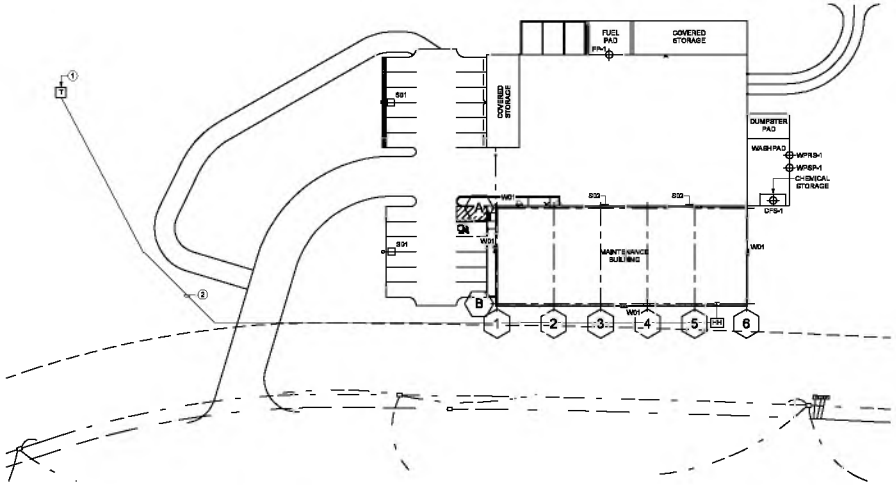

1 MAINTENANCE BUILDING - SITE PLAN - ELECTRICAL
1" = 30'-0"

RW Monster Golf Maintenance Building

94 CHALET ROAD
KAMELSHA LAKE, NY 12751

JCJARCHITECTURE
120 HUYSHOPE AVENUE
SUITE 400
HARTFORD, CT 06106
860.247.6223

©2019 JCJ Architecture

CONSULTANTS:

NOT FOR CONSTRUCTION

P.I.C. _____ L.D. _____
P.M. _____ P.A. _____

ISSUE 11/08/2019
JOB H18294.00 PHASE 14
DRAWN DSL
SCALE 1" = 30'-0"

REVISIONS:

SITE PLAN - MAINTENANCE BUILDING

E-112