


CONDENSATE PIPING

1. INSTALL NEW CONDENSATE PIPING SYSTEM FOR ALL NEW FURNACES, VRF FAN COILS AND HEAT RECOVERY BOX. PIPING SHALL BE TYPE L COPPER. CONTRACTOR SHALL BE RESPONSIBLE FOR PIPING ELEVATIONS.
2. PRIOR TO ORDERING ANY EQUIPMENT:  
- CONTRACTOR SHALL WALK SITE WITH OWNER'S REP AND ENGINEER TO "PROVE" INSTALLATION OF NEW CONDENSATE PIPING SYSTEM.

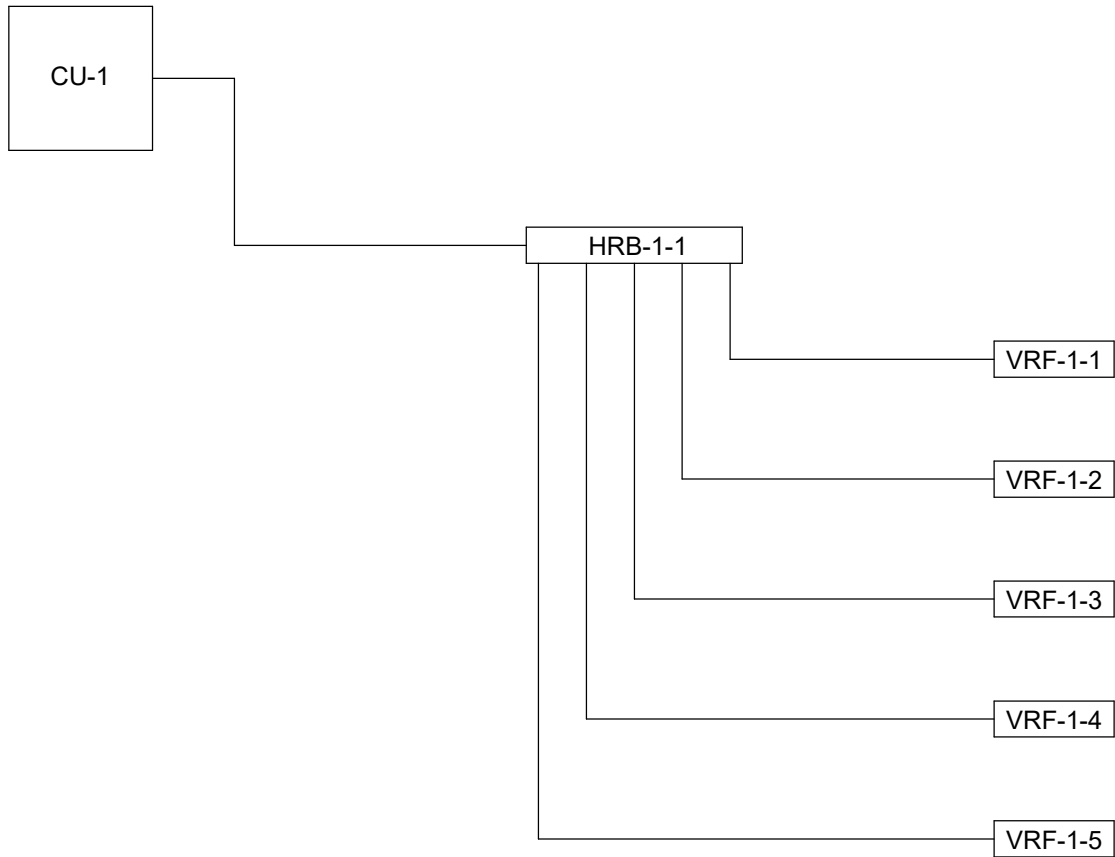


FIRST FLOOR VRF REFRIGERANT PIPING ONE-LINE DIAGRAM

GENERAL NOTE  
SEE DWG M601 FOR HOT WATER  
ONE-LINE DIAGRAM

KEYED NOTES

- 1 EXTEND CONDENSATE DOWN TO JAN SINK.  
TERMINATE W/ AIR GAP.  
INSTALL VERTICAL CONDENSATE PIPE EXPOSED AND TIGHT  
TO WALL. VERTICAL EXPOSED PIPE SHALL BE SUPPORTED  
AT 3 EQUAL INTERVALS (MIN.).

DATE:	06/21/2023
DRAWN BY:	ACS
SCALE:	1/8" = 1' - 0"
REVIEWED BY:	TJH
PROJECT NO.:	20-2006
FILE:	

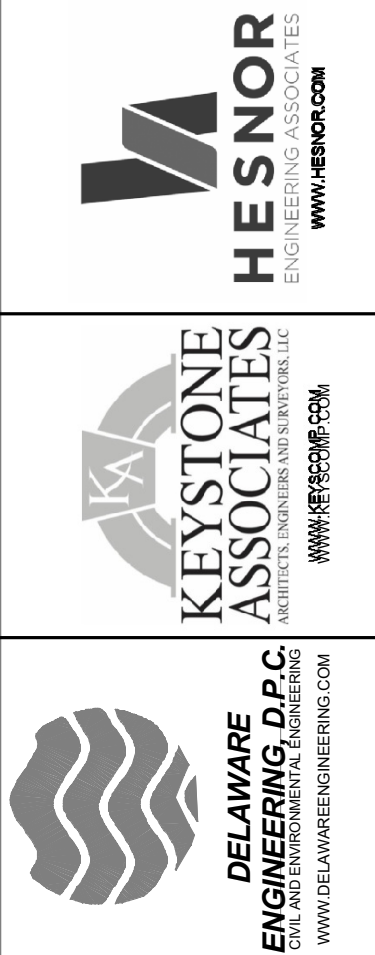

REVISIONS	
NO.	DESCRIPTION

PORT EWEN FIRE  
DEPARTMENT, ULSTER, NEW  
YORK

PIPING PLAN - FIRST FLOOR

SHEET:  
M201

BID PLANS