


CONDENSATE PIPING

1. INSTALL NEW CONDENSATE PIPING SYSTEM FOR ALL NEW FURNACES, VRF FAN COILS AND HEAT RECOVERY BOX. PIPING SHALL BE TYPE L COPPER. CONTRACTOR SHALL BE RESPONSIBLE FOR PIPING ELEVATIONS.
2. PRIOR TO ORDERING ANY EQUIPMENT:
- CONTRACTOR SHALL WALK SITE WITH OWNER'S REP AND ENGINEER TO "PROVE" INSTALLATION OF NEW CONDENSATE PIPING SYSTEM.
3. SEE DIVISION 15 PART 15.4.9 ON SHEET M-601 FOR ADDITIONAL INFORMATION.

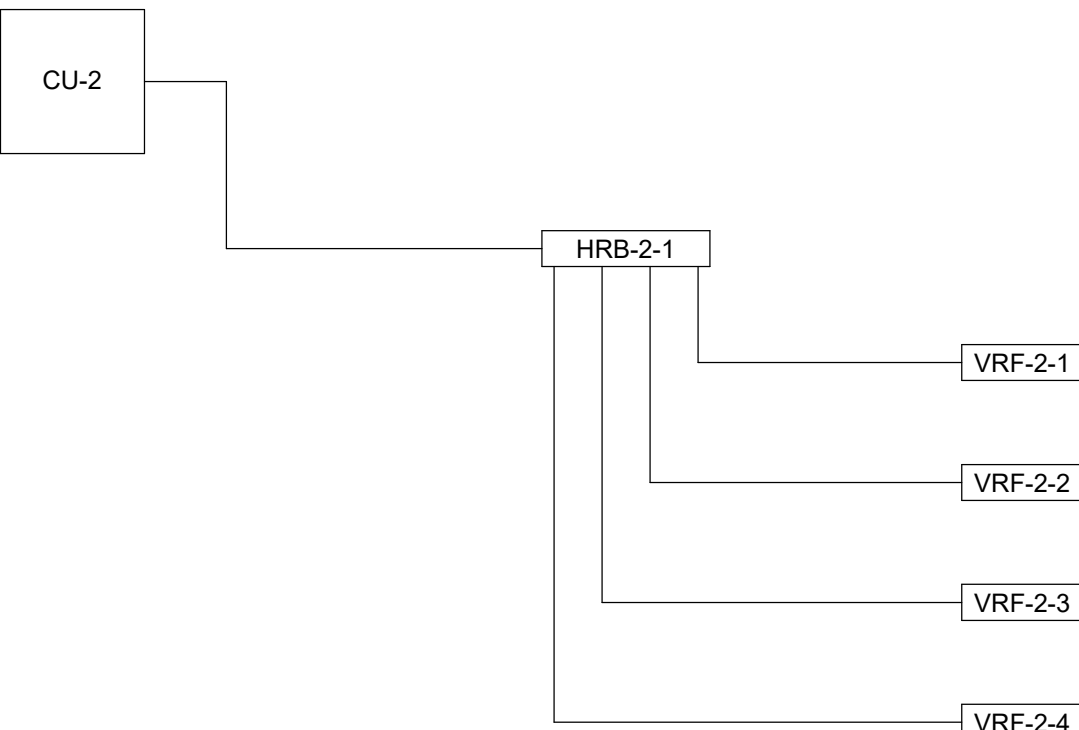

SECOND FLOOR VRF REFRIGERANT PIPING ONE-LINE DIAGRAM

KEYED NOTES

- ① EXTEND CONDENSATE DOWN TO JAN SINK. TERMINATE W/ AIR GAP. INSTALL VERTICAL CONDENSATE PIPE EXPOSED AND TIGHT TO WALL. VERTICAL EXPOSED PIPE SHALL BE SUPPORTED AT 3 EQUAL INTERVALS (MIN.).

DATE:	06/21/2023
DRAWN BY:	ACS
SCALE:	1/8" = 1' - 0"
REVIEWED BY:	TJH
PROJECT NO.:	20-2006
FILE:	



REVISIONS	
NO.	DESCRIPTION

PORT EWEN FIRE
DEPARTMENT, ULSTER, NEW
YORK

PIPING PLAN - SECOND FLOOR

SHEET:
M202

BID PLANS