


FULL SCHEMATIC WATER BOOSTER SYSTEM PROFILE

SENIOR CENTER UNDER THIS CONTRACT

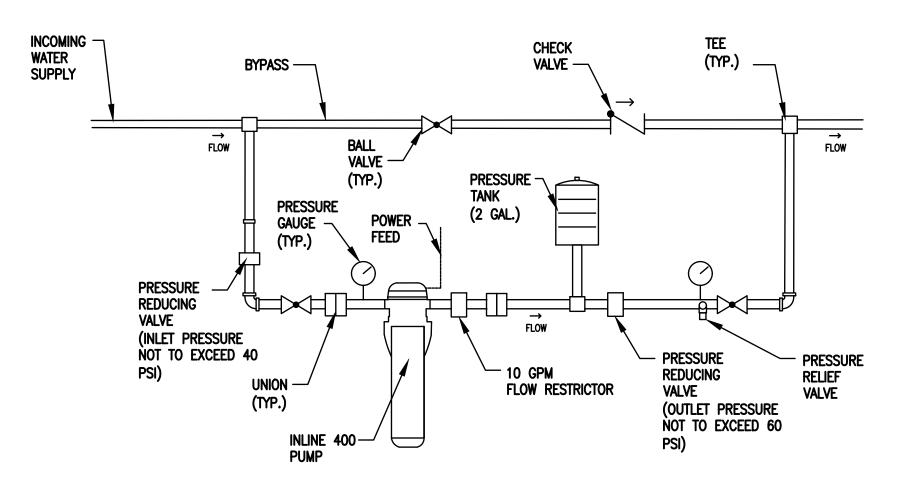

2 INLINE BOOSTER PUMP PIPING SCHEMATIC Scale: NTS

INLINE PRESSURE BOOSTER PUMP

MARK	MODEL	MANF.	ELECTRICAL
P-1	INLINE 400	LITTLE GIANT	1/3 HP 115V 60 HZ 6.6 AMP

NOTES: PRESSURE TANK PURCHASED WITH UNIT. PRESSURE TANK TO BE MOUNTED NO MORE THAN 5 FEET FROM BOOSTER PUMP. UNIT IS EQUIPPED WITH A FLOW SENSOR AND DUAL PRESSURE SWITCHES.

UNIT WILL TURN ON WHEN DISCHARGE PRESSURE DROPS BELOW 40 PSI AND FLOW THROUGH THE PUMP IS GREATER THAN 1/2 GPM.

					ADDITION TO THIS VIOLATION OF SEC NEW YORK STATE	DOCUMENT IS A TION 7209 OF THE	
					PROJECT ENGINEER: AE	DRAWN BY: MP/PD	
				100 No. 072392 45	DESIGNED BY:	CHECKED BY:	
O	DATE	REVISION	INT.	TOFESSION	MP/PD	BA/WDM	

A HE V.	d	D&B AND	Engineers Architects	C

TOWN OF BLOOMING GROVE	
COUNTY	NEW YORK
LASSER PARK SENIOR CENTER	

CONTRACT 2

PROJECT NO.

5708

DATE:

AUGUST 2023

SCALE:

PLUMBING

N.T.S.

DRAWING NO.