



GENERAL NOTES

- A. REFER TO SHEET E-001.1 FOR ELECTRICAL SYMBOL LEGEND AND PANELBOARD SCHEDULES.
- B. REFER TO E-001.1 FOR ELECTRICAL DETAILS.
- C. COORDINATE CIRCUIT, DISCONNECT, AND STARTER SIZE(S) AND TERMINATION LOCATION(S) PRIOR TO ROUGH-IN.
- D. HATCHING INDICATES AREAS WITH NO WORK.
- E. NOT ALL EXISTING DEVICES ARE SHOWN ON PLAN.
- F. REFER TO MECHANICAL SHEETS FOR ADDITIONAL DEMOLITION SCOPE.

KEY NOTES

- 1 REFER TO SHEET E-201.1 FOR DETAIL INFORMATION, QUANTITY, AND LOCATION FOR DROP CORDS TO BE PROVIDED IN WORKROOM.
- 2 REFER TO SHEET E-201.1 FOR DETAIL INFORMATION, QUANTITY, AND LOCATION FOR DATA OUTLETS TO BE PROVIDED IN WORKROOM.
- 3 EXISTING WATER COOLER TO BE REMOVED AND REPLACED WITH NEW. REPLACE EXISTING GFCI RECEPTACLE WITH A REGULAR DUPLEX RECEPTACLE, AND PROVIDE A 5mA GFCI BREAKER FOR THE CIRCUIT SERVING THE WATER COOLER.
- 4 EXISTING EXHAUST FAN TO BE REMOVED AND REPLACED WITH NEW (FRACTIONAL HP, 120V, 1Ø). DISCONNECT FROM AND RECONNECT TO EXISTING CIRCUIT. EXTEND EXISTING CONDUIT AND WIRING AS REQUIRED.
- 5 EXISTING VENDING MACHINE TO REMAIN. VERIFY THAT VENDING MACHINE IS GFCI-PROTECTED. PROVIDE A GFCI BREAKER IF VENDING MACHINE IS NOT INTEGRALLY GFCI-PROTECTED.
- 6 NEW ICE MACHINE. REUSE EXISTING DEDICATED RECEPTACLE. PROVIDE A GFCI BREAKER FOR THE EXISTING CIRCUIT.
- 7 NEW REFRIGERATOR. REUSE EXISTING DEDICATED RECEPTACLE. PROVIDE A GFCI BREAKER FOR THE EXISTING CIRCUIT.
- 8 EXISTING CASEWORK TO BE REMOVED AND REPLACED WITH NEW. REMOVE EXISTING MICROWAVE RECEPTACLE AND PROVIDE NEW GFCI RECEPTACLE AS SHOWN. EXTEND EXISTING CONDUIT AND WIRING AS REQUIRED.
- 9 EXISTING CASEWORK TO BE REMOVED AND REPLACED WITH NEW. PROVIDE NEW DEDICATED GFCI RECEPTACLE. WIRE WITH (2) #12, (1) #10 IN 3/4" TO A SPARE 20A/1P BREAKER IN THE NEAREST EXISTING 200/120V PANELBOARD WITH AVAILABLE CAPACITY. PROVIDE A NEW BREAKER IF NO SPARES EXIST.

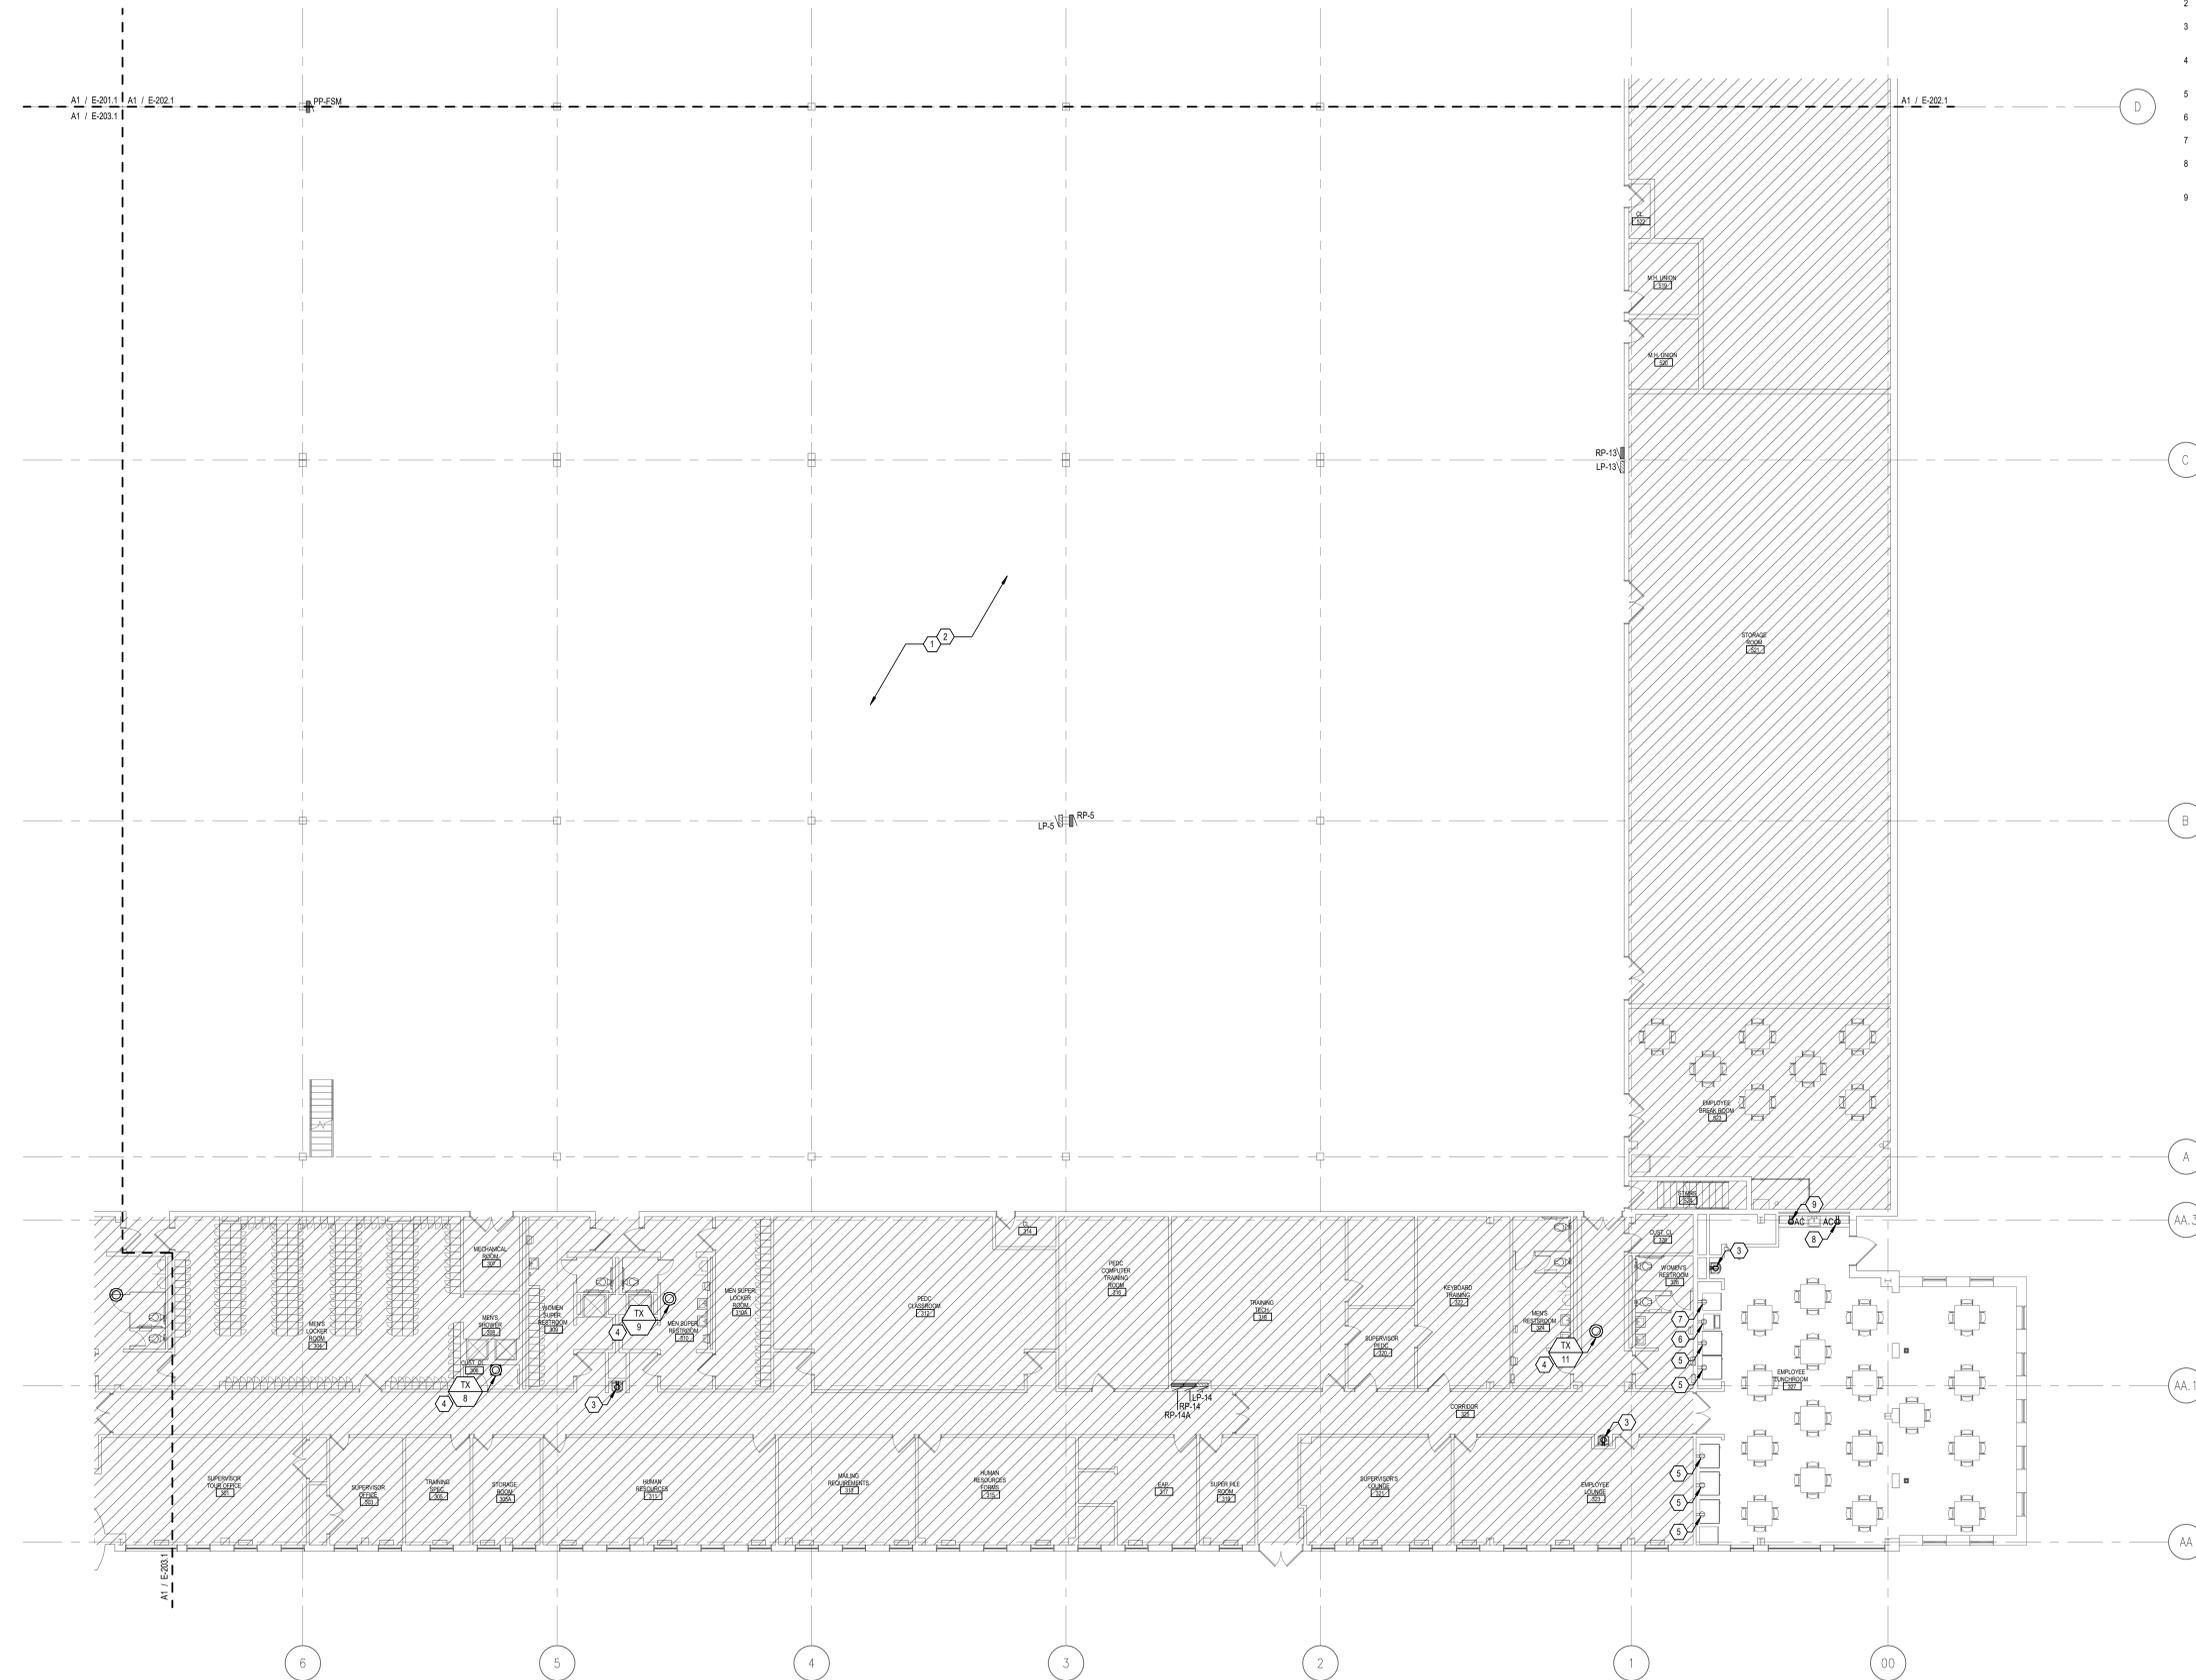

A1 POWER PLAN - AREA 'D'
 1" = 10'-0"

NOT FOR CONSTRUCTION

DESIGNER	AS
PROJECT MANAGER	JR
DRAWING NO.	2022359.04

USPS - MID-HUDSON, NY
 391 GOVERNOR DRIVE
 NEWBURGH, NY 12550



E-204.1 ELECTRICAL - POWER PLAN - AREA 'D'
 Scale: NTS Date: 02/23/2023 Revisions: 100% OWNER REVIEW

Project: USPS - MID-HUDSON, NY
 USPS File Number: 355306-02

Facilities: 4301 Wilson Blvd., Suite 300, Arlington, VA 22203-1861

© Copyright 2006-2009, United States Postal Service