	AIR DISTRIBUTION DEVICE SCHEDULE (MANUFACTURED BY TITUS)												
MARK	MODEL	TYPE	INSTALATION METHOD	NECK SIZE (L" X W" or DIAMETER")	FACE SIZE (L" X W")	AIRFLOW CFM	FRAME TYPE	FINISH	MATERIAL	ACCESSORIES DAMPER OTHER		REMARKS	
CD-1	OMNI	SQUARE FACE	CEILING BOAD	Note 1	Note 1	Note 1	1	Note 2, White	STEEL	OBD		INSULATED BLANKET	
CD-2	OMNI	SQUARE FACE	CEILING BOAD	Note 4	Note 4	Note 1	1	Note 2, White	STEEL	OBD		INSULATED BLANKET	
LSD-1	FL-15 - JT - 1 SLOT	FLOW SUPPLY BAR DIFFUSER	CEILING BOARD	14 x 2.75	14 x 1.5	Note 1	11	Note 2, White	ALUMINUM	COMAD, JTCP	14" Plenum	1 SLOT, TWO END BORDERS	
LRD-1	FL-15 - 1 SLOT	FLOW RETURN BAR DIFFUSER	CEILING BOARD	14 x 2.75	14 x 1.5	Note 1	11	Note 2, White	ALUMINUM	PFS	14" Plenum	1 SLOT, TWO END BORDERS	
CG-1	350RS	RETURN GRILLE	SIDE WALL SURFACE	Note 1	Note 1	Note 1	Note 2	Note 2, White	STEEL	OBD			
HRG-1	350RS	RETURN GRILLE	SIDE WALL SURFACE	Note 1	Note 1	Note 1	Note 2	Note 2, 3	STEEL				
EG-1	25RL	EXHAUST GRILLE	SIDE WALL SURFACE	Note 1	8 X 8	Note 1	1	Note 2, White	STEEL				
HSR-1	300RL	SUPPLY GRILLE	DUCT SURFACE	Note 1	6 X 4	Note 1	1	Note 2, 3	STEEL	OBD			
FR-1	CT-540	SUPPLY DIFFUSER	FLOOR	Note 1	Note 1	Type 5	Note 2	Note 2, 3	ALUMINUM	OBD			
FR-2	CT-540	SUPPLY DIFFUSER	FLOOR	Note 4	Note 4	Type 5	Note 2	Note 2, 3	ALUMINUM	OBD			
FRG-1	CT-540	RETURN DIFFUSER	FLOOR	Note 1	Note 1	Type 5	Note 2	Note 2, 3	ALUMINUM				
FRG-2	CT-540	RETURN DIFFUSER	FLOOR	Note 4	Note 4	Type 5	Note 2	Note 2, 3	ALUMINUM				

ACCESSORIES: PFS-PLASTER FRAME DMPR- DAMPER DL-DRUM LOUVER EXT-LINDAB AIR EXTRACTOR

NOTES:

1. SEE PLANS

2. SHALL BE SELECT AND APPROVE BY ARCHITECT

3. COLOR SELECTED BY ARCHITECT 4. VIF DIMMENSIONS AND FEASIBILITY OF REPLACEMENT EXSIT. DIFFUSER

OBD-OPPOSED BLADE DAMPER COMAD - CABLE OPERABLE MANUAL ADJUSTABLE DAMPER

	ELECTRIC HEATER SCHEDULE											
					HEATING		ELECTR					
MARK		MFR	MODEL	Dim. (In)	CAPACITY	INPUT	AMPS	VOLT/PH/HZ	REMARKS			
				IN	(BTU/HR)	W						
EWH-1	Electric Wall Heater	Stelpro	ASOA2002W	15.8x12.5x4	6,826	2,000	8.30	208/1/60	1, 3			
EBR-1	Electric Baseboard Radiator	Stelpro	AALUX118098	71x4.6x2	3,071	900		208/1/60	2			
EBR-2	Electric Baseboard Radiator	Stelpro	AALUX112068	41x4.6x2	1,365	400		208/1/60	2			
EWR-1	Electric Wall Radiator	Runtall	EWP-8-208D	36x23x2.5	3,924	1,150	5.50	208/1/60	1, 4			
REMARKS:												

PROVIDE SELF-CONTAINED THERMOSTAT AND INTEGRAL DISCONNECT SWITCH PROVIDE WALL MOUNTED THERMOSTAT. HEATER SHALL BE INSTALL IN WALL RECESS. COLOR SHALL BE SELECT BY ARCHITECT.

FAN SCHEDULE											
						ELEC	CTRICAL	OPER			
MARK	SERVICE - DESTINATION	MFR	MODEL	CFM	S.P.	H.P.	VOLT/PH/HZ	WT	Sones	REMARK	
					(IN W.G.)	Watt		(LBS)			
TX-1	TOILET EXH.	LORENCOOK	GN-622	300	0.250	136.0	115/1/60	35	3	1	
REMARK	S:										
1	Provide with factory mounted Dis	connect Switch, Speed	I controller and Bad	kdraft Damp	oer.						

LOUVERS SCHEDULE (MANUFACTURED BY RUSKIN)

MARK	MODEL	TYPE	THICKNESS INCH	SIZE L" X H"	FREE AREA SQ.FT.	AIRFLOW CFM	MIN. WATER PENETRA TION FPM	VELOCITY FPM	APD IN.W.C.	REMARKS
L-1	ELF-375DX	OUTSIDE AIR INTAKE	4	10 x 18	0.68	400	875	588	0.055	

1. PROVIDE WITH BIRD SCREEN AND ETENDED SILL 2. COLOR SHALL BE SELECTED BY ARCHITECT

DEHUMIDIFIER UNIT SCHEDULE

	Unit Number			DH-2	DH-4	DH-5	DH-8	DH-9	DH-11
-	Service Area			FCU-2	FCU-4	FCU-5	FCU-8	FCU-9	FCU-11
	Туре			Mechanical Refrigerant	Mechanical Refrigeran				
Ī	Install loation			Indoor	Indoor	Indoor	Indoor	Indoor	Indoor
	Dehumidifier model		TINO	DR-120	DR-120	DR-120	DR-120	DR-120	DR-120
Ī	Reactivation heater			Hot Gas Reheat	Hot Gas Reheat				
-	Process air	CFM		345	345	345	345	345	345
Ī	ESP	in WC	DIF	0.2	0.2	0.2	0.2	0.2	0.2
Ī	EAT	deg	M	70	70	70	70	70	70
-	LAT	deg	DEHUMIDIF	80	80	80	80	80	80
-	Filter			1" Pleated (1)	1" Pleated (1)				
	Relative Humidity	%	ICA	60	60	60	60	60	60
	Pints / day		MECHANICAL	88	88	88	88	88	88
Ī			ЭСН						
Ĩ	Electrical	V/ph/Hz		120/1/60	120/1/60	120/1/60	120/1/60	120/1/60	120/1/60
	MCA	А	Honeywell	5.3	5.3	5.3	5.3	5.3	5.3
	MOP	А	ney	15	15	15	15	15	15
			Ho						
Ī	Weight	lbs		86	86	86	86	86	86
Ī	NOTES:			1, 2	1, 2	1, 2	1, 2	1, 2	1, 2

1 Provide disconect switch 1 Supply and Return ducted connection to FCU Return duct.

2 Provide dedicated electrical outlet.

New York State Parks, Recreation and **Historic Preservation**

Governor Kathy Hochul Commissioner Pro Tempore Randy Simons

IT IS A VIOLATION OF STATE EDUCATION LAW FOR ANY PERSON, UNLESS UNDER THE DIRECTION OF A LICENSED ARCHITECT/ENGINEER TO ALTER THIS DOCUMENT IN ANYWAY. ALTERATIONS MUST HAVE THE SEAL AFFIXED ALONG WITH A DESCRIPTION OF THE ALTERATIONS, DATE AND ARCHITECT'S/ENGINEER'S

Architectural Consultant
BEYER BLINDER BELLE ARCHITECTS & PLANNERS
120 BROADWAY, 20TH FLOOR, NEW YORK, NY 10271

BEYER BLINDER BELLE

Structural Consultant
THORNTON TOMASETTI
120 BROADWAY, 15TH FLOOR, NEW YORK, NY 10271

Thornton Tomasetti

MEP / FP / IT Consultant
LANDMARKS FACILITIES GROUP
252 EAST AVENUE, NORWALK, CT 06855

LFG LANDMARK FACILITIES GROUP, INC.

Civil Consultant cha consulting, inc. 3 Winners Circle, PO BOX 5269, ALBANY, NY 12205



Landscape Consultant RHODESIDE HARWELL LANDSCAPE ARCHITECTURE 347 WEST 36TH STREET, SUITE 1201, NEW YORK, NY 10018



Lighting Consultant
HLB LIGHTING
38 EAST 32ND STREET, 11TH FLOOR, NEW YORK, NY 10016



Signage Consultant
LVCK - A BEYER BLINDER BELLE STUDIO
120 BROADWAY, 20TH FLOOR, NEW YORK, NY 10271


LVCK | A Beyer Blinder Belle Studio

NYS OPRHP Taconic Region 9 Old Post Rd, PO Box 308 Staatsburg, NY 12580 (845) 889 - 4100

Regional Director: Linda Cooper Capital District Manager: Garrett Jobson

Project Title: John Jay Homestead Site And Building Enhancements

Project Location:
400 Jay Street
Katonah NY 10536

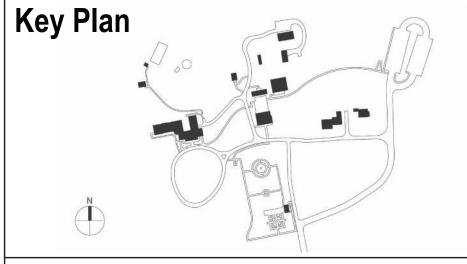

REV	'ISIONS		
Rev No		Description	Date:

	Seal and Signature	
3у:	THE OF NEW SENEMBO	TOR!
Ву:	OF OS9878	

LFG DATE 07/10/24 Sheet Title

Drawing Number

BEDFORD HOUSE MECHANICAL SCHEDULES

M-301

Project Number: TA-JJ-2023-001 Sheet: 258 of 327

MECHANICAL SCHEDULES BEDFORD HOUSE (GEO-EXCH VRF) 1 ME0 N.T.S.