


7/17/2024 2:34:44 PM

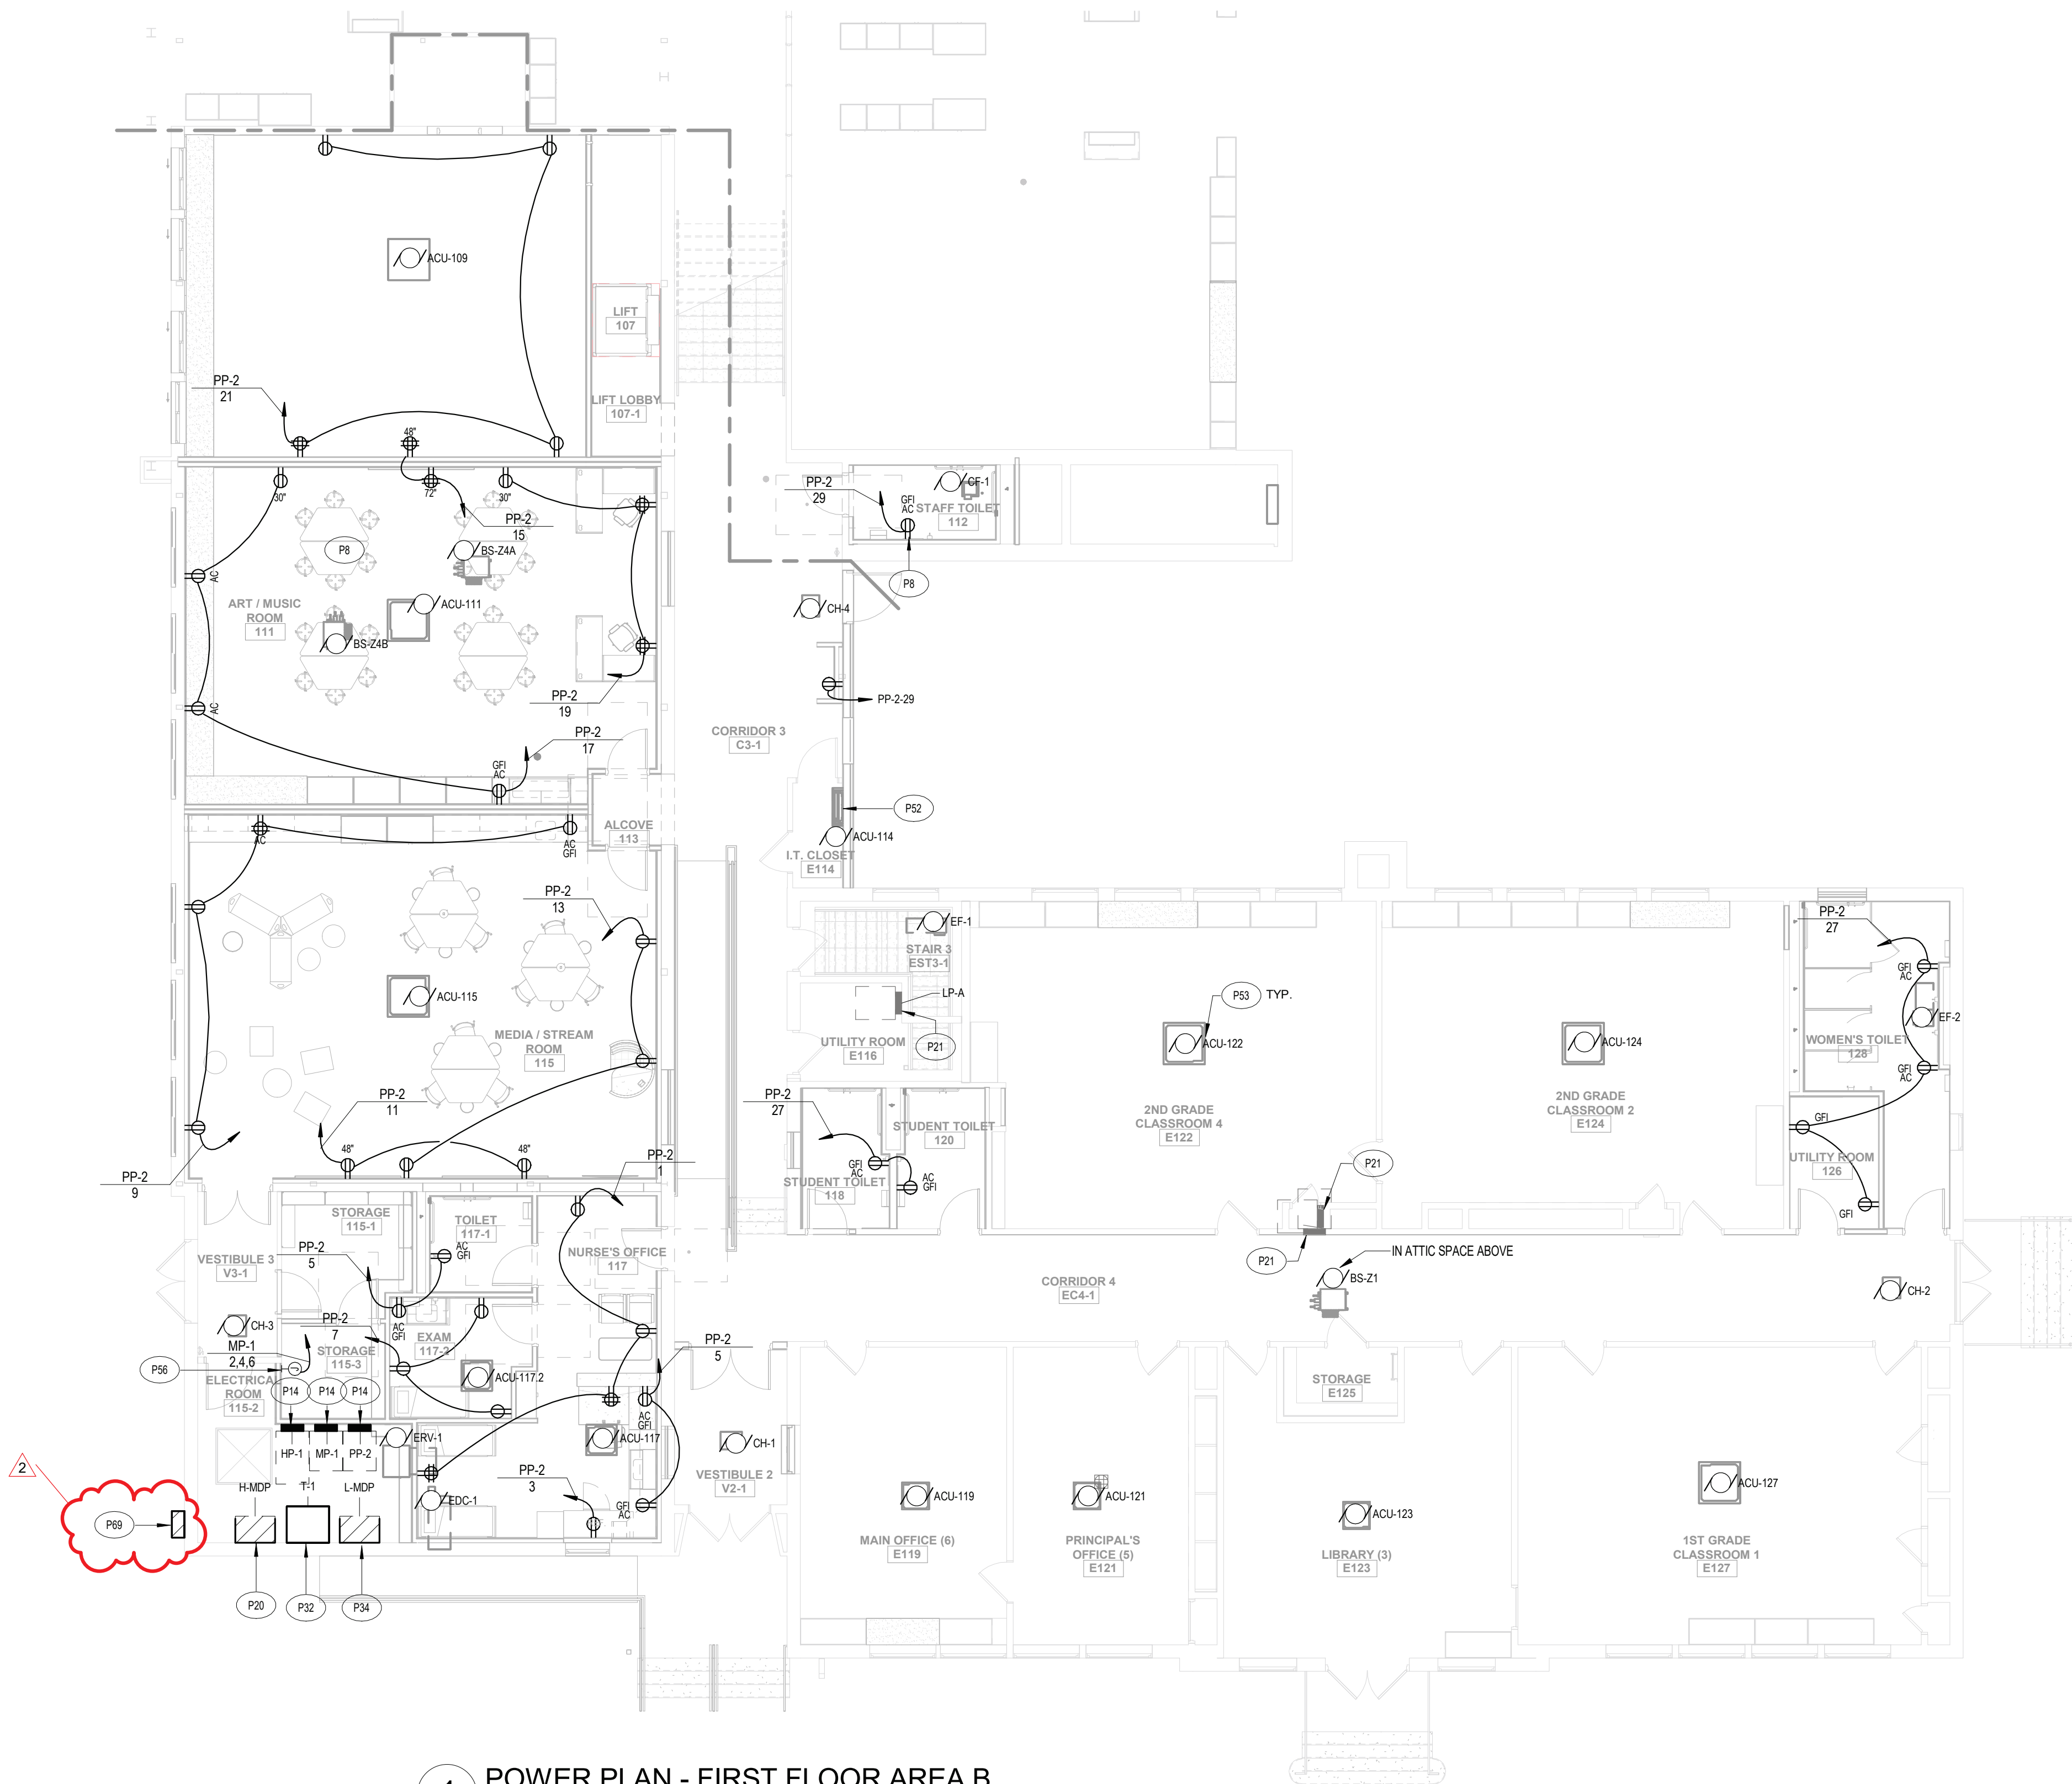

1 POWER PLAN - FIRST FLOOR AREA B
SCALE: 1/8" = 1'-0"


GENERAL NOTES:

- SEE DRAWING ES000 FOR APPLICABLE GENERAL NOTES, ABBREVIATIONS, SYMBOLS AND LEGENDS

KEYNOTE LEGEND

- P8 PROVIDE RECEPTACLES INDICATED.
P14 PROVIDE ELECTRICAL PANELBOARD AS INDICATED. REFER TO ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
P20 PROVIDE 800A, 480/277V, 3PH, 4W MAIN DISTRIBUTION BOARD L-MDP. REFER TO ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
P21 RE-FEED EXISTING PANELBOARD FROM DISTRIBUTION BOARD L-MDP. REFER TO ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
P32 PROVIDE 300KVA 480V PRIMARY-120/277V SECONDARY TRANSFORMER IN APPROXIMATE LOCATION SHOWN. REFER TO ONE-LINE DIAGRAM ON DRAWING EX-01 FOR ADDITIONAL INFORMATION.
P34 PROVIDE 800A, 120/208V, 3PH, 4W DISTRIBUTION BOARD L-MDP. REFER TO ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
P52 SPLIT SYSTEM INDOOR UNIT POWERED VIA ACU-17 ON ROOF.
P53 REFER TO EQUIPMENT CONNECTION SCHEDULE FOR FURTHER INFORMATION.
P55 PROVIDE POWER CONNECTION TO KILN AS INDICATED. VERIFY EXACT LOCATION FROM POWER CONNECTION KILN IN ROOM FOR METAL WORK.
P69 PROVIDE A SALENIT MODEL NUMBER MTSWC08030MR002V RM KSP MANUAL TRANSFER SWITCH (MTS). MTS TO BE INSTALLED ON EXTERIOR WALL OF ELECTRIC ROOM AT 30" TO BOTTOM OF MTS. VERIFY EXACT LOCATION OF MTS PRIOR TO INSTALLATION.

KEY PLAN:

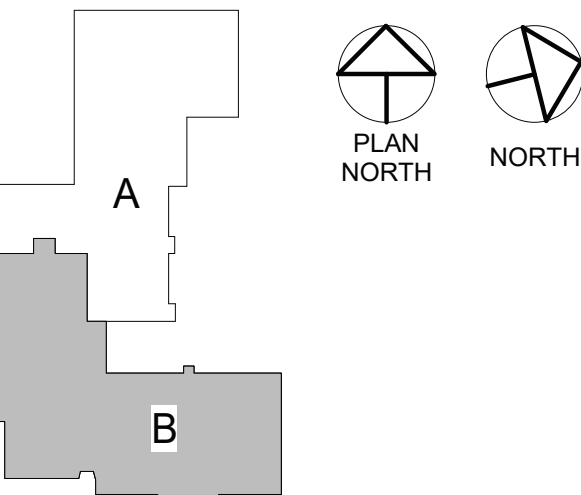

SED NO. 44-09-01-04-0-005-008

THIS SHEET INCORPORATES COLOR GRAPHICS WHICH INDICATE IMPORTANT INFORMATION AND SHALL BE PRINTED IN COLOR IF REPRODUCED BY A CONTRACTOR.

BCA Architects & Engineers

Watertown | Ithaca | Saratoga Springs | Rochester
WWW.THEBCGROUP.COM

COPYRIGHT © 2022 - BCA ARCHITECTS & ENGINEERS. WARNING - IT IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW FOR ANY UNAUTHORIZED ALTERATIONS TO THIS DOCUMENT AS PER ARTICLE 145 AND 147.

BCA
ARCHITECTS
ENGINEERS



HIGHLAND FALLS-FORT MONTGOMERY CSD
ALTERATIONS AND ADDITIONS TO:
FORT MONTGOMERY ELEMENTARY SCHOOL

HIGHLAND FALLS - ORANGE COUNTY - NEW YORK

REV	DATE	DESCRIPTION
1	05/28/2024	SED ADDENDUM #1
2	07/17/2024	BID ADDENDUM NO.3


DRAWN BY MAH	PROJECT NUMBER 2022-138
CHECKED BY SGV	DATE 06/07/2024

POWER PLAN - FIRST FLOOR AREA B

BUILDING NUMBER SHEET NUMBER

ES E101

7/17/2024 2:34:44 PM

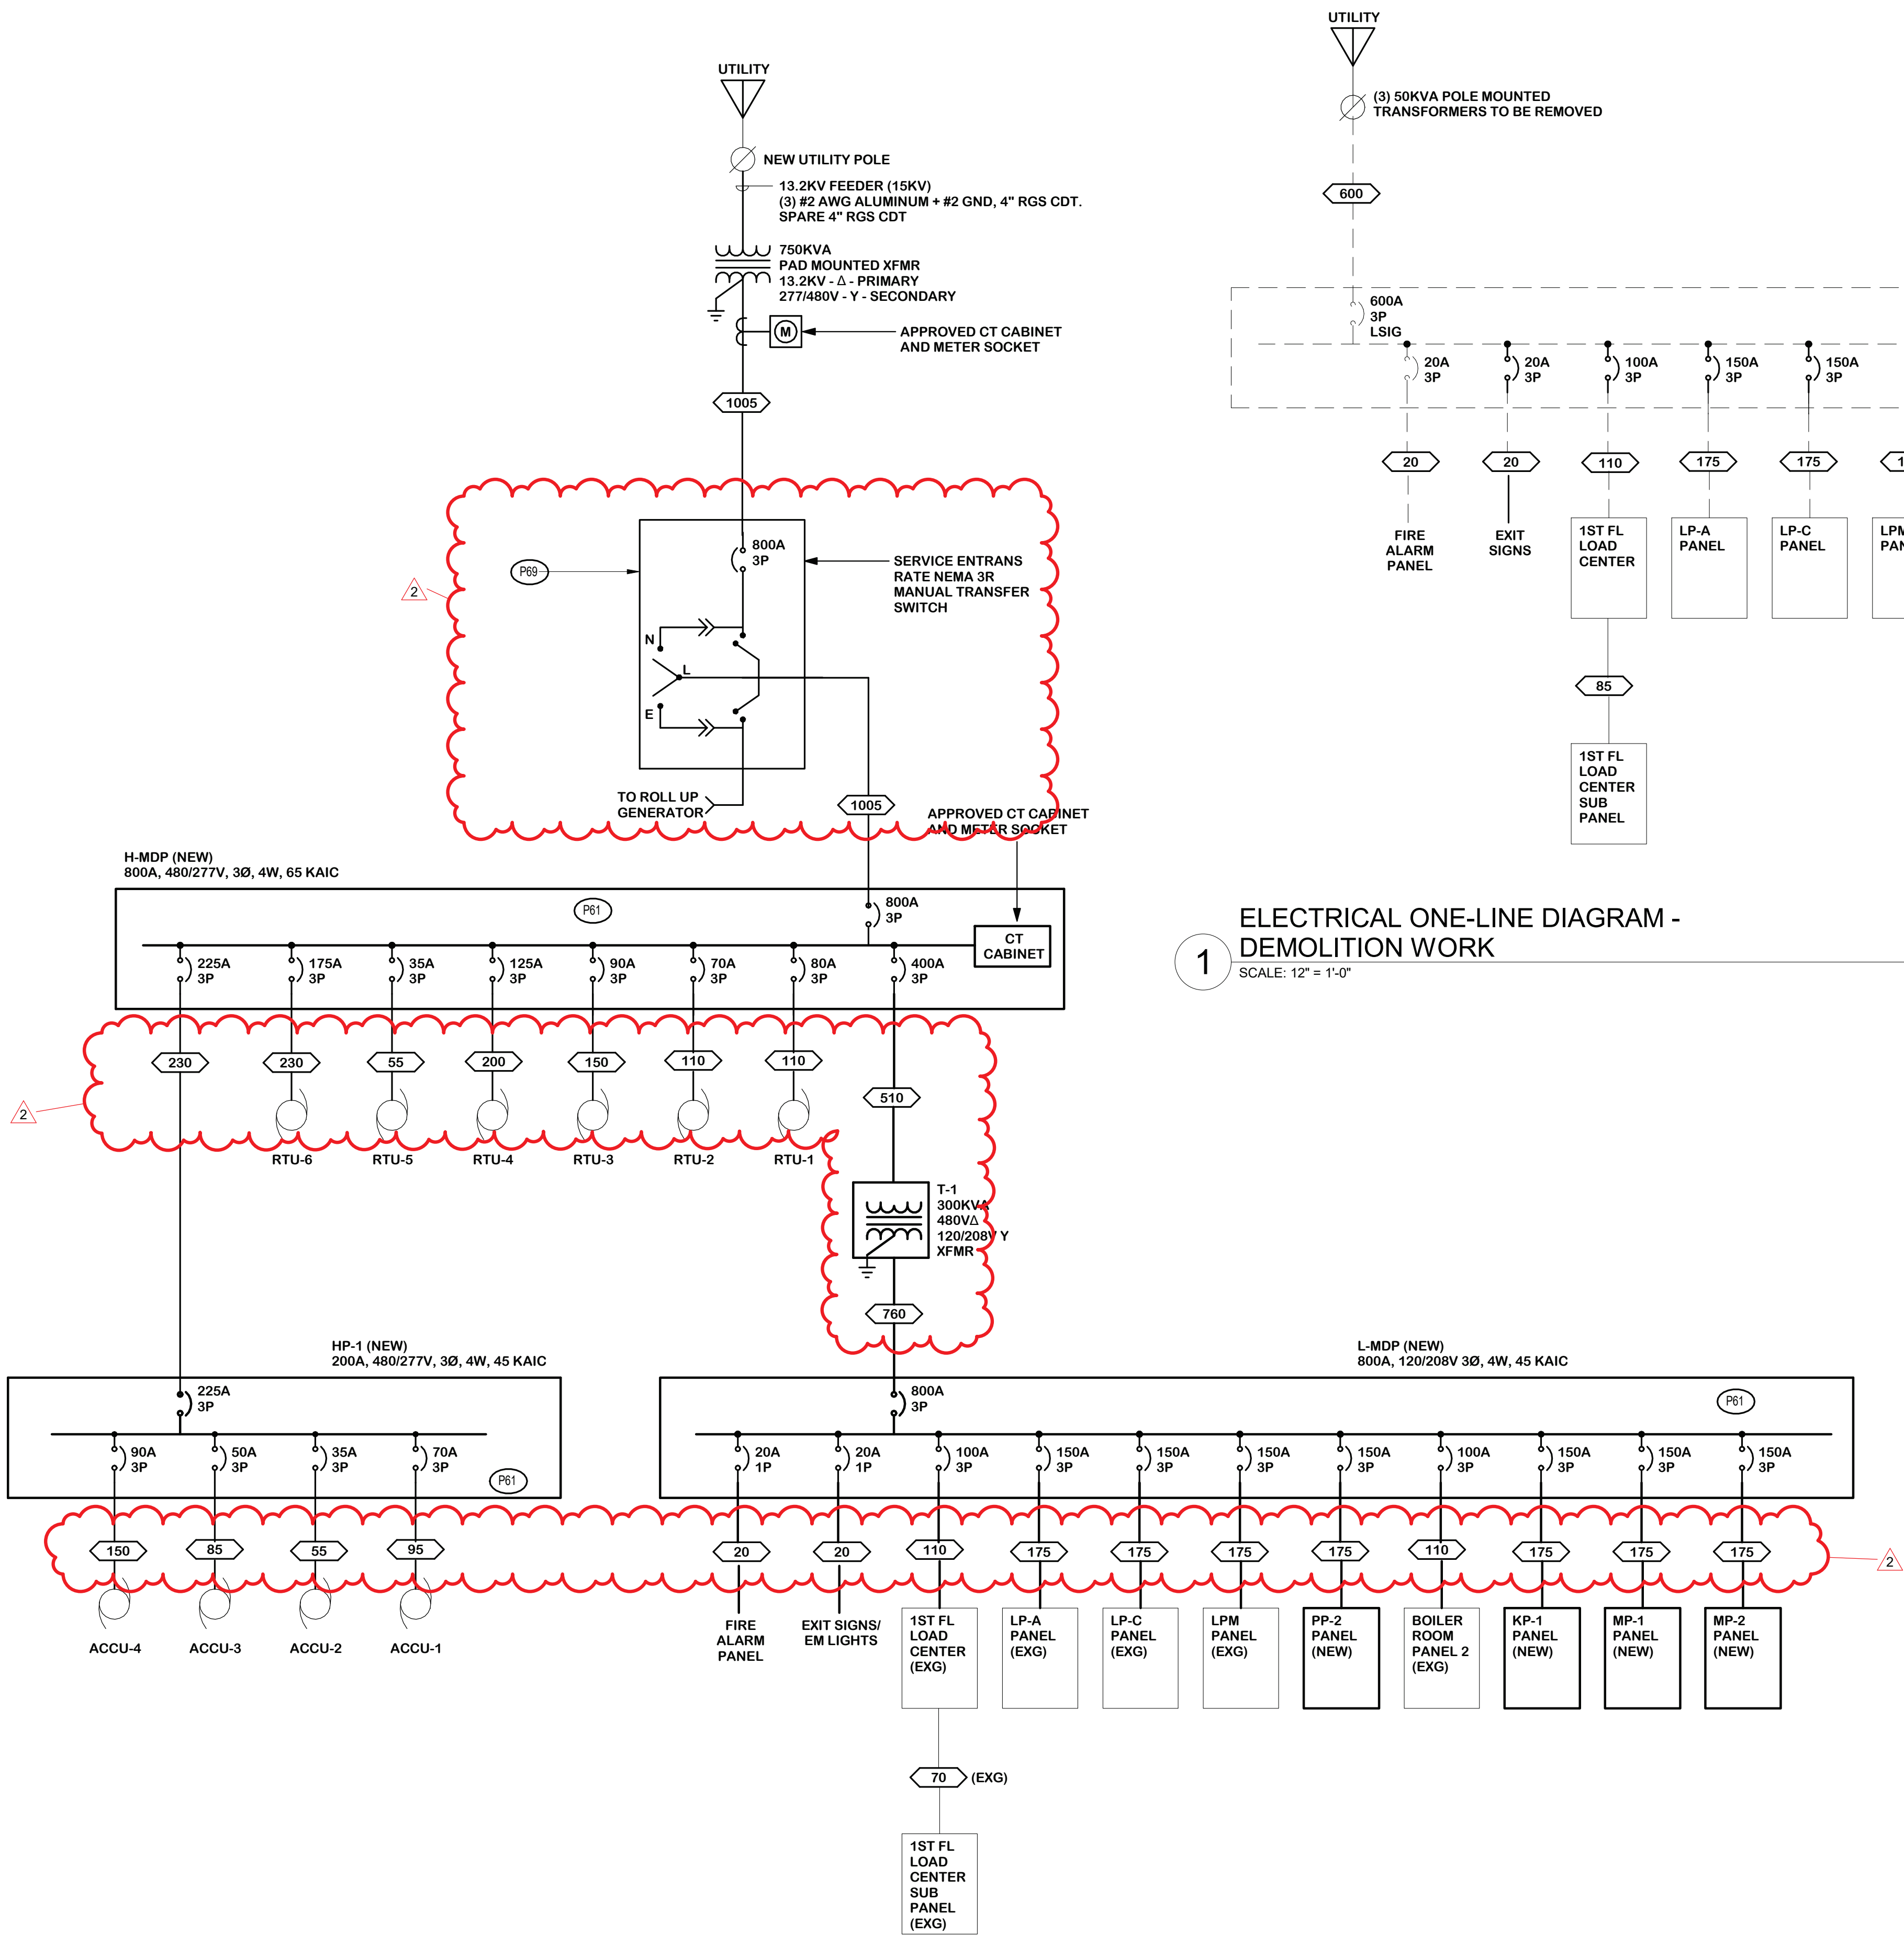

ELECTRICAL ONE-LINE DIAGRAM - NEW WORK
SCALE: 12" = 1'-0"

SINGLE LINE SHEET NOTES

- OVERCURRENT DEVICES OF ENTIRE DISTRIBUTION SYSTEM SHALL MEET STATED FAULT CURRENT VALUES WITH FULLY RATED EQUIPMENT.
- CONDUCTOR LENGTHS INDICATED ON THE SINGLE LINE DIAGRAM ARE FOR FAULT CURRENT CALCULATIONS ONLY. ACTUAL LENGTH SHALL BE DETERMINED BY FIELD CONDITIONS AND ACTUAL ROUTES OF FEEDERS.
- REFER TO SWITCHBOARD SCHEDULES AND DISTRIBUTION PANEL SCHEDULES FOR ADDITIONAL REQUIREMENTS. WHERE A DISCREPANCY EXISTS BETWEEN EQUIPMENT ON THE SINGLE LINE DIAGRAM AND THE DETAILED SCHEDULES, THE ITEM OR ARRANGEMENT WITH BETTER QUALITY, GREATER QUANTITY, OR HIGHER COST SHALL BE USED.
- ALL DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
- REFER TO THE MOTOR AND SPECIAL CONNECTION SCHEDULE FOR ALL FEEDERS DESIGNATED "SC".
- GROUNDING ELECTRODE CONDUCTORS SIZES ARE NOT INDICATED ON THE SINGLE LINE DIAGRAM ARE. REFER TO THE GROUNDING RISER DIAGRAM FOR CONNECTIONS AND CONDUCTOR SIZES.

GENERAL NOTES:

- SEE DRAWING E6000 FOR APPLICABLE GENERAL NOTES, ABBREVIATIONS, SYMBOLS AND LEGENDS
- REFER TO MINIMUM CONDUIT AND WIRING SCHEDULE ON DRAWING E600 FOR FEEDER INFORMATION

ELECTRICAL KEYED NOTES:

2. PROVIDE A SALENT MODEL NUMBER MTSW08033XR800V RM K3SP MANUAL TRANSFER SWITCH (MTS), MTS TO BE INSTALLED ON EXTERIOR WALL OF ELECTRIC ROOM AT 3" TO BOTTOM OF MTS.

KEY PLAN:

SED NO. 44-09-01-04-0-005-008

THIS SHEET INCORPORATES COLOR GRAPHICS WHICH INDICATE IMPORTANT INFORMATION AND SHALL BE PRINTED IN COLOR IF REPRODUCED BY A CONTRACTOR.

BCA Architects & Engineers
Watertown | Ithaca | Saratoga Springs | Rochester
WWW.THEBCGROUP.COM

COPYRIGHT © 2022 - BCA ARCHITECTS & ENGINEERS. WARNING - IT IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW FOR ANY UNAUTHORIZED ALTERATIONS TO THIS DOCUMENT AS PER ARTICLE 145 AND 147.

BCA
ARCHITECTS
ENGINEERS



HIGHLAND FALLS-FORT MONTGOMERY CSD
ALTERATIONS AND ADDITIONS TO:
FORT MONTGOMERY ELEMENTARY SCHOOL

HIGHLAND FALLS - ORANGE COUNTY - NEW YORK

REV	DATE	DESCRIPTION
1	05/28/2024	SED ADDENDUM #1
2	07/17/2024	BID ADDENDUM NO.3

DRAWN BY MAH, TMF	PROJECT NUMBER 2022-138
CHECKED BY SGV	DATE 06/07/2024

ELECTRICAL DIAGRAMS

BUILDING NUMBER SHEET NUMBER
ES E400

MINIMUM CONDUIT AND WIRE SCHEDULE						
FEEDER TYPE	COPPER CONDUCTORS		CONDUIT SIZE			
	Ø & N	GND	20+H+GND	30+GND	30+H+GND	30+2N+2GND
20	#12	#12	1 1/2"	1 1/2"	1 1/2"	3/4"
30	#10	#10	1 1/2"	1 1/2"	3/4"	3/4"
40	#8	#10	3/4"	3/4"	1"	1"
55	#6	#10	1"	1"	1"	1"
70	#4	#8	1 1/4"	1 1/4"	1 1/4"	1 1/4"
85	#3	#8	1 1/4"	1 1/4"	1 1/4"	1 1/2"
95	#2	#8	1 1/4"	1 1/4"	1 1/2"	1 1/2"
110	#1	#6	1 1/2"	1 1/2"	1 1/2"	2"
150	#10	#6	1 1/2"	1 1/2"	2"	2"
175	#20	#6	2"	2"	2"	2 1/2"
200	#30	#6	2"	2"	2"	2 1/2"
230	#40	#4	2"	2"	2 1/2"	2 1/2"
255	250 KCM	#4	2 1/2"	2 1/2"	2"	3"
285	300 KCM	#4	2 1/2"	3"	3"	3"
310	350 KCM	#3	3"	3"	3"	3 1/2"
335	400 KCM	#3	3"	3"	3"	3 1/2"
380	500 KCM	#3	3"	3"	3 1/2"	4"
510	(2) 250 KCM	(2) #1	(2) 2 1/2"	(2) 2 1/2"	(2) 3"	(2) 3"
570	(2) 300 KCM	(2) #1	(2) 2 1/2"	(2) 2 1/2"	(2) 3"	(2) 3 1/2"
620	(2) 350 KCM	(2) #1	(2) 3"	(2) 3"	(2) 3"	(2) 3 1/2"
760	(2) 500 KCM	(2) #10	(2) 3"	(2) 3"	(2) 3 1/2"	(2) 4"
1005	(3) 400 KCM	(3) #20	(3) 3"	(3) 3"	(3) 3"	(3) 3 1/2"
1240	(4) 350 KCM	(4) #30	(4) 3"	(4) 3"	(4) 3"	(4) 3 1/2"
1260	(3) 600 KCM	(3) #30	(3) 3 1/2"	(3) 3 1/2"	(3) 4"	(3) 5"
1675	(5) 400 KCM	(5) #40	(5) 3"	(5) 3"	(5) 3 1/2"	(5) 4"
1680	(4) 600 KCM	(4) #40	(4) 3 1/2"	(4) 3 1/2"	(4) 4"	(4) 5"
2010	(6) 400 KCM	(6) 250 KCM	(6) 3"	(6) 3"	(6) 3 1/2"	(6) 4"
2100	(5) 600 KCM	(5) 250 KCM	(5) 3 1/2"	(5) 3 1/2"	(5) 4"	(5) 5"
2520	(6) 600 KCM	(6) 350 KCM	(6) 3 1/2"	(6) 3 1/2"	(6) 4"	(6) 5"
2660	(7) 500 KCM	(7) 350 KCM	(7) 3 1/2"	(7) 3 1/2"	(7) 3 1/2"	(7) 5"
3040	(8) 500 KCM	(8) 400 KCM	(8) 3 1/2"	(8) 3 1/2"	(8) 3 1/2"	(8) 5"
4275	(8) 750 KCM	(8) 500 KCM	(8) 4"	(8) 4"	(8) 5"	(8) 5"
EQ EQUIPMENT FEEDER - REFER TO ELECTRICAL EQUIPMENT SCHEDULE						
FEEDER DESIGNATION						
GROUND CONDUCTORS: (0) - NO GROUND (1G) - EQUIPMENT GND OR ISOLATED GND (2G) - EQUIPMENT GND AND ISOLATED GND SYSTEM DESCRIPTION: (3) - 10, 3W OR 30, 3W (4) - 30, 4W (5) - 30, 5W (2 NEUTRALS) CONDUCTOR AMPACITY: (SEE FEEDER SCHEDULE)						

GENERAL NOTES:

A. THE ABOVE FEEDER SCHEDULE IS A SCHEDULE OF TYPICAL FEEDERS AND SOME SIZES MAY NOT BE UTILIZED.
B. ALL CONDUCTOR AMPACITIES ARE BASED ON TABLE 310-15(b)(16) OF THE NEC FOR COPPER CONDUCTOR TYPE THW/THWN.

C. FEEDER SIZES SHOWN ON THE RISER DIAGRAM INDICATE FEEDER AMPACITIES AND DO NOT NECESSARILY CORRESPOND TO CIRCUIT BREAKER AMPACITIES. CERTAIN FEEDERS MAY BE SIZED FOR THE DERATION FACTORS REQUIRED BY CODE AND/OR ARE OVERSIZED FOR VOLTAGE DROP.

D. WHERE MULTIPLE CONDUITS AND CONDUCTORS ARE INDICATED FOR A SINGLE FEEDER, EACH CONDUIT SHALL CONTAIN 1 PARALLEL PHASE, NEUTRAL, AND GROUND CONDUCTORS INDICATED.

E. CONDUIT ABOVE GRADE Indoors SHALL BE EMT. CONDUIT ABOVE GRADE OUTDOORS SHALL BE GALVANIZED IMC OR RMC. CONDUIT BELOW GRADE SHALL BE PVC WITH GALVANIZED RMC ELBOWS. CONDUIT SIZE INDICATED IS MINIMUM SIZE REGARDLESS OF CONDUIT TYPE.

F. CONDUITS SIZED LARGER THAN INDICATED SHALL BE PERMITTED FOR RUNS WITH UP TO (4) 90° ELBOWS, OR FOR PULLING LONGER RUNS.

ELECTRICAL EQUIPMENT CONNECTION SCHEDULE																																		
LOCATION			EQUIPMENT INFORMATION							CIRCUIT INFORMATION							MOTOR STARTER							DISCONNECT				FIRE ALARM/FAN SHUT-DOWN		DUCT MOUNTED SMOKE DETECTOR(S)		SCHEDULE NOTES		ID
ID	NAME	NO	MOTOR NO.	POWER	FLA	MCA	BREAKER SIZE	VOLT	PH	PANEL	NO.	WIRE & CONDUIT SIZE	DESCRIPTION	NEMA ENCLOSURE	FURNISH	INSTALL	LOCATION	DESCRIPTION	NEMA ENCLOSURE	FURNISH	LOCATION	FIRE ALARM/FAN SHUT-DOWN	DUCT MOUNTED SMOKE DETECTOR(S)	SCHEDULE NOTES		ID								
ACCU-1	ROOF	--	0	0.00 hp	45.0 A	56.2 A	70.0 A	480 V	3	HP-1	1,3.5	3#4-86G, 1" C	MANUF. - SINGLE POINT POWER	3R	MANUF.	MANUF.	AT UNIT	DIV. 26 - FUSED SWITCH	3R	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-1									
ACCU-2	ROOF	--	0	0.00 hp	22.5 A	28.1 A	35.0 A	480 V	3	HP-1	2,4.6	3#8-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	3R	MANUF.	MANUF.	AT UNIT	DIV. 26 - FUSED SWITCH	3R	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-2									
ACCU-3	ROOF	--	0	0.00 hp	34.6 A	43.3 A	50.0 A	480 V	3	HP-1	7,8.11	3#6-#10G, 1" C	MANUF. - SINGLE POINT POWER	3R	MANUF.	MANUF.	AT UNIT	DIV. 26 - FUSED SWITCH	3R	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-3									
ACCU-4	ROOF	--	0	0.00 hp	63.7 A	79.6 A	90.0 A	480 V	3	HP-1	8,10.12	3#2-86G, 1 1/4" C	MANUF. - SINGLE POINT POWER	3R	MANUF.	MANUF.	AT UNIT	DIV. 26 - FUSED SWITCH	3R	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-4									
ACCU-5	ROOF	--	0	0.00 hp	13.7 A	17.1 A	20.0 A	208 V	1	MP-1	9.11	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	3R	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	3R	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-5									
ACCU-6	ROOF	--	0	0.00 hp	18.1 A	22.6 A	25.0 A	208 V	1	MP-2	4.6	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	3R	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	3R	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-6									
ACCU-7	ROOF	--	0	0.00 hp	9.9 A	12.4 A	20.0 A	208 V	1	MP-1	1.3	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	3R	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	3R	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-7									
ACCU-8	ROOF	--	0	0.00 hp	9.9 A	12.4 A	20.0 A	208 V	1	MP-2	39.41	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	3R	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	3R	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-8									
ACCU-102.3	P.E. OFFICE	102-3	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-2	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-102.3									
ACCU-103	O.T.P.T. OFFICE	103	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-2	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-103									
ACCU-104	KINDERGARTEN CLASSROOM 11	104	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-2	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-104									
ACCU-104.2	OFFICE	104-2	0	0.00 hp	0.2 A	0.3 A	20.0 A	208 V	1	MP-2	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-104.2									
ACCU-105	KINDERGARTEN CLASSROOM 10	105	0	0.00 hp	11.1 A	1.4 A	20.0 A	208 V	1	MP-2	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-105									
ACCU-106	PRE-K CLASSROOM 9	106	0	0.00 hp	1.1 A	1.4 A	20.0 A	208 V	1	MP-2	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-106									
ACCU-109	RESOURCE ROOM	109	0	0.00 hp	1.1 A	1.4 A	20.0 A	208 V	1	MP-1	13.15	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-109									
ACCU-110	PRE-K CLASSROOM 8	110	0	0.00 hp	1.4 A	1.8 A	20.0 A	208 V	1	MP-2	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-110									
ACCU-111	ART / MUSIC ROOM	111	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-1	13.15	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-111									
ACCU-114	I.T. CLOSET	114	0	0.00 hp	9.9 A	12.4 A	20.0 A	208 V	1	MP-1	5.7	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - FUSED SWITCH	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-114									
ACCU-115	MEDIA / STREAM ROOM	115	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-1	13.15	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-115									
ACCU-117			0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-1	13.15	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-117									
ACCU-117.2	EXAM-3	117-2,3	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-1	13.15	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-117.2									
ACCU-119	MAIN OFFICE (B)-3	E119-3	0	0.00 hp	0.3 A	0.4 A	20.0 A	208 V	1	MP-1	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-119									
ACCU-121	PRINCIPAL'S OFFICE (B)-3	E121-3	0	0.00 hp	0.3 A	0.4 A	20.0 A	208 V	1	MP-1	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-121									
ACCU-122	2ND GRADE CLASSROOM 4-3	E122-3	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-1	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-122									
ACCU-123	LIBRARY (B)-3	E123-3	0	0.00 hp	0.3 A	0.4 A	20.0 A	208 V	1	MP-1	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-123									
ACCU-124	2ND GRADE CLASSROOM 2,3	E124-3	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-1	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-124									
ACCU-127	1ST GRADE CLASSROOM 1,3	E127-3	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-1	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-127									
ACCU-202	ELECTRICAL ROOM	202	0	0.00 hp	9.9 A	12.4 A	20.0 A	208 V	1	MP-2	27.29	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-202									
ACCU-203	FACULTY ROOM	203	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-203									
ACCU-204	K-2 GRADE CLASSROOM 12	204	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-204									
ACCU-204.2	OFFICE	204-2	0	0.00 hp	0.2 A	0.3 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-204.2									
ACCU-205	FIRST GRADE CLASSROOM 13	E205	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-205									
ACCU-206	KINDERGARTEN CLASSROOM 14	E206	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-206									
ACCU-209	ART / MUSIC ROOM	111	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-209									
ACCU-210	ART / MUSIC ROOM	111	0	0.00 hp	12.2 A	1.5 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5.7	ACCU-210									
BS-21	CORRIDOR 4	E4-1	0	0.00 hp	0.5 A	0.6 A	20.0 A	208 V	1	MP-1	23.25	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	BS-21									
BS-24A	ART / MUSIC ROOM	111	0	0.00 hp	0.1 A	0.1 A	20.0 A	208 V	1	MP-1	13.15	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	BS-24A									
BS-24B	ART / MUSIC ROOM	111	0	0.00 hp	0.1 A	0.1 A	20.0 A	208 V	1	MP-1	13.15	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	BS-24B									
BS-25	FIRST GRADE CLASSROOM 13	E205	0	0.00 hp	0.5 A	0.4 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	BS-25									
BS-26A	KINDERGARTEN CLASSROOM 14	E206	0	0.00 hp	0.3 A	0.4 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	BS-26A									
BS-26B	KINDERGARTEN CLASSROOM 14	E206	0	0.00 hp	0.3 A	0.4 A	20.0 A	208 V	1	MP-2	7.9	3#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	BS-26B									
CF-1	STAFF TOILET	112	0	0.00 hp	0.3 A	0.4 A	20.0 A	120 V	1	MP-2	27	2#10-#10G, 1/2" C	DIV. 23 - ELECTRICALLY COMMUTATED MOTOR	1	DIV. 23	DIV. 23	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	CF-1									
CH-1	VESTIBULE 2,3	V2-1,3	0	0.00 hp	10.0 A	12.5 A	20.0 A	120 V	1	PR-2	23	2#10-#10G, 3/4" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	CH-1									
CH-2	CORRIDOR 4	V4-1	0	0.00 hp	10.0 A	12.5 A	20.0 A	120 V	1	PR-2	25	2#10-#10G, 1/2" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	CH-2									
CH-3	VESTIBULE 3	V3-1	0	0.00 hp	0.2 A	12.5 A	20.0 A	120 V	1	MP-1	21	2#10-#10G, 1/2" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	CH-3									
CH-4	CORRIDOR 3	V3-1	0	0.00 hp	10.0 A	12.5 A	20.0 A	120 V	1	MP-1	27	2#10-#10G, 1/2" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	CH-4									
CH-5	VESTIBULE 1	V1-2	0	0.00 hp	10.0 A	12.5 A	20.0 A	120 V	1	MP-2	17	2#10-#10G, 1/2" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	CH-5									
EDC-1			0	0.00 hp	16.7 A	20.8 A	25.0 A	120 V	1	MP-1	17	2#10-#10G, 1/2" C	MANUF. - SINGLE POINT POWER	1	MANUF.	MANUF.	AT UNIT	DIV. 26 - CIRCUIT BREAKER	1	DIV. 26	AT UNIT	(none)	(none)	12.3,5	EDC-1									
EDC-2	ELECTRICAL ROOM	202	0	0.00 hp	51.1 A	61.1 A	70.0 A	480 V	3	MP-2	11,13.0 A	3#4-86G, 1" C	MANUF. - SINGLE POINT POWER	3R	MANUF.	MANUF.	AT UNIT	DIV. 26 - FUSED SWITCH	3R	DIV. 26	AT UNIT	(none)	(none)	12.3,5	EDC-2									
EDC-3	STORAGE	203	0	0.00 hp	38.5 A	48.1 A	50.0 A	208 V	1	MP-2	19,21	3#4-86G, 1" C	MANUF. - SINGLE POINT POWER	1																				

