



Friedman Fisher Associates, P.C.

WARNING:

THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.



REGISTRATION EXPIRES
10/31/24


CONTRACT

HVAC

TITLE: REPLACE BUILDING CHILLERS,
BUILDING 144

LOCATION:
COOK CHILL PRODUCTION CENTER
145 OLD ORANGEBURG ROAD
ORANGEBURG, NY


CLIENT: OFFICE OF
MENTAL HEALTH

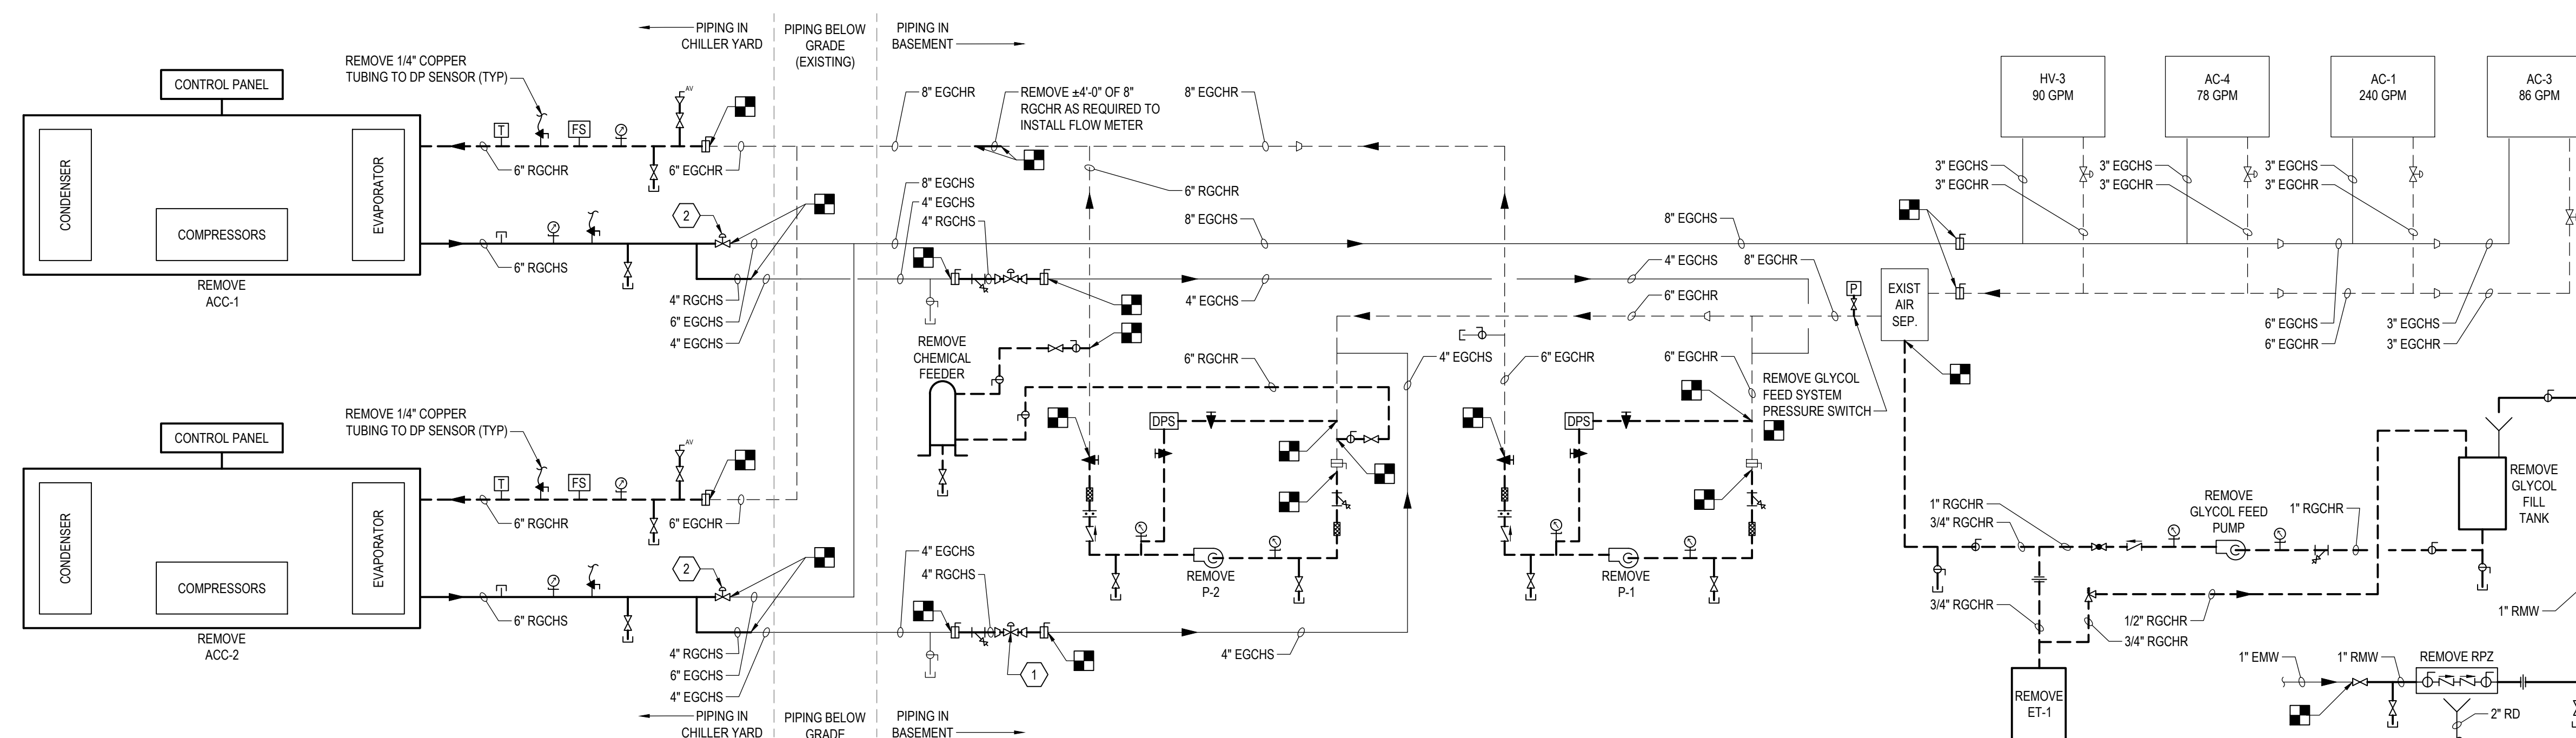

1 CHILLED WATER FLOW DIAGRAM - REMOVALS

KEYED NOTES

1. TURN THE TWO 2-1/2" BY-PASS CONTROL VALVE ACTUATORS (VALVE BODY TO BE REMOVED) OVER TO THE DIRECTOR'S REPRESENTATIVE (PALLETIZE AND SHRINK WRAP). DELIVER TO LOCATION AS DIRECTED BY THE DIRECTOR'S REPRESENTATIVE.
2. TURN THE TWO 6" CHILLER CONTROL VALVE ACTUATORS (VALVE BODY TO BE REMOVED) OVER TO THE DIRECTOR'S REPRESENTATIVE (PALLETIZE AND SHRINK WRAP). DELIVER TO LOCATION AS DIRECTED BY THE DIRECTOR'S REPRESENTATIVE.

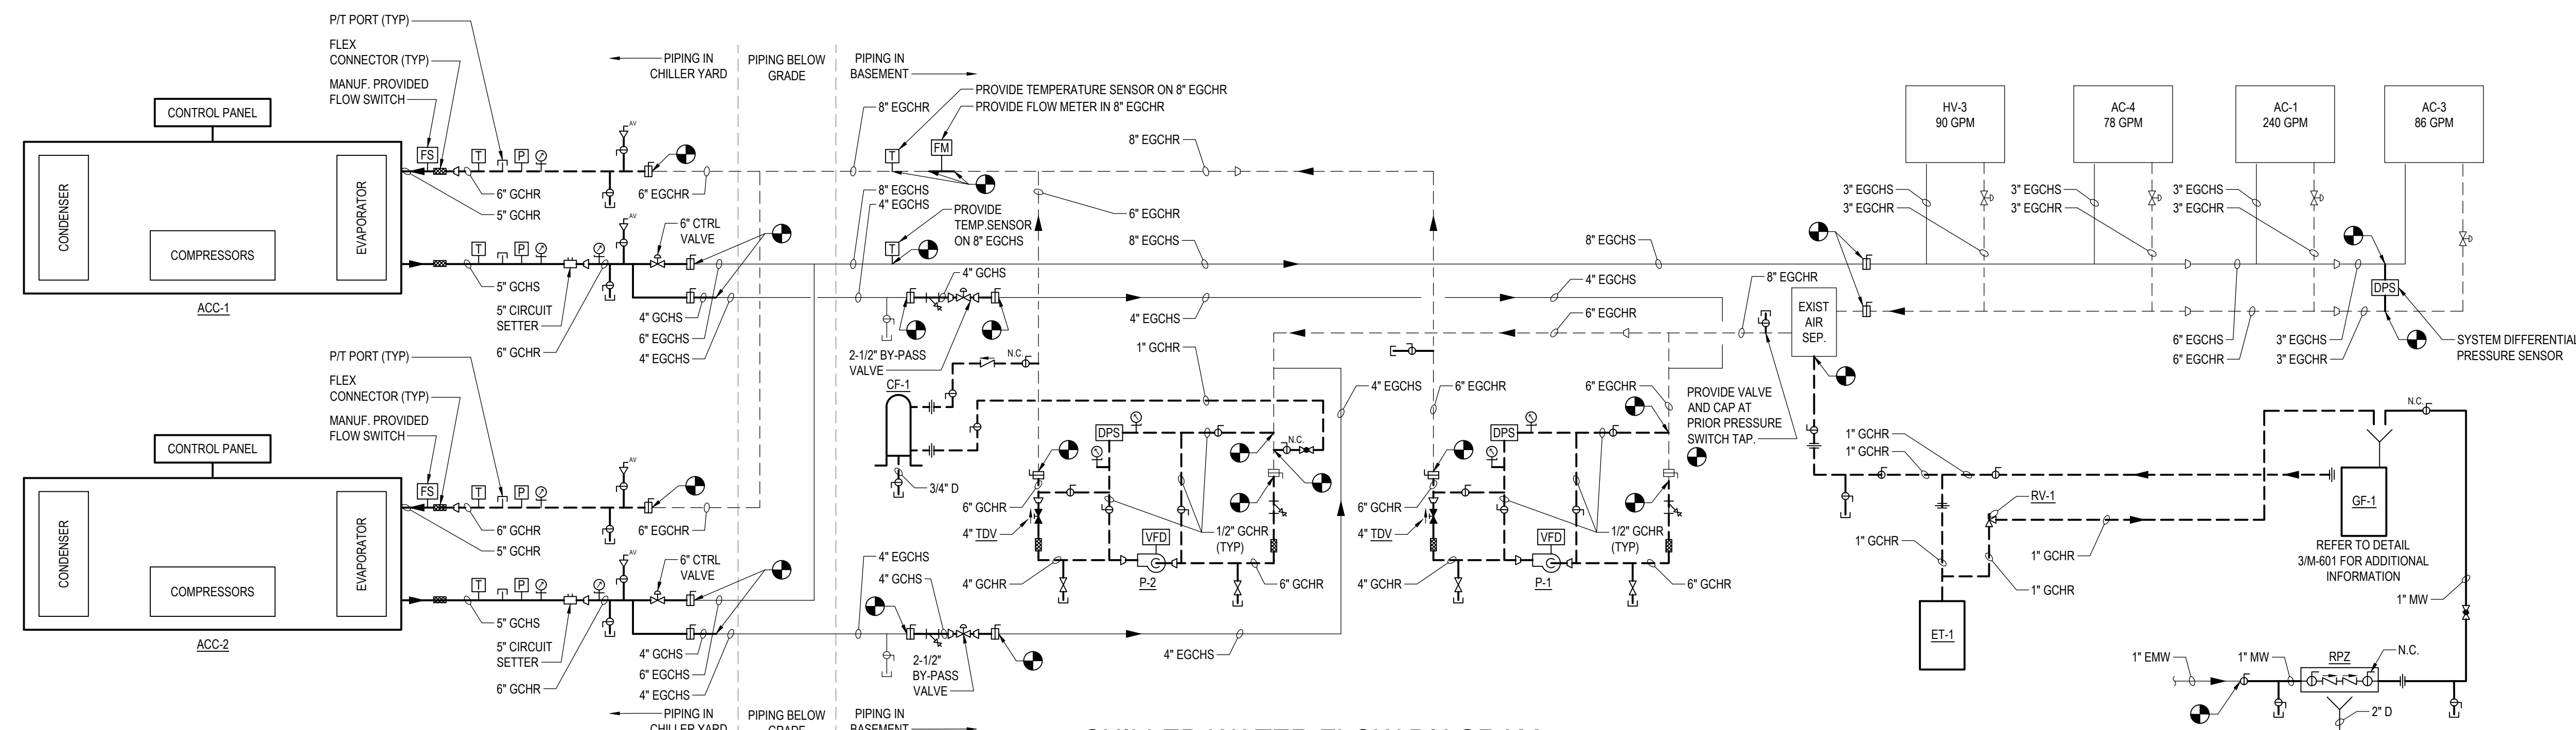

2 CHILLED WATER FLOW DIAGRAM

[illegible]

CHILLED WATER FLOW DIAGRAMS

DRAWING NUMBER

M-501

SHEET 10 OF 18