




1 HVAC - EQUIPMENT, MAKE-UP AIR UNIT, 100% OA NTS

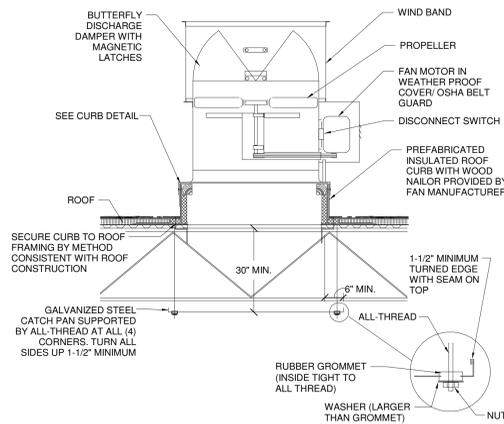


2 HVAC - EQUIPMENT, UPBLAST VENTILATION FAN NTS

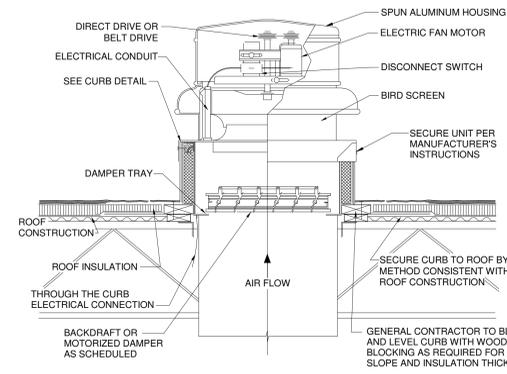


3 HVAC - EQUIPMENT, EXHAUST FAN, ROOF MOUNTED DOWNBLAST NTS

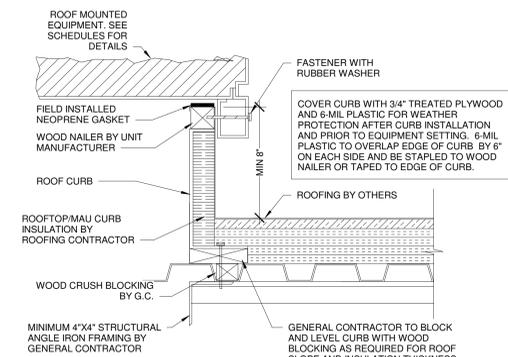


4 HVAC - EQUIPMENT - RTU / MAU CURB DETAIL NTS

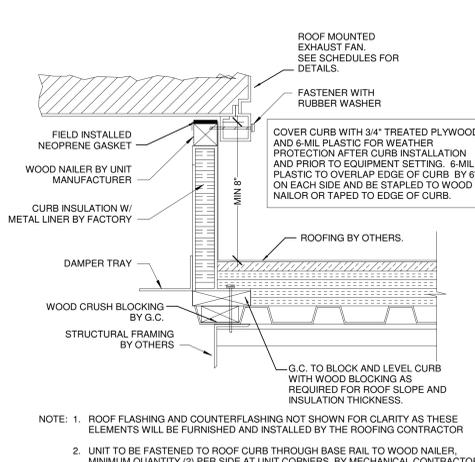


5 HVAC - EQUIPMENT - EXHAUST FAN CURB DETAIL NTS

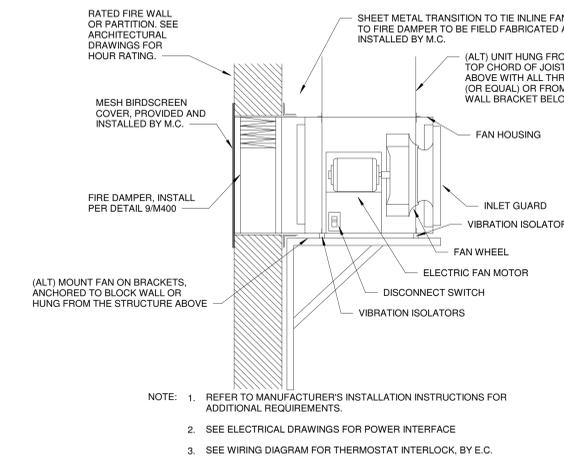


6 HVAC - EQUIPMENT, EXHAUST FAN, IN-LINE NTS

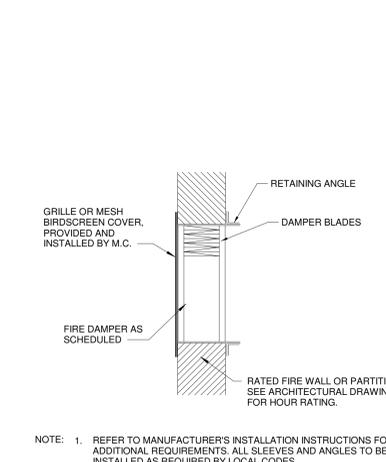


7 HVAC - LIFE SAFETY, FIRE DAMPER, W/O DUCT CONNECTION NTS

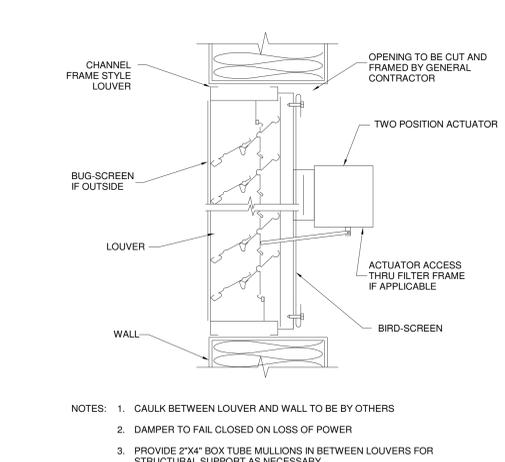


8 HVAC - LOUVER DAMPER NTS

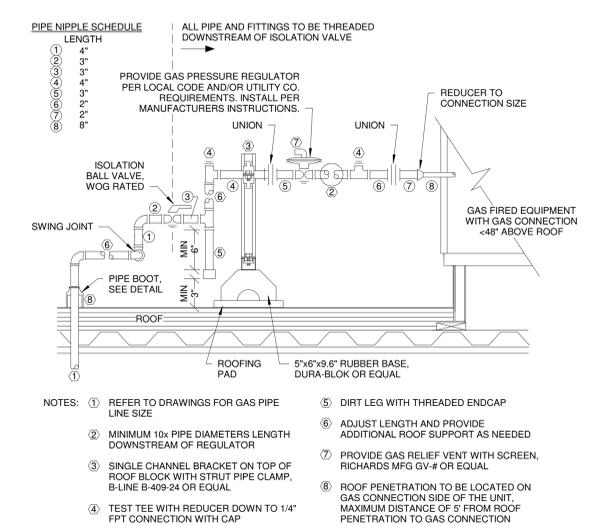



9 PIPING - GAS CONNECTION TO RTU, LOW CONNECTION NTS

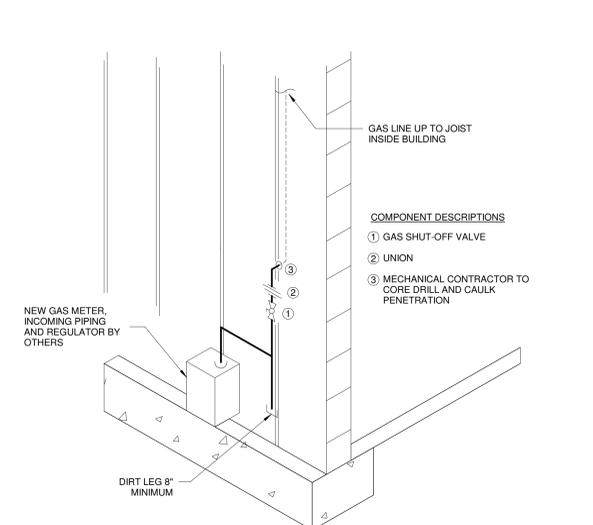

10 PIPING - GAS METER CONNECTION, ISO NTS

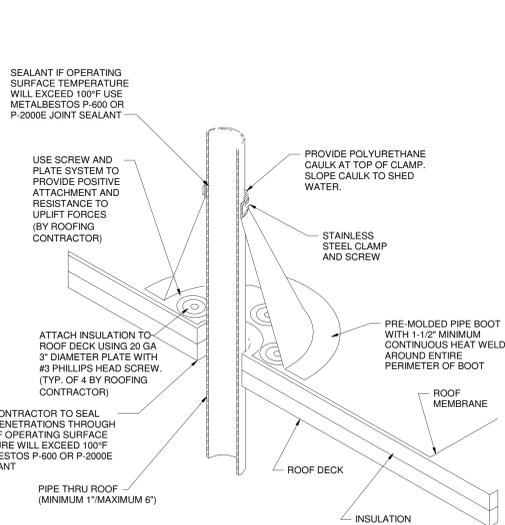

11 PIPING - PIPE THRU ROOF NTS



SUBMITTALS

REV	Date	Description
A	02/09/24	FINAL PROGRESS SET
B	02/09/24	FINAL PROGRESS SET
C	02/09/24	PERMIT SET

NOT FOR CONSTRUCTION

NDBS NATIONAL DESIGN BUILD SERVICES
11840 Borman Dr.
St. Louis, MO 63146
P: 636.228.6400
F: 636.228.6410
Any reproduction or unauthorized use of this document or any part of the without the expressed consent of National Design Build Services Inc. is prohibited.

THE PERSONAL SEAL AFFIXED TO THIS SHEET INDICATES THAT THE PROFESSIONAL ENGINEER WHOSE NAME APPEARS THEREON HAS PREPARED OR HAS DIRECTED THE PREPARATION OF THE MATERIAL ON THIS SHEET. OTHER DRAWINGS, SPECIFICATIONS, REPORTS, DOCUMENTS OR INSTRUCTIONS, NOT EXHIBITING THIS SEAL, RELATING TO OR INTENDED TO BE USED FOR ANY PARTS OR PART OF THE PROJECT IN WHICH THIS SHEET PERTAINS, SHALL NOT BE CONSIDERED PREPARED BY OR THE RESPONSIBILITY OF THE ENGINEERED AND IS HEREBY DISCLAIMED IN ACCORDANCE WITH SECTION 327.412 R.S., N.J.