


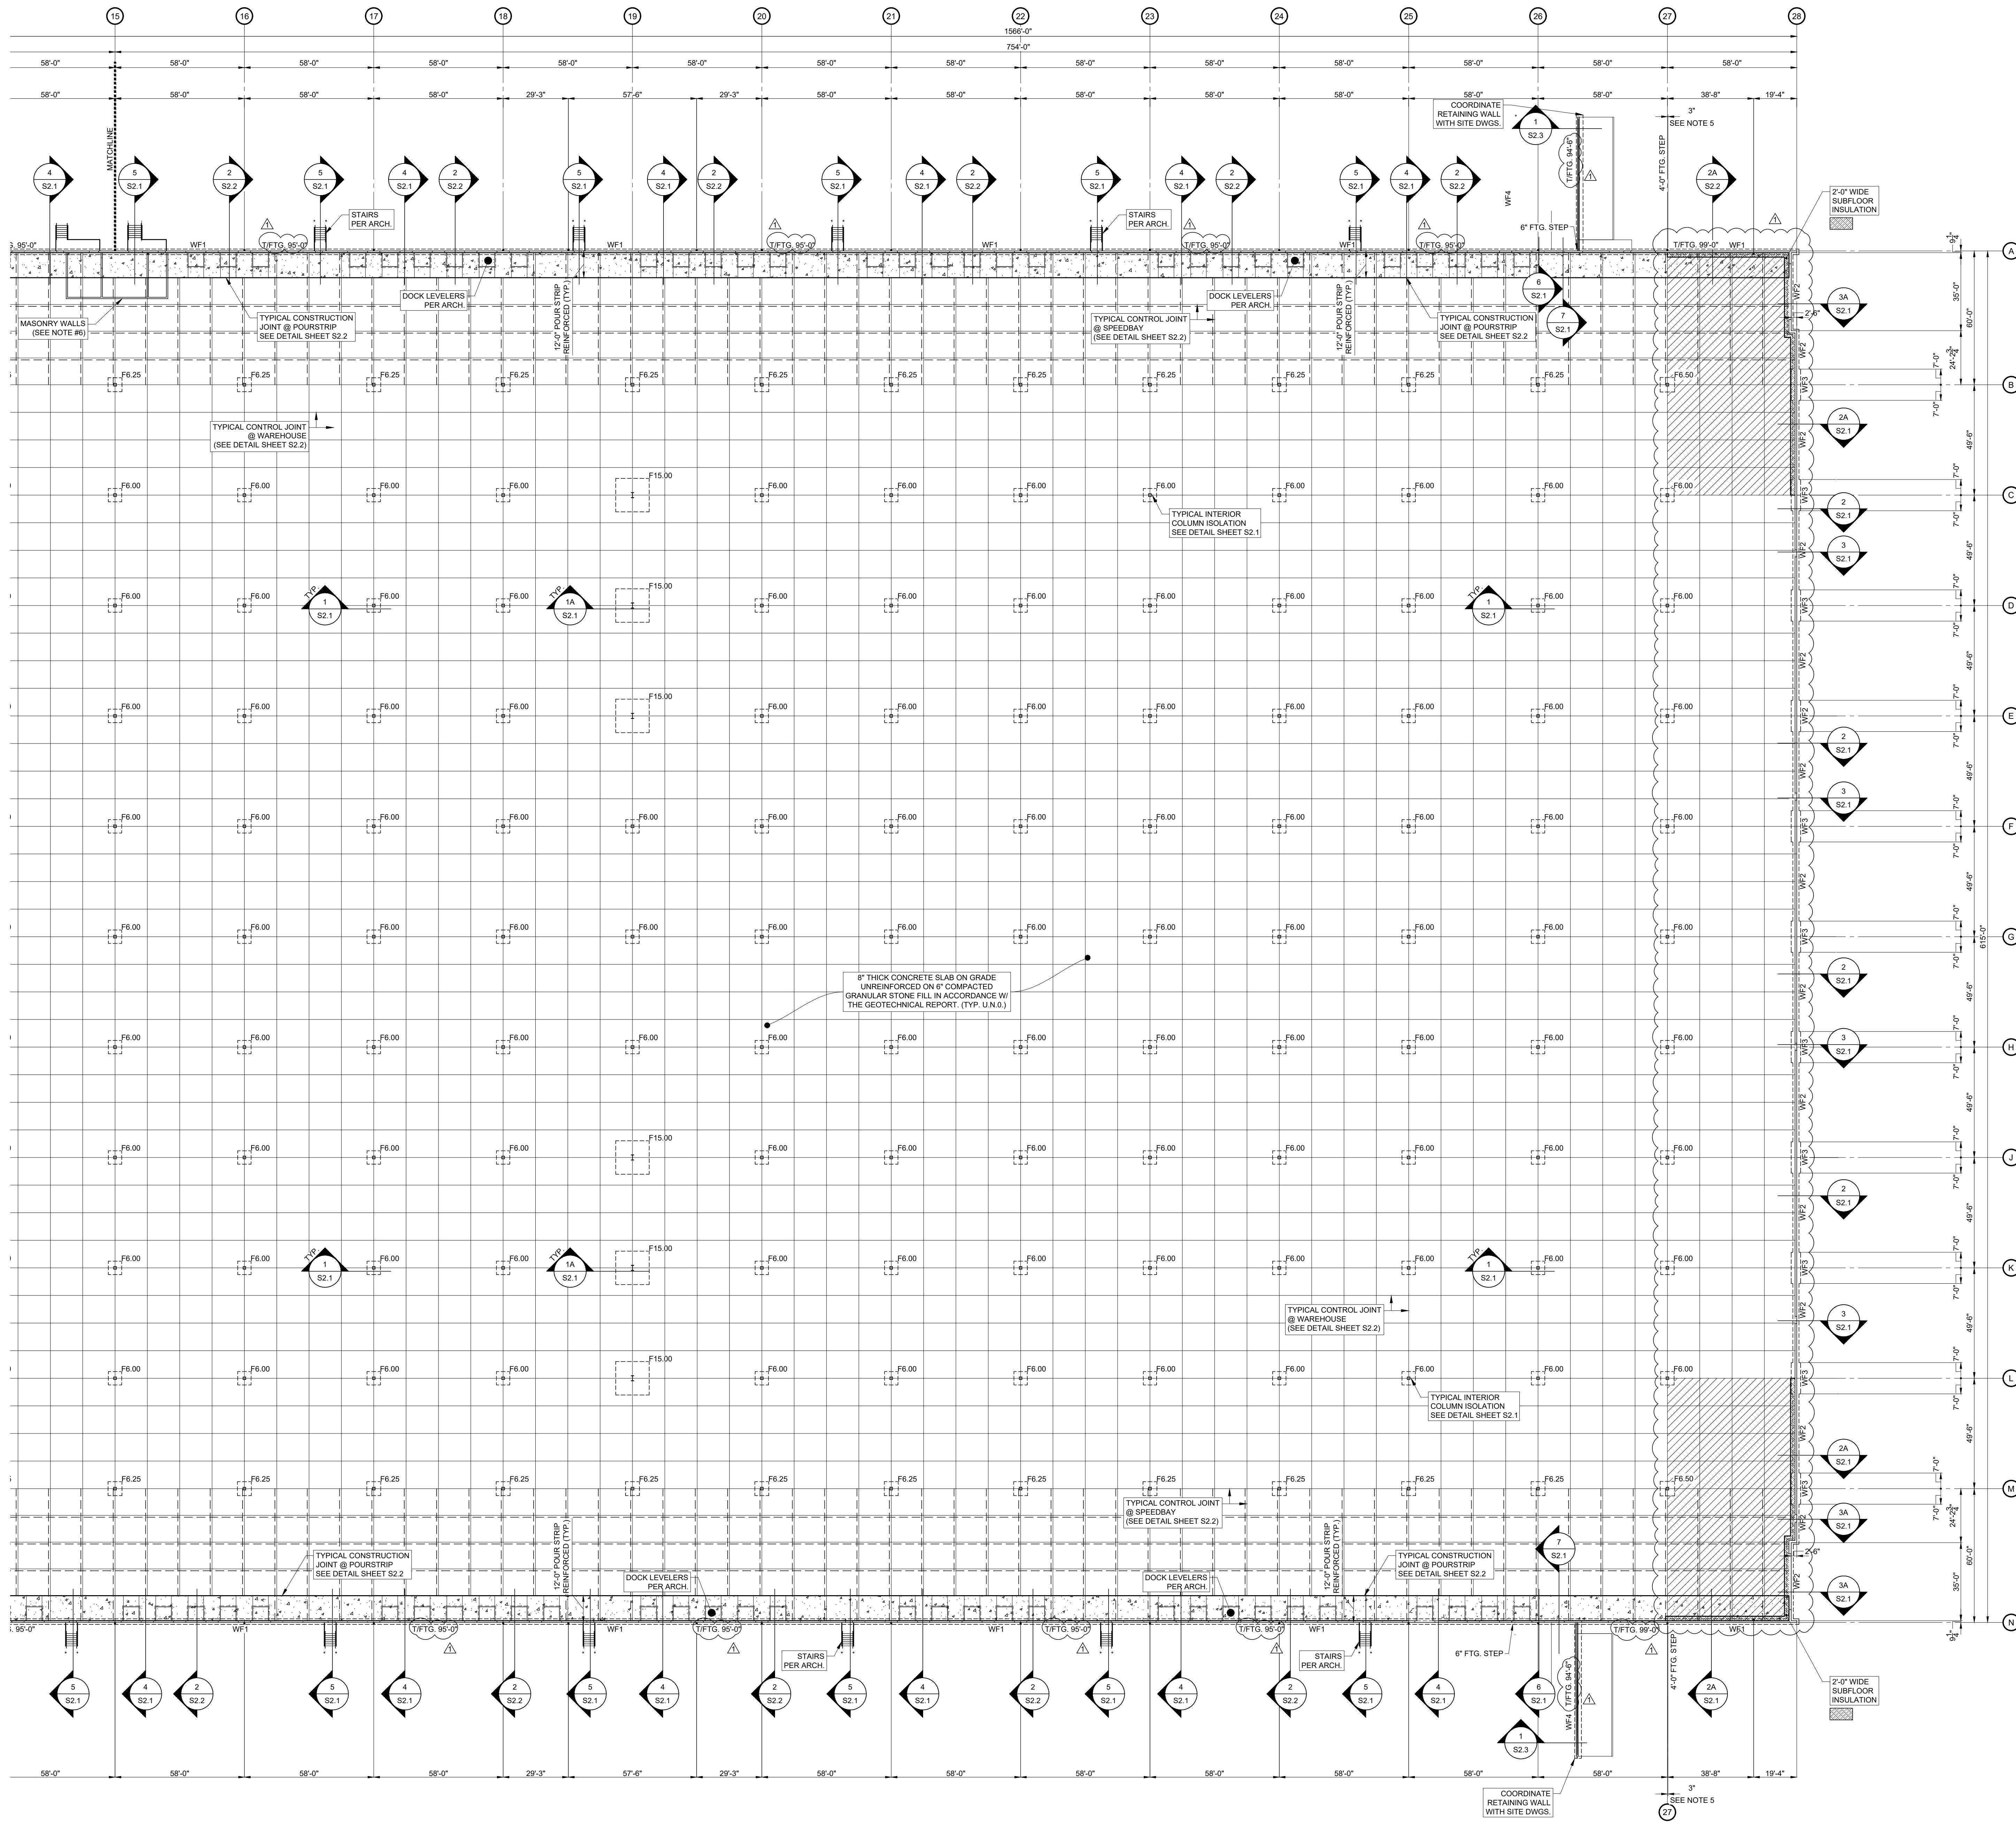

**AREA "B"
FOUNDATION PLAN**

- SCALE: 1" = 30'
- NOTES:
1. FINISH FLOOR REFERENCE ELEVATION = 100'-0" (EL. +315.50' VERIFY WITH CIVIL DWGS.)
 2. TOP OF INTERIOR COLUMN FOOTING ELEVATION = 95'-10" U.N.O.
 3. TOP OF EXTERIOR FOOTING ELEVATION = 99'-0" U.N.O.
 4. COORDINATE ALL DOOR OPENINGS AND LOCATIONS WITH ARCHITECTURAL DRAWINGS.
 5. VERIFY LOCATION OF ALL FOOTING STEPS WITH PANEL DRAWINGS PRIOR TO CASTING FOOTINGS.
 6. PROVIDE 9" CMU WALLS REINFORCE WITH #4 @ 24" O.C. SEE DETAIL SHEET S2.3.
 7. INDICATES 10 MIL VAPOR BARRIER UNDER SLAB ON GRADE REINFORCE WITH W.W.P. 60S W2/SW2.9.
 8. INDICATES TO PROVIDE LOAD PLATE BASKETS IN SPEED BAYS ONLY.
 9. INDICATES POUR STRIP. COORDINATE DIMENSIONS AND REINFORCEMENT WITH PLAN.

WALL FOOTING SCHEDULE		
MARK	FOOTING SIZE W x L x D	FOOTING REINFORCEMENT
WF1	2'-6"x3'-0"	3-#4 CONT. TOP & BOT. W/ #3 TIES @ 48" O.C.
WF2	2'-9"x3'-0"	6-#4 CONT. TOP & BOT. W/ #4 TIES @ 48" O.C.
WF3	4'-3"x3'-0"	9-#4 CONT. TOP & BOT. W/ #4 TIES @ 24" O.C.
WF4		SEE DETAIL 1-S2.3

COLUMN FOOTING SCHEDULE		
MARK	FOOTING SIZE W x L x D	FOOTING REINFORCEMENT
F6.00	6'-0"x6'-0"x1'-2"	6 - #6 E.W. BOT.
F6.25	6'-3"x6'-3"x1'-2"	6 - #6 E.W. BOT.
F6.50	6'-6"x6'-6"x1'-3"	7 - #6 E.W. BOT.
F15.00	15'-0"x15'-0"x3'-6"	18 - #6 E.W. TOP & BOT.

KEY PLAN

SCALE: NONE

