


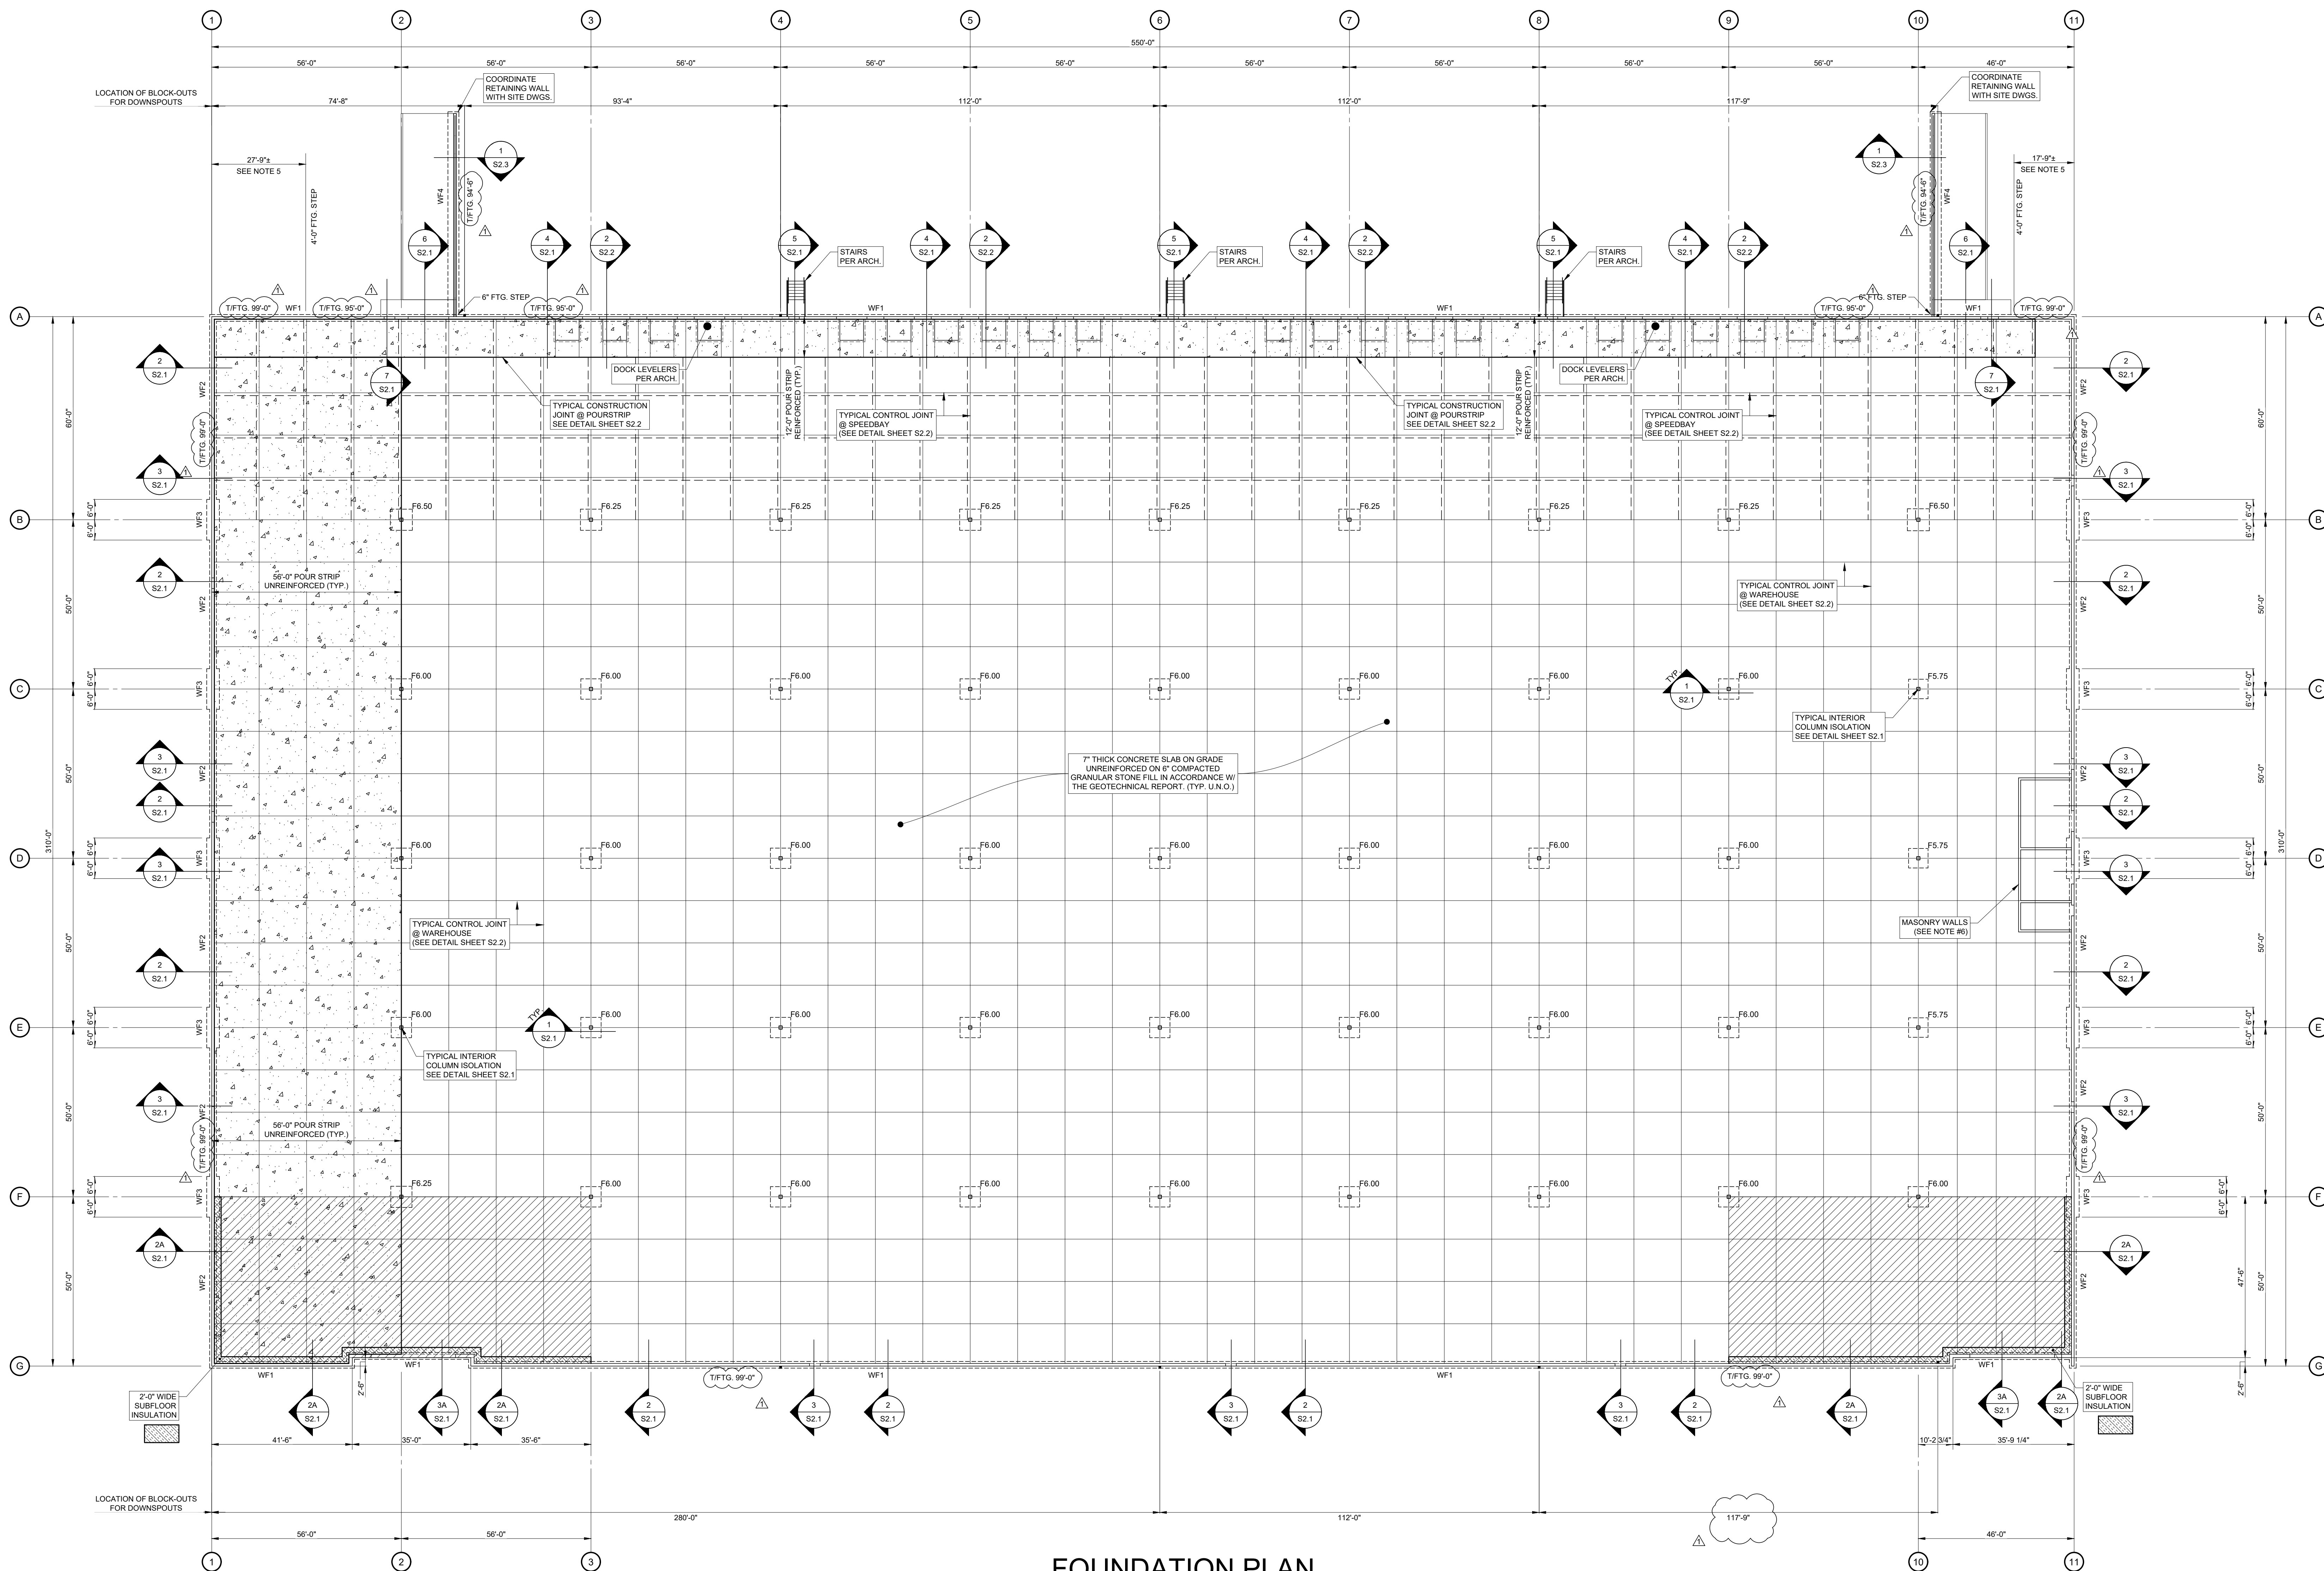

FOUNDATION PLAN

SCALE: 1" = 20'

NOTES:

1. FINISH FLOOR REFERENCE ELEVATION = 100'-0" (EL. +320.00') VERIFY WITH CIVIL DWGS.
2. TOP OF INTERIOR COLUMN FOOTING ELEVATION = 48'-0" U.N.O.
3. TOP OF EXTERIOR FOOTING ELEVATION = 90'-0" U.N.O.
4. COORDINATE ALL DOOR OPENINGS AND LOCATIONS WITH ARCHITECTURAL DRAWINGS.
5. VERIFY LOCATION OF ALL FOOTING STEPS WITH PANEL DRAWINGS PRIOR TO CASTING FOOTINGS.
6. PROVIDE 8" CMU WALLS REINFORCE WITH #4 @ 24" O.C. SEE DETAIL SHEET S2.3.
7. INDICATES 10 MIL VAPOR BARRIER UNDER SLAB ON GRADE. REINFORCE WITH W.W.F. 6X6-W2.6W/2.3.
8. INDICATES TO PROVIDE LOAD PLATE BASKETS IN SPEED BAYS ONLY.
9. INDICATES POUR STRIP. COORDINATE DIMENSIONS AND REINFORCEMENT WITH PLAN.

COLUMN FOOTING SCHEDULE		
MARK	FOOTING SIZE W x L x D	FOOTING REINFORCEMENT
F5.75	5'-0"x5'-0"x1'-0"	7 - #5 E.W. BOT.
F6.00	6'-0"x6'-0"x1'-1"	7 - #5 E.W. BOT.
F6.25	6'-3"x6'-3"x1'-1"	7 - #5 E.W. BOT.
F6.50	6'-6"x6'-6"x1'-2"	7 - #5 E.W. BOT.

WALL FOOTING SCHEDULE		
MARK	FOOTING SIZE W x D	FOOTING REINFORCEMENT
WF1	2'-4"x3'-0"	3 - #4 CONT. TOP & BOT. W/ #3 TIES @ 48" O.C.
WF2	2'-0"x3'-0"	4 - #4 CONT. TOP & BOT. W/ #4 TIES @ 48" O.C.
WF3	3'-0"x3'-0"	8 - #4 CONT. TOP & BOT. W/ #4 TIES @ 24" O.C.
WF4		SEE DETAIL 1-S2.3