


NO.	DATE	DESCRIPTION
12-04-23	COORDINATION SET	
12-08-23	75% PROGRESS SET	
01-26-24	90% PROGRESS SET	
02-09-24	PERMIT SET	

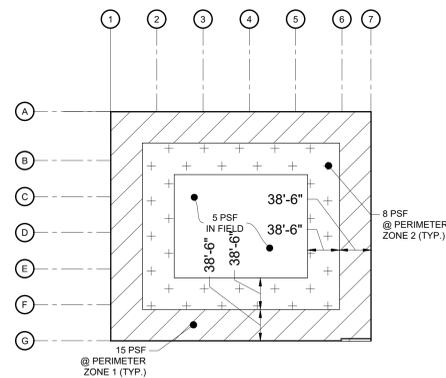


**UPLIFT DIAGRAM  
 ON JOIST GIRDER - MWFRS**

SCALE: NONE

NOTE:

- LOADS INDICATED REPRESENT NET MWFRS SERVICE UPLIFT VALUES.

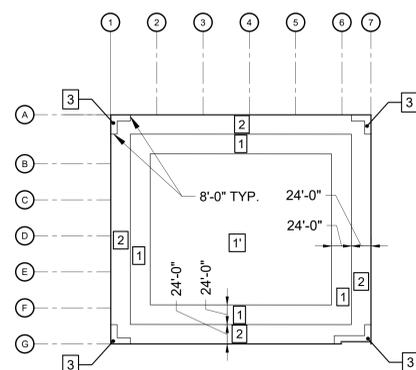


**UPLIFT DIAGRAM  
 ON JOISTS - C&C**

SCALE: NONE

NOTE:

- LOADS INDICATED IN TABLE REPRESENT NET COMPONENTS & CLADDING SERVICE UPLIFT VALUES, VARY WITH ZONE (SEE UPLIFT DIAGRAM ON JOISTS - C&C).
- USE PRESSURE VALUE BELOW OBTAINED UTILIZING ALLOWABLE EFFECTIVE AREA AS DEFINED BY ASCE 7, CHAPTER 30 FOR JOIST UPLIFT.

COMPONENTS & CLADDING NET UPLIFT									
NET SERVICE LEVEL SURFACE PRESSURES (PSF)									
ROOF ZONE / AREA	10 sf	20 sf	50 sf	100 sf	200 sf	350 sf	500 sf	1000 sf	1500 sf
NEGATIVE ZONE 1	-29.0	-26.8	-24.0	-21.8	-19.6	-17.8	-16.7	-16.7	-16.7
NEGATIVE ZONE 1'	-15.0	-15.0	-15.0	-15.0	-12.3	-10.2	-8.8	-6.2	-6.2
NEGATIVE ZONE 2	-39.6	-36.7	-33.1	-30.3	-27.5	-25.2	-23.8	-23.8	-23.8
NEGATIVE ZONE 3	-55.4	-49.8	-42.4	-36.7	-31.2	-26.6	-23.8	-23.8	-23.8

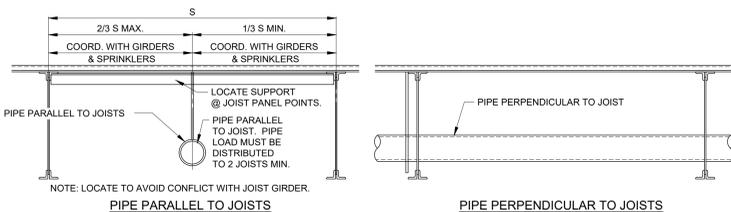


**SPRINKLER MAIN SUPPORT DETAIL**

SCALE: NO SCALE

NOTES:

- WHEN PARALLEL TO JOISTS 4" AND SMALLER PIPE MAY HANG FROM SINGLE JOIST, BUT MUST SPREAD OUT SO THAT THE SAME JOIST IS NOT AFFECTED BY MORE THAN ONE PIPE.
- WHEN PARALLEL TO JOISTS 6" PIPES SHOULD BE LOCATED AS SHOWN IN SPACE BETWEEN JOISTS AND SPREAD OUT SO THAT THE SAME JOIST IS NOT AFFECTED BY MORE THAN ONE PIPE. EXCEPTION: IF PIPE LOCATIONS ARE PROVIDED DURING DESIGN LOADS CAN BE MODIFIED TO ACCOUNT FOR PIPES.
- PIPES GANGED TOGETHER MUST BE REVIEWED BY EOR FOR SPECIFIC LOADS PRIOR TO JOIST FABRICATION.
- DO NOT SPACE HANGERS MORE THAN 15' APART.
- WHEN PERPENDICULAR, PIPES LARGER THAN 6" SHALL BE REVIEWED BY EOR FOR SPECIFIC LOADS PRIOR TO JOIST FABRICATION.
- DO NOT HANG WITH A BEAM CLAMP FROM BOTTOM CHORD OF JOIST OR GIRDER. BOTTOM CHORD HANGERS MUST BE CONCENTRIC, IF USED.
- HANGERS SHALL BE LOCATED WITHIN 3" OF PANEL POINTS OR JOIST SHALL BE REINFORCED PER TYP. REINF. AT POINT LOADS DETAIL.
- DO NOT SUPPORT MAINS FROM JOISTS THAT ALSO SUPPORT MECHANICAL EQUIPMENT WITHOUT E.O.R. REVIEW.

DETAIL BOOK REF.  
 S2.26  
 8/24/2023

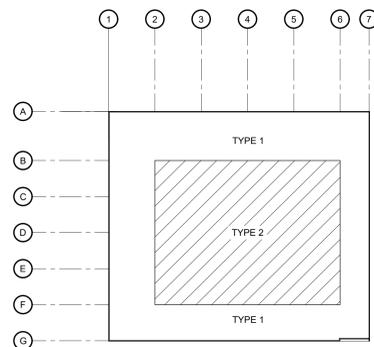


**ROOF DECK  
 ATTACHMENT LAYOUT PLAN**

SCALE: NONE

**WELDED ROOF DECK ATTACHMENT  
 FASTENER SCHEDULE**

TYPE #	FASTENERS "A" 5/8"Ø PUDDLE WELDS	FASTENERS "B" #10 TEK SCREWS
TYPE 1	36/7	3
TYPE 2	36/5	2

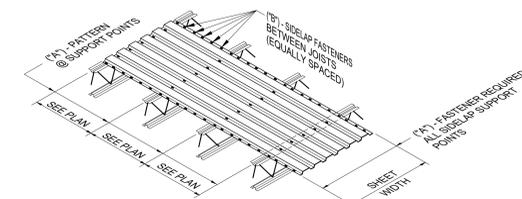


**TYPICAL ROOF DECK ATTACHMENT**

SCALE: NONE

NOTES:

- ROOF DECK PER PLAN MIN. THREE SPAN CONDITION.
- FASTEN THROUGH MULTIPLE SHEETS AT ALL END AND SIDE LAPS.
- END LAPS SHALL OCCUR ONLY AT SUPPORT POINTS.


DETAIL BOOK REF.  
 S2.19  
 1/27/2023

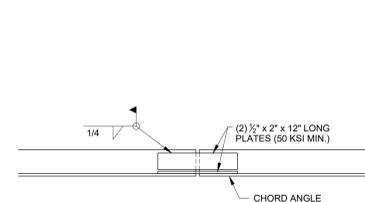

**TYPICAL DIAPHRAM  
 CHORD SPLICE**

SCALE: NONE

DETAIL BOOK REF.  
 S2.18  
 1/27/2023

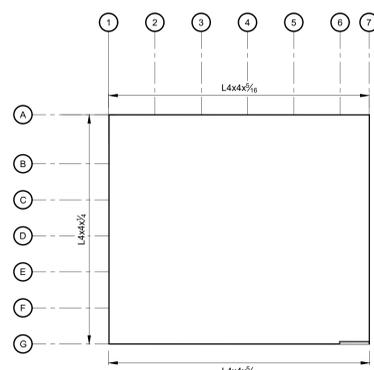


**DECK CHORD ANGLE  
 ATTACHMENT PLAN**

SCALE: NONE

NOTES:


- ALL CHORD ANGLES TO HAVE YIELD STRENGTH OF 50 KSI MIN.

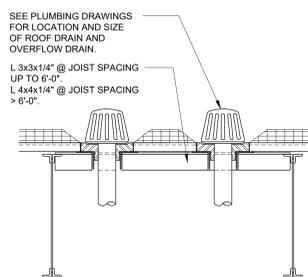

**TYPICAL ROOF  
 DRAIN SUPPORT**

SCALE: NONE

DETAIL BOOK REF.  
 S2.27  
 1/27/2023

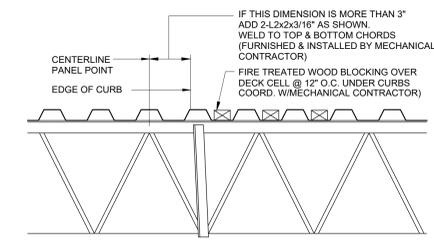


**JOIST REINFORCEMENT AT  
 ROOF TOP UNIT CURBS**

SCALE: NONE

- NOTE: DO NOT ADD EQUIPMENT TO JOISTS SUPPORTING SPRINKLER MAINS W/OUT E.O.R. APPROVAL.

DETAIL BOOK REF.  
 S2.23-N  
 1/27/2023

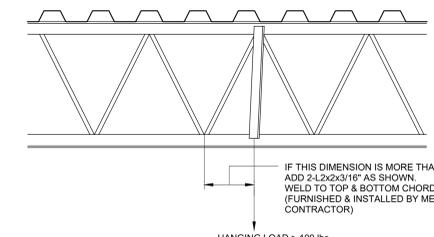


**JOIST REINFORCEMENT AT  
 HANGING LOADS**

SCALE: NONE

- NOTE: DO NOT ADD EQUIPMENT TO JOISTS SUPPORTING SPRINKLER MAINS W/OUT E.O.R. APPROVAL.

DETAIL BOOK REF.  
 S2.24  
 1/27/2023


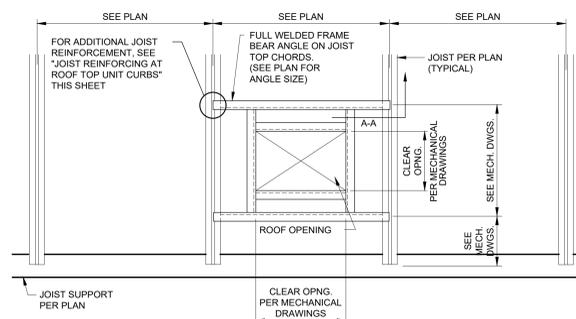


**TYPICAL ROOF OPENING**

SCALE: NO SCALE

- NOTE: THE UNIT IS SUPPORTED BY THE UNIT CURB WHICH MUST BE DESIGNED TO SPAN TO SUPPORTING MEMBERS.

DETAIL BOOK REF.  
 S2.23-N  
 1/27/2023

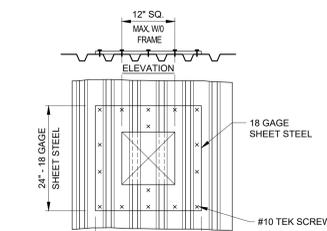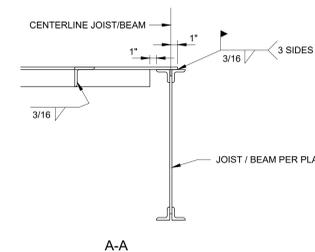

**ROOF DECK OPENING ≤ 12"**

SCALE: NO SCALE

- NOTE: WHERE DECK OPENINGS ARE GREATER THAN 12" ON ANY SIDE PROVIDE L4x4x1/4" FRAME @ EXHAUST FANS.

DETAIL BOOK REF.  
 S2.25  
 1/27/2023