




- Keyed Notes:**
- CONNECT HP TO CORRESPONDING RCU PER MANUFACTURERS REQUIREMENTS.
  - RE-CONNECT STORED CEILING MOUNTED ELECTRICAL DEVICES. MODIFY/ EXTEND CIRCUITRY AS REQUIRED.
  - REMOVE WALL MOUNTED DEVICES TO ACCOMMODATE CEILING REPLACEMENT. PRESERVE AND REINSTALL DEVICES AFTER CEILING REPLACEMENT. EXTEND / MODIFY CIRCUITRY AS NECESSARY. COORDINATE ALL WORK WITH GENERAL CONTRACTOR.

- General Notes:**
- REFER TO DRAWING AE050 FOR GENERAL NOTES
  - REFER TO AE600 PANEL BOARD SCHEDULES FOR ADDITIONAL INFORMATION

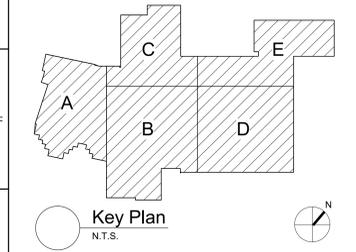

S.E.D. Control No. 62-18-01-06-0-007-019

| Rev. No. | Date | Description |
|----------|------|-------------|
|          |      |             |
|          |      |             |
|          |      |             |



complex world | CLEAR SOLUTIONS

Tetra Tech Engineers, Architects & Landscape Architects, P.C.

**BID SET**



Walkkill Central School District  
Walkkill, New York

Reconstruction to:  
Walkkill Senior High School

First Floor Power Plan - Area E

|                     |                     |                 |
|---------------------|---------------------|-----------------|
| Drawn By:<br>Author | Date:<br>06/30/2023 | Drawing Number: |
| Project No.:        | AE162               |                 |
| 17597-22002         |                     |                 |

1 First Floor Power Plan - Area E  
1/8" = 1'-0"