



10 SPF Equipment Support Detail
1 1/2" = 1'-0"

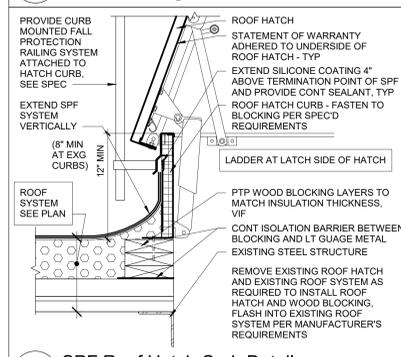


11 SPF Roof Hatch Curb Detail
1 1/2" = 1'-0"

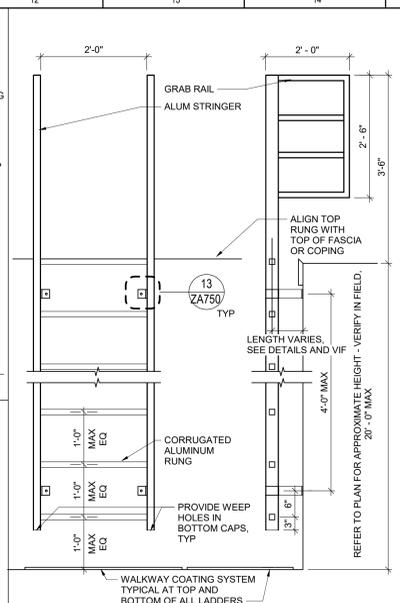


6 Typ Exterior Alum Ladder Detail
3/4" = 1'-0"


NOTES:
- VERIFY LADDER HEIGHT IN FIELD PRIOR TO FABRICATION.
- REFER TO SPECIFICATION SECTION 05 50 00 FOR LADDER INFORMATION AND REQUIREMENTS INCLUDING DELEGATED DESIGN.
- ALL OPEN TUBE ENDS TO BE CAPPED/SEALED CLOSED.
- ALL JOINTS TO BE FULLY WELDED.
- VERIFY BRACKET LENGTH IN FIELD REQUIRED TO CLEAR EXISTING OVERHANGS, PROJECTIONS AND EXISTING WALL SYSTEM COMPONENTS.
- COORDINATE EXACT LADDER LOCATIONS IN FIELD TO AVOID EXISTING CONFLICTS ON WALL AND ROOF PENETRATIONS.
- PROVIDE ANCHORAGE AND BLOCKING TO WITHSTAND 900 LBS LIVE LOAD WITHOUT ANY DISTRESSING CONNECTIONS.

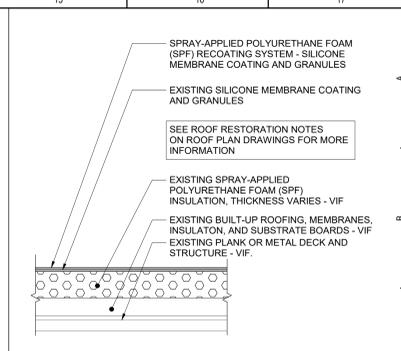


1 Roof System RS-3 (SPF)
1 1/2" = 1'-0"

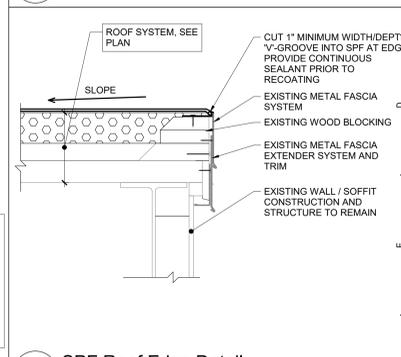


2 SPF Roof Edge Detail
1 1/2" = 1'-0"

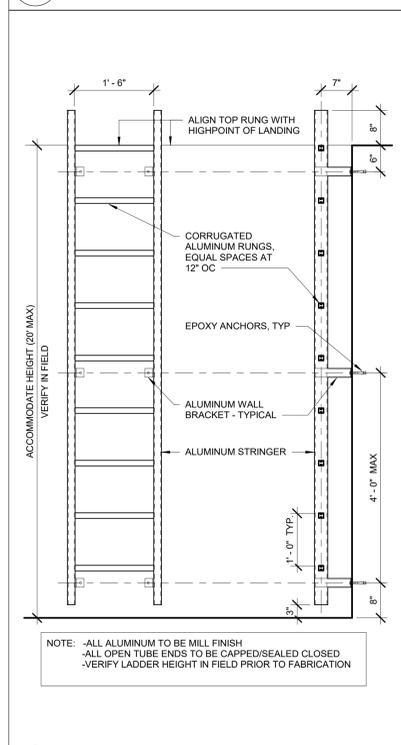


12 Typical Interior Aluminum Ladder Detail
3/4" = 1'-0"

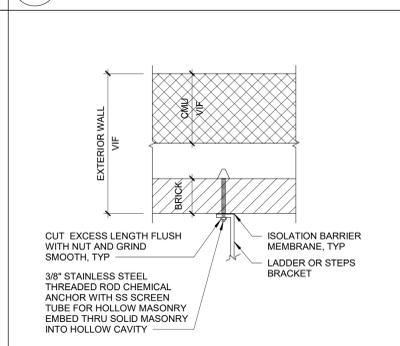


7 Ladder Anchor Detail at Exterior
1 1/2" = 1'-0"

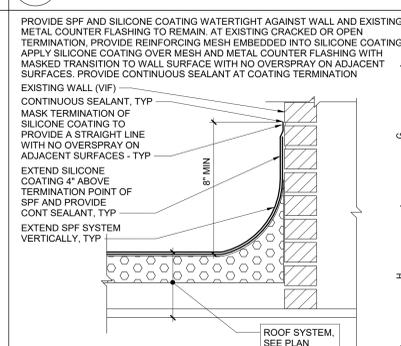


3 SPF Base Flashing Detail at Wall
1 1/2" = 1'-0"

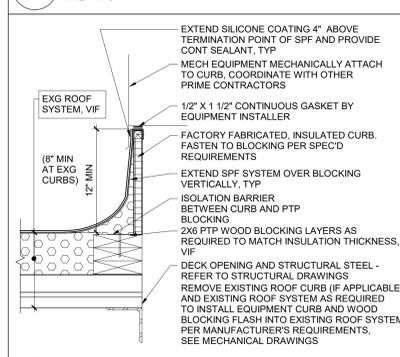


8 SPF Equipment Curb Detail
1 1/2" = 1'-0"

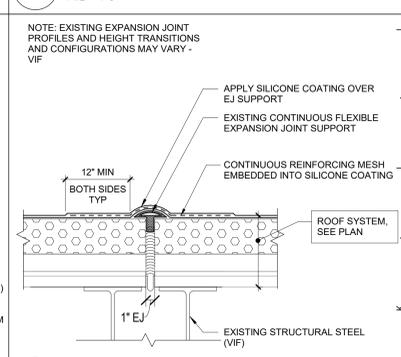


4 SPF Expansion Joint Detail
1 1/2" = 1'-0"

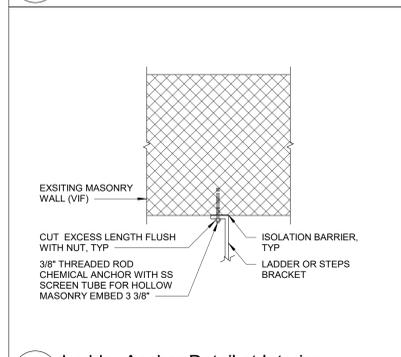

13 Ladder Anchor Detail at Interior
1 1/2" = 1'-0"

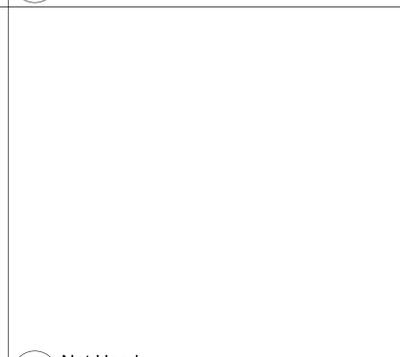

9 Not Used
1 1/2" = 1'-0"

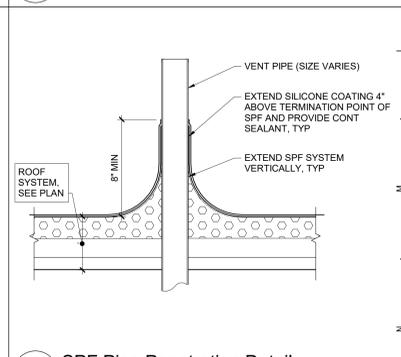

5 SPF Pipe Penetration Detail
1 1/2" = 1'-0"

S.E.D. Control No. 62-18-01-06-0-007-019
S.E.D. Control No. 62-18-01-06-0-002-015
S.E.D. Control No. 62-18-01-06-0-005-017

Rev. No.	Date	Description
1	11/16/23	SED ADD NO. 1

WALKKILL CENTRAL SCHOOL DISTRICT

complex world | CLEAR SOLUTIONS

Tetra Tech Engineers, Architects & Landscape Architects, P.C.

TETRA TECH ARCHITECTS & ENGINEERS

Walkkill Central School District
Walkkill, New York

Reconstruction to:
Walkkill Senior High School
John G. Borden Middle School
Plattekill Elementary School

Roof Details

Drawn By: RAV/CEC Date: 06/30/2023 Drawing Number: 17597-22002

ZA750

BID SET