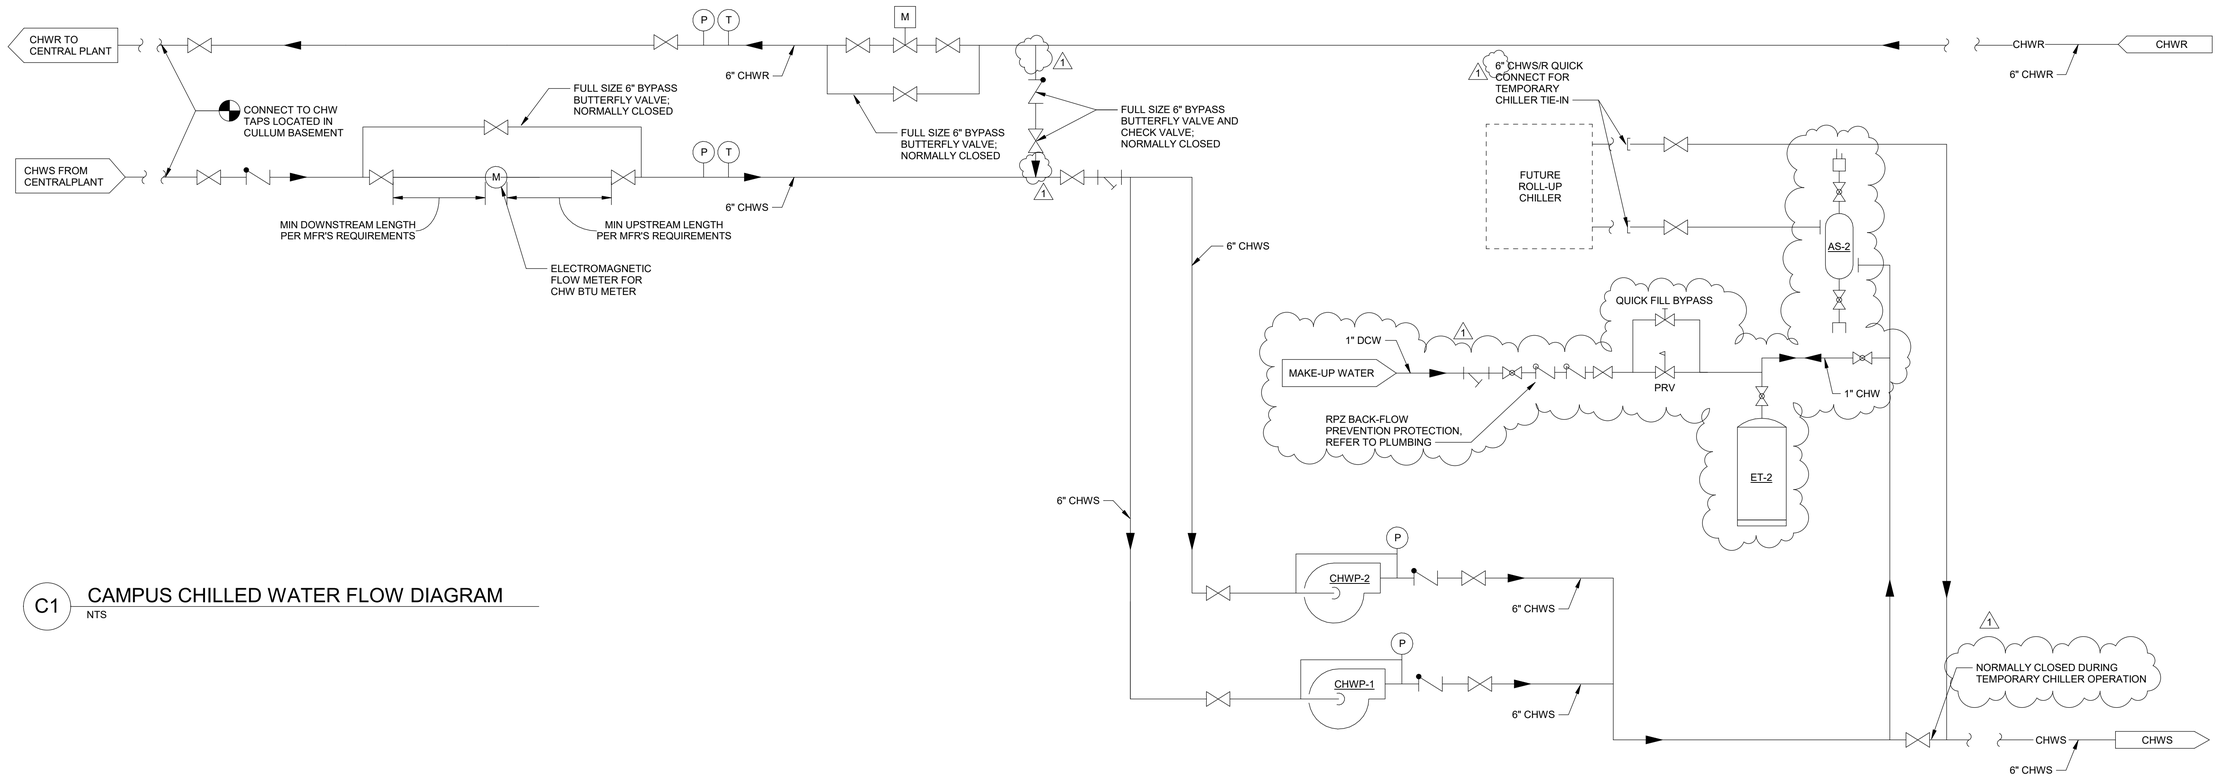

C1 CAMPUS CHILLED WATER FLOW DIAGRAM

NTS

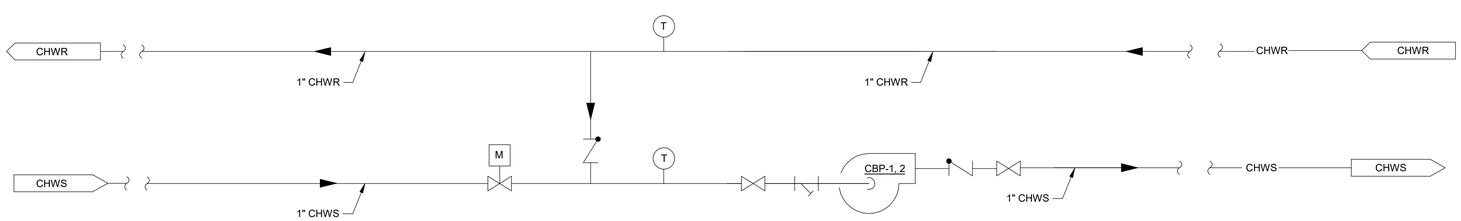

NOTES:

1. PROVIDE CHILLED BEAM WITH CONDENSATION SENSOR. REFER TO CONTROLS.

A1 CHILLED BEAM CHILLED WATER FLOW DIAGRAM (CBP-1, 2)

NTS

US Army Corps of Engineers ®

MARK	ISSUED VIA AMENDMENT DESCRIPTION	DATE
1		06/16/2023

DESIGNED BY: N. SLEEM
DRAWN BY: C. DEVANEY
CHECKED BY: D. GORDON
SUBMITTED BY:
SIZE: ANSI D
FILE NAME:

ISSUE DATE: 01 MARCH 2023
SOLICITATION NO.: W912DS-19-R-0014
CONTRACT NO.: W912DS-19-C-0031-L
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
LINCOLN HALL
WEST POINT, NEW YORK

JACOBS / EWING COLE A Joint Venture

BUILDINGS 605/607 RENOVATION - LINCOLN HALL

CHILLED WATER FLOW DIAGRAMS
CAMPUS CHW AND CHILLED BEAM LOOP

SHEET ID

M-702

REVISED RTA SUBMISSION 03/01/2023