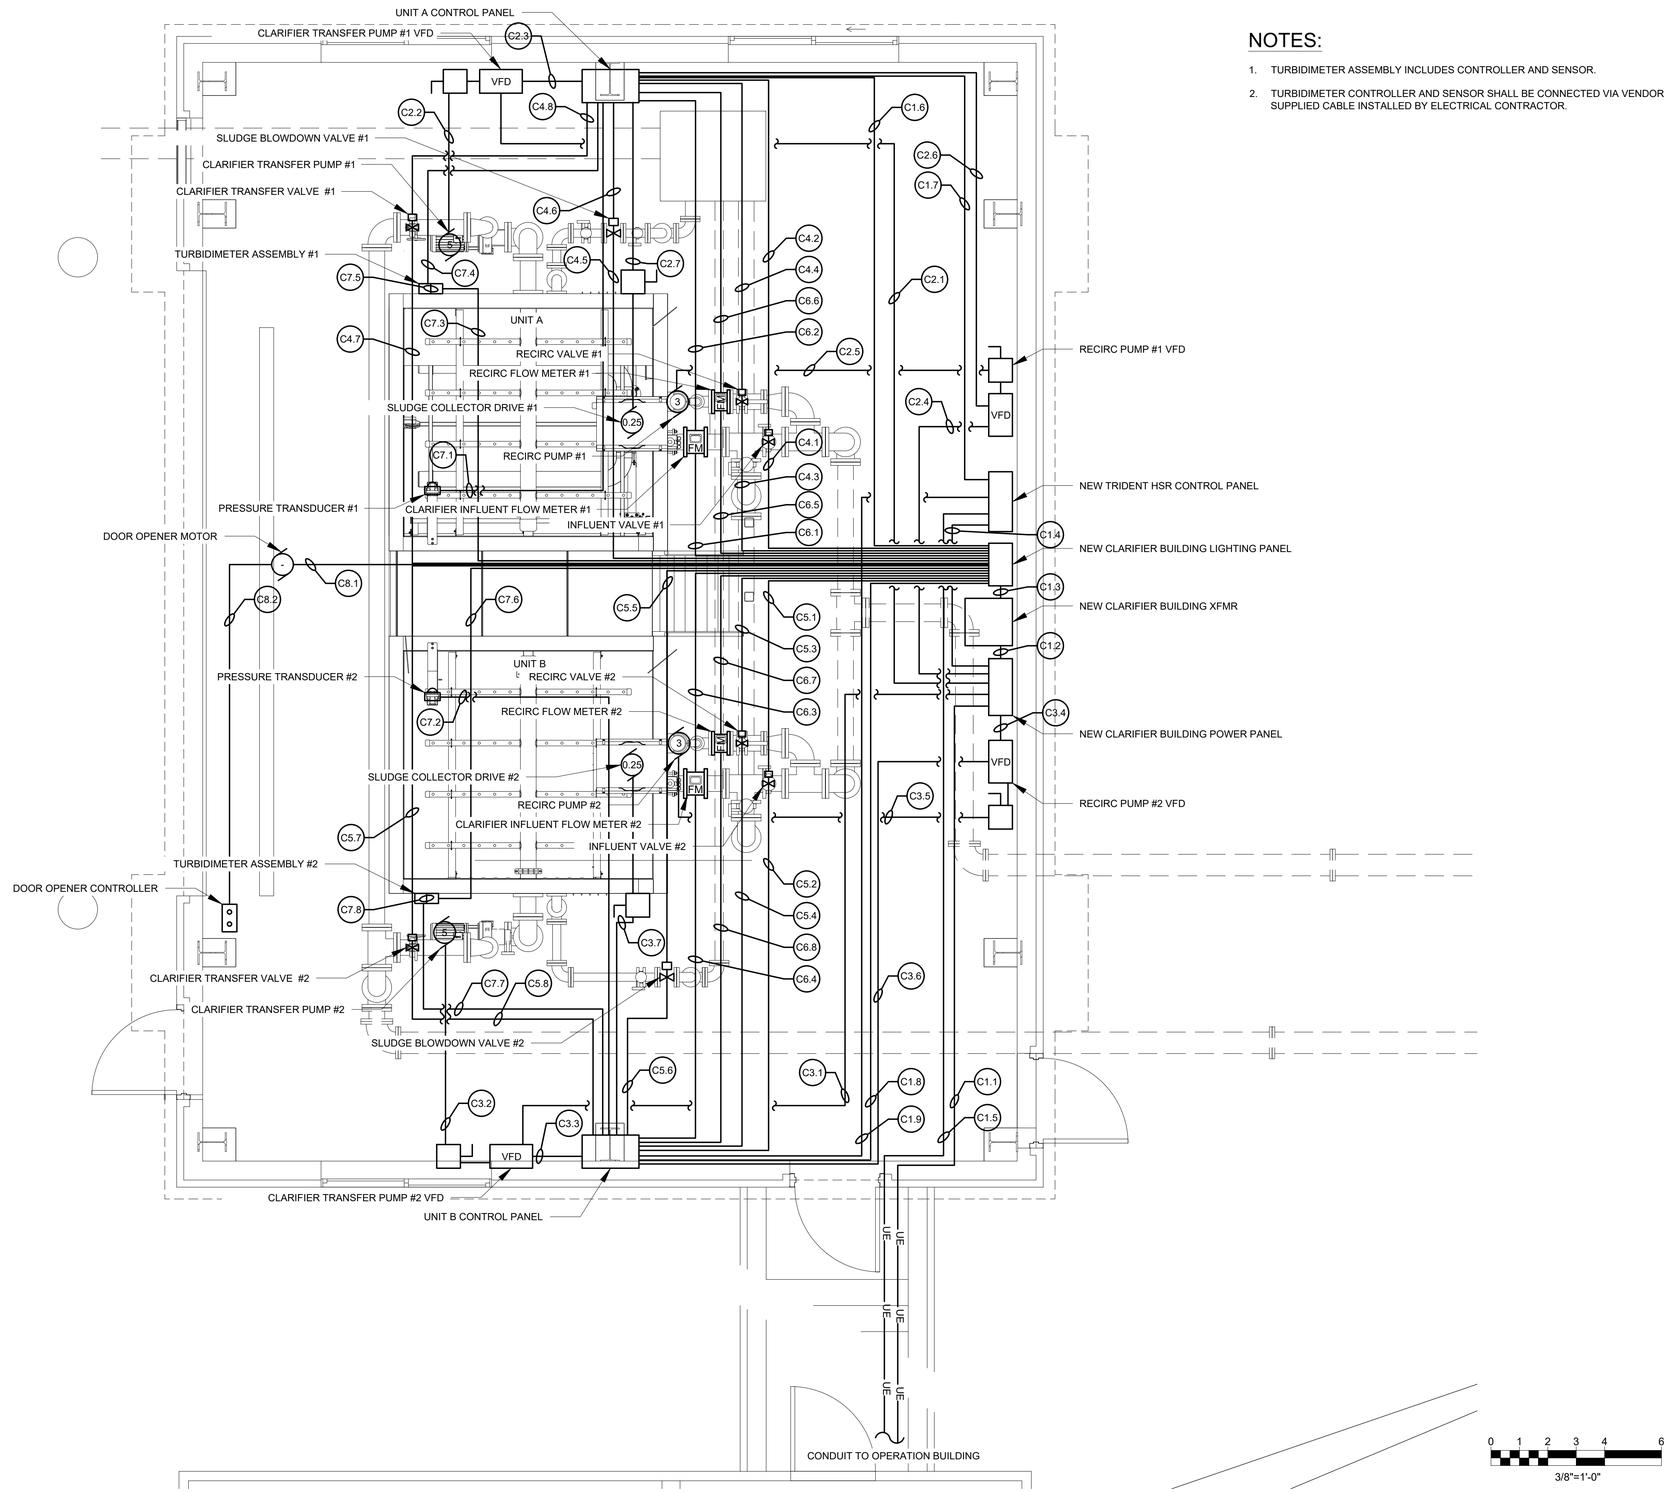

NOTES:

1. TURBIDIMETER ASSEMBLY INCLUDES CONTROLLER AND SENSOR.
2. TURBIDIMETER CONTROLLER AND SENSOR SHALL BE CONNECTED VIA VENDOR SUPPLIED CABLE INSTALLED BY ELECTRICAL CONTRACTOR.

DATE: 9/30/2024
DRAWN BY: EMB
SCALE: AS SHOWN
REVIEWED BY: RF
PROJECT NO.: ----
FILE:

DELAWARE ENGINEERING, D.P.C.
CIVIL AND ENVIRONMENTAL ENGINEERING
28 MADISON AVENUE EXTENSION, ALBANY, NY 12203 - 518.452.1290
55 SOUTH MAIN ST, ONEONTA, NY 13820 - 607.432.8073
31 NORTH MAIN STREET, LIBERTY, NY 12754 - 845.747.9952
6 TOWNSEND STREET, WALTON, NY 13856 - 607.865.9235
16 EAST MARKET ST., RED HOOK, NY 12571 - 518.452.1290
548 BROADWAY, MONTICELLO, NY 12701 - 845.791.7777

REVISIONS

NO.	DATE	DESCRIPTION

RHINEBECK WTP
PLANT IMPROVEMENTS
VILLAGE OF RHINEBECK
DUTCHESS COUNTY, NEW YORK

NEW CLARIFIER BUILDING
ELECTRICAL PLAN

SHEET:
E-105

WARNING – IT IS A VIOLATION OF NEW YORK EDUCATION LAW SECTION 7209.2, FOR ANY PERSON, UNLESS HE IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER OR LAND SURVEYOR, TO ALTER THIS DOCUMENT IN ANY WAY. IF ALTERED THE ALTERING PERSON SHALL COMPLY WITH THE REQUIREMENTS OF NEW YORK EDUCATION LAW, SECTION 7209.2.