


NOTES:


1. DEHUMIDIFIER INCLUDES SJT, L7-30P, 10FT POWER CHORD. PROVIDE 277V, 1Ø RECEPTACLE WITHIN 10FT OF UNIT.

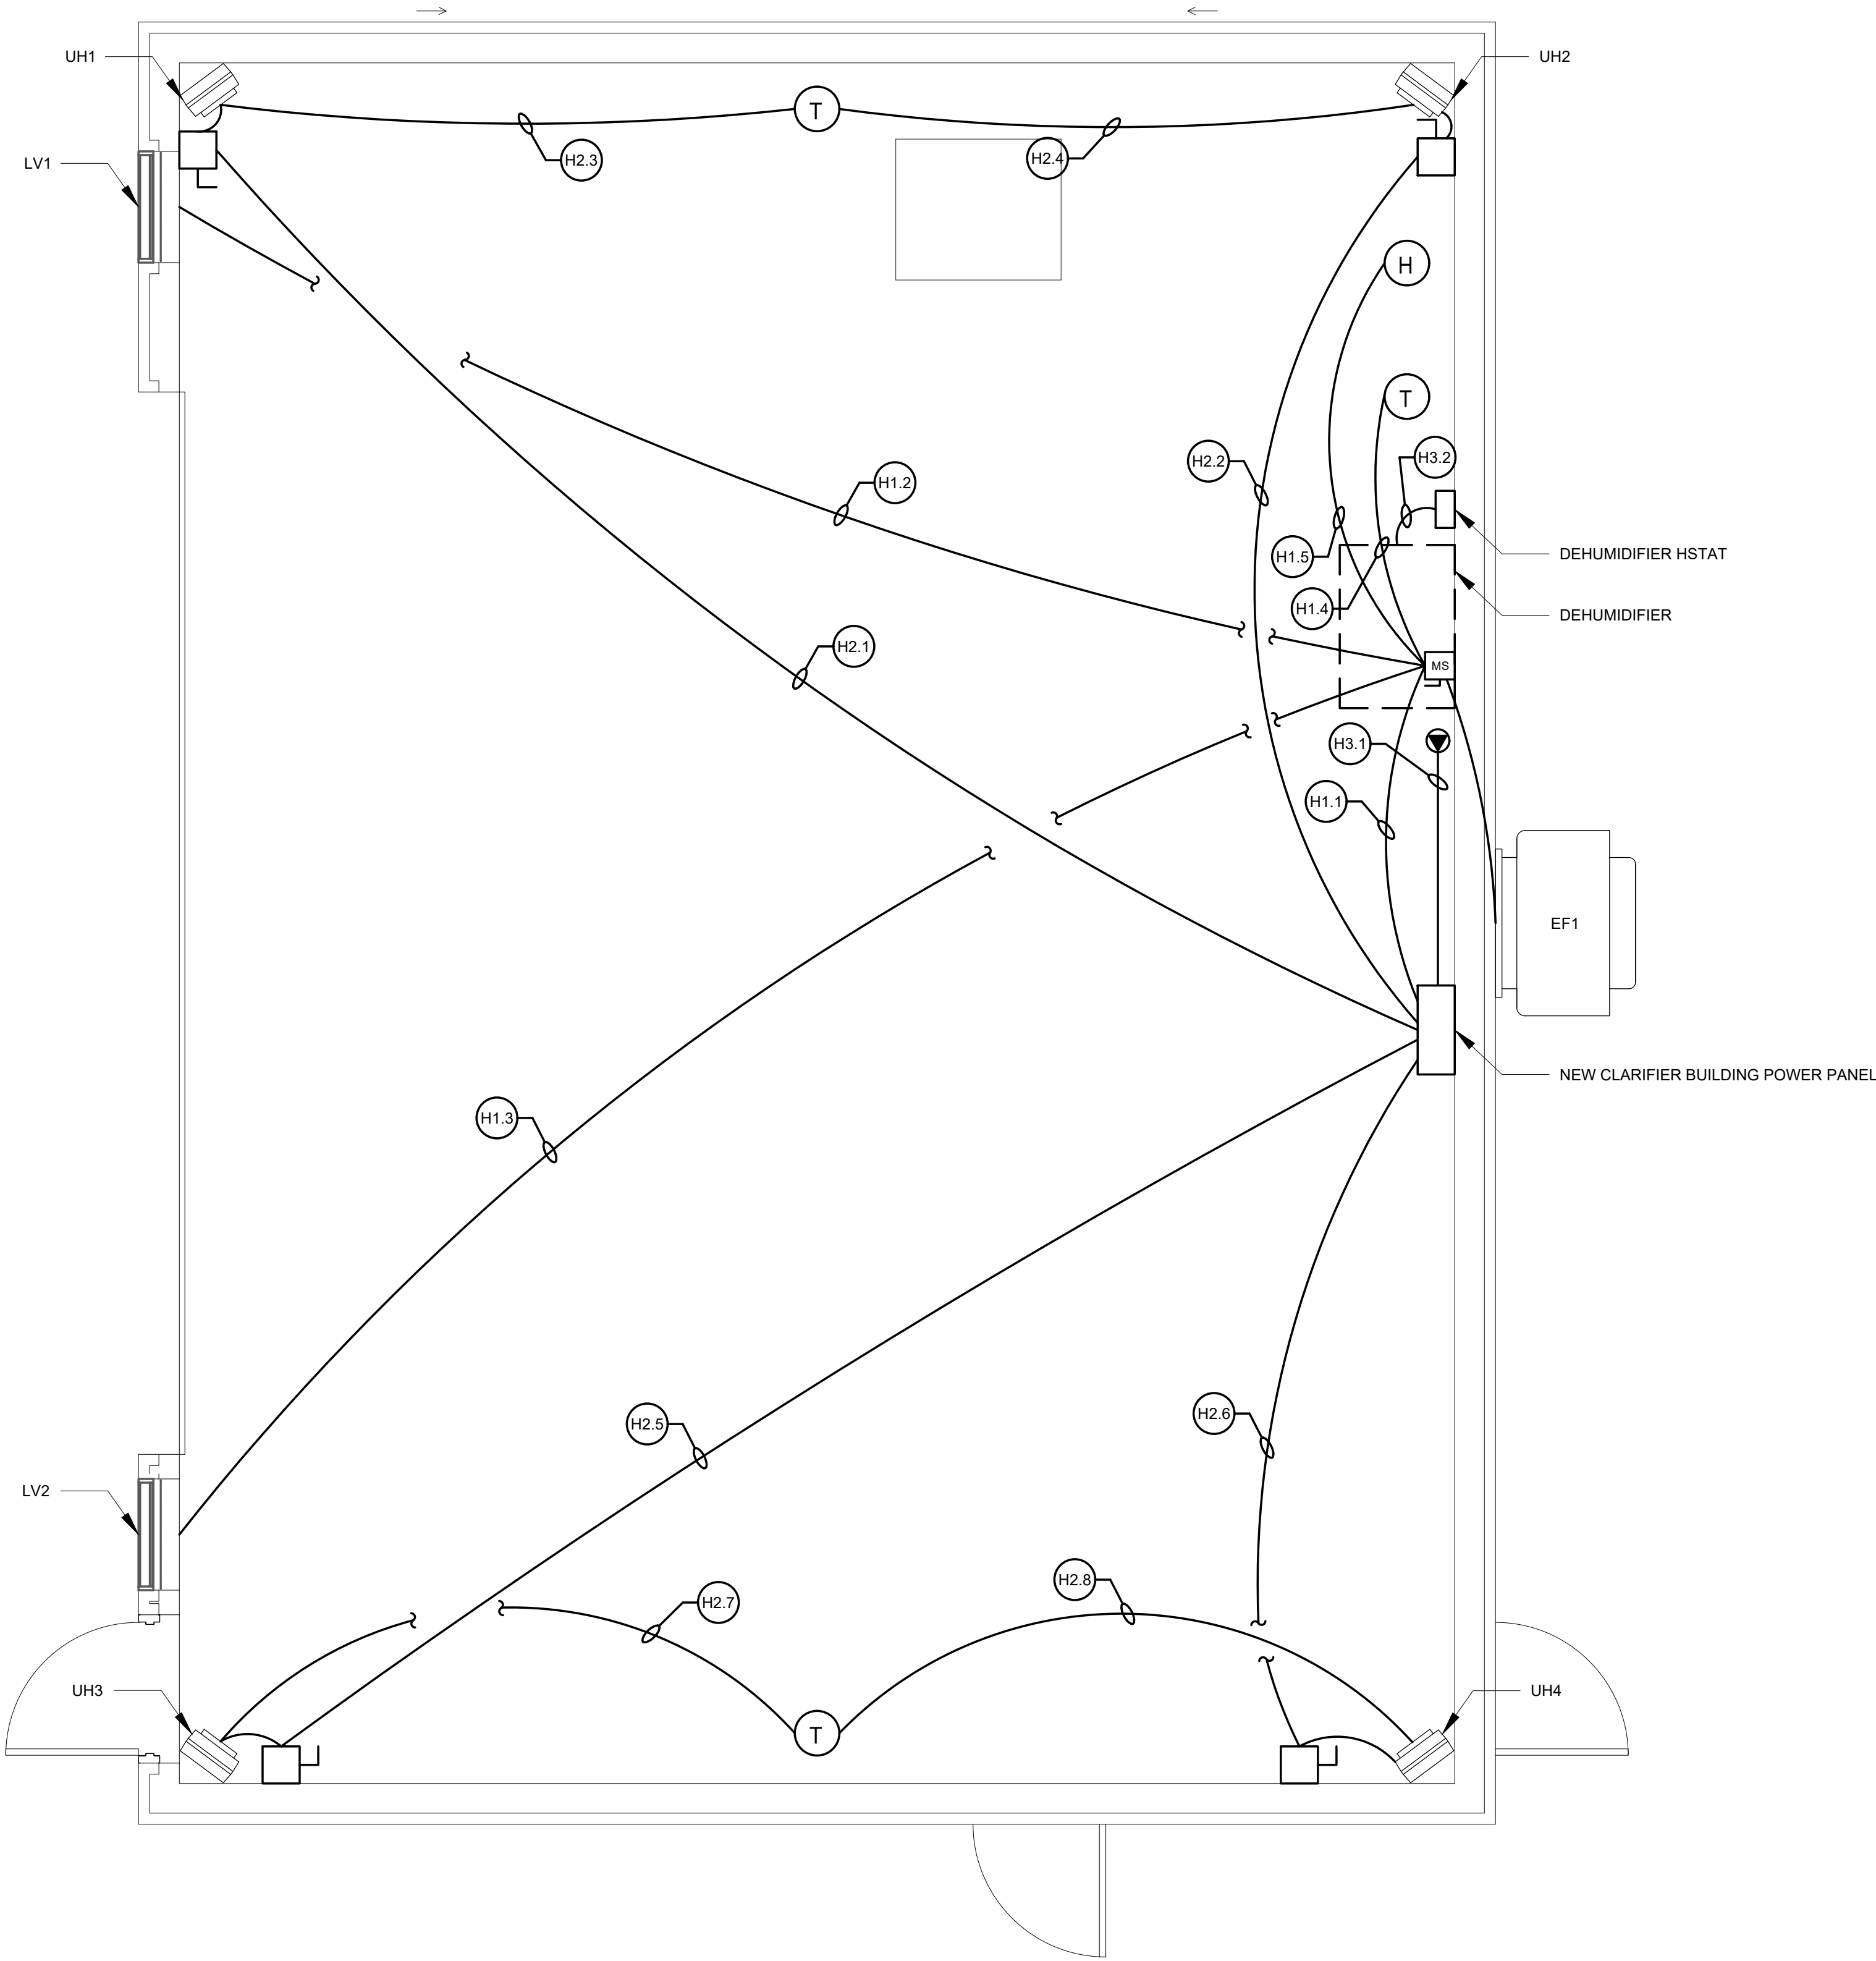

DATE:	9/30/2024
DRAWN BY:	EMB
SCALE:	AS SHOWN
REVIEWED BY:	RF
PROJECT NO.:	----
FILE:	

**DELAWARE
ENGINEERING, D.P.C.**
CIVIL AND ENVIRONMENTAL ENGINEERING

28 MADISON AVENUE EXTENSION, ALBANY, NY 12203 - 518.452.1290
55 SOUTH MAIN ST. ONEONTA, NY 13820 - 607.432.8073
31 NORTH MAIN STREET, LIBERTY, NY 12754 - 845.747.8862
110 WEST MAIN STREET, NEW PALTZ, NY 12561 - 845.255.8888
16 EAST MARKET STREET, RED HOOK, NY 12571 - 518.452.1290
548 BROADWAY, MONTICELLO, NY 12701 - 845.791.7777

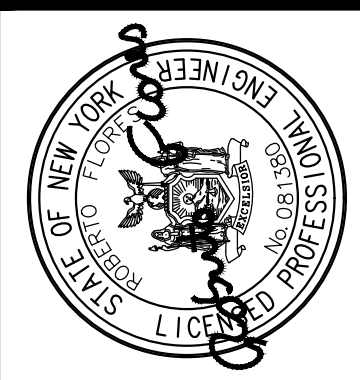

REVISIONS		DESCRIPTION
NO.	DATE	

RHINEBECK WTP
PLANT IMPROVEMENTS
VILLAGE OF RHINEBECK
DUTCHESS COUNTY, NEW YORK

NEW CLARIFIER BUILDING
HVAC ELECTRICAL PLAN