JOB NO	MODEL NUMBER	DRAWN BY	SCHEMATIC TYPE	DESCRIPTION OF OPERATION
6784502	SC-110110MA		INSTALL	120V 1 Phase w/ control for 1 Exhaust Fan, Exhaust on in Fire, Lights out in Fire, Relay On/Off with Supply Fan, Fantal On/Off Thermostatically Controlled. Room temperature sensor shipped loose for Field installation.
JOB NAME: Peekskill Firehouse Kitchen I...	DATE: 5/8/2024		DWG NO: ECP #1-1	

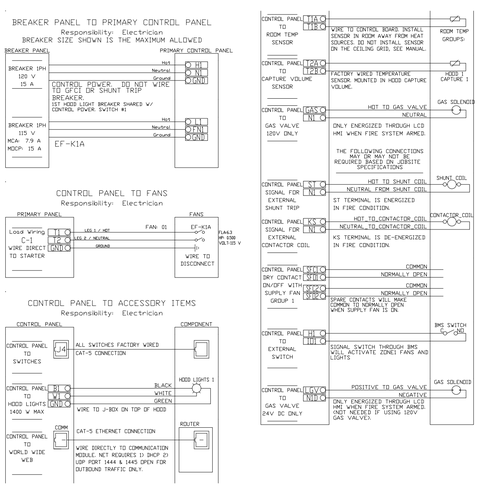

JOB NO	MODEL NUMBER	DRAWN BY	SCHEMATIC TYPE	DESCRIPTION OF OPERATION
6784502	SC-110110MA		INSTALL	120V 1 Phase w/ control for 1 Exhaust Fan, Exhaust on in Fire, Lights out in Fire, Relay On/Off with Supply Fan, Fantal On/Off Thermostatically Controlled. Room temperature sensor shipped loose for Field installation.
JOB NAME: Peekskill Firehouse Kitchen I...	DATE: 5/8/2024		DWG NO: ECP #1-2	

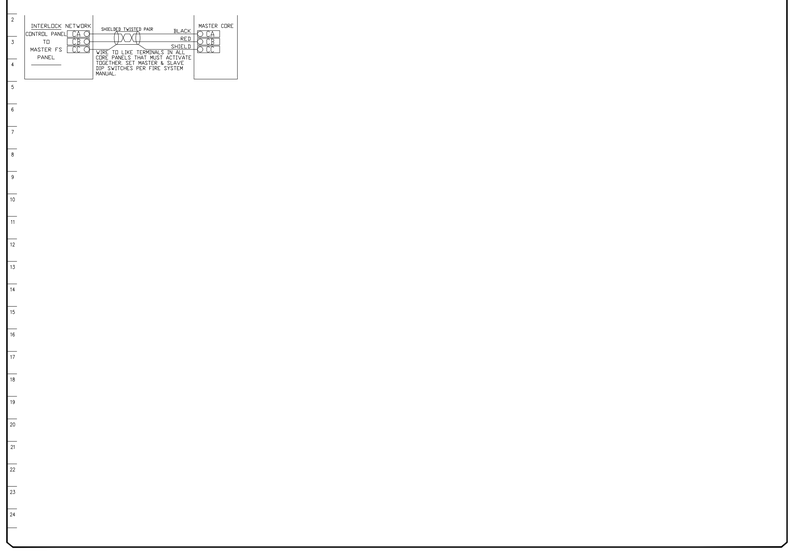

JOB NO	MODEL NUMBER	DRAWN BY	SCHEMATIC TYPE	DESCRIPTION OF OPERATION
6784502	SC-110110MA		INSTALL	120V 1 Phase w/ control for 1 Exhaust Fan, Exhaust on in Fire, Lights out in Fire, Relay On/Off with Supply Fan, Fantal On/Off Thermostatically Controlled. Room temperature sensor shipped loose for Field installation.
JOB NAME: Peekskill Firehouse Kitchen I...	DATE: 5/8/2024		DWG NO: ECP #2-1	

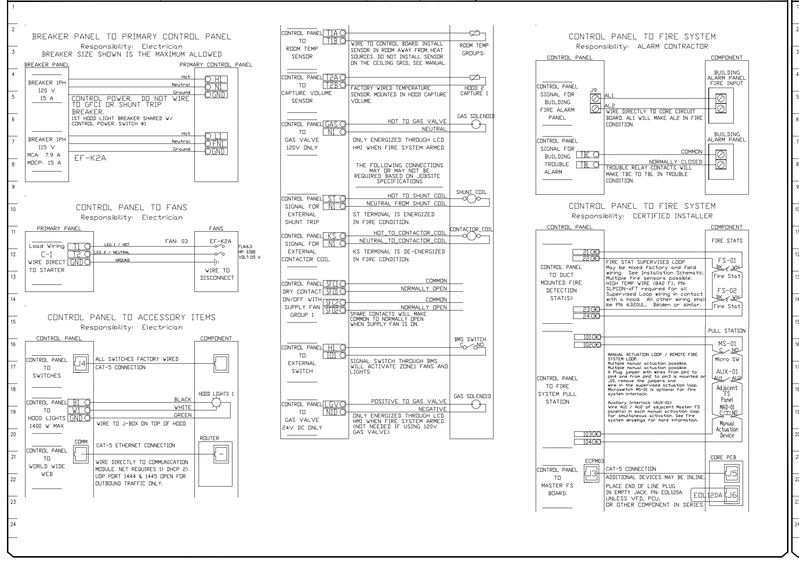

JOB NO	MODEL NUMBER	DRAWN BY	SCHEMATIC TYPE	DESCRIPTION OF OPERATION
6784502	SC-110110MA		INSTALL	120V 1 Phase w/ control for 1 Exhaust Fan, Exhaust on in Fire, Lights out in Fire, Relay On/Off with Supply Fan, Fantal On/Off Thermostatically Controlled. Room temperature sensor shipped loose for Field installation.
JOB NAME: Peekskill Firehouse Kitchen I...	DATE: 5/8/2024		DWG NO: ECP #2-2	

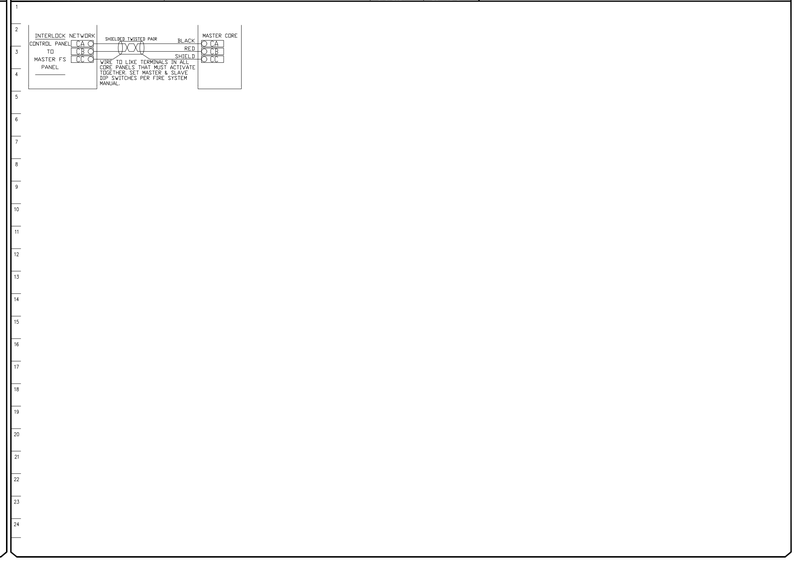

REVISIONS

DESCRIPTION	DATE

econ·air
N. NJ & S. NY
www.econair.com
: Rutherford, NJ 07070 PHONE: (201) 995 - 4962 FAX: 9197475024 EMAIL: regfl@econair.com

Peekskill Firehouse Kitchen Incubator R2
701 Washington Street,
Peekskill, NY, 10566

DATE: 7/30/2024
DWG.#: 6784502
DRAWN BY: billy.gast
SCALE: N.T.S.
MASTER DRAWING
SHEET NO. 9

JTA
JOSEPH THOMPSON
ARCHITECT

Joseph G. Thompson Architect, PLLC
108 N Division Street, Ste 100
Peekskill, New York 10566

PH: (845)532-8156
EM: joe@jthompsonarch.com

NOTES:

IT IS A VIOLATION OF THE LAW FOR ANY PERSON, UNLESS ACTING UNDER THE DIRECTION OF A LICENSED ARCHITECT OR ENGINEER, TO ALTER AN ITEM IN ANY WAY. IF AN ITEM BEARING THE SEAL OF AN ARCHITECT OR ENGINEER IS ALTERED, THE ALTERING ARCHITECT OR ENGINEER SHALL AFFIX TO HIS ITEM THE SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY HIS SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION.

DO NOT SCALE DRAWINGS. WRITTEN DIMENSIONS GOVERN.

© JOSEPH G THOMPSON ARCHITECT, PLLC. ALL RIGHTS RESERVED.

SEAL
ERIC D. FELLENZER, P.E.
NY PROFESSIONAL ENGINEER
NO. 073084-1
ISSUED 1995 EXP. 8/25

PEEKSKILL FIREHOUSE KITCHEN INCUBATOR

City of Peekskill (Owner)
701 Washington Steet
Peekskill, New York 10566
S-B-L: 32.20-9-1
City of Peekskill - Westchester County

DRAFT CONSTRUCTION DOCUMENT - NOT FOR PERMIT OR CONSTRUCTION

UNAUTHORIZED ALTERATION OR ADDITION TO A PLAN BEARING A LICENSED PROFESSIONAL ENGINEER'S SEAL IS A VIOLATION OF SECTION 7209, SUB-DIVISION 2 OF THE N.Y. STATE EDUCATION LAW.
FELLENZER ENGINEERING, LLP
CERTIFICATE OF AUTHORIZATION #: 0017795

FELLENZER ENGINEERING LLP
www.fellp.com

22 Mulberry St., Suite 2A,
Middletown, NY 10940
t 845-343-1481 fx 845-343-4986

181 Church St., Suite 100,
Poughkeepsie, NY 12601
t 845-454-9704 fx 855-320-8735

DESIGNED BY:	DRAWN BY:	APPROVED BY:	FE PROJECT #:
RW	JCL	EDF	23-369

⅛" ¼" ½" 0 1" 2"
REFERENCE SCALE

Date: September 17, 2024
Revisions:

H4.09

File Name: F:\2023\23-369 Peekskill Firehouse Kitchen Incubator\HVAC\H4.01 - H4.12 (CAPTIVEAIRE).dwg (Layout: H4.09)
Date: Tue, Sep 17, 2024 - 10:09 AM (Name: wpb)