

## Town of Montgomery Police Station

106 Bracken Road, Montgomery New York, 12549

### ADDENDUM #3: April 25, 2025

#### General Summary:

1. **As a notification**, specification section 00 01 10 Table of Contents has been updated and included for reference purposes.
2. **As a notification**, specification sections 10 51 13 Metal Lockers and 10 56 13 Metal Storage Shelving have been revised to clarify the requirements.
3. **As a notification**, specification section 32 31 13 Chain Link Fences and Gates has been revised; the update replaces the previous specification.
4. **As a notification**, Architectural drawing A-002 - Drawing List has been updated and included for reference purposes.
5. **As a notification**, A-201 - First Floor Plan, A-700 - First Floor Finish Plan, A-703 - First Floor Paint Plan, A-800 - Doors & Window Schedule, A-900 - First Floor Furniture Plan, A-902 - Interior Sign Schedule, and A-903 - First Floor were updated.
6. **As a notification**, civil drawings 2 of 6 – Site Plan, 3 of 6 – Grading, Utility, and Lighting Plan, and 4 of 6 – Erosion and Sediment Control Plan have been updated to include additional information on the guard rail and chain link fence clarification. Additionally, the scales on the grading/utility plans have been updated.
7. **As a notification**, any outstanding questions that have been submitted prior to the issuance of this Addendum will be addressed in a forthcoming addendum.

#### Contractor Questions:

1. Could you please confirm who is supplying the wireless locks and gateways for the doors labeled "ES"? These doors are marked as "ES" on the schedule.

**RESPONSE:** The GC is responsible for running all wiring including network wiring and supplying and installing the electronic strikes for the access control system. The owner is responsible for supplying and installing the access control system including, but not limited to, gateways and card readers.

2. Who is responsible for the installation of the wireless locks and gateways? Please note that each gateway requires a CAT6 cable run.  
**RESPONSE:** See response to question #1.
3. Could you please clarify which hollow metal (HM) doors are specified as bullet-resistant?  
**RESPONSE:** The bullet resistant HM door specification has been removed. There are no Bullet Resistant doors in this project.
4. Could you please clarify which windows are required to be soundproof?  
**RESPONSE:** The only window required to be soundproof is window type E between room #104 & #105.
5. Section 10 51 13 – Metal Lockers: The spec calls for lockers to be disassembled, stored and reinstalled. Please clarify these lockers on the plans.  
**RESPONSE:** No evidence lockers are to be disassembled and reused. All lockers are to be new, *see* revised specification section 10 51 13 - Metal Lockers attached to this addendum.
6. Section 10 51 13 – Metal Lockers: There are (4) evidence lockers shown on the plans. Please clarify which door configuration is required for each.  
**RESPONSE:** All lockers are to be new, *see* revised specification section 10 51 13 - Metal Lockers attached to this addendum.
7. Section 10 51 13 – Metal Lockers: There are (4) “firearm lockers” shown on the plans. Please clarify what interior components are required.  
**RESPONSE:** Existing Firearm Lockers are to be relocated.
8. Please confirm the anticipated start date of construction.  
**RESPONSE:** Once all bids have been reviewed and the owner accepts a bid, the owner intends to enter into contract with the accepted bidder and begin work, if the lowest responsible bidder’s price is within the Town’s anticipated project budget. The Town has elected not to release the anticipated project budget.
9. Please advise if M/WBE and/or SDVOB participation is required.  
**RESPONSE:** There are no W/MBE or SDVOB requirements for this project.
10. Please confirm this building does not require a sprinkler system.  
**RESPONSE:** Confirmed, no sprinkler is required for this building.
11. Is there a preferred fire alarm vendor?  
**RESPONSE:** There is no preferred fire alarm vendor.



12. Will the BMS/Controls & Fire Alarm systems be required to be tied into the adjacent building?  
**RESPONSE:** No, there is no fire alarm or BMS control tie-in with the adjacent buildings.
13. Drawing A-800 depicts Typical Door Elevations which are not keyed into the Door Schedule. Please advise.  
**RESPONSE:** Drawings A-800 has been revised and is attached to this addendum.
14. Please confirm there is an adequate water source available on site for construction use.  
**RESPONSE:** As detailed in the specification section 01 50 00 Temporary Facilities, the Contractor for General Construction shall provide and pay for all electrical power, water, heating and cooling, and ventilation required for construction purposes.
15. Please provide glazing requirements for all glass.  
**RESPONSE:** All glazing requirements are detailed in specification section 08 43 13
16. Please provide window frame material.  
**RESPONSE:** Window frames are to be constructed of Aluminum per specifications.
17. Please confirm there is adequate electrical supply on site for construction use.  
**RESPONSE:** As detailed in the specification section 01 50 00 Temporary Facilities, the Contractor for General Construction shall provide and pay for all electrical power, water, heating and cooling, and ventilation required for construction purposes.
18. Please identify locations of Wood Guard Rail detailed on C3D Construction Details 2.  
**RESPONSE:** The civil drawings have been updated to include additional guard rail details. The updated civil drawings are attached to this addendum.
19. Section 08 43 13: Please specify the number of coats required for painted finish.  
**RESPONSE:** The paint finish is detailed in specification section 09 21 16 Gypsum Board Assemblies.
20. Could you please provide the specifications for the occupancy and vacancy sensors?  
**RESPONSE:** Occupancy and vacancy sensor specifications are per spec section 26 55 00 2.2.
21. Please clarify the chain link fence heights at the kennel.  
**RESPONSE:** The civil drawings and chain link specifications have been modified and are included within this addendum.



22. Where are the acoustic panels shown on drawings showing?  
**RESPONSE:** The hanging ceiling panels, and wall mounted acoustic panels are shown on drawing A-205 and A-506 for acoustic panel locations. See specification section 09 84 30 SOUND-ABSORBING WALL AND CEILING UNITS for additional information.
23. Is Honeywell line of fire alarm system an acceptable alternate to the specified alarm?  
**RESPONSE:** As noted in addendum #2, specification section 00 43 25 Substitution Request Form During Procurement, CSI Form 1.5C Substitution Request (During the Bid Period) is being provided for substitution requests during the bid.
24. Acoustic Wall Panel AWP-1 is listed on A-702 Finish Schedule but cannot be located on the drawings. Please advise if these are required and provide an elevation.  
**RESPONSE:** The hanging ceiling panels and wall mounted acoustic panels are shown on drawing A-205 and A-506 for acoustic panel locations. See specification section 09 84 30 Sound-Absorbing Wall and Ceiling Units for additional information.
25. Numerous details on A-625 depict adhered manufactured stone veneer which do not correlate to the Exterior Finish Schedule or Elevations drawings A-300/A-301. Please advise.  
**RESPONSE:** These are typical details and are for reference only. Some typical details may not fully apply to this project.
26. Numerous details on A-626 depict fiber cement panels which do not correlate to the Exterior Finish Schedule or Elevations drawings A-300/A-301. Please advise.  
**RESPONSE:** These are typical details and are for reference only. Some typical details may not fully apply to this project.
27. Solid Surface Countertop finish tag SS-2 is noted as Corian and Quartz. Please advise.  
**RESPONSE:** As specified in Section 12 36 00 Countertops the product is a quartz material manufactured by Corian.
28. Detail 9 / S-301 notes a joist reinforcement detail which does not appear to be keyed into the structural framing plans. Please advise where this occurs.  
**RESPONSE:** The locations where joist reinforcement is required are dependent on where equipment is hung from the joists in the field. As noted on the detail if the loads are located within 4" of a panel point reinforcing is not required. Detail 9/S-301 typically applies to loads over 100 pounds.
29. Finish Schedule drawing A-702 notes Finish Schedule Legend tag ACT-2 which is not keyed into the Finish Schedule.  
**RESPONSE:** ACT-2 is located in room #101 as noted in the Finish Schedule.



30. Please provide specifications for the water cooler noted on drawing P-101W, note 7, fixture EWC-A. This fixture does not appear on any schedules  
**RESPONSE:** The water cooler is specified in Section 22 40 00 Plumbing Fixtures.
31. A-500 Key Note 05 and 53 both reference mirrors and are used in same place 3/A-500 and 1/A-500, please clarify.  
**RESPONSE:** There are two different size mirrors in this project. The single user toilet rooms receive the mirror indicated in note #53. The multi-user toilet receives the mirror indicated by note #5.
32. A-500 Key Note 111 for Booking Bench by Owner is in Transfer Shower 138 in Women's Locker 119, confirm this is correct tag and bench by Owner.  
**RESPONSE:** Bench is to be part of the shower unit. Note #111 was inadvertently included in the elevation.
33. A-504 Break Room Interior Elevations, Elevation U appears to show an oven or other appliance under countertop, please provide details and/or spec.  
**RESPONSE:** This is an undercounter microwave. See specifications Section 11 30 13 APPLIANCES.
34. A-203 Enlarged Men's Women Locker Room & Booking: Booking room shows 15' 10 3/8" bench, please provide spec and/or details.  
**RESPONSE:** The 15'-10 3/8" dimension refers to the room width at that location. The bench is to be 11'-0" in length as indicated on drawing A-100-ED.
35. Per drawing E-002, please confirm the limits of work to be performed by the Utility Company related to the new incoming electrical service. Our assumption is the new overhead line and new utility pole, which will have a pole-mounted transformer, shall be furnished and installed by the Utility Company. The pole riser and underground secondary service feeder will be part of this contract. Please confirm.  
**RESPONSE:** It is the design teams understanding that the utility pole, overhead wire, pole mounted transformers are by the utility company. Pole riser and underground secondary are to be included in the GC bid.
36. Please advise if any duct smoke detectors are required.  
**RESPONSE:** Provide (1) duct smoke detector for RTU-2. See drawing E-601 Electrical Equipment and Control Schedule and Addendum 3 drawing H-101 for additional information.
37. The drawings and specifications do not indicate any fireproofing requirements. Please confirm there are no requirements for fireproofing.  
**RESPONSE:** Please see drawings. Please see A-007 and A-008 for fire rating requirements.



38. Drawing A-602, detail 2 indicates 3500 psi concrete and no fiber mesh for the new sidewalks but drawing A-18-2309-01 indicates 4000 psi concrete with fiber mesh monolithic curb. Please clarify which detail should be followed.  
**RESPONSE:** Follow drawing A-18-2309-01 for exterior sidewalks specifications.
39. Reference specification section 28 31 13; 1.04, A. Allowances.  
1. See section 01 21 00 - Allowances affecting this section.  
Question, there is no section 01 21 00 Allowances.  
**RESPONSE:** There are no allowances for this project.
40. Please clarify Door schedule on A-800 door type column.  
**RESPONSE:** Drawings A-800 has been revised to clarify the door elevation numbers.
41. Details 1 & 2/A-608 appear to show horizontal sliding windows. Please confirm all windows on the project are fixed.  
**RESPONSE:** Details shown on drawing A-608 are typical and may not fully represent each condition.
42. Which glazing is detail 2/A-622 for?  
**RESPONSE:** Details shown on drawing A-622 are typical and may not fully represent each condition.
43. Which glazing is detail 11/a-603 for?  
**RESPONSE:** Details shown on drawing A-603 are typical and may not fully represent each condition.
44. Is window type E hollow metal or aluminum frame? What type of glass?  
**RESPONSE:** Window Type-E is specified in Section 08 56 75 Sound Control Windows.



**SECTION 00 01 10  
TABLE OF CONTENTS**

**PROCUREMENT AND CONTRACTING REQUIREMENTS**

**Division 00 -- Procurement and Contracting Requirements**

- 00 01 10 - Table of Contents
- 00 11 13 - Advertisement for Bids
- 00 21 13 - Instructions to Bidders
- 00 40 90 - Bidders Checklist
- 00 41 00 - Bid Form
- 00 43 00 - Stockholder / Partnership Affidavit
- 00 43 22 - Unit Prices Form
- 00 43 23 - Alternates Form
- 00 43 25 - Substitution Request Form During Procurement
- 00 43 27 - Separate Prices Break-Out Form
- 00 43 29 - Receipt of Addenda Form
- 00 43 30 - Non-Collusive Bidding Certification
- 00 43 31 - Iran Divestment Act Certification
- 00 43 32 - Sexual Harassment Certification Form
- 00 43 40 - Sales Tax Exemption Instructions
- 00 49 50 - Disclosure of Prior Non-Responsibility Determinations

**AIA Documents**

- A101-2017 – Standard Form of Agreement Between Owner and Contractor
- A101-2017 – A101 Exhibit A: Insurance and Bonds
- A201-2017 – General Conditions of the Contract for Construction
- A305-2020 – Contractor’s Qualification Statement, including Exhibits A - E
- A310 - 2010 – Bid Bond
- A312 - 2010 – Payment Bond
- A312 - 2010 – Performance Bond
- C106-2013 – Digital Data Licensing Agreement
- G701-2017 – Change Order
- G702-1992 – Application and Certificate for Payment
- G703 - 1992 – Continuation Sheet
- G704-2017 – Certificate of Substantial Completion
- G705-2001 – List of Subcontractors
- G706-1994 – Contractor’s Affidavit of Payment of Debts and Claims
- G706A-1994 – Contractor’s Affidavit of Release of Claims
- G707-1994 – Consent of Surety to Final Payment
- G707A-1994 – Consent of Surety to Reduction in or Partial Release of Retainage
- G709-2018 – Proposal Request
- G710-2017 – Architect’s Supplemental Instructions
- G714-2017 – Construction Change Directive

G715-2017 – Supplemental Attachment for ACORD Certificate of Insurance 25

G716-2004 – Request for Information

G804-2001 – Register of Bid Documents

**Attachments**

Geotechnical Report

Comcheck

Project Labor Agreement

Prevailing Wage Schedule for Article 8 Public Work Project

**SPECIFICATIONS**

**Division 01 -- General Requirements**

01 10 00 - Summary

01 20 00 - Price and Payment Procedures

01 22 00 - Unit Prices

01 23 00 - Alternates

01 25 00 - Substitution Procedures

01 30 00 - Administrative Requirements

01 32 16 - Construction Progress Schedule

01 40 00 - Quality Requirements

01 45 33 - Code-Required Special Inspections

01 50 00 - Temporary Facilities and Controls

01 57 13 - Temporary Erosion and Sediment Control

01 57 19 - Temporary Environmental Controls

01 60 00 - Product Requirements

01 70 00 - Execution and Closeout Requirements

01 74 19 - Construction Waste Management and Disposal

01 79 00 - Demonstration and Training

01 91 13 - General Commissioning Requirements

01 91 13.01 - Supplemental General MEP Commissioning Requirements

01 91 20 - Commissioning Plan

**Division 03 -- Concrete**

03 30 00 - Cast-in-Place Concrete

03 35 11 - Concrete Floor Finishes

**Division 04 -- Masonry**

04 20 00 - Unit Masonry

04 73 00 - Manufactured Stone Masonry

**Division 05 -- Metals**

05 12 00 - Structural Steel Framing

05 21 00 - Steel Joist Framing

05 31 00 - Steel Decking

05 40 00 - Cold-Formed Metal Framing

05 50 00 - Metal Fabrications

05 51 00 - Metal Stairs

05 51 33 - Metal Ladders

**Division 06 -- Wood, Plastics, and Composites**

06 10 53 - Miscellaneous Rough Carpentry

06 41 00 - Architectural Wood Casework

**Division 07 -- Thermal and Moisture Protection**

07 05 43 - Cladding Support Systems

07 05 53 - Fire and Smoke Assembly Identification

07 11 13 - Bituminous Dampproofing

07 21 00 - Thermal Insulation

07 21 19 - Foamed-In-Place Insulation

07 27 00 - Air Barriers

07 42 13 - Metal Wall Panels

07 42 13.23 - Metal Composite Material Wall Panels

07 53 23 - Ethylene-Propylene-Diene-Monomer Roofing - Versico

07 84 00 - Firestopping

07 92 00 - Joint Sealants

**Division 08 -- Openings**

08 06 71 - Door Hardware Schedule

08 11 13 - Hollow Metal Doors and Frames

08 14 16 - Flush Wood Doors

08 34 73 - Sound Control Door Assemblies

08 43 13 - Aluminum-Framed Storefronts

08 44 13 - Glazed Aluminum Curtain Walls

08 56 53 - Security Windows

08 56 75 - Sound Control Windows

08 71 00 - Door Hardware

08 80 00 - Glazing

08 87 23 - Safety and Security Films

**Division 09 -- Finishes**

09 21 16 - Gypsum Board Assemblies

09 30 00 - Tiling

09 51 00 - Acoustical Ceilings

09 65 00 - Resilient Flooring

09 65 66 - Resilient Athletic Flooring

09 68 13 - Tile Carpeting

09 84 30 - Sound-Absorbing Wall and Ceiling Units

09 90 00 - Painting and Coating - Commercial Facility Guide Specification - Sherwin-Williams

**Division 10 -- Specialties**

- 10 14 16 - Plaques
- 10 14 19 - Dimensional Letter Signage
- 10 14 23 - Panel Signage
- 10 21 13.17 - Phenolic Toilet Compartments - ASI
- 10 21 23 - Cubicle Curtains and Track
- 10 28 00 - Toilet, Bath, and Laundry Accessories
- 10 43 00 - Emergency Aid Specialties
- 10 44 00 - Fire Protection Specialties
- 10 51 13 - Metal Lockers
- 10 56 13 - Metal Storage Shelving
- 10 56 26 - Mobile Storage Shelving
- 10 73 16.13 - Metal Canopies

**Division 11 -- Equipment**

- 11 30 13 - Appliances

**Division 12 -- Furnishings**

- 12 24 00 - Window Shades
- 12 35 53.13 - Metal Laboratory Casework
- 12 36 00 - Countertops

**Division 22 -- Plumbing**

- 22 05 00 - Basic Plumbing Requirements
- 22 05 23 - Valves
- 22 05 53 - Plumbing Identification
- 22 05 80 - Excavation and Backfill
- 22 07 00 - Insulation
- 22 10 10 - Piping Systems and Accessories
- 22 10 20 - Underground Piping Systems and Accessories
- 22 10 30 - Pumps
- 22 11 00 - Water Supply
- 22 13 00 - Sanitary, Waste and Storm Drainage Systems
- 22 30 10 - Equipment
- 22 34 00 - Water Heaters
- 22 40 00 - Plumbing Fixtures
- 22 67 00 Water Treatment Equipment
- 22 70 10 Natural Gas Systems

**Division 23 -- Heating, Ventilating, and Air-Conditioning (HVAC)**

- 23 05 00 - Basic Mechanical Requirements
- 23 05 04 - Electric Wiring
- 23 05 13 - Motors
- 23 05 14 - Motor Controllers

- 23 05 30 - Roof Curbs
- 23 05 48 - Vibration Isolation of Mechanical Systems
- 23 05 50 - Wind Restraint for HVAC Systems
- 23 05 53 - Mechanical Identification
- 23 05 93 - Testing, Adjusting and Balancing
- 23 07 10 - Insulation
- 23 20 10 - Piping Systems and Accessories
- 23 31 00 - Sheet Metal and Ductwork Accessories Construction
- 23 33 13 - Fire and Smoke Dampers
- 23 34 00 - Fans
- 23 36 00 - Variable Volume Terminal Units
- 23 37 13 - Registers and Diffusers
- 23 81 26.11 - Ductless Split System Air Conditioner
- 23 81 43 - Packaged Rooftop Heat Pump Unit
- 23 82 39 - Unit Heaters and Cabinet Unit Heaters (Hydronic and Electric)

**Division 26 -- Electrical**

- 26 05 00 - Basic Electrical Requirements
- 26 05 01 - Basic Materials and Methods
- 26 05 26 - Grounding
- 26 05 27 - Grounding and Bonding for Building Structure
- 26 20 00 - Electric Distribution
- 26 27 13 - Electric Service
- 26 32 13 - Power Generation - Generator, Automatic Transfer Switch and Accessories
- 26 50 00 - Lighting
- 26 55 00 - Lighting Controls

**Division 27 -- Communications**

- 27 32 26 - Ring-Down Emergency Telephones

**Division 28 -- Electronic Safety and Security**

- 28 10 00 - Access Control
- 28 31 02 - Analog Addressable Fire Alarm
- 28 31 13 - Emergency Responder Communications Enhancement System (ERCES)

**Division 31 -- Earthwork**

- 31 05 19 - Geosynthetics for Earthwork
- 31 10 00 - Site Clearing
- 31 22 00 - Grading
- 31 23 16 - Excavation
- 31 23 16.13 - Trenching
- 31 23 16.26 - Rock Removal
- 31 23 23 - Fill
- 31 40 10 - Dewatering

**Division 32 -- Exterior Improvements**

- 32 12 16 - Asphalt Paving
- 32 13 13 - Concrete Paving
- 32 15 29 - Monolithic Concrete Curb and Sidewalk
- 32 16 23 - Sidewalks
- 32 17 23 - Pavement Markings
- 32 17 26 - Tactile Warning Surfacing
- 32 31 13 - Chain Link Fences and Gates
- 32 35 00 - Screening Devices
- 32 91 19 - Landscape Grading
- 32 93 00 - Plants

**Division 33 -- Utilities**

- 33 01 10 - Existing Utilities and Structures
- 33 01 10.58 - Disinfection of Water Utility Piping Systems
- 33 01 15 - Testing and Inspecting Water Lines
- 33 01 17 - Testing and Inspection of Gravity Lines
- 33 04 30 - Drainage Structures
- 33 05 61 - Concrete Manholes
- 33 16 16 - Ductile Iron Pipe
- 33 16 17 - Restraint Systems
- 33 16 25 - Tapping Sleeves and Valves
- 33 16 27 - Copper Pipe (Buried) & Necessary Fittings
- 33 16 28 - Valves, Meters and Appurtenances - Water
- 33 31 13 - Site Sanitary Sewerage Gravity Piping
- 33 37 06 - Sanitary Sewer Connections
- 33 41 00 - Subdrainage
- 33 42 30 - Stormwater Drains
- 33 46 16 - High Density Polyethylene Pipe

**END OF SECTION 00 01 10**

## SECTION 10 51 13 METAL LOCKERS

### PART 1 GENERAL

#### 1.01 SECTION INCLUDES

- A. Metal lockers.
- B. Locker benches.
- C. Owner supplied items

#### 1.02 REFERENCE STANDARDS

- A. ADA Standards - 2010 ADA Standards for Accessible Design; 2010.
- B. ASTM A1008/A1008M - Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Required Hardness, Solution Hardened, and Bake Hardenable; 2023, with Editorial Revision.
- C. ICC A117.1 - Accessible and Usable Buildings and Facilities; 2017.

#### 1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Manufacturer's published data on locker construction, sizes, and accessories.
- C. Shop Drawings: Indicate locker plan layout, numbering plan and combination lock code.
- D. Manufacturer's Installation Instructions: Indicate component installation assembly.

### PART 2 PRODUCTS

#### 2.01 MANUFACTURERS

- A. Metal Lockers:
  - 1. Basis of Design: Donnegan Systems, Inc.; First Responder Duty Lockers, Evidence Storage Lockers, and Weapons Lockers: [www.donegan.com](http://www.donegan.com)
  - 2. Art Metal Products: [www.artmetalproducts.com/#sle](http://www.artmetalproducts.com/#sle).
  - 3. DeBourgh Manufacturing Co: [www.debourgh.com/#sle](http://www.debourgh.com/#sle).
  - 4. Lockers MFG: [www.lockersmfg.com/#sle](http://www.lockersmfg.com/#sle).
  - 5. Fascoe Security Products; Police Personel Lockers: [www.fascosecurityproducts.com](http://www.fascosecurityproducts.com)
  - 6. Lyon Workspace Products: [www.lyonworkspace.com/#sle](http://www.lyonworkspace.com/#sle).
  - 7. Republic Storage Systems Co: [www.republicstorage.com/#sle](http://www.republicstorage.com/#sle).
  - 8. Substitutions: See Section 01 60 00 - Product Requirements.

#### 2.02 LOCKER APPLICATIONS

- A. Owner supplied lockers:
  - 1. Contractor will disassemble, store, transport and reinstall lockers designated to be reused from current police station and install where indicated on the drawings.
  - 2. Weapons lockers: total - 4.
- B. Evidence Lockers
  - 1. Construction:
    - a. 16 gauge all welded steel construction
    - b. Individual compartments & master front door
    - c. Heavy duty piano hinges
    - d. Configuration and Dimensions: see drawings.
      - 1) Pass through evidence locker to have (5) doors at processing side: Model ED3-41.
- C. Weapons Lockers
  - 1. Relocate (4) existing lockers supplied by owner
- D. First Responder Duty Lockers: Metal lockers, free-standing wardrobe unit with drawer base.

1. Wardrobe Unit:
  - a. Width: 18 inches (457 mm).
  - b. Depth: 24 inches (610 mm).
  - c. Height: 73 inches (1.854 m).
2. Configuration: Single tier.
3. Drawer Base: Match lockers.
4. Fittings: Size and configuration as indicated on drawings.
  - a. Stationary lockers to have (2) shelves, and larger portion of long gun storage; will also require rolling doors. Units are to be 7'-1" tall
5. Ventilation: Perforated side panels, doors, and back panels; integrated fan system.
6. Latching: Three-point, Cremone latching, with padlockable turn handle.
7. Locking: Padlock hasps, for padlocks provided by Owner.

## **2.03 METAL LOCKERS**

- A. Locker Case Construction:
  1. Heavy-Duty, Welded Construction: Made of formed and welded together sheet steel; metal edges finished smooth without burrs; baked enamel or powder coat finished inside and out.
    - a. Locker Body Components: Formed and flanged from steel sheet of the following type and minimum thicknesses:
      - 1) Perforated Steel Sheet: Commercial Steel (CS), Type B, supplied for exposed applications and complying with ASTM A1008/A1008M and the following:
        - (a) Perforations: Manufacturer's standard pattern of square holes.
      - 2) Body and Shelves: 16 gauge, 0.0598 inch (1.52 mm).
      - 3) Backs: 18 gauge, 0.0478 inch (1.21 mm).
      - 4) Base: 18 gauge, 0.0478 inch (1.21 mm).
        - (a) Height: 4 inches (100 mm).
    - b. Frames: Formed channel shape, welded and ground flush, welded to body, resilient gaskets and latching for quiet operation.
      - 1) Door Frame: 16 gauge, 0.0598 inch (1.52 mm), minimum.
    - c. Where ends or sides are exposed, provide flush panel closures.
    - d. Provide filler strips where indicated or required, securely attached to lockers.
- B. Doors: Channel edge; welded construction, manufacturer's standard stiffeners, grind and finish edges smooth.
  1. Door Thickness: 16 gauge, 0.0598 inch (1.52 mm), minimum.
  2. Form recess for operating handle and locking device.
- C. Latches and Door Handles: Manufacturer's standard.
  1. Latching: Manufacturer's standard for locking arrangement selected.
    - a. Three-Point/Three-Sided Cremone Latch.
      - 1) Latching mechanism operated by a steel handle welded to a three-point Cremone-type assembly.
      - 2) Latching rods, 3/8 inch (9.5 mm) diameter, engage top and bottom edge of locker frame. 3/16 inch (4.8 mm) thick center latch engages door jamb.
- D. Hinges: Continuous piano hinge with powder coat finish to match locker color.
- E. Sloped Top: 20 gauge, 0.0359 inch (0.91 mm), with closed ends.
- F. Trim: 20 gauge, 0.0359 inch (0.91 mm).
- G. Coat Hooks: Stainless steel or zinc-plated steel.
- H. Locks: Locker manufacturer's standard type indicated in Applications article above.

## **2.04 LOCKER BENCHES**

- A. Locker Benches: Stationary type; bench top of laminated birch; painted steel pedestals.
  1. Accessibility: Comply with ICC A117.1 and ADA Standards.

## **PART 3 EXECUTION**

### **3.01 INSTALLATION**

- A. Install in accordance with manufacturer's instructions.
- B. Place and secure on prepared base.
- C. Install lockers plumb and square.
- D. Install fittings if not factory installed.
- E. Replace components that do not operate smoothly.

**END OF SECTION 10 51 13**

**SECTION 10 56 13  
METAL STORAGE SHELVING**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Case type shelving.
- B. Shelving accessories.

**1.02 RELATED REQUIREMENTS**

- A. Section 10 56 26 - Mobile Storage Shelving: Installation of metal storage shelving on mobile carriages.

**1.03 REFERENCE STANDARDS**

**1.04 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Manufacturer's data sheets on each product to be used, including:
  - 1. Rated uniform shelf loads.
  - 2. Details of shelving assemblies, including reinforcement.
  - 3. Accessories.
- C. Test Reports: Provide independent agency test reports documenting compliance with specified structural requirements.
- D. Shop Drawings: Indicate location, type, and layout of shelving, including lengths, heights, and aisle layout, and relationship to adjacent construction.
  - 1. Indicate methods of achieving specified anchoring requirements.
- E. Selection Samples: For each finish product specified, color chips representing manufacturer's full range of available colors and finishes.
- F. Warranty: Submit manufacturer warranty and ensure that forms have been completed in Owner's name and registered with manufacturer.

**1.05 QUALITY ASSURANCE**

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section, with not less than three years of documented experience.

**1.06 DELIVERY, STORAGE, AND HANDLING**

- A. Inspect for dents, scratches, or other damage. Replace damaged units.
- B. Store in manufacturer's unopened packaging until ready for installation.
- C. Store under cover and elevated above grade.

**1.07 WARRANTY**

- A. See Section 01 78 00 - Closeout Submittals, for additional warranty requirements.
- B. Provide one year manufacturer warranty covering defects of manufacturing and workmanship and rust and corrosion.

**PART 2 PRODUCTS**

**2.01 MANUFACTURERS**

- A. Case Type Shelving:
  - 1. Spacesaver Corporation: [www.spacesaver.com/#sle](http://www.spacesaver.com/#sle). - Basis of Design
- B. Case Type Shelving Cabinets:
  - 1. Spacesaver Corporation High Density Mobile Storage (HDMS) Systems: [www.spacesaver.com/#sle](http://www.spacesaver.com/#sle).
  - 2. Substitutions: See Section 01 60 00 - Product Requirements.

## **2.02 SHELVING - GENERAL**

- A. See drawings for layout and sizes.
  - 1. General:
    - a. Mobile shelving to be (4) units, 36"x48", with (6) equal shelves, and rolling doors.  
Units are to be 7'-4" tall

## **2.03 CASE TYPE SHELVING**

- A. Case Type Shelving: Steel, closed sides, with shelving brackets, shelving surfaces, and accessories as specified.
  - 1. Unit Width: 24 inches (610 mm), overall.
  - 2. Shelf Capacity: Uniform distributed load of 50 psf (2.4 kPa), minimum.
  - 3. Shelf Deflection: L/140, maximum, under specified uniform load.
  - 4. Adjustability of Shelving: At intervals of 6 inches (150 mm) on center.
  - 5. Shelves per Unit: As indicated on drawings.
  - 6. Finish: Baked enamel, medium gloss.
  - 7. Color: As selected by Architect from manufacturer's standard range.
  - 8. Provide single-face and double-face units where indicated.
  - 9. Number of Units: As indicated on drawings.
- B. Case Construction: Formed sheet metal comprising vertical support members and enclosure panels.
  - 1. Shelf Support Members: 16 gauge, 0.0598 inch (1.52 mm), minimum; manufacturer's standard profile.
  - 2. Face Width of Exposed Vertical Supports: 2 inches (51 mm), maximum.
  - 3. Panels: 24 gauge, 0.0239 inch (0.61 mm), minimum.
  - 4. Connecting Hardware: Manufacturer's standard.
- C. Shelves: Formed sheet metal, finished on all surfaces with slots for dividers.
  - 1. Thickness: 16 gauge, 0.0598 inch (1.52 mm), minimum.
  - 2. Shelf Edge Profile: Extending 3/4 inch (19 mm), maximum, below top surface of shelf.

## **2.04 ACCESSORIES**

- A. Kick Plates: Formed sheet metal; enclose open space between bottom shelf and floor on all front sides and open ends; finished to match.
- B. Label Holders: Steel, attached to front face of shelf.
  - 1. Size: 2-1/4 by 3/4 inches (56 by 20 mm).
  - 2. Finish: Manufacturer's standard.
  - 3. Mounting: Slide-on.

## **PART 3 EXECUTION**

### **3.01 PREPARATION**

- A. Clean surfaces thoroughly prior to installation.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.

### **3.02 INSTALLATION**

- A. Install in accordance with manufacturer's instructions.
- B. Install shelving with shelf surfaces level and vertical supports plumb; adjust feet and bases as required.

### **3.03 CLEANING**

- A. Clean shelving and surrounding area after installation.

### **3.04 PROTECTION**

- A. Protect installed products until completion of project.

B. Touch-up, repair or replace damaged products before Date of Substantial Completion.

**END OF SECTION 10 56 13**

**SECTION 32 31 13**  
**CHAIN LINK FENCES AND GATES**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Posts, rails, and frames.
- B. Wire fabric.
- C. Concrete.
- D. Manual gates with related hardware.
- E. Accessories.

**1.02 REFERENCE STANDARDS**

- A. ASTM A121 - Standard Specification for Metallic-Coated Carbon Steel Barbed Wire; 2022.
- B. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- C. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2023.
- D. ASTM A392 - Standard Specification for Zinc-Coated Steel Chain-Link Fence Fabric; 2011a (Reapproved 2022).
- E. ASTM A1011/A1011M - Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength; 2023.
- F. ASTM F567 - Standard Practice for Installation of Chain-Link Fence; 2023.
- G. ASTM F1043 - Standard Specification for Strength and Protective Coatings on Steel Industrial Fence Framework; 2018 (Reapproved 2022).
- H. ASTM F1083 - Standard Specification for Pipe, Steel, Hot-Dipped Zinc-Coated (Galvanized) Welded, for Fence Structures; 2018 (Reapproved 2022).
- I. CLFMI CLF-SFR0111 - Security Fencing Recommendations; 2014.
- J. CLFMI WLG 2445 - Wind Load Guide for the Selection of Line Post and Line Post Spacing; 2023.
- K. FS RR-F-191/1D - Fencing, Wire and Post Metal (Chain-Link Fence Fabric); 1990.

**1.03 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on fabric, posts, accessories, fittings and hardware.
- C. Shop Drawings: Indicate plan layout, spacing of components, post foundation dimensions, hardware anchorage, and schedule of components. See CLFMI CLF-SFR0111 for planning and design recommendations.

**PART 2 PRODUCTS**

**2.01 CHAIN LINK FENCE AND GATE ELEMENTS**

- A. Fence around Dog Kennel: 6'-0" high chain link fence.

**2.02 COMPONENTS**

- A. Line Posts: 2.38 inch (60 mm) diameter.
- B. Corner and Terminal Posts: 2.88 inch (73 mm) diameter.
- C. Gate Posts: 3-1/2 inch (89 mm) diameter.
- D. Top and Brace Rail: 1.66 inch (42 mm) diameter, plain end, sleeve coupled.

- E. Gate Frame: 1.66 inch (42 mm) diameter for welded fabrication.
- F. Fabric: 2 inch (51 mm) diamond mesh interwoven wire, 9 gauge, 0.1483 inch (3.8 mm) thick, top selvage knuckle end closed, bottom selvage twisted tight.

### **2.03 MATERIALS**

- A. Posts, Rails, and Frames:
  - 1. ASTM A1011/A1011M, Designation SS; hot-rolled steel strip, cold formed to pipe configuration, longitudinally welded construction, minimum yield strength of 50 ksi (345 MPa); zinc coating complying with ASTM F1043 and ASTM F1083.
  - 2. Line Posts: Type I round in accordance with FS RR-F-191/1D.
  - 3. Terminal, Corner, Rail, Brace, and Gate Posts: Type I round in accordance with FS RR-F-191/1D.
- B. Wire Fabric:
  - 1. ASTM A392 zinc coated steel chain link fabric.
- C. Concrete:
  - 1. Bagged or ready mixed, normal portland cement 3,000 psi strength at 28 days, 4" slump.

### **2.04 COMPONENTS**

- A. Line Posts: 2.38 inch (60 mm) diameter.
- B. Corner and Terminal Posts: 2.88 inch (73 mm) diameter.
- C. Fabric: 2 inch (51 mm) diamond mesh interwoven wire, 6 gauge, 0.1920 inch (4.9 mm) thick, top selvage knuckle end closed, bottom selvage twisted tight.

### **2.05 MANUAL GATES AND RELATED HARDWARE**

- A. Hardware for Single Swinging Gates: 180 degree hinges, 2 for gates up to 60 inches (1,525 mm) high, 3 for taller gates; fork latch with gravity drop and padlock hasp; keeper to hold gate in fully open position.
- B. Hinges: Finished to match fence components.
- C. Latches: Finished to match fence components.

### **2.06 ACCESSORIES**

- A. Caps: Cast steel galvanized; sized to post diameter, set screw retainer.
- B. Fittings: Sleeves, bands, clips, rail ends, tension bars, fasteners and fittings; steel.

### **2.07 FINISHES**

- A. Components (including Fabric): Galvanized in accordance with ASTM A123/A123M, at 1.9 ounces per square foot (565 g/sq m).
- B. Hardware: Hot-dip galvanized to weight required by ASTM A153/A153M.
- C. Accessories: Same finish as framing.

## **PART 3 EXECUTION**

### **3.01 INSTALLATION**

- A. Install framework, fabric, accessories and gates in accordance with ASTM F567.
- B. Set intermediate, terminal, and gate posts plumb, in concrete footings with top of footing 1 inch (25 mm) above finish grade; slope concrete away from post. Slope top of concrete for water runoff.
- C. Line Post Footing Depth Below Finish Grade: ASTM F567.
- D. Corner, Gate and Terminal Post Footing Depth Below Finish Grade: ASTM F567.
- E. Provide top rail through line post tops and splice with 6 inch (150 mm) long rail sleeves.
- F. Install a 7 gauge, 0.1770 inch (4.5 mm) coil spring wire in place of top rail.

- G. Position bottom of fabric maximum 2 inches (50 mm) above finished grade.
- H. Fasten fabric to top rail, line posts, braces, and bottom tension wire with tie wire at maximum 15 inches (380 mm) on centers.
- I. Attach fabric to end, corner, and gate posts with tension bars and tension bar clips.
- J. Install bottom tension wire stretched taut between terminal posts.
- K. Peen all bolts upon installation.

**3.02 TOLERANCES**

- A. Maximum Variation From Plumb: 1/4 inch (6 mm).
- B. Maximum Offset From True Position: 1 inch (25 mm).

**3.03 CLEANING**

- A. Clean jobsite of excess materials; scatter excess material from post hole excavations uniformly away from posts. Remove excess material if required.
- B. Clean fence with mild household detergent and clean water rinse well.

**END OF SECTION 32 31 13**



CONSTRUCTION NOTES

- ALL DIMENSIONS ARE TO ROUGH FRAMING.
- NOTE: NOT ALL CONSTRUCTION NOTES MAY BE SPECIFIC TO THIS DRAWING.
- NOTE: F.F. ELEVATION 422.00 ON CIVIL DWG. = F.F. ELEV. 100'-0" ON ARCH. - STRUC. & MEP DWGS.
- NOTE: F.F. ELEVATION 100'-0" ON ARCH. - STRUC. & MEP DWGS REFERS TO EXISTING FIRST FLOOR SLAB.
- F.F. ELEVATIONS
- MAIN FLOOR: 100'-0"
- SECOND FLOOR: 114'-0"
- GENERAL CONTRACTOR TO VERIFY ALL ROUGH OPENING SIZES WITH RESPECTIVE MANUFACTURERS (DOOR/WINDOW/DOORSET/ETC.) PRIOR TO ORDERING AND LAYING OUT MASONRY OPENINGS AND/OR LAYING OUT STUD FRAMING.
- SEE LIFE SAFETY PLANS FOR LOCATIONS OF FIRE EXTINGUISHERS. GC TO CONSULT WITH LOCAL AUL PRIOR TO COORDINATION TO CONFIRM ACCEPTANCE OF LOCATIONS BY FIRE MARSHAL. FIRE EXTINGUISHER CABINETS TO BE PROVIDED AT ALL FINISHED OFFICE SPACES AND/OR PUBLIC AREAS AND WALL HUNG EXPOSED FIRE EXTINGUISHERS AT ALL OTHER LOCATIONS. PROVIDE OPENING AND BLOSSOM WITHIN FRAMING FOR WALL CABINETS AND MOUNTING HARDWARE.
- ALL WALLS SHALL EXTEND 12" ABOVE THE FINISH CEILING HEIGHT DIMENSION. ALL WALLS AROUND CONFERENCE ROOMS, PRIVATE OFFICES, SEPARATING PUBLIC SPACES FROM OFFICE SPACES, AND WALLS INDICATED TO BE ACOUSTICAL WALLS WITH ACOUSTICAL GYPSUM BOARD, ARE TO BE BUILT TO THE FLOOR ABOVE AND BE SEALED WITH ACOUSTICAL CAULK, INSULATION AND GYPSUM BOARD IS TO CONTINUE TO THE TOP OF THE WALL, BOTH SIDES. PER AREA ABOVE BEING SYSTEM IS OCCUPIED BY HVAC EQUIPMENT, PROVIDE ADEQUATE ACCESS FOR SERVICE TO SAID UNITS.
- THE CLIMATE TO BE COORDINATED WITH OWNER AND THEIR EXISTING ADJACENT OFFICE BUILDING. SEE ELECTRICAL DRAWINGS AND SPECIFICATIONS.
- CONSTRUCTION TO BEGIN ONLY AFTER ALL BUILDING COMPONENTS HAVE BEEN DESIGNED AND CONFIRMED. ALL WORK SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO PRESERVE ALL EXISTING WORK IN PROGRESS, AND AS A WHOLE, ASSURING HIMSELF THAT THE WORK ON ANY OR ALL OF THE PROJECT IS READY FOR PERIODIC ARCHITECTURAL REVIEW, BEFORE CALLING UPON THE ARCHITECT AND OWNER TO MAKE THEIR STEP-BY-STEP PROJECT OBSERVATION VISIT OF THE WORK.
- THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCING, AND PROCEDURES REQUIRED FOR SAFE DECEPTION AND COMPLETION OF WORK, AND FOR INITIATING, MAINTAINING AND SUPERVISING ALL SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK.
- THE CONTRACTOR MUST PROVIDE ALL REQUIRED RATINGS FOR PRE-RESISTIVE SEPARATION WALLS, FLOOR/CEILING ASSEMBLIES, IN ACCORDANCE WITH THE LATEST EDITION OF THE GOVERNING CODE AND LOCAL CODES.
- ALL WALL PENETRATIONS SHALL BE HORIZONTALLY ALIGNED AT EACH FLOOR LEVEL. STRUCTURAL DETAILS AND SPECIFICATIONS OF ANY FRAMING MEMBERS, BRACING, ETC. SUPERSEDE THE ARCHITECTURAL DRAWINGS.
- FIRST FLOOR TO BE SLAB ON GRADE. PROVIDE CONTROL JOINTS IN THE SLAB AS PER THE SPECIFICATIONS AND STRUCTURAL DRAWINGS.
- PRE SEPARATION WALLS ARE REQUIRED AS INDICATED ON THE LIFE SAFETY PLAN AND/OR WALL TYPES. SEE LIFE SAFETY PLAN. RESISTIVE WALL TYPES AND FIRE RATED DETAILS AND STRUCTURAL DRAWINGS. ALL RATED WALLS, FLOORS AND CEILING ARE TO BE A PART OF AN APPROVED UL FIRE RATED ASSEMBLY.
- HOLLOW METAL DOORS WITH HOLLOW METAL FRAMES ARE INCLUDED WITH THIS PROJECT. SEE DOOR SCHEDULE. THE GC IS REQUIRED TO COORDINATE AND INSTALL ALL ACCESS CONTROL DOOR HARDWARE.
- MODULAR FURNITURE, CONFERENCE TABLES AND MONITORING STATIONS (E.G. INDIVIDUAL DATA AND POWER TO BE PROVIDED TO EACH - SEE ELECTRICAL DRAWINGS).
- UNCLIPPING HARDWARE TO BE INSTALLED UNDER ALL FLOORS. NO EXCEPTIONS.
- SEE ADD DRAWINGS FOR INTERIOR ELEVATIONS, DETAILS, DIMENSIONS AND MOUNTING HEIGHTS OF MILLWORK AND CABINETS.
- GC TO PROVIDE ALL NECESSARY BLOCKING FOR MILLWORK, SHELVING, ETC.
- SEE STRUCTURAL, MECHANICAL, ELECTRICAL, PLUMBING, FIRE PROTECTION, AND IT/AV DRAWINGS AND SPECIFICATIONS FOR COORDINATION OF ALL RELATED ITEMS, INCLUDING UNDERGROUND WORK.
- WHERE SHIPY'S CONSULT WITH FIRM L&P TO BE PROVIDED FROM THE IT/TELECOM ROOM TO THE PLUMBING SPACE.
- FLOOR OUTLETS (DATA AND POWER) TO BE PROVIDED UNDER ALL PRE-EXISTING MILLWORK AT ALL DISPATCH AND RECORDS, AT MULTIPLE LOCATIONS UNDER EACH CONFERENCE ROOM TABLE MARK "C" O.C. ONE CENTERED FLOOR BOX AT A SIX PERSON TABLE, TWO FLOOR BOXES, 6'-0" O.C. AT AN 8-12 PERSON TABLE, ETC. SEE ELECTRICAL DRAWINGS AND SPECIFICATIONS.
- WATER LINE TO BE PROVIDED TO BREAKROOM MILLWORK FOR COFFEE MAKER. CIVIL DRAWINGS AND SPECIFICATIONS FOR ALL SITE IMPROVEMENTS AND INCOMING UTILITIES BEYOND 5'-0" OUTSIDE OF THE BUILDING FOOTPRINT.
- MIN. 2" x 2" IMPROVISED AREA REQUIRED AT EACH EXIT DOOR, E.G. TO PROVIDE EXTERIOR CONCRETE PADS IF ASPHALT IS NOT PROVIDED FOR ON CIVIL DRAWINGS. SEE STRUCTURAL AND CIVIL DRAWINGS AND SPECIFICATIONS.
- GC TO INCLUDE LINE ITEM ALLOWANCE FOR EVIDENCE STORAGE EQUIPMENT, EVIDENCE LOCKERS, AND SHELVING.
- THESE DRAWINGS DO NOT CONTAIN COMPLETE SPECIFICATIONS, DETAILS AND INFORMATION REQUIRED FOR THE EXTERIOR FINISHES OF THE PROJECT. ADDITIONAL INFORMATION SHALL BE OBTAINED FROM THE OWNER.
- SEE CIVIL DRAWINGS AND SPECIFICATIONS FOR ALL SITE IMPROVEMENTS AND INCOMING UTILITIES BEYOND 5'-0" OUTSIDE OF THE BUILDING FOOTPRINT.
- ALL WINDOWS WITH SILLS LESS THAN 36" AFF AND MORE THAN 2" ABOVE FINISH GRADE OF OTHER SURFACE SHALL HAVE LATCH HARDWARE COMPLIANT WITH ASTM F 2000. LIMITING OPENING TO 4".
- SPACING/CONFIGURATION OF TRUSSES TO BE ADJUSTED AS REQUIRED TO ACCOMMODATE THE OPENINGS FOR ANY SHIPY AND LATCH HARDWARE COMPLIANT TO THOSE DRAWINGS TO BE SUBMITTED FOR APPROVAL PRIOR TO FABRICATION.
- GC TO COORDINATE FRAMING DEPTH LAYOUT WITH HVAC LOCATIONS AND MANUFACTURER INSTALLATION INSTRUCTIONS/RECOMMENDED CLEARANCES (COORDINATE HVAC UNIT PLACEMENT WITH INTAKE/EXHAUST LOUVER LOCATIONS INDICATED ON EXTERIOR ELEVATIONS).
- STRUCTURAL DETAILS AND SPECIFICATIONS OF ANY FRAMING MEMBERS, BRACING, ETC. SUPERSEDE THE ARCHITECTURAL DRAWINGS.
- FIRE RATING OF WALLS ARE TO BE CONTINUOUS BEHIND ANY ELEMENTS THAT PENETRATE THEM, I.E. FIRE EXTINGUISHER CABINETS, ELECTRICAL OUTLETS, RECESSED LIGHTING, ETC. SEE TYPICAL DETAILS ON A-600 DRAWINGS.

KEY NOTES

- 01 HOLLOW METAL DOOR - SEE SPECS.
- 40 BULLET RESISTANT TRANSPARENT WINDOW - SEE SPECS.
- 46 GARDBASE CAN - SEE SPECS.
- 57 HANDWOOD LOCKER BENCH - SEE SPECS.
- 79 FIREARM LOCKER - SEE SPECS.
- 80 STAINLESS STEEL MILLWORK - SEE SPECS.
- 81 HEAVY DUTY METAL LOCKERS: SINGLE TIER WITH DRAWER BELOW - SEE SPECS.
- 85 EVIDENCE LOCKER WITH REFRIGERATOR - SEE SPECS.
- 87 HIGH DENSITY METAL EVIDENCE LOCKER SYSTEM - SEE SPECS.
- 90 WALL MOUNTED TV, BY OWNER.
- 98 FLOOR DRAIN, SEE PLUMBING DRAWINGS.
- 99 EVIDENCE LOCKER - SEE SPECS.
- 103 CURTAIN WALL SYSTEM - SEE SPECS.
- 105 GARDBASE RECEPTACLE SEE SPECS.
- 107 (B) I AUTO-DIAL PHONE WITH PEDESTAL - SEE SPECS.
- 111 BENCHING BENCH - BY OWNER.
- 122 HALF WALL.

WALL LEGEND:		DOOR LEGEND:	
	MTL STUD WALL		PERSONNEL DOOR TAG
	CMU WALL		FIRST FLR LEVEL
	PARTIAL HT. WALL		STOREFRONT DOOR TAG
	ACOUSTICAL MTL STUD WALL		FIRST & SECOND FLR LEVEL
			PERSONNEL DOOR TAG
			SECOND FLR LEVEL

REVISIONS:

NUM.	DATE	DESCRIPTION
A	04/17/25	ADDENDUM 2
B	04/25/25	ADDENDUM 3

100% BID DOCUMENTS

25 WALLKILL AVE • MONTGOMERY • NY 12549  
 O. 845.294.2724 | F. 888.305.6442

WWW.ADGARCHITECT.COM  
 CONTACT@ADGARCHITECT.COM

ARCHITECTS ARCHITECTURE • PLANNING • INTERIORS

Project: TOWN OF MONTGOMERY POLICE STATION  
 106 BRACKEN ROAD  
 MONTGOMERY, NEW YORK 12549

Drawing: FIRST FLOOR PLAN


Project: 23138 Date: 02/24/25

Drawn: IDEA Scale: AS NOTED

Drawing Number:

A-201

Exp. 02/28/2026

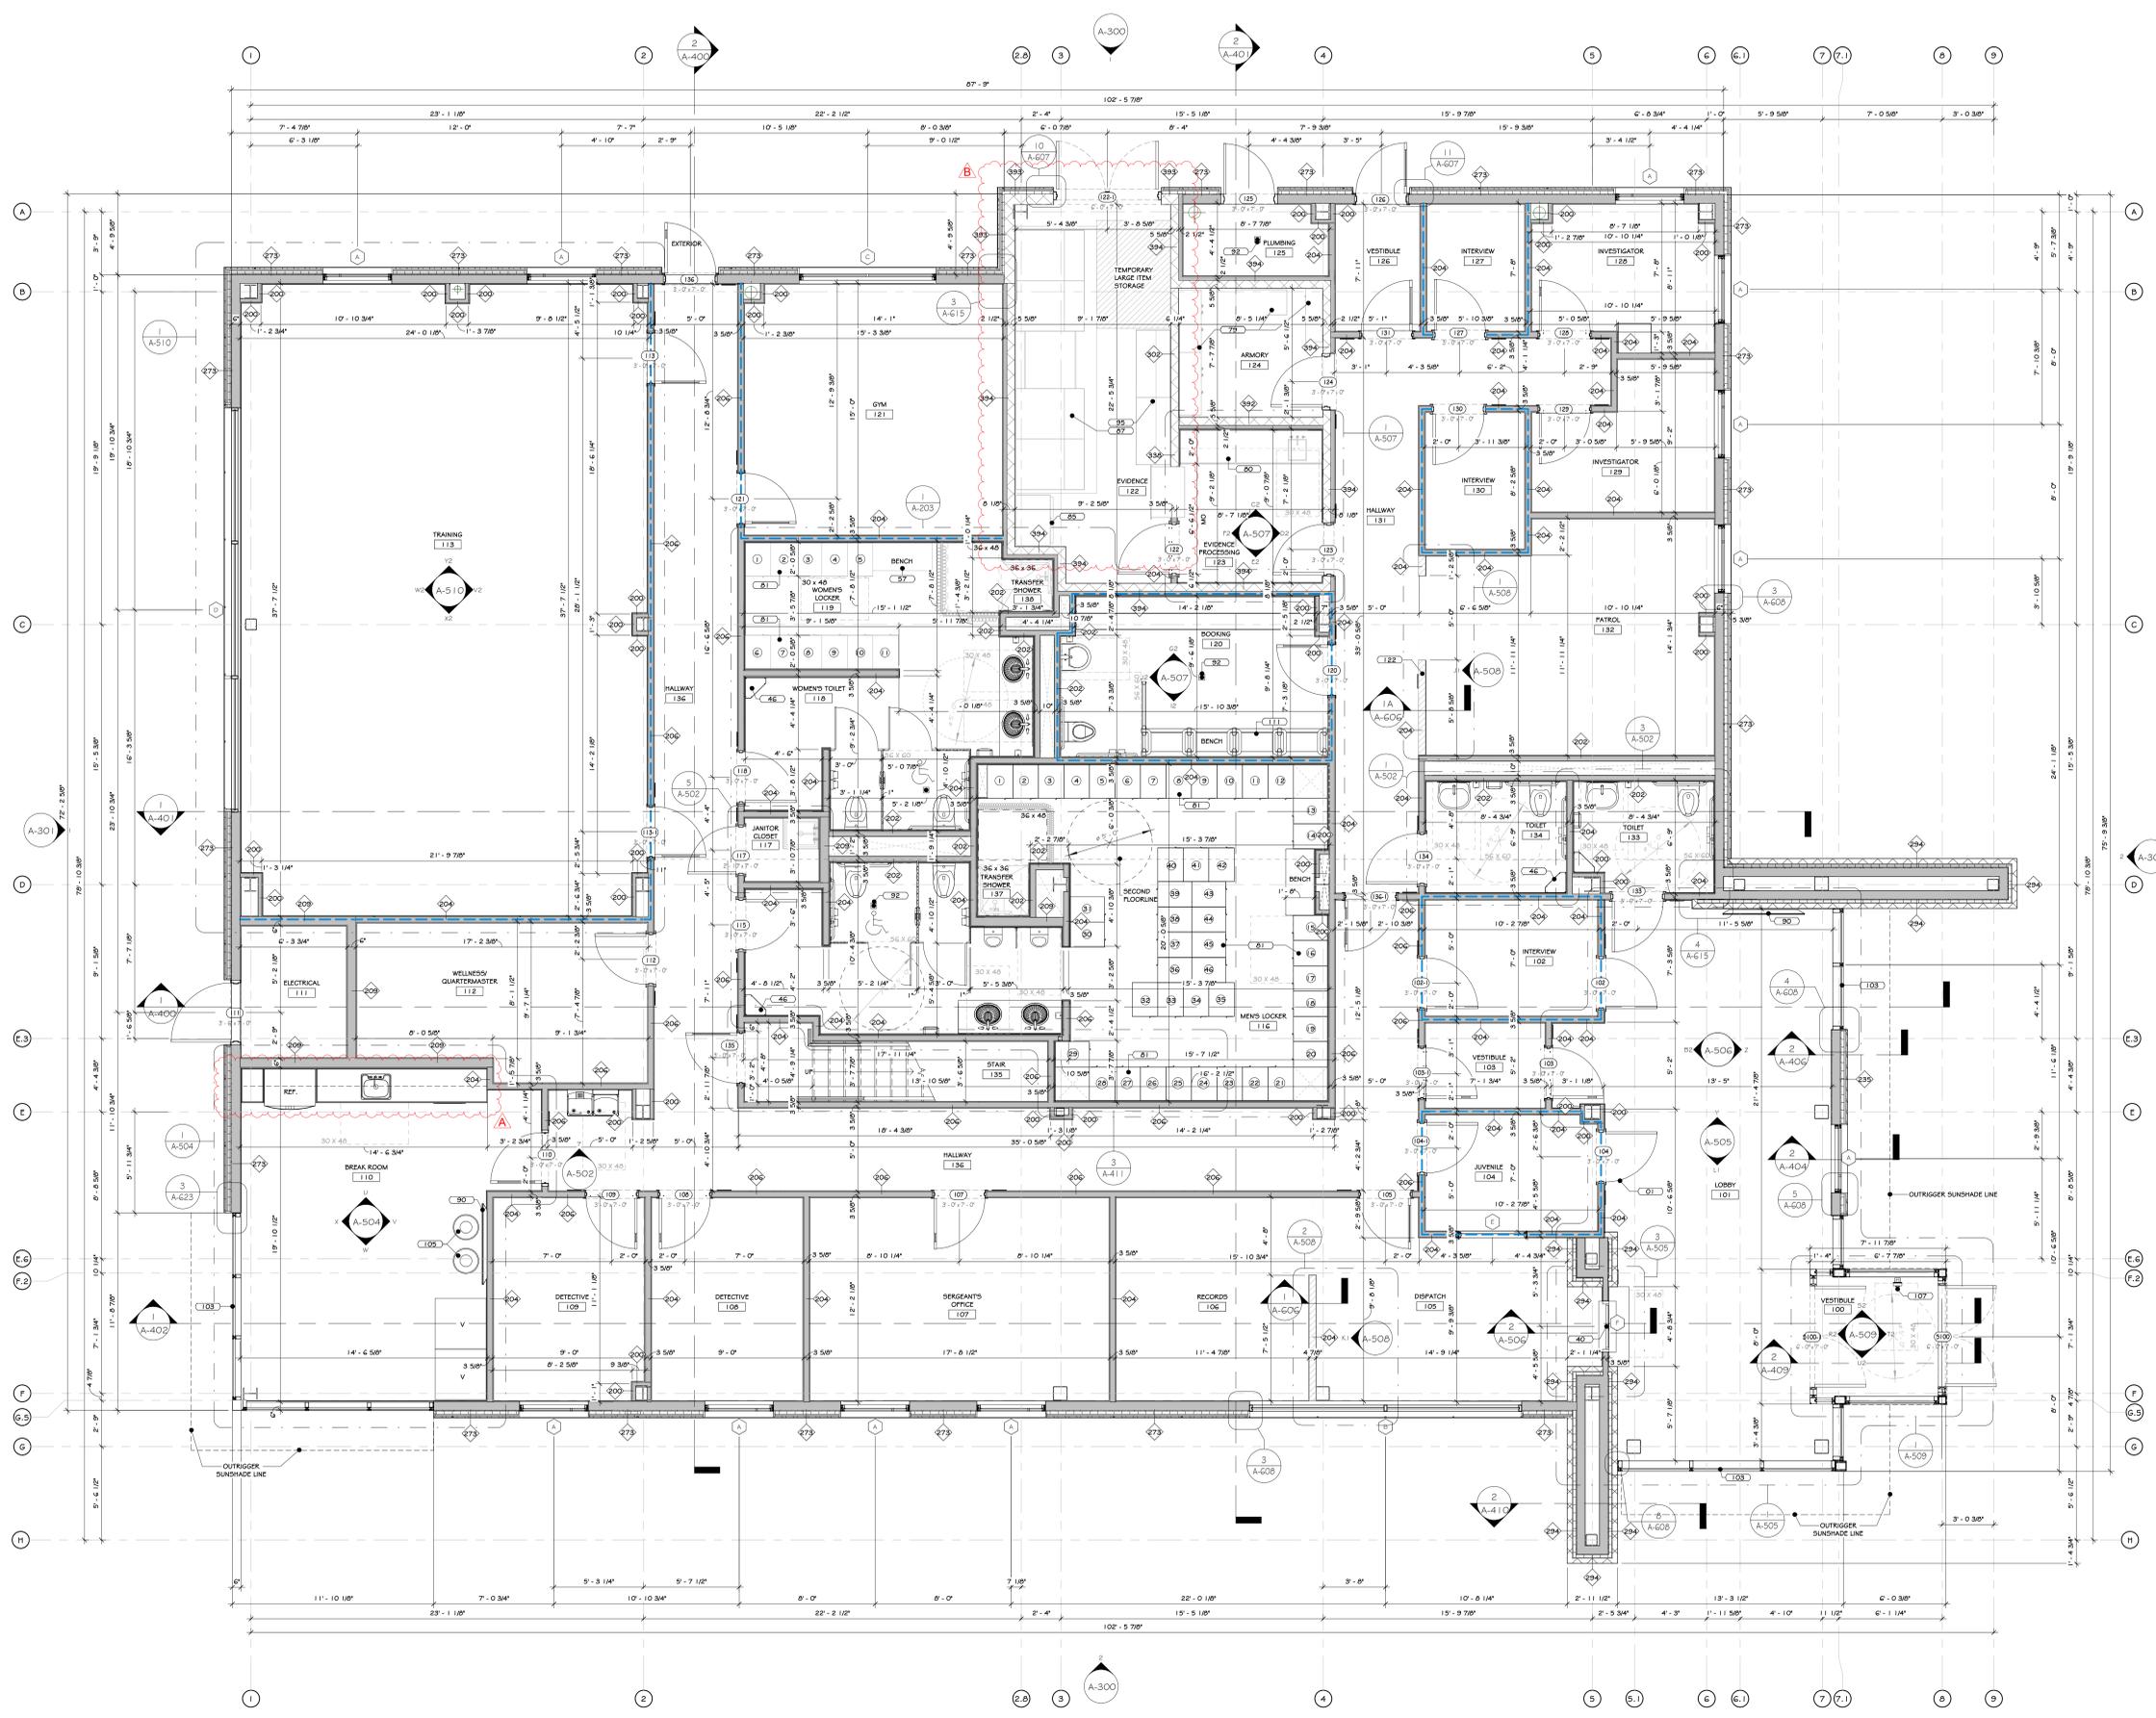

1 FIRST FLOOR PLAN  
 1/4" = 1'-0"



1 FIRST FLOOR FINISH PLAN  
1/4" = 1'-0"

CONSTRUCTION NOTES

1. PROVIDE SCHEDULES AT ALL FINISH MATERIAL TRANSITIONS, INCLUDING, BUT NOT LIMITED TO TILE TO CARPET, TILE TO D.P. 80, CARPET TO WOOD, WOOD TO TILE, ETC.
2. SEE REFLECTED CEILING PLANS FOR CEILING SPECIFICATIONS & FINISH SCHEDULE. (SEE SPECS)
3. BACKSPLASH BREAKROOM: DUAL-TILE COLOR WHEEL / LINEN. SEE SPECS.
4. DOOR NOTES: ALL FLUSH WOOD DOORS TO MONTGOMERY NATURAL ROTARY BIRCH FINISH TO BE SELECTED BY ARCHITECT.
5. ILM FRAME NOTES: TO BE PAINTED SHERWIN WILLIAMS "GRIZZLE GRAY" ALKYL ENAMEL SEMI GLOSS FINISH (SEE SPECS)
6. EXPOSED STEEL TO BE PAINTED: SHERWIN WILLIAMS WEB GRAY #7075.
7. REFER ALSO TO INTERIOR ELEVATIONS AND FINISH SCHEDULE.
8. SUBMIT PHYSICAL SAMPLES OF ALL FINISHES FOR ARCHITECT'S APPROVAL PRIOR TO ORDERING.
9. SUBMIT DETAILED MILLWORK SHOP DRAWINGS FOR ARCHITECT'S APPROVAL PRIOR TO FABRICATION.
10. FULL EXTENT OF FLOOR AND WALL FINISHES IS NOT SHOWN FOR CLARITY. FLOOR AND WALL FINISHES TO EXTEND UNDER BENCH APPLIANCES AND CABINETS.
11. SEE SPECIFICATIONS FOR ANY FINISHES NOT INCLUDED IN THE FINISH PLANS.

FIRST FLOOR INTERIOR FINISH LEGEND

MARK	SYMBOL	LOCATION	COLOR AND MATERIAL	NOTES
FL-1	[Symbol]	DETECTIVE, HALLWAY, WILMINGTON/QUARTERMASTER, SERGEANTS, RECORDS, DISPATCH, LOBBY, VESTIBULE, INTERVIEW, LOBBY, PATROL, # INVESTIGATOR.	LUXURY VINYL TILE	SEE SPECS
FL-2	[Symbol]	BREAK ROOM/LOBBY/BOOKING	LUXURY VINYL TILE	SEE SPECS
FL-3	[Symbol]	COMMON TOILET, MENS LOCKER, WOMENS LOCKER, MENS TOILET, WOMENS TOILET	CERAMIC TILES	SEE SPECS
FL-4	[Symbol]	PLUMBING, EVIDENCE, ARMORY, EVIDENCE PROCESSING, JANITOR CLOSET, ELECTRICAL	SEALED CONCRETE	SEE SPECS
FL-5	[Symbol]	TRAINING	CARPET TILES	SEE SPECS
FL-6	[Symbol]	TRAINING	CARPET TILES	SEE SPECS
FL-7	[Symbol]	VESTIBULE	WALK OFF MAT	SEE SPECS
FL-8	[Symbol]	GYM	RUBBER FLOORING	SEE SPECS
FL-10	[Symbol]	TRAINING, STAR	RUBBER STAIR TREAD	SEE SPECS

REVISIONS:

NUM.	DATE	DESCRIPTION
A	04/17/25	ADDENDUM 2
B	04/25/25	ADDENDUM 3

100% BID DOCUMENTS

PROJECT

KEY PLAN

WORK AREA

ADG ARCHITECTS

25 WALLKILL AVE • MONTGOMERY • NY 12549  
O. 845.294.2724 | F. 888.305.6442  
WWW.ADGARCHITECT.COM  
CONTACT@ADGARCHITECT.COM

ARCHITECTURE • PLANNING • INTERIORS

Project: TOWN OF MONTGOMERY POLICE STATION  
106 BRACKEN ROAD  
MONTGOMERY, NEW YORK 12549

Drawing: FIRST FLOOR FINISH PLAN

04/25/2025

Project: 23138 Date: 02/24/25  
Drawn: IDEA Scale: AS NOTED  
Drawing Number:  
**A-700**

Exp. 02/28/2026



1 FIRST FLOOR PAINT PLAN  
1/4" = 1'-0"

CONSTRUCTION NOTES

**PAINT SCHEDULE**

COLOR	DESCRIPTION
<span style="color: green;">█</span>	A SW #6134 NETSUKZ
<span style="color: purple;">█</span>	B SW #7012 CREAMY
<span style="color: red;">█</span>	C SW #7670 GRAY SHINGLE
<span style="color: yellow;">█</span>	D SW #706A GRIZZLE GRAY (DOOR FRAMES, EXPOSED STEEL, ETC.)

**LEGEND:**  
 - - - - - DASHED LINES INDICATE THE SOFFIT, FASCIA AND HIGH WALL ABOVE, UNLESS OTHERWISE NOTED.

**NOTES:**

- NOTE: 9" x 9" SAMPLE WALL TO BE PAINTED FOR EACH COLOR, TO BE APPROVED BY ARCHITECT & OWNER PRIOR TO PURCHASE OF PAINTED FOR FULL PROJECT.
- DOOR NOTES - ALL FLUSH WOOD DOORS TO BE DARK BROWN ROTARY NATURAL BIRCH. FINISH TO BE SELECTED BY ARCHITECT.
- HM FRAME NOTES ON - TO BE PAINTED SHERWIN WILLIAMS GRIZZLE GRAY ALKYL ENAMEL SEMI GLOSS FINISH.

STEEL DOOR NOTE:

**REVISIONS:**

NUM.	DATE	DESCRIPTION
A	04/17/25	ADDENDUM 2
B	04/25/25	ADDENDUM 3

**100% BID DOCUMENTS**

PREPARED BY

KEY PLAN

WORK AREA

**ADG ARCHITECTS**  
ARCHITECTURE • PLANNING • INTERIORS

25 WALKKILL AVE • MONTGOMERY • NY 12549  
 O. 845.294.2724 | F. 888.305.6442  
 WWW.ADGARCHITECT.COM  
 CONTACT@ADGARCHITECT.COM

Project: **TOWN OF MONTGOMERY POLICE STATION**  
 106 BRACKEN ROAD  
 MONTGOMERY, NEW YORK 12549



Drawing: **FIRST FLOOR PAINT PLAN**

Exp. 02/28/2026




Project: 23138 Date: 02/24/25  
 Drawn: IDEA Scale: AS NOTED  
 Drawing Number:

**A-703**

Mark	From	Location	#	Nominal Size		Hand	Label	STC	Mat'l	Finish	Mat'l	Thickness	Door Slab		HDW Set	Mark	Remarks	
				Width	Height								Finish	Elev.				
S100	Vestibule	100	Exterior	-	6'-0"	7'-0"									01	S100-1	See Sections 08 43 13 and 08 44 13	
S100-1	Vestibule	100	Lobby	101	6'-0"	7'-0"									01	S100-1	See Sections 08 43 13 and 08 44 13	
102	Interview	102	Lobby	101	3'-0"	7'-0"	LHR	56	HM	Paint	WD	1-3/4"	FF	1	06	102	See Sections 08 34 73	
102-1	Interview	102	Hallway	136	3'-0"	7'-0"	RH	45 min	HM	Paint	WD	1-3/4"	FF	1	07	102-1	See Sections 08 34 73	
103	Corridor	103	Lobby	101	3'-0"	7'-0"	LHR		HM	Paint	WD	1-3/4"	FF	5	14	103	See Sections 08 14 16	
103-1	Corridor	103	Hallway	136	3'-0"	7'-0"	RH	45 min	HM	Paint	WD	1-3/4"	FF	5	15	103-1	See Sections 08 14 16	
104	Juvenile	104	Lobby	101	3'-0"	7'-0"	RHR	56	HM	Paint	WD	1-3/4"	FF	1	06	104	See Sections 08 34 73	
104-1	Juvenile	104	Hallway	136	3'-0"	7'-0"	LH	45 min	HM	Paint	WD	1-3/4"	FF	1	07	104-1	See Sections 08 34 73	
105	Dispatch	105	Hallway	136	3'-0"	7'-0"	LH	45 min	HM	Paint	WD	1-3/4"	FF	5	08	105	See Sections 08 14 16	
107	Sergeants Office	107	Hallway	136	3'-0"	7'-0"	RH	45 min	HM	Paint	WD	1-3/4"	FF	5	09	107	See Sections 08 14 16	
108	Detective	108	Hallway	136	3'-0"	7'-0"	RH	45 min	HM	Paint	WD	1-3/4"	FF	5	07	108	See Sections 08 14 16	
109	Detective	109	Hallway	136	3'-0"	7'-0"	LH	45 min	HM	Paint	WD	1-3/4"	FF	5	07	109	See Sections 08 14 16	
110	Breakroom	110	Hallway	136	3'-0"	7'-0"	LH	45 min	HM	Paint	WD	1-3/4"	FF	5	05	110	See Sections 08 14 16	
111	Electrical	111	Exterior	-	3'-6"	7'-0"	RHR		HM	Paint	HM	1-3/4"	Paint	4	16	111		
112	Wellness / Quartermaster	112	Hallway	136	3'-0"	7'-0"	RH	45 min	HM	Paint	WD	1-3/4"	FF	1	08	112	Solid door; no vision lite; See Section 08 14 16	
113	Training	113	Hallway	136	3'-0"	7'-0"	LHR	45 min	37	HM	Paint	WD	1-3/4"	FF	5	06	113	See Sections 08 14 16
113-1	Training	113	Hallway	136	3'-0"	7'-0"	LHR	45 min	37	HM	Paint	WD	1-3/4"	FF	5	06	113-1	See Sections 08 14 16
115	Mens Toilet	115	Hallway	136	3'-0"	7'-0"	LH	45 min	HM	Paint	WD	1-3/4"	FF	1	04	115	See Sections 08 14 16	
117	Janitor Closet	117	Hallway	136	3'-0"	7'-0"	RHR	45 min	HM	Paint	WD	1-3/4"	FF	7	19	117	See Sections 08 14 16	
118	Womens Toilet	118	Hallway	136	3'-0"	7'-0"	RH	45 min	HM	Paint	WD	1-3/4"	FF	1	04	118	See Sections 08 14 16	
120	Booking	120	Hallway	131	3'-0"	7'-0"	LH	45 min	56	HM	Paint	HM	1-3/4"	Paint	6	07	120	See Sections 08 34 73
121	Gym	118	Hallway	136	3'-0"	7'-0"	RH	45 min	HM	Paint	WD	1-3/4"	FF	5	07	121		
122	Evidence	122	Evidence Processing	123	3'-0"	7'-0"	LH	90 min	HM	Paint	HM	1-3/4"	Paint	1	10	122		
122-1	Evidence	122	Exterior	-	6'-0"	7'-0"	RHRA	90 min	HM	Paint	HM	1-3/4"	Paint	1	17	122-1		
123	Evidence Processing	123	Hallway	131	3'-0"	7'-0"	LH	90 min	HM	Paint	HM	1-3/4"	Paint	1	11	123		
124	Armory	124	Hallway	131	3'-0"	7'-0"	LH	90 min	HM	Paint	HM	1-3/4"	Paint	1	11	124		
125	Plumbing	125	Exterior	-	3'-0"	7'-0"	RHR		HM	Paint	HM	1-3/4"	Paint	1	18	125		
126	Vestibule	126	Exterior	-	3'-0"	7'-0"	LHR		HM	Paint	HM	1-3/4"	Paint	6	18	126		
127	Interview	127	Hallway	131	3'-0"	7'-0"	LH		56	HM	Paint	HM	1-3/4"	Paint	1	07	127	See Sections 08 34 73
128	Investigator	128	Hallway	131	3'-0"	7'-0"	LH		HM	Paint	HM	1-3/4"	Paint	5	07	128		
129	Investigator	129	Hallway	131	3'-0"	7'-0"	RH		HM	Paint	HM	1-3/4"	Paint	5	07	129		
130	Interview	130	Hallway	131	3'-0"	7'-0"	RH		HM	Paint	HM	1-3/4"	Paint	1	07	130		
131	Hallway	131	Vestibule	126	3'-0"	7'-0"	LHR		HM	Paint	HM	1-3/4"	Paint	6	13	131		
133	Toilet	133	Lobby	101	3'-0"	7'-0"	RH		HM	Paint	WD	1-3/4"	FF	1	02	133	See Sections 08 14 16	
134	Toilet	134	Hallway	131	3'-0"	7'-0"	RH		HM	Paint	HM	1-3/4"	Paint	1	03	134		
135	Stair	135	Hallway	136	3'-0"	7'-0"	LHR	45 min	HM	Paint	WD	1-3/4"	FF	5	06	135	See Sections 08 14 16	
136	Hallway	136	Exterior	-	3'-0"	7'-0"	RHR		HM	Paint	HM	1-3/4"	Paint	5	18	136		
136-1	Hallway	136	Hallway	131	3'-0"	7'-0"	RH	45 min	HM	Paint	WD	1-3/4"	FF	6	07	136-1	See Sections 08 14 16	
Second Floor																		
201	Records	201	Hallway	208	3'-0"	7'-0"	LH		HM	Paint	WD	1-3/4"	FF	1	07	201	See Sections 08 14 16	
202	IT Closet	209	Hallway	208	3'-0"	7'-0"	LH		HM	Paint	WD	1-3/4"	FF	1	07	202	See Sections 08 14 16	
203	Chiefs Office	203	Hallway	208	3'-0"	7'-0"	LH		HM	Paint	WD	1-3/4"	FF	5	07	203	See Sections 08 14 16	
204	Lieutenant	204	Hallway	208	3'-0"	7'-0"	RH		HM	Paint	WD	1-3/4"	FF	5	07	204	See Sections 08 14 16	
205	Conference	205	Hallway	208	3'-0"	7'-0"	LH		HM	Paint	WD	1-3/4"	FF	8	07	205	See Sections 08 14 16	
206	Storage	206	Hallway	208	3'-0"	7'-0"	RH		HM	Paint	WD	1-3/4"	FF	1	07	206	See Sections 08 14 16	
207	Mechanical	207	Hallway	208	3'-0"	7'-0"	RH		HM	Paint	WD	1-3/4"	FF	1	07	207	See Sections 08 14 16	
207-1	Mechanical	207	Exterior	-	3'-0"	7'-0"	LHR		HM	Paint	HM	1-3/4"	Paint	1	18	207-1		
																	0	
																		0
																		0
																		0

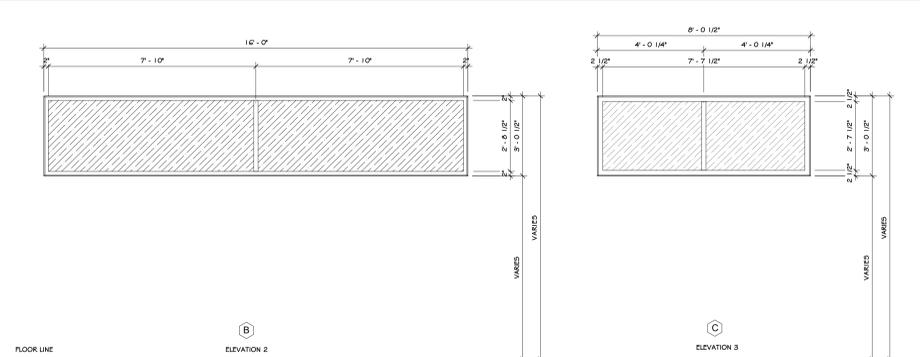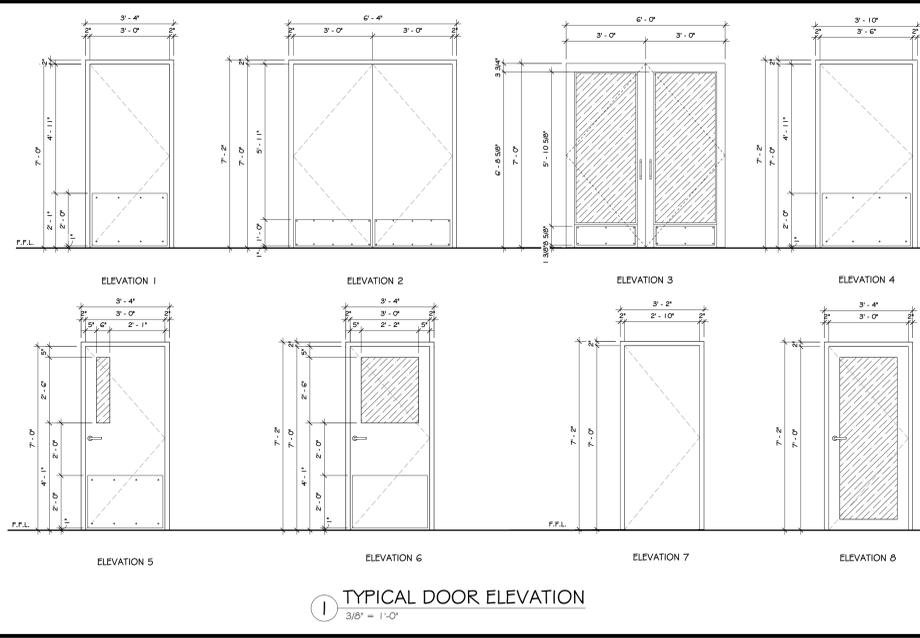

MARK	ELEVATION	WIDTH	HEIGHT	QTY
A	1	4'-0 1/2"	6'-0 1/2"	14
B	2	16'-0"	3'-0 1/2"	2
C	3	6'-0 1/2"	3'-0 1/2"	2
D	4	24'-0"	3'-0 1/2"	1
E	5	4'-0"	4'-0"	1
F	6	3'-0 1/4"	3'-0"	1

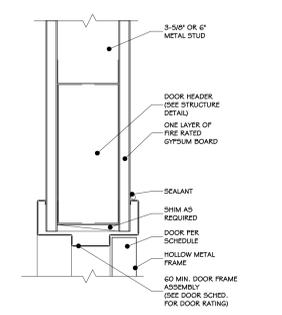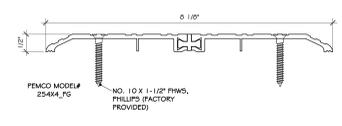

**CONSTRUCTION NOTES**

- ALL SIZES TO BE VERIFIED IN FIELD WITH FRAMING.
- ALL THRESHOLDS SHALL BE ALUMINUM.
- ALL WEATHER STRIPPING SHALL BE ALUMINUM.
- ALL KICKPLATES SHALL BE STAINLESS STEEL.
- ALL SETS MAY NOT BE USED IN THIS PROJECT.
- ALL DOOR HARDWARE TO BE SAME STYLE - SUBMIT TO ARCHITECT FOR APPROVAL.
- DOOR PROVIDOR TO COORDINATE KEYS WITH OWNER THROUGH ARCHITECT.
- FURNISH KEYS FOR EACH LOCK.
- FURNISH MASTER KEYS.
- LABEL ALL KEYS WITH SELF-LOCKING CLIPS, BY ROOM NUMBER.
- ALL CLOSERS TO HAVE HOLD-OPEN FEATURE.
- DOOR AND HARDWARE SHOP DRAWINGS ARE TO BE SUBMITTED TO THE ARCHITECT ONLY AFTER GENERAL CONTRACTOR HAS RECEIVED THEM AND CONFIRMED THAT ALL SIZES WORK WITH ROUGH OPENINGS PROVIDED IN THE FIELD. SUBMITTED SHOP DRAWINGS MUST CONTAIN APPROVAL SIGNATURE FROM GENERAL CONTRACTOR PRIOR TO SUBMISSION TO ARCHITECT.

**ABBREVIATIONS**

- |   |                                    |
|---|------------------------------------|
| <b>DOOR CORE:</b>                                 | <b>FRAME CONSTRUCTION:</b>         |
| FFC - PARTICLE CORE                               | KD - KNOCK DOWN                    |
| HC - HONEYCOMB                                    | FFW - FULL FACE WELD               |
| POLY - POLYURETHANE FOAM                          | FF - PRE-FINISHED                  |
| SOLID - SOLID WOOD                                |                                    |
| <b>DOOR EDGE:</b>                                 | <b>ANCHOR TYPE:</b>                |
| HDWD - MATCHING HARDWOOD STILES                   | MS - METAL STUD                    |
|   | MRY - MASONRY CMU                  |
|   | WS - WOOD STUD                     |
|   | AS - ALUMINUM STOREFRONT           |
|   | STLCHN - STEEL CHANNEL             |
| <b>FINISHES:</b>                                  | <b>LABEL:</b>                      |
| PT - PAINTED                                      | AW - 3 HOUR "A"                    |
| STN - STAINED                                     | BW - 1 1/2 HOUR "B"                |
| B.A. - BRONZED ANNOZIDED                          | CW - 3/4 HOUR "C"                  |
| MILL - MILL FINISH BRUSHED                        |                                    |
| <b>MATERIALS:</b>                                 | <b>DESIGNATIONS:</b>               |
| AGO - GALVANNEAL STEEL                            | BA - BRONZED ANNOZIDED             |
| HM - HOLLOW METAL                                 | INT - INTERIOR, OR INTERIOR MOUNT  |
| SL - PREMIUM PLAIN SLICED (TYPE TO BE DETERMINED) | EXT - EXTERIOR, OR EXTERIOR MOUNT  |
| WD - WOOD   | PV - PIVOT HINGE                   |
| AL - ANODIZED ALUMINUM                            | SL - SLIM LINE                     |
| ALM - ANODIZED ALUMINUM CLEAR FINISH              | WS - WALL STOP                     |
| BAL - BRUSHED ALUMINUM                            | FS - FLOOR STOP                    |
|   | WSTP - WEATHER STRIP               |
|   | INTNL - INTERNAL CONCEALED IN HEAD |
| <b>DOOR TYPE:</b>                                 | HD - HEAVY DUTY                    |
| C - CUSTOM GLASS                                  |                                    |
| F - FLUSH   |                                    |
| G - GLASS   |                                    |
| HG - HALF GLASS                                   |                                    |
| VP - 4"x25" NARROW LITE                           |                                    |
| LB - 24"x24" LOUVER                               |                                    |

**REVISIONS:**

NUM.	DATE	DESCRIPTION
1/B	04/25/25	ADDENDUM 3

**100% BID DOCUMENTS**

**ADG ARCHITECTS** ARCHITECTURE • PLANNING • INTERIORS

25 WALKKILL AVE • MONTGOMERY • NY 12549  
O. 845.294.2724 | F. 888.305.6442  
WWW.ADGARCHITECT.COM  
CONTACT@ADGARCHITECT.COM

Project: **TOWN OF MONTGOMERY POLICE STATION**  
106 BRACKEN ROAD  
MONTGOMERY, NEW YORK 12549

Drawing: **DOORS & WINDOW SCHEDULE**

Project: 23138 Date: 02/24/25  
Drawn: IDEA Scale: AS NOTED  
Drawing Number:  
**A-800**  
Exp. 02/28/2026

CONSTRUCTION NOTES

FURNITURE TO BE SELECTED BY OWNER




1 FIRST FLOOR FURNITURE PLAN  
1/4" = 1'-0"

REVISIONS:

NUM.	DATE	DESCRIPTION
A	04/17/25	ADDENDUM 2
B	04/25/25	ADDENDUM 3

100% BID DOCUMENTS



KEY PLAN



25 WALLKILL AVE • MONTGOMERY • NY 12549  
O. 845.294.2724 | F. 888.305.6442  
WWW.ADGARCHITECT.COM  
CONTACT@ADGARCHITECT.COM  
ARCHITECTURE • PLANNING • INTERIORS

Project: TOWN OF MONTGOMERY POLICE STATION  
106 BRACKEN ROAD  
MONTGOMERY, NEW YORK 12549

Drawing: FIRST FLOOR FURNITURE PLAN




Project: 23138 Date: 02/24/25  
Drawn: IDEA Scale: AS NOTED  
Drawing Number:

A-900

Exp. 02/28/2026



1 FIRST FLOOR INTERIOR SIGN SCHEDULE PLAN  
3/16" = 1'-0"

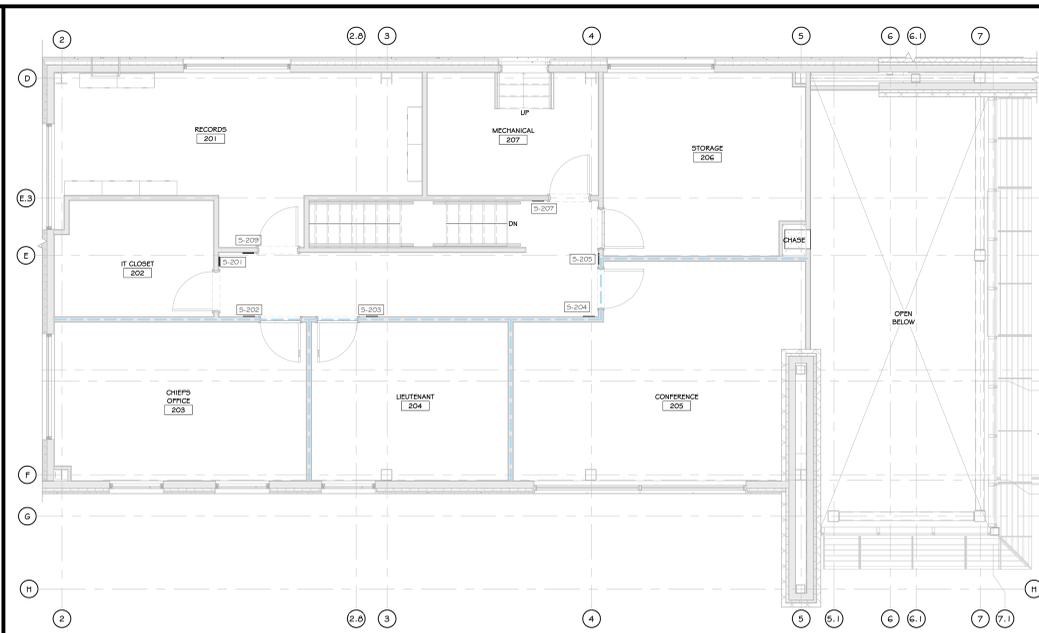

2 SECOND FLOOR INTERIOR SIGN SCHEDULE  
3/16" = 1'-0"

1ST & 2ND FLOOR INTERIOR SIGN SCHEDULE

MARK	TYPE	ROOM #	CITY	TITLE (SINGULAR)	REMARKS
S-100	SN-1	104	I	JUVENILE	TEXT TO BE COORDINATED W/ OWNER
S-101	SN-1	102	I	INTERVIEW	TEXT TO BE COORDINATED W/ OWNER
S-102	SN-3	133	I	UNisex TOILET	TEXT TO BE COORDINATED W/ OWNER
S-103	SN-1	103	I	OFFICES	TEXT TO BE COORDINATED W/ OWNER
S-104	SN-1	104	I	JUVENILE	TEXT TO BE COORDINATED W/ OWNER
S-105	SN-7	102	I	EXIT	TEXT TO BE COORDINATED W/ OWNER
S-106	SN-12	102	I	INTERVIEW	TEXT TO BE COORDINATED W/ OWNER
S-107	SN-12	131	I	BOOKING	TEXT TO BE COORDINATED W/ OWNER
S-108	SN-12	136	I	OFFICES	TEXT TO BE COORDINATED W/ OWNER
S-109	SN-3	134	I	TOILET	TEXT TO BE COORDINATED W/ OWNER
S-110	SN-1	128	I	PATROL	TEXT TO BE COORDINATED W/ OWNER
S-111	SN-1	130	I	EXIT	TEXT TO BE COORDINATED W/ OWNER
S-112	SN-1	129	I	INTERVIEW	TEXT TO BE COORDINATED W/ OWNER
S-113	SN-7	126	I	EXIT	TEXT TO BE COORDINATED W/ OWNER
S-114	SN-1	127	I	INTERVIEW	TEXT TO BE COORDINATED W/ OWNER
S-115	SN-7	126	I	EXIT	TEXT TO BE COORDINATED W/ OWNER
S-116	SN-1	124	I	ARMORY	TEXT TO BE COORDINATED W/ OWNER
S-117	SN-1	123	I	EVIDENCE PROCESSING	TEXT TO BE COORDINATED W/ OWNER
S-118	SN-1	122	I	EVIDENCE ROOM	TEXT TO BE COORDINATED W/ OWNER
S-119	SN-1	120	I	BOOKING	TEXT TO BE COORDINATED W/ OWNER
S-120	SN-3	135	I	STAIR	TEXT TO BE COORDINATED W/ OWNER
S-121	SN-3	113	I	MENS TOILET/LOCKERS	TEXT TO BE COORDINATED W/ OWNER
S-122	SN-3	118	I	WOMEN'S TOILET/LOCKERS	TEXT TO BE COORDINATED W/ OWNER
S-123	SN-3	121	I	GM	TEXT TO BE COORDINATED W/ OWNER
S-124	SN-7	113	I	TRAINING	TEXT TO BE COORDINATED W/ OWNER
S-125	SN-7	112	I	EXIT	TEXT TO BE COORDINATED W/ OWNER
S-126	SN-1	113	I	BREAK ROOM	TEXT TO BE COORDINATED W/ OWNER
S-127	SN-1	112	I	WELLNESS/QUARTERMASTER	TEXT TO BE COORDINATED W/ OWNER
S-128	SN-1	110	I	DETECTIVE	TEXT TO BE COORDINATED W/ OWNER
S-129	SN-1	109	I	DETECTIVE	TEXT TO BE COORDINATED W/ OWNER
S-130	SN-1	108	I	DETECTIVE	TEXT TO BE COORDINATED W/ OWNER
S-131	SN-1	107	I	SERGEANT OFFICE	TEXT TO BE COORDINATED W/ OWNER
S-132	SN-1	106	I	DISPATCH & RECORD	TEXT TO BE COORDINATED W/ OWNER
S-133	SN-1	105	I	JANITORS CLOSET	TEXT TO BE COORDINATED W/ OWNER
S-134	SN-13	100	I	911 EMERGENCY PHONE	TEXT TO BE COORDINATED W/ OWNER
S-135	SN-1	101	I	DISPATCH	TEXT TO BE COORDINATED W/ OWNER
S-201	SN-1	202	I	IT ROOM	TEXT TO BE COORDINATED W/ OWNER
S-202	SN-1	203	I	CHIEF'S OFFICE	TEXT TO BE COORDINATED W/ OWNER
S-203	SN-1	203	I	LEUTENANT	TEXT TO BE COORDINATED W/ OWNER
S-204	SN-1	205	I	CONFERENCE	TEXT TO BE COORDINATED W/ OWNER
S-205	SN-1	206	I	STORAGE	TEXT TO BE COORDINATED W/ OWNER
S-207	SN-1	207	I	MECHANICAL	TEXT TO BE COORDINATED W/ OWNER
S-209	SN-5	209	I	RECORDS	TEXT TO BE COORDINATED W/ OWNER

- ### CONSTRUCTION NOTES
- INTERIOR SIGNAGE DRAWINGS AND INFORMATION CONTAINED IN THIS SHEET IS FOR GENERAL DESIGN REQUIREMENTS ONLY. CONTRACTOR SHOULD VERIFY PROJECT CONDITIONS AND COORDINATE WITH OWNER FOR SPECIFIC REQUIREMENTS.
  - GC TO COORDINATE W/ OWNERS REF. TO DETERMINE IF ANY ADDITIONAL DIRECTIONAL SIGNAGE IS REQUIRED. REFER TO SPECIFICATIONS FOR WALL MOUNTING METHODS & ADDITIONAL INFORMATION.
  - ELECTRICAL ROOM TO HAVE DOOR MOUNTED SIGN WITH RED LETTERS "ELECTRIC ROOM".
  - SPRINKLER ROOM TO HAVE DOOR MOUNTED SIGN WITH RED LETTERS "SPRINKLER ROOM".
  - CUSTOM NAME/LOGO SIGNAGE TO BE PROVIDED AND INSTALLED BY AN OWNER APPROVED VENDOR. GC TO PROVIDE ALL BLOCKING, ELECTRIC AND ANGLIARY ITEMS.
  - U.O.M. MOUNT ALL SIGNS WITH BOTTOM EDGE OF SIGN, 30-INCHES ABOVE THE FINISHED FLOOR SURFACE, LEVEL.
  - COUSE REQUIRED SIGNAGE: RESTROOMS, BREAK ROOM, WELLNESS ROOMS, UTILITY ROOMS, EXITS, FIRE EXTINGUISHERS, RATED WALLS WITH CONCEALED SPACES, OCCUPANCY SIGNAGE.
  - INTERIOR AND EXTERIOR SIGNS IDENTIFYING PERMANENT ROOMS AND SPACES SHALL BE VISUAL CHARACTERS, RAISED CHARACTERS AND BRAILLE COMPLYING WITH ICC A117.1. WHERE PICTOGRAMS ARE PROVIDED AS DESIGNATIONS OF INTERIOR ROOMS AND SPACES, THE PICTOGRAMS SHALL HAVE VISUAL CHARACTERS, RAISED CHARACTERS AND BRAILLE COMPLYING WITH ICC A117.1.
  - SIGNS THAT PROVIDE DIRECTION TO OR INFORMATION ABOUT, PERMANENT INTERIOR SPACES OF THE SITE AND FACILITIES SHALL COMPLY WITH VISUAL CHARACTERS COMPLYING WITH ICC A117.1.
  - EXCEPTION: BUILDING DIRECTIONS, PERSONNEL NAMES, COMPANY OR OCCUPANT NAMES AND LOGOS, MENUS AND TEMPORARY (7 DAYS OR LESS) SIGNS ARE NOT REQUIRED TO COMPLY WITH ICC A117.1.
  - DIRECTIONAL SIGNAGE INDICATING THE ROUTE TO THE NEAREST LIFE ACCESSIBLE ELEMENT SHALL BE PROVIDED AT THE FOLLOWING LOCATIONS: THESE DIRECTIONAL SIGNS SHALL MEET THE INTERNATIONAL SYMBOLS OF ACCESSIBILITY AND SIGN CHARACTERS SHALL MEET THE VISUAL CHARACTER REQUIREMENTS IN ACCORDANCE WITH ICC A117.1.
    - INACCESSIBLE BUILDING ENTRANCES.
    - INACCESSIBLE PUBLIC TOILETS AND BATHING FACILITIES.
    - ELEVATORS NOT SERVING AN ACCESSIBLE ROUTE.
    - AT EACH SEPARATE SECTOR AND AT EACH CORNER INDICATING THE LOCATION OF THE NEAREST FAMILIARIZED USE TOILET OR BATHING ROOM WHERE:
    - AT STAIRS AND STAIRWAYS SERVING A REQUIRED ACCESSIBLE SPACE, BUT NOT PROVIDING AN APPROVED ACCESSIBLE MEANS OF EGRESS.
    - WHERE DRINKING FOUNTAINS FOR PERSONS USING WHEELCHAIRS AND DRINKING FOUNTAINS FOR STANDING PERSONS ARE NOT LOCATED ADJACENT TO EACH OTHER, DIRECTIONAL SIGNAGE SHALL BE PROVIDED INDICATING THE LOCATION OF THE OTHER DRINKING FOUNTAINS.
  - ACCESSIBLE ELEMENTS SIGNAGE: REQUIRED ACCESSIBLE ELEMENTS SHALL BE IDENTIFIED BY THE INTERNATIONAL SYMBOL OF ACCESSIBILITY AT THE FOLLOWING LOCATIONS:
    - ACCESSIBLE PARKING SPACES, UNLESS THE TOTAL NUMBER OF PARKING SPACES PROVIDED IS FOUR OR LESS. EXCEPTION: IN GROUP 1, 1.1, 1.2, 1.3, 1.4 AND 1.5 FACILITIES, WHERE PARKING SPACES ARE ASSIGNED TO SPECIFIC TRAVELING UNITS OR SLEEPING UNITS, IDENTIFICATION OF ACCESSIBLE PARKING SPACES IS NOT REQUIRED.
    - ACCESSIBLE PASSENGER LOADING ZONES.
    - ACCESSIBLE ROOMS WHERE MULTIPLE SINGLE-USER TOILET OR BATHING ROOMS ARE CLUSTERED AT A SINGLE LOCATION.
    - ACCESSIBLE ENTRANCES WHERE NOT ALL ENTRANCES ARE ACCESSIBLE.
    - ACCESSIBLE CHECK-OUT AND/OR WHERE NOT ALL AND/OR ACCESSIBLE. THE SIGN, WHERE PROVIDED, SHALL BE ABOVE THE CHECK-OUT AISLE IN THE SAME LOCATION AS THE CHECK-OUT AISLE NUMBER OR TYPE OF CHECK-OUT IDENTIFICATION.
    - FAMILY OR ASSISTED-USE TOILET AND BATHING ROOMS.
    - ACCESSIBLE DRESSING, FITTING AND LOCKER ROOMS WHERE NOT ALL SUCH ROOMS ARE ACCESSIBLE.
    - ACCESSIBLE AREAS OF REFUGE.
    - EXTERIOR AREAS FOR ASSISTED RESCUE.
    - LOCKERS THAT ARE REQUIRED TO BE ACCESSIBLE.
  - TOILET ROOM DOOR SIGNS:
    - WOMEN'S TOILET ROOMS: INCLUDE FEMALE PICTOGRAM.
    - MEN'S TOILET ROOMS: INCLUDE MALE PICTOGRAM.
    - UNISEX TOILET ROOMS: INCLUDE MALE AND FEMALE PICTOGRAMS.
    - ACCESSIBLE TOILET ROOMS: INCLUDE INTERNATIONAL SYMBOL OF ACCESSIBILITY.
  - RAISED LETTER SIGNAGE SHALL BE FABRICATED AND INSTALLED ACCORDING TO THE FOLLOWING REFERENCES: AMERICAN A117.1, CHAPTER 7, AMERICAN NATIONAL STANDARDS FOR ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES/INTERNATIONAL CODE COUNCIL, 2009, 29 CFR CHAPTER XVII, OSHA, PARAGRAPH (1910.133)(b)(1).
  - RAISED LETTER SIGN:
    - BASE MATERIAL: 1/8 INCH THICKNESS.
    - COLOR: MATCH DOOR FINISH COLOR.
    - LETTERS AND NUMBERS SHALL BE RAISED 1/32" MIN. IN UPPER CASE. LOWER CASE SHALL NOT BE ITALIC, OBLIQUE, SCRIPT, HIGHLY DECORATIVE OR OF OTHER UNUSUAL FORMS. FOR OTHER SIGNAGE IDENTIFICATION REFER TO ICC A117.1, CHAPTER 7, 2009 SECTION 703.4.
    - WHERE A SIGN CONTAINING RAISED CHARACTERS AND BRAILLE IS PROVIDED AT A DOOR, THE SIGN SHALL BE INSTALLED ON THE WALL AT THE LATCH SIDE OF THE DOOR, AT DOUBLE DOORS WITH ONE ACTIVE LEAF, THE SIGN SHALL BE LOCATED ON THE INACTIVE LEAF. AT DOUBLE DOORS WITH TWO ACTIVE LEAVES, THE SIGN SHALL BE TO THE RIGHT OF THE RIGHT-HAND DOOR, WHERE THERE IS NO WALL SPACE ON THE LATCH SIDE OF A SINGLE DOOR, OR TO THE RIGHT SIDE OF DOUBLE DOORS. SIGNS SHALL BE ON THE NEAREST ADJACENT WALL. SIGNS CONTAINING RAISED CHARACTERS AND BRAILLE SHALL BE LOCATED SO THAT A CLEAR FLOOR AREA 18 INCHES (455 MM) MINIMUM BY 18 INCHES (455 MM) MINIMUM, CENTERED ON THE ADJACENT WALL, IS PROVIDED BEYOND THE ARC OF DOUBLE DOORS BEHIND THE CLOSED POSITION AND 45 DEGREE OPEN POSITION. FOR DOUBLE DOORS, POSITION CENTER OF SIGN TO THE RIGHT OF THE RIGHT-HAND DOOR HINGES, WHERE THERE IS NO WALL SPACE ON THE SINGLE DOOR, OR TO THE RIGHT SIDE OF DOUBLE DOORS, SIGN SHALL BE ON THE NEAREST ADJACENT WALL.
    - THE CHARACTERS AND BACKGROUND OF SIGNS SHALL HAVE A NON-GLOSS FINISH. CHARACTERS SHOULD CONTRAST WITH THEIR BACKGROUND - EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND. PICTOGRAMS SHALL HAVE A FIELD HEIGHT OF 6" MIN. WITH A NON-GLOSS FINISH AND CONTRAST WITH THEIR BACKGROUND. PICTOGRAMS SHALL HAVE TEXT DESCRIPTORS PLACED DIRECTLY ON THE PICTOGRAM.
  - SIGNAGE REQUIREMENTS FOR FIRE WALLS, FIRE BARRIERS, FIRE PARTITIONS, SMOKE BARRIERS, SMOKE PARTITIONS, OR ANY OTHER WALLS REQUIRED TO HAVE PROTECTED OPENINGS:
    - PERMANENT SIGNS OR STENCILING SHALL BE LOCATED WITHIN ANY CONCEALED SPACES.
    - LOCATIONS: SIGNS SHALL BE LOCATED WITHIN 18" FEET (4875 MM) OF THE END OF EACH WALL AND AT INTERVALS NOT EXCEEDING 30 FEET (9144 MM) MEASURED HORIZONTALLY ALONG THE WALL OR PARTITION.
    - LETTERING: SIGNS SHALL INCLUDE LETTERING NOT LESS THAN 3 INCHES (76 MM) IN HEIGHT WITH A MINIMUM 3/16-INCH (9.5 MM) STROKE IN RED, OR ANOTHER CONTRASTING COLOR IF RED WILL NOT CREATE A CONTRAST.
    - SIGNS SHALL INCLUDE "FIRE AND/OR SMOKE BARRIER - PROTECT ALL OPENINGS".
  - PERMANENT SIGNAGE:
    - PERMANENT SIGNAGE (A.K.A. FEEL-AND-TOUCH SIGNS) SHALL BE LIMITED TO THE FOLLOWING:
      - EMERGENCY EXIT ONLY SIGNS AT PERSONNEL DOORS.
      - FIRE EXTINGUISHER LOCATOR IDENTIFICATION SIGNS.
      - EXTERIOR MECHANICAL ROOM SIGNS, I.E. SPRINKLER ROOM, ELECTRICAL ROOM, ETC.
    - PERMANENT SIGNAGE SHALL BE LIMITED TO A SET APPLICATION METHOD, APPLIED TO SMOOTH, DRY, CLEAN SUBSTRATES.
    - CLEANING OF THE SUBSTRATE TO WHICH THE SIGN WILL BE APPLIED AND APPLICATION SHALL BE IN STRICT ACCORD WITH THE FILM MANUFACTURERS PRINT/PUBLISHED GENERAL PROCEDURES.
    - APPROVED SIGN FILM MATERIAL:
      - 3M COMMERCIAL GRAPHICS, CONTROLAC BRAND, GRAPHIC FILM SERIES 1800, OR APPROVED EQUAL.
      - GRAPHIC FILM SERIES 182, 2 SERIES 180, PRODUCT SHALL NOT BE APPLIED WHEN SHEET LIFE OF MATERIAL HAS REACHED OR EXCEEDS THIS REQUIREMENT.
  - REFER TO LIFE SAFETY DRAWINGS FOR EXIT SIGN LOCATIONS AND ADDITIONAL SIGNAGE RELATED INFORMATION.
  - FURNISH AND INSTALL ALL TRAFFIC AND EXTERIOR SIGNS INCLUDING ALL SIGNPOSTS AS SHOWN ON THE DRAWINGS UNLESS NOTES OTHERWISE. ALL TRAFFIC SIGNS SHALL BE HIGH INTENSITY FLUORESCENT, GRADE (IF GRADED).
  - ALL TRAFFIC SIGNS AND FREE-STANDING SIGNPOSTS SHALL CONFORM TO THE US DEPARTMENT OF TRANSPORTATION, FEDERAL HIGHWAY ADMINISTRATION (FHWA) MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD), LATEST EDITION UNLESS OTHERWISE SPECIFIED BY STATE OR LOCAL REQUIREMENTS.
  - EXTERIOR SIGNAGE: THE OWNER'S AGENT SHALL FURNISH AND INSTALL THE OWNER'S SIGNATURE BUILDING MOUNTED AND GROUND LEVEL EXTERIOR SIGNAGE.
  - BEFORE INSTALLATION, THE OWNER'S AGENT WILL COORDINATE THE FINAL SIGNAGE SELECT/DESIGN WITH LOCAL APPLICABLE CODES OR REQUIREMENTS, AS WELL AS ALL LOCAL AUTHORITIES HAVING JURISDICTION.
  - EXTERIOR SIGNAGE, BUILDING MOUNTED, STRUCTURAL REQUIREMENTS: THE OWNER'S SIGNAGE VENDOR SHALL FURNISH AND INSTALL ALL STRUCTURAL REINFORCING, SUPPLIES, ELECTRIC BOARDS, AND ASSOCIATED HARDWARE AS REQUIRED TO SUPPORT THE BUILDING MOUNTED SIGNAGE. VENDOR TO COORDINATE W/ G.C. PRIOR TO APPLICATION OF EXTERIOR WALL FINISH. GC IS RESPONSIBLE FOR PROVIDING ALL ELECTRICAL, STRUCTURAL BLOCKING, ETC., PRIOR TO WALL FINISH BEING INSTALLED.

### REVISIONS:

NUM.	DATE	DESCRIPTION
A	04/17/25	ADDENDUM 2
B	04/25/25	ADDENDUM 3

---

### 100% BID DOCUMENTS

**ADG ARCHITECTS**

25 WALLKILL AVE • MONTGOMERY • NY 12549  
 O. 845.294.2724 | F. 888.305.6442

WWW.ADGARCHITECT.COM  
 CONTACT@ADGARCHITECT.COM


ARCHITECTURE • PLANNING • INTERIORS


Project: **TOWN OF MONTGOMERY POLICE STATION**  
 106 BRACKEN ROAD  
 MONTGOMERY, NEW YORK 12549

Drawing: **INTERIOR SIGN SCHEDULE**

Project: 23138 Date: 02/24/25  
 Drawn: IDEA Scale: AS NOTED  
 Drawing Number: 04252005

Exp. 02/28/2026

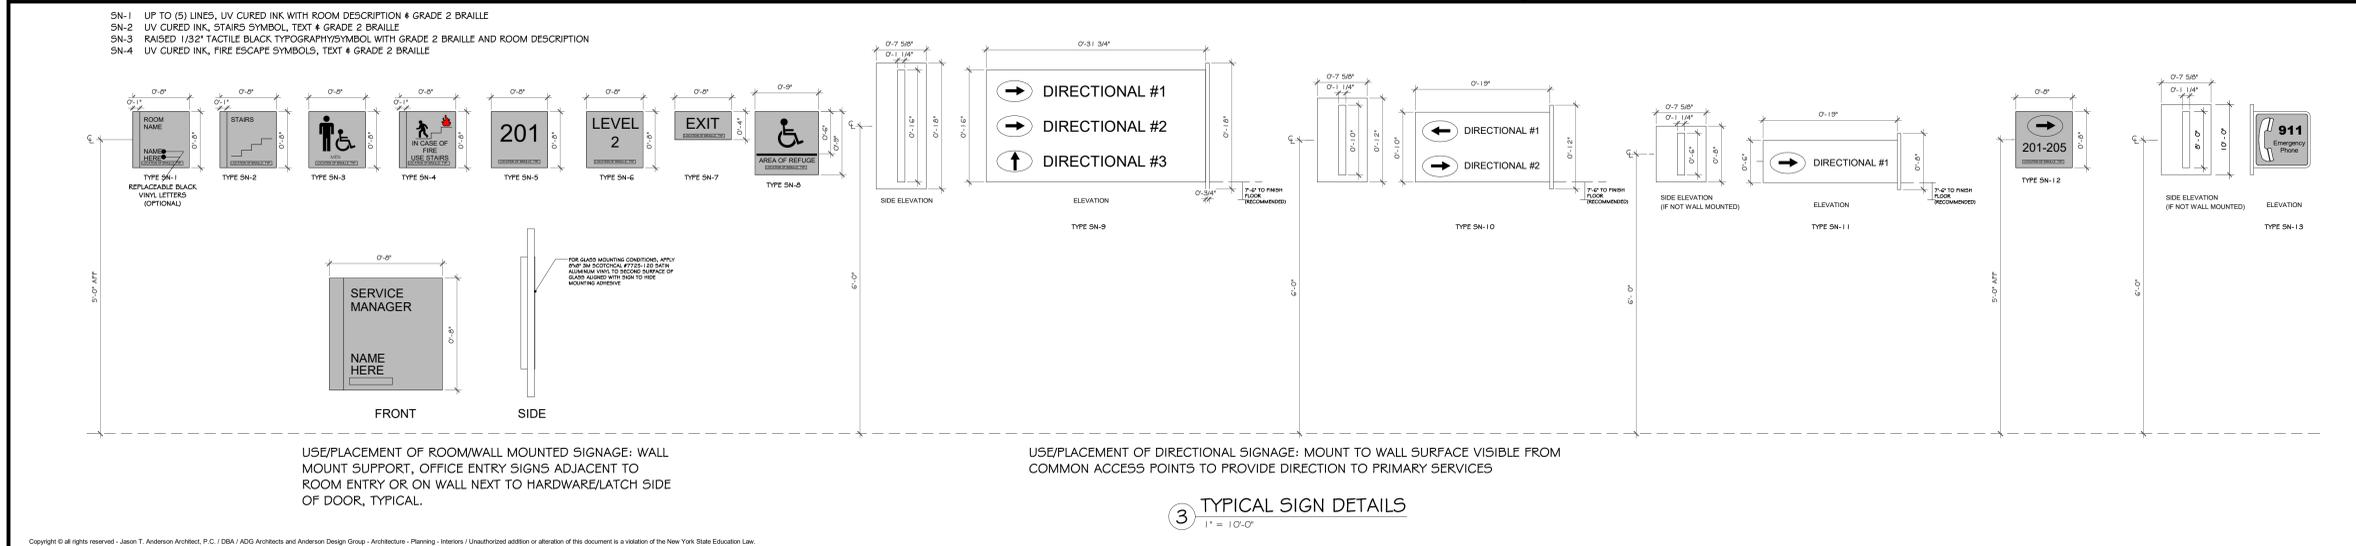


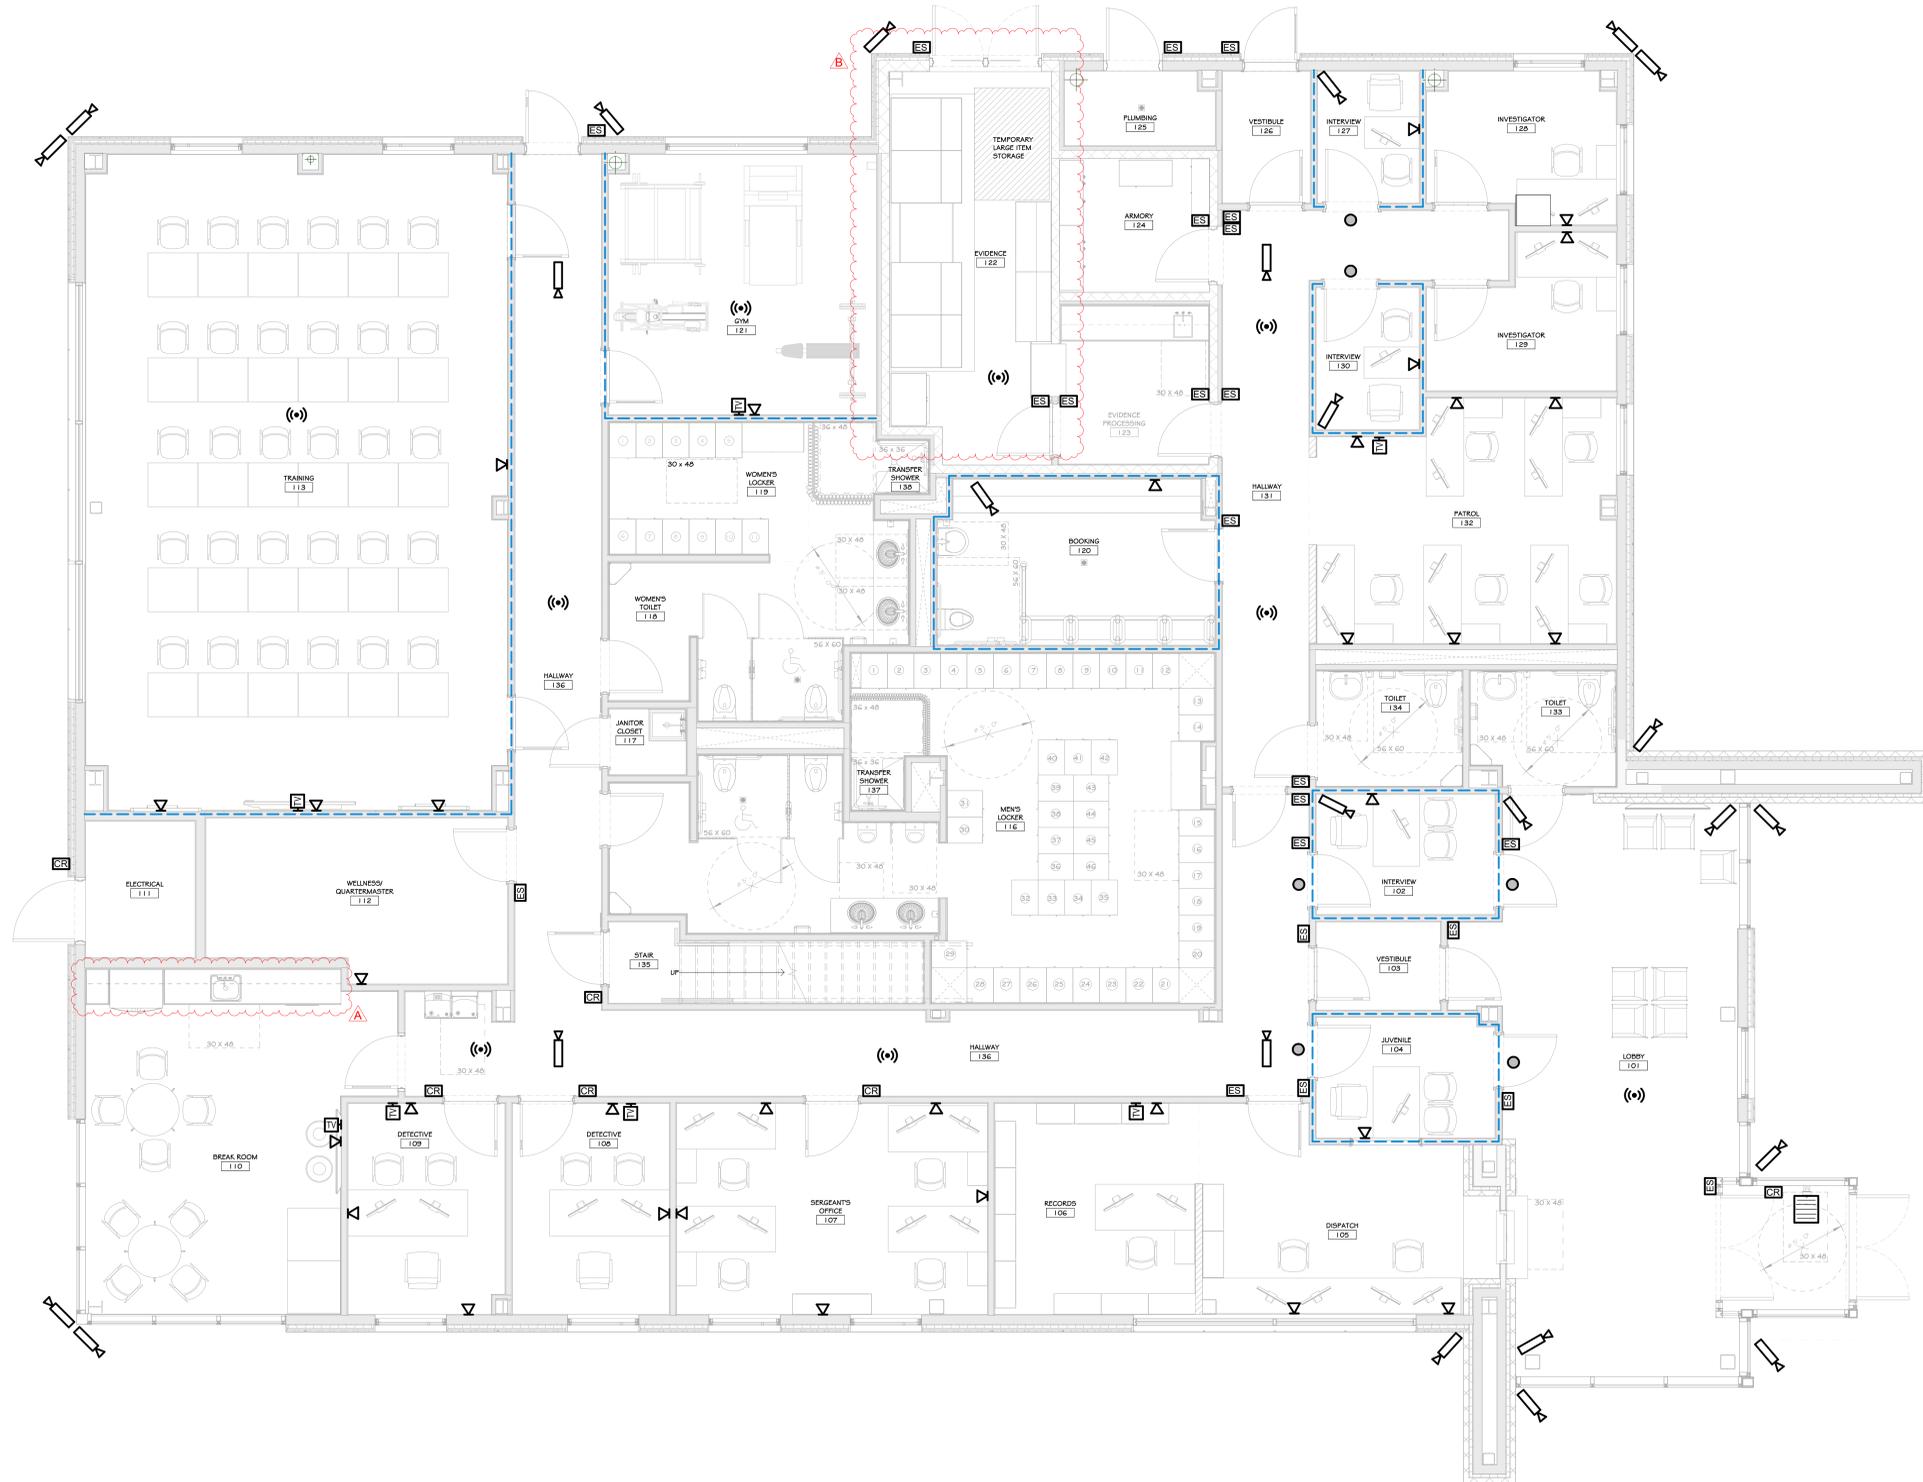

1 FIRST FLOOR IT-AV PLAN  
1/4" = 1'-0"

CONSTRUCTION NOTES

- ELECTRICAL CONTRACTOR WILL BE RESPONSIBLE FOR INSTALLING ALL DATA BOXES, DATA CONDUIT, AND RUNNING OF DATA CABLING AS DESCRIBED IN NOTE #2.
- DATA CABLING TO BE INSTALLED AS NOTED:
  - BLUE - NETWORK
  - WHITE - VOIP
  - PURPLE - WIFI
  - GREEN - ACCESS CONTROL CABLE
  - ORANGE - CAMERAS
- THE OWNER WILL BE RESPONSIBLE FOR ALL DATA WIRING PUNCH DOWNS, FACE PLATES, LABELING, AND CERTIFYING OF DATA CABLING.
- THE OWNER WILL PROVIDE ALL NECESSARY NETWORKING EQUIPMENT, INCLUDING BUT NOT LIMITED TO, PATCH PANELS, 19 RACK WIRE LABELERS, WIRELESS NETWORKING EQUIPMENT, 4 TELEVISIONS.
- THE OWNER WILL PROVIDE ALL SPEAKERS AND MICROPHONE SYSTEMS.
- THE OWNER WILL PROVIDE THE CAMERA SYSTEM AND ALL ASSOCIATED EQUIPMENT AND CAMERAS.
- THE OWNER WILL PROVIDE THE VOIP PHONE SYSTEM AND ASSOCIATED EQUIPMENT.
- CONDUIT TO BE PROVIDED AT THE FLOOR OF THE 11, ROOM TO ALLOW CABLES TO PASS FROM FLOOR TO FLOOR.

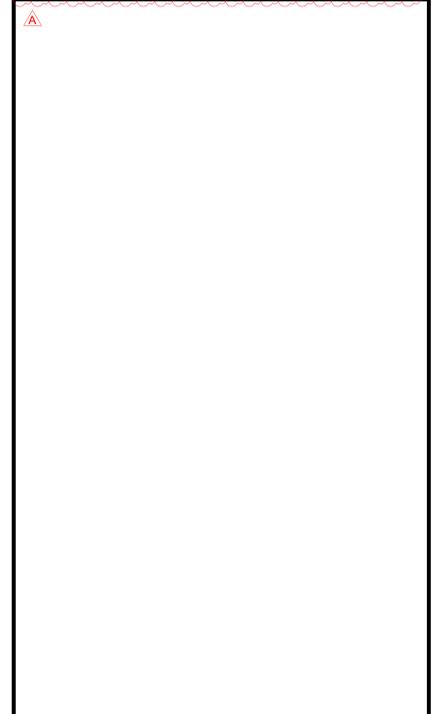

LEGEND

	SECURITY CAMERA
	DATA OUTLET
	CABLE TELEVISION OUTLET
	WIRELESS ACCESS POINT
	ACCESS CONTROL READER
	ELECTRONIC STRIKE (12V REDD)
	SECURITY MONITOR
	911 EMERGENCY PHONE
	PRIVACY INDICATOR LIGHT

REVISIONS:

NUM.	DATE	DESCRIPTION
A	04/17/25	ADDENDUM 2
B	04/25/25	ADDENDUM 3

100% BID DOCUMENTS

PROJECT

KEY PLAN

ADG ARCHITECTS

25 WALKHILL AVE • MONTGOMERY • NY 12549  
O. 845.294.2724 | F. 888.305.6442  
WWW.ADGARCHITECT.COM  
CONTACT@ADGARCHITECT.COM

ARCHITECTURE • PLANNING • INTERIORS

Project: TOWN OF MONTGOMERY POLICE STATION  
106 BRACKEN ROAD  
MONTGOMERY, NEW YORK 12549

Drawing: FIRST FLOOR IT-AV PLAN

Project: 23138 Date: 02/24/25  
Drawn: IDEA Scale: AS NOTED  
Drawing Number: A-903

L. 4113 P. 305



LOCATION PLAN  
1 INCH = 2000 FEET

LEGEND:

- PROPOSED GRASS
- PROPOSED CONCRETE
- PROPOSED PAVEMENT
- PROPERTY LINE
- ADJOINING PROPERTY LINE
- EXISTING EDGE OF PAVEMENT/CURB
- PROPOSED LOT LINE//RIGHT OF WAY
- PROPOSED EDGE OF PAVEMENT AND CURB
- PROPOSED DRIVEWAY
- PROPOSED GUIDERAIL
- PROPOSED FENCE
- PROPOSED MAJOR CONTOUR
- PROPOSED MINOR CONTOUR
- PROPOSED SANITARY SEWER
- PROPOSED DRAINAGE
- EXISTING WATER
- EXISTING SEWER
- EXISTING GAS
- EXISTING COMMUNICATION LINE
- EXISTING ELECTRIC
- UNKNOWN MARKOUT
- EXISTING LIGHTING POLES



RECORD OWNER:


TOWN OF MONTGOMERY  
110 BRACKEN ROAD  
MONTGOMERY, NY 12549

L. 4113 P. 305  
L. 4728 P. 64  
30 - 1 - 87  
FM LOT  
MAP NO. 138-94

AREA:

11.496± AC.

GRAPHIC SCALE



COPYRIGHT 2024, LANC & TULLY, P.C.

LANC & TULLY  
Engineering and Surveying, P.C.

P.O. Box 687, Rt. 207  
Goshen, N.Y. 10924  
(845) 294-3700

SITE PLAN PREPARED FOR

NEW POLICE FACILITY  
(TOWN OF MONTGOMERY)

TOWN OF MONTGOMERY  
ORANGE COUNTY, NEW YORK

Date:	MARCH 6, 2024
Revisions:	MARCH 28, 2024 JUNE 18, 2024 AUGUST 15, 2024 OCTOBER 24, 2024 DECEMBER 23, 2024 JANUARY 14, 2025 APRIL 17, 2025 APRIL 25, 2025
CAD File:	SITE PLAN-364/WALLS
Layout:	SITE PLAN
Sheet No.:	2 OF 6
Drawing No.:	C30
A-18	- 2309 - 01

Drawn By: PDLs  
Checked By:  
Scale: 1" = 20'  
Tax Map No.: 30-1-87




COPIES FROM THE ORIGINAL OF THIS DOCUMENT NOT MARKED WITH AN ORIGINAL OF THE PROFESSIONAL ENGINEER'S AND/OR LAND SURVEYOR'S STAMP OR EMBOSSED SEAL SHALL NOT BE CONSIDERED VALID, TRUE COPIES.



UNAUTHORIZED ALTERATION OR ADDITION TO THIS DOCUMENT IS A VIOLATION OF SECTION 7209-2 OF THE NEW YORK STATE EDUCATION LAW.




**LEGEND:**

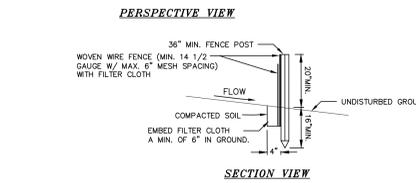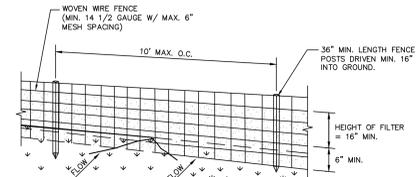


**CONSTRUCTION SPECIFICATIONS**

1. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES OR STAPLES. POSTS SHALL BE STEEL EITHER "T" OR "U" TYPE OR HARDWOOD.
2. FILTER CLOTH TO BE TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID SECTION. FENCE SHALL BE WOVEN WIRE, 12 1/2 GAUGE, 6" MAXIMUM MESH OPENING.
3. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVERLAPPED BY SIX INCHES AND FOLDED. FILTER CLOTH SHALL BE EITHER FILTER X, MIRAFI 100X, STABILINKA T140N, OR APPROVED EQUIVALENT.
4. PREFABRICATED UNITS SHALL BE GEOFAB, ENVIROFENCE, OR APPROVED EQUIVALENT.
5. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

**SILTATION FENCE**  
NOT TO SCALE

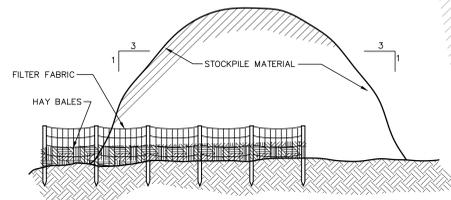

**TYPICAL STOCKPILE DETAIL**  
NOT TO SCALE

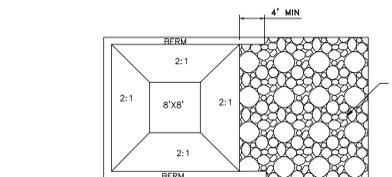

**CONCRETE WASHOUT AREA DETAIL**  
NOT TO SCALE

COPIES FROM THE ORIGINAL OF THIS DOCUMENT NOT MARKED WITH AN ORIGINAL OF THE PROFESSIONAL ENGINEER'S AND/OR LAND SURVEYOR'S STAMP OR EMBOSSED SEAL SHALL NOT BE CONSIDERED VALID, TRUE COPIES.



**CATCH BASIN SEDIMENT TRAP**  
NOT TO SCALE

**CONSTRUCTION SPECIFICATION FOR ST-III**

1. SEDIMENT SHALL BE REMOVED AND THE TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN THE SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH OF THE TRAP. REMOVED SEDIMENT SHALL BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
2. THE VOLUME OF SEDIMENT STORAGE SHALL BE 3600 CUBIC FEET PER ACRE OF CONTRIBUTORY DRAINAGE. THE MAXIMUM DRAINAGE AREA IS 3 ACRES.
3. THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.
4. CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND WATER POLLUTION SHALL BE MINIMIZED.
5. THE SEDIMENT TRAP SHALL BE REMOVED AND THE AREA STABILIZED WHEN THE CONTRIBUTED DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.
6. ALL CUT SLOPES SHALL BE 1:1 OR FLATTER.


**STORM DRAIN INLET FILTER DETAIL**  
NOT TO SCALE

**CONSTRUCTION SPECIFICATIONS:**

1. FILTER FABRIC SHALL HAVE AN EOS OF 40-85.
2. WOODEN FRAME SHALL BE CONSTRUCTED OF 2" x 4" CONSTRUCTION GRADE LUMBER.
3. WIRE MESH THROAT SHALL BE A CONTINUOUS PIECE 30 INCH MINIMUM WIDTH WITH A LENGTH 4 FEET LONGER THAN THE THROAT. IT SHALL BE SHARPED AND SECURELY NAILED TO A 2" x 4" WEIR.
4. THE WEIR SHALL BE SECURELY NAILED TO 2" x 4" SPACERS 9 INCHES LONG SPACED NO MORE THAN 6 FEET APART.
5. THE ASSEMBLY SHALL BE PLACED AGAINST THE INLET AND SECURED BY 2" x 4" ANCHORS 2 FEET LONG EXTENDING ACROSS THE TOP OF THE INLET AND HELD IN PLACE BY SANDBAGS OR ALTERNATE WEIGHTS.
6. THE STONE USED TO HOLD AND COVER THE FILTER FABRIC SHALL BE LOOSELY PLACED, 2" MIN. DIAM. ROUND STONE.

MAXIMUM DRAINAGE AREA 1 ACRE

**STABILIZED CONSTRUCTION ENTRANCE DETAIL**  
NOT TO SCALE

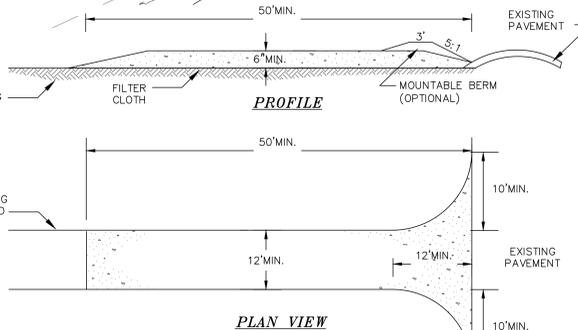

**CONSTRUCTION SPECIFICATIONS:**

1. STONE SIZE - 1" TO 4" STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.
2. LENGTH - AS REQUIRED, BUT NOT LESS THAN 50 FEET (EXCEPT ON A SINGLE RESIDENCE LOT WHERE 30 FOOT MINIMUM WOULD APPLY).
3. THICKNESS - NOT LESS THAN SIX (6) INCHES.
4. WIDTH - 12 FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCUR. 24-FOOT MINIMUM IF THERE IS ONLY ONE ACCESS TO THE SITE.
5. GEOTEXTILE - WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE. FILTER CLOTH WILL NOT BE REQUIRED ON A SINGLE FAMILY RESIDENCE LOT.
6. SURFACE WATER - ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE. IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
7. MAINTENANCE - THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT INTO PUBLIC RIGHT OF WAY THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHT OF WAY MUST BE REMOVED IMMEDIATELY.
8. WASHING - WHEN WHEEL WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
9. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN.

**SEDIMENT AND EROSION CONTROL SEQUENCING**

1. CONSTRUCT STABILIZED CONSTRUCTION ENTRANCES WHERE SHOWN ON THE PLAN.
2. INSTALL SEDIMENT BARRIERS/SWALES/DITCHES/DIKES AT DOWN SLOPE AREAS FROM ALL PROPOSED GRADING OPERATIONS, AND INSTALL OTHER SEDIMENTATION AND EROSION CONTROL STRUCTURES OR MEASURES AS SHOWN ON THE DRAWINGS.
3. LAND DISTURBANCE SHALL BE LIMITED TO ONLY THAT AREA NECESSARY FOR DEVELOPMENT. NO MORE THAN FIVE (5) ACRES OF UNPROTECTED SOIL SHALL BE DISTURBED ONE TIME. PREVIOUS EARTHWORK SHALL BE STABILIZED AS SPECIFIED BEFORE ADDITIONAL AREA IS EXPOSED.
4. CLEAR EXISTING TREES AND VEGETATION FROM AREAS TO BE EXCAVATED OR FILLED, THEN STRIP AND STOCKPILE TOPSOIL FROM ALL AREAS TO BE DISTURBED. SEED STOCKPILED TOPSOIL WITH TEMPORARY RYEGRASS COVER AS SPECIFIED BELOW (SEE NOTE 8), AND ERECT A SILT FENCE AROUND THE STOCKPILE.
5. PROTECT ALL TREES WHICH ARE TO REMAIN AND WHICH ARE IN OR NEAR CONSTRUCTION AREAS DIRECTED IN THE FIELD WITH SNOW FENCING OR TREE TRUNK PLACE SNOW FENCING AT THE DRIPLENE SURROUNDING TREES, IF POSSIBLE, OR TO MAINTAIN A MINIMUM DIAMETER OF 10 FEET AROUND TREES. WHERE FENCING MUST BE PLACED CLOSER THAN THE DRIP LINE, PLACE 4 INCHES OF WOOD CHIPS OVER ROOT ZONE TO EXTEND TO THE DRIP LINE. MAINTAIN THIS WOOD CHIP PROTECTION FOR THE DURATION OF CONSTRUCTION.
6. PERFORM NECESSARY EXCAVATION OR FILL OPERATIONS TO BRING SITE TO DESIRED SUBGRADE. INSTALL STORM DRAINAGE SYSTEM.
7. INSTALL SEDIMENT BARRIERS AROUND ALL STORM DRAIN INLETS, OR MODIFY SEDIMENT CONTROL MEASURES INSTALLED IN #2 ABOVE AND MAINTAIN UNTIL ALL DISTURBED AREAS ARE STABILIZED WITH VEGETATION AND ALL PAVEMENTS ARE PAVED WITH A BASE COURSE.
8. SEED ALL DISTURBED AREAS WHICH WILL REMAIN UNDISTURBED FOR A PERIOD OF 15 DAYS OR MORE AND WHICH WILL NOT BE UNDER CONSTRUCTION WITHIN 30 DAYS WITH TEMPORARY RYEGRASS COVER, AS FOLLOWS (METHOD OF SEEDING IS OPTIONAL):
  - A. LOOSEN SEEDBED BY DIGGING TO A 4" DEPTH.
  - B. SEED WITH 5 LBS PER ACRE PERENNIAL OR ANNUAL RYEGRASS.
  - C. MULCH WITH 100-200 BALES PER ACRE OF BLOWN AND CHOPPED HAY BOUND IN PLACE WITH 2000 LBS PER ACRE CELLULOSE FIBER MULCH, AND WITH AN APPROVED TACKIFIER BINDER.
9. IF CONSTRUCTION IS SUSPENDED OR COMPLETED, ALL DISTURBED AREAS SHALL BE SEED AND MULCHED IMMEDIATELY. ALL SLOPES STEEPER THAN ONE ON THREE (1/3) AND PERIMETER TRENCHES AND TRAP EMBANKMENTS SHALL, ON COMPLETION, BE IMMEDIATELY STABILIZED WITH TEMPORARY SEEDING AND MULCHING.
10. AFTER COMPLETION OF SITE CONSTRUCTION, FINE GRADE AND SPREAD TOPSOIL ON ALL LAWN AREAS AND SEED WITH PERMANENT LAWN MIX AS FOLLOWS (SEE LANDSCAPE PLAN FOR OTHER PLANTING INFORMATION):
  - A. LIME TOPSOIL TO PH 6.0.
  - B. FERTILIZE WITH 20 LBS PER SQ. FT. OF 5-10-10, 50% WATER SOLUBLE NITROGEN FERTILIZER.
  - C. SEED WITH 5 LBS PER 1000 SQ. FT. OF THE FOLLOWING MIXTURE, OR OTHER MIXTURE APPROVED BY THE LANDSCAPE ARCHITECT: 40% JAMESTOWN CHEWINGS FESCUE, 40% BARON KENTUCKY BLUEGRASS AND 20% YORKTOWN PERENNIAL RYEGRASS.
  - D. MULCH AS DESCRIBED FOR TEMPORARY SEEDING (NOTE 8 ABOVE).
  - E. FERTILIZE 4 WEEKS AFTER GERMINATION WITH 10 LBS 20-10-10 FERTILIZER PER 1000 SQ. FT.
11. DURING THE PROGRESS OF CONSTRUCTION, MAINTAIN ALL SEDIMENT TRAPS, BARRIERS, AND FILTERS AS NECESSARY TO PREVENT THEIR BEING CLOGGED UP WITH SEDIMENT.
12. AFTER PAVEMENTS ARE INSTALLED AND PERMANENT VEGETATIVE COVER AND PLANTINGS ARE ESTABLISHED, REMOVE SEDIMENT BARRIERS AND SEED THOSE DISTURBED AREAS.
13. MAINTAIN ALL SEEDED AND PLANTED AREAS TO INSURE A VIABLE STABILIZED VEGETATIVE COVER.
14. STRUCTURAL MEASURES MUST BE MAINTAINED TO BE EFFECTIVE. IN GENERAL, THESE MEASURES MUST BE PERIODICALLY INSPECTED TO INSURE STRUCTURAL INTEGRITY, TO DETECT VANDALISM DAMAGE, AND FOR CLEANING AND REPAIR WHENEVER NECESSARY.
15. DURING CONSTRUCTION, ALL STRUCTURES SHOULD BE INSPECTED WEEKLY AND AFTER EVERY RAIN. REMOVE ACCUMULATED SEDIMENT AND STOCKPILE AND STABILIZE IN AN AREA NOT SUBJECT TO FURTHER EROSION.
16. AFTER CONSTRUCTION IS COMPLETED, PERMANENT SEDIMENT OR EROSION CONTROL STRUCTURES SHOULD BE INSPECTED AT LEAST SEMI-ANNUALLY AND AFTER EVERY RAIN.

**WINTER SITE STABILIZATION AND INSPECTIONS**

THIS GUIDANCE IS TO ADDRESS THE REQUIREMENTS FOR WINTER SITE STABILIZATION ON CONSTRUCTION SITES WHERE THE OWNER/OPERATOR WISHES TO REDUCE WEEKLY SITE INSPECTIONS THAT ARE REQUIRED PURSUANT TO PART III.D.3.A. OF THE STATE POLLUTANT DISCHARGE ELIMINATION SYSTEM GENERAL PERMIT GP-02-01.

THE OWNER/OPERATOR IS REQUIRED TO HAVE A QUALIFIED PROFESSIONAL CONDUCT A SITE INSPECTION AT LEAST EVERY 7 CALENDAR DAYS FROM THE END OF A STORM EVENT OF 0.5 INCHES OR GREATER. AT THE END OF THE CONSTRUCTION SEASON WHEN SOIL DISTURBANCE ACTIVITIES WILL BE FINALIZED OR SUSPENDED UNTIL THE FOLLOWING SPRING, IT MAY BE DESIRABLE TO REDUCE THE FREQUENCY OF THE REQUIRED INSPECTIONS.

IF THE SOIL DISTURBANCE IS COMPLETELY SUSPENDED AND THE SITE IS PROPERLY STABILIZED AN OWNER/OPERATOR MAY REDUCE THE SELF-INSPECTION FREQUENCY, BUT SHALL MAINTAIN A MINIMUM OF MONTHLY INSPECTIONS IN ALL SITUATIONS (EVEN WHEN THERE IS TOTAL WINTER SHUTDOWN), DURING PERIODS OF REDUCED INSPECTION FREQUENCY, INSPECTIONS MUST STILL BE DONE AFTER EVERY STORM EVENT OF 0.5 INCHES OR GREATER.

TO BE ALLOWED TO REDUCE INSPECTION FREQUENCIES, THE OPERATOR MUST COMPLETE STABILIZATION ACTIVITIES (PERIMETER CONTROLS, TRACKING BARRIERS ETC) BEFORE PROPER INSTALLATION IS PRECLUDED BY SNOW COVER OR FROZEN GROUND. IF VEGETATION IS DESIRED, SEEDING, PLANTING, AND/OR SOODING MUST BE SCHEDULED TO AVOID DIE-OFF FROM FALL FROSTS AND ALLOW FOR PROPER GERMINATION/ESTABLISHMENT.

ALL EROSION AND SEDIMENT CONTROLS MUST BE INSTALLED AND MAINTAINED ACCORDING TO THE NYS STANDARDS AND SPECIFICATIONS FOR EROSION AND SEDIMENT CONTROL (AKA BLUE BOOK). THE MAIN ITEMS TO CONSIDER ARE:


1. SITE STABILIZATION - ALL BARE/EXPOSED SOILS MUST BE STABILIZED BY AN ESTABLISHED VEGETATION, STRAW OR MULCH, MATTING, ROCK OR OTHER APPROVED PRODUCT SUCH AS ROLLED EROSION CONTROL PRODUCT. SEEDING OF AREAS ALONG WITH MULCHING IS ENCOURAGED, HOWEVER SEEDING ALONE IS NOT CONSIDERED ACCEPTABLE FOR PROPER STABILIZATION.
2. SEDIMENT BARRIERS - BARRIERS MUST BE PROPERLY INSTALLED AT ALL NECESSARY PERIMETER AND SENSITIVE LOCATIONS.
3. SLOPES - ALL SLOPES AND GRADES MUST BE PROPERLY STABILIZED WITH APPROVED METHODS. ROLLED EROSION CONTROL PRODUCTS MUST BE USED ON ALL SLOPES GREATER THAN 3/1, OR WHERE CONDITIONS FOR EROSION DICTATE SUCH MEASURES.
4. SOIL STOCKPILES - STOCKPILES MUST BE PROTECTED BY THE USE OF ESTABLISHED VEGETATION, AN ANCHORED-DOWN STRAW OR MULCH, ROLLED EROSION CONTROL PRODUCT OR OTHER DURABLE COVERING. A BARRIER MUST BE INSTALLED AROUND THE PILE TO PREVENT EROSION AWAY FROM THAT LOCATION.
5. CONSTRUCTION ENTRANCE - ALL ENTRANCE/EXIT LOCATIONS TO THE SITE MUST BE PROPERLY STABILIZED AND MUST BE MAINTAINED TO ACCOMMODATE SNOW MANAGEMENT AS SET FORTH IN THE NYS STANDARDS AND SPECIFICATIONS FOR EROSION AND SEDIMENT CONTROL.
6. SNOW MANAGEMENT - SNOW MANAGEMENT MUST NOT DESTROY OR DEGRADE EROSION AND SEDIMENT CONTROL PRACTICES.

FROZEN GROUND, WINTER CONDITIONS AND EQUIPMENT CAN AFFECT EROSION AND SEDIMENT CONTROL PRACTICES. CHECK FOR DAMAGE DURING MONTHLY INSPECTIONS AND REPAIR AS NECESSARY. THIS IS ESPECIALLY IMPORTANT DURING THAW AND PRIOR TO SPRING RAIN EVENTS. WEEKLY INSPECTIONS MUST RESUME NO LATER THAN MARCH 15 OR AS DIRECTED BY THE DEPARTMENT.

THIS EROSION CONTROL PLAN SHALL BE USED FOR EROSION CONTROL METHODS AND LOCATIONS ONLY. DO NOT USE THIS PLAN FOR BUILDING, PAVED AREA, UTILITY LOCATIONS, ETC.

THE CONTRACTOR IS ASSIGNED THE RESPONSIBILITY FOR THE CONSTRUCTION AND MAINTENANCE OF THE MEASURES AS DETAILED ON THIS PLAN AND ACCOMPANYING TECHNICAL SPECIFICATIONS

**GRAPHIC SCALE**



1 inch = 20 feet

COPYRIGHT 2024, LANC & TULLY, P.C.

**LANC & TULLY**  
Engineering and Surveying, P.C.

P.O. Box 687, Rt. 207  
Goshen, N.Y. 10924  
(845) 294-3700

EROSION AND SEDIMENT CONTROL PLAN  
PREPARED FOR


**NEW POLICE FACILITY**  
(TOWN OF MONTGOMERY)

TOWN OF MONTGOMERY  
ORANGE COUNTY, NEW YORK

DATE: MARCH 6, 2024  
 REVISION: MARCH 29, 2024  
 AUGUST 15, 2024  
 OCTOBER 24, 2024  
 DECEMBER 3, 2024  
 JANUARY 14, 2025  
 APRIL 23, 2025  
 APRIL 25, 2025

Drawn by: PDLs  
 Checked by:  
 Scale: 1" = 20'  
 Tax Map No.: 30-1-87  
 Drawing No.: C30  
 A- 18 - 2309 - 01

- H-101 DRAWING...** (X)
- 1 OPEN ENDED DUCT, CUT AT 45 DEGREE ANGLE.
  - 2 RETURN GRILLE TO BE CENTERED ON DOOR FRAME, MOUNT AS HIGH AS POSSIBLE WHILE KEEPING ASSOCIATED DUCTWORK IN FIRST FLOOR CEILING SPACE.
  - 3 PROVIDE PRICE RETURN AIR SILENCER (RAS) AT RETURN GRILLE. SIZE OF RAS TO MATCH RETURN GRILLE SIZE.

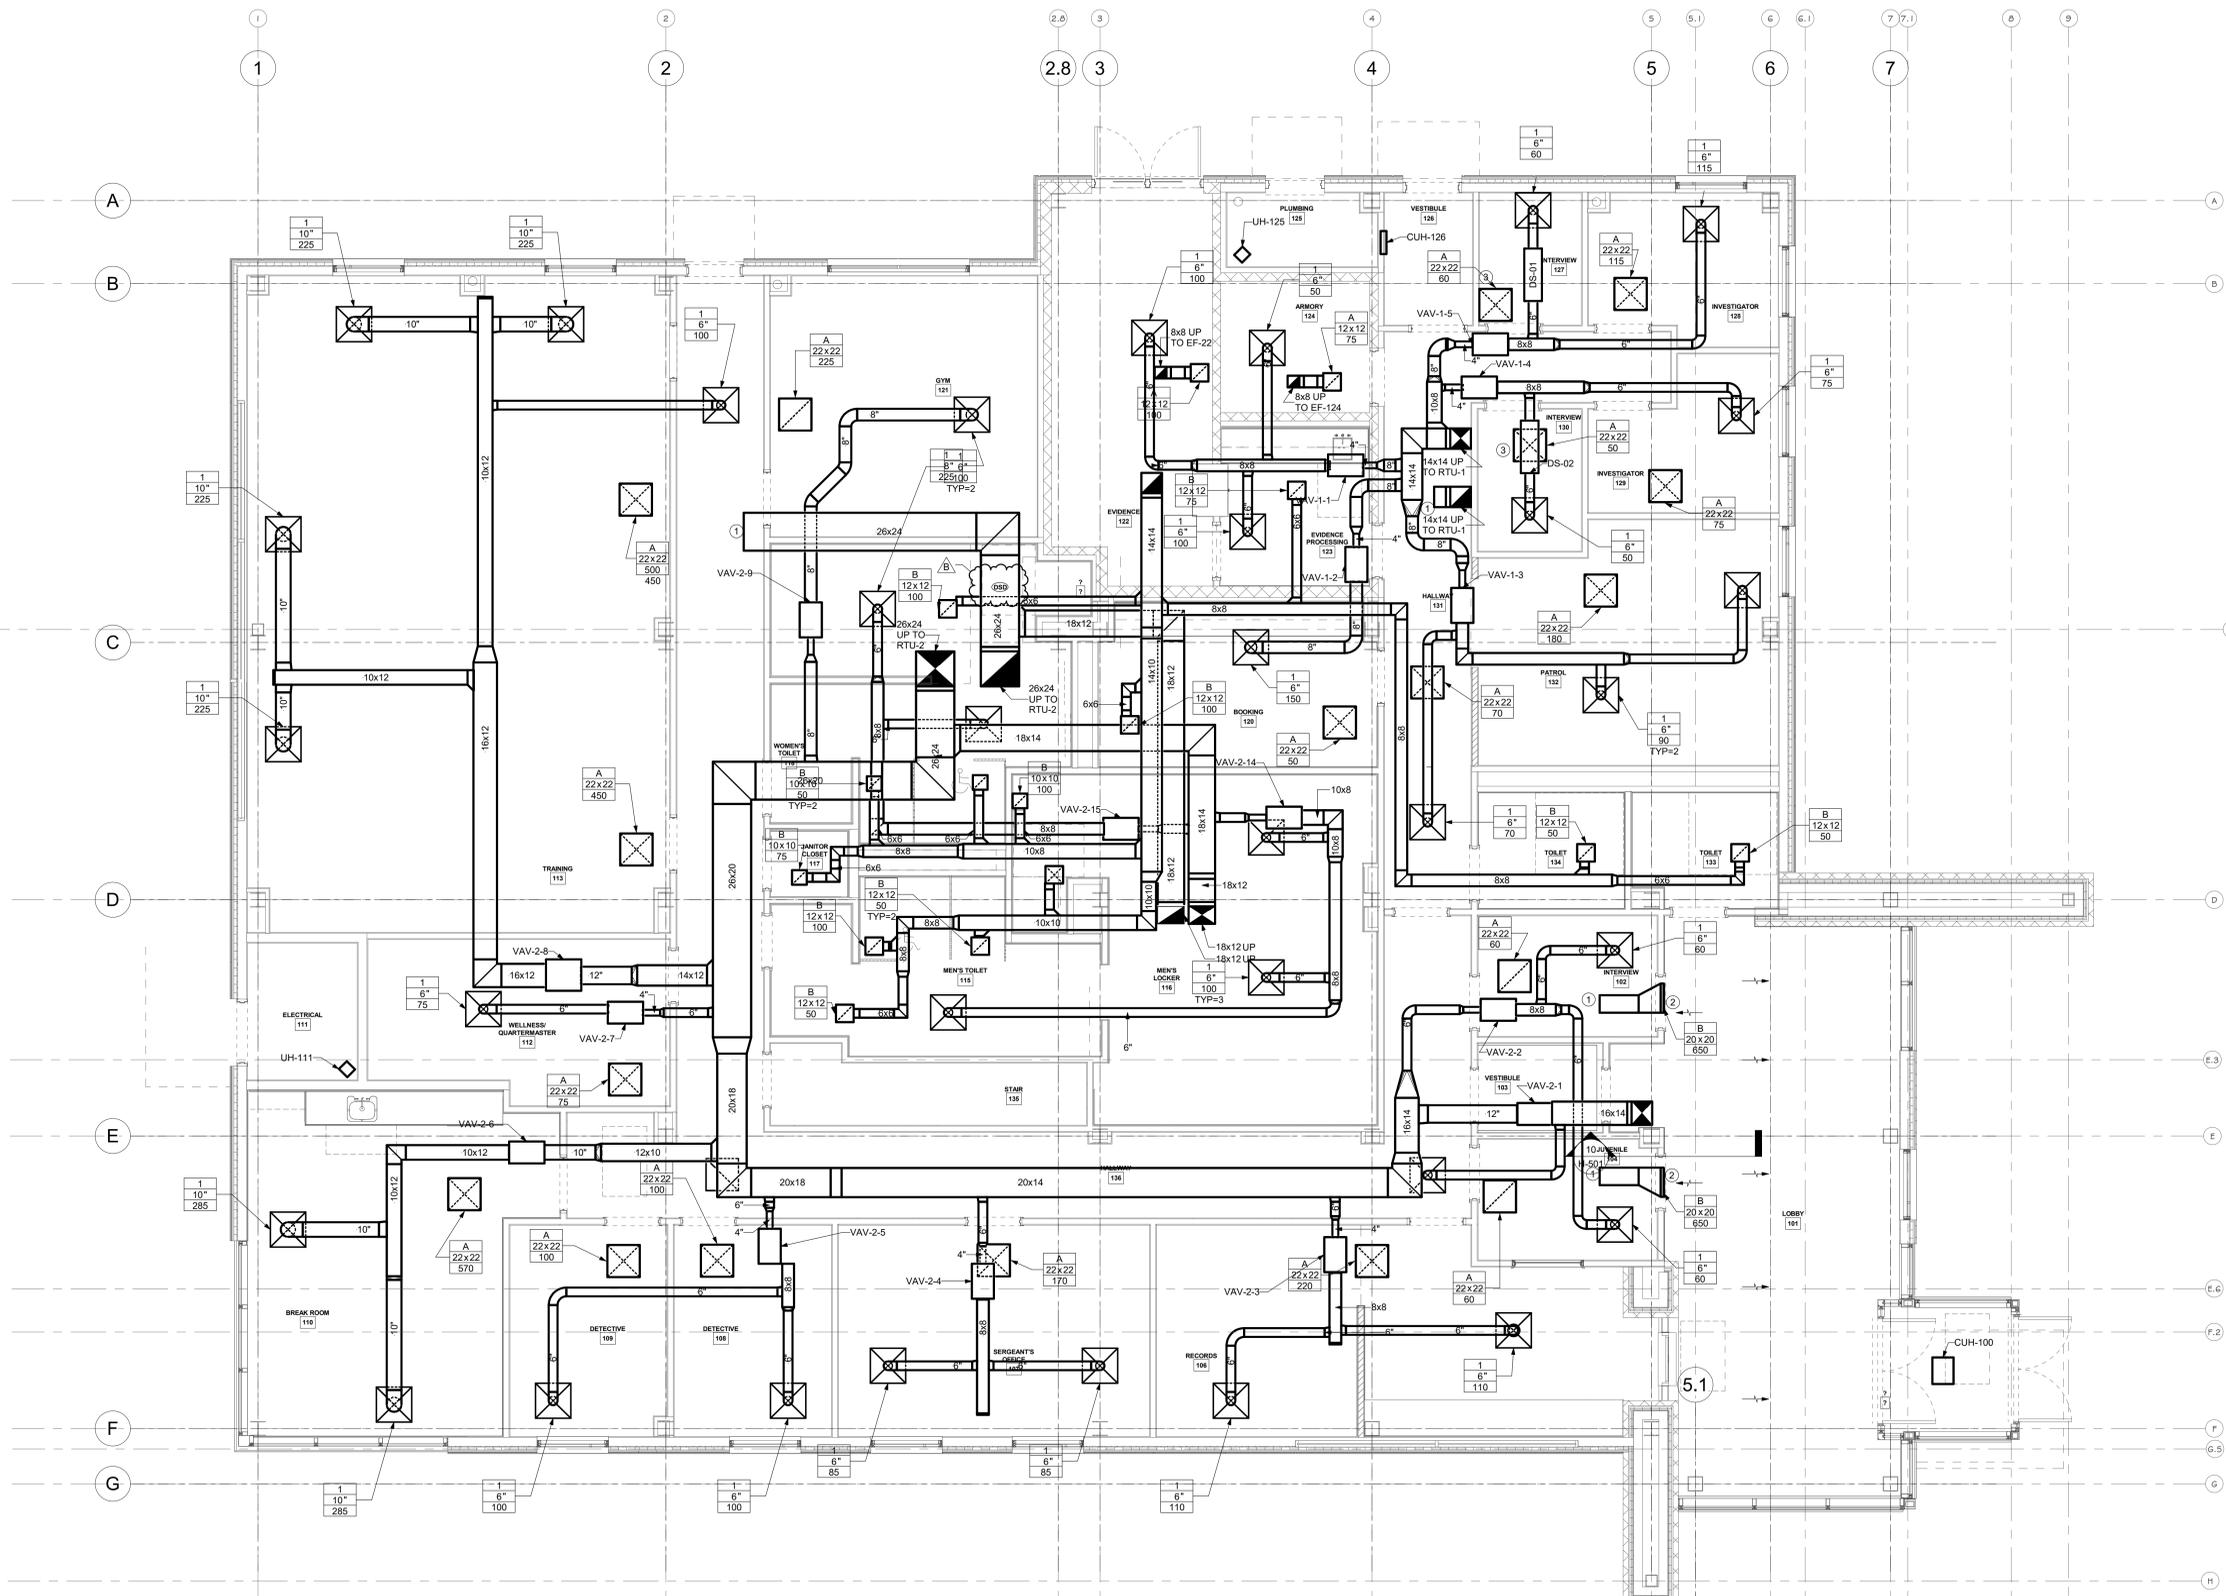

1 FIRST FLOOR PLAN - HVAC  
1/4" = 1'-0"



**ME ENGINEERING**  
Mechanical/Electrical Engineering Consultants  
Capital District | Rochester | Buffalo | Syracuse  
433 STATE STREET, 4TH FLOOR SCHENECTADY, NY 12305 518.533.2171  
www.meengineering.com

**REVISIONS:**

NUM.	DATE	DESCRIPTION
B	04/25/25	APPENDUM 3

**100% BID DOCUMENTS**

**ADG ARCHITECTS** ARCHITECTURE • PLANNING • INTERIORS  
25 WALKILL AVE • MONTGOMERY • NY 12549  
O. 845.294.2724 | F. 888.305.6442  
WWW.ADGARCHITECT.COM  
CONTACT@ADGARCHITECT.COM

Project: **TOWN OF MONTGOMERY POLICE STATION**  
110 BRACKEN ROAD, MONTGOMERY,  
NEW YORK 12549

Drawing: **FIRST FLOOR PLAN - HVAC**

Project: 23138 Date: 2/24/25  
Drawn: JDH Scale: AS NOTED  
Drawing Number:  
**H-101**