

## SUBMITTAL COVERSHEET Nanuet UFSD –Phase 3 Projects

**Architect:**

KSQ Architects  
215 W 40<sup>th</sup> Street, 15<sup>th</sup> Floor  
New York, NY 10018

**Owner:**

Nanuet Union Free School District  
101 Church Street  
Nanuet, NY 10954

**Construction Manager:**

Jacobs  
One Penn Plaza, 54<sup>th</sup> floor  
New York, NY 10019

**Contractor:** Joe Lombardo Plumbing & Heating of Rockland Inc

**Contract:** Ron Lombardo

**Address:** 321 Spook Rock Road Suite 109A

845-357-6537

**Telephone:**

Suffern, New York 10901

**Fax:** 845-357-8529

**School Name:** Nanuet Union Free School District Phase 3 Bond Projects @ Barr Middle School & Nanuet High School

**Type of Submittal:**

**Re-submittal:** [ ] No [ ] Yes

[ ] Shop Drawings

[ ] Product Data

[ ] Schedule

[ ] Sample

[ ]

[ ] Test Report

[ ] Certificate

[ ] Color Sample

[ ] Warranty

[ ]

**Submittal Description:**

REFRIGERATION PIPING INSULATION

**Product Name:**

**Manufacturer:**

**Subcontractor/  
Supplier:**

ATLANTIC CONTRACTING AND SPECIALTIES

**References:**

**Spec. Section No.:** 230719

**Drawing No(s):**

**Paragraph:**

**Rm. or Detail No(s):**

**Architect's/ Engineer's Review Stamp**

SAGE ENGINEERING ASSOCIATES, LLP

☐ Reviewed

☒ Furnish as Corrected

☐ Rejected

☐ Revise and Resubmit

☐ Submit Specified Item

This review is only for general conformance with the design concept and the information given in the Construction Documents. Corrections or comments made on the shop drawings during this review do not relieve the contractor from compliance with the requirements of the plans and specifications. Review of a specific item shall not include review of an assembly of which the item is a component. The Contractor is responsible for dimensions to be confirmed and correlated at the jobsite; information that pertains solely to the fabrication processes or to the means, methods, techniques, sequences and procedures of construction; coordination of the Work with that of all other trades and performing all Work in a safe and satisfactory manner.

**SAGE LOG NO. M-47**

Date: 2/6/2024

By: J. Venditte

**Contractor Review Statement:**

These documents have been checked for accuracy and coordinated with job conditions and Contract requirements by this office and have been found to comply with the provisions of the Contract Documents.

Ronald J. Lombardo

2.6.24

Name:

Date:

Company Name:

Joe Lombardo Plumbing & Heating of Rockland Inc.

1. Provide exterior jacketing over external refrigerant insulation and provide PVC jacketing over interior insulated refrigerant lines where routed within exposed spaces, crawlspaces and mechanical rooms.

**Remarks:**

1/4" TO 1"      1 3/8"

**TABLE C403.2.10**  
**MINIMUM PIPE INSULATION THICKNESS (in inches)**<sup>a, c</sup>

FLUID OPERATING TEMPERATURE RANGE AND USAGE (°F)	INSULATION CONDUCTIVITY		NOMINAL PIPE OR TUBE SIZE (inches)				
	Conductivity Btu · in./[h · ft <sup>2</sup> · °F] <sup>b</sup>	Mean Rating Temperature, °F	< 1	1 to < 1½	1½ to < 4	4 to < 8	≥ 8
> 350	0.32 – 0.34	250	4.5	5.0	5.0	5.0	5.0
251 – 350	0.29 – 0.32	200	3.0	4.0	4.5	4.5	4.5
201 – 250	0.27 – 0.30	150	2.5	2.5	2.5	3.0	3.0
104 DEGREES LIQUID	141 – 200	125	1.5	1.5	2.0	2.0	2.0
	105 – 140	100	1.0	1.0	1.5	1.5	1.5
40 DEGREES SUCTION	40 – 60	75	0.5	0.5	1.0	1.0	1.0
	< 40	50	0.5	1.0	1.0	1.0	1.5

For SI: 1 inch = 25.4 mm, °C = [(°F) - 32]/1.8.

- a. For piping smaller than 1½ inches and located in partitions within conditioned spaces, reduction of these thicknesses by 1 inch shall be permitted (before thickness adjustment required in footnote b) but not to a thickness less than 1 inch.
- b. For insulation outside the stated conductivity range, the minimum thickness (T) shall be determined as follows:  

$$T = r \{ (1 + t/r)K/k - 1 \}$$
where:  
T = minimum insulation thickness,  
r = actual outside radius of pipe,  
t = insulation thickness listed in the table for applicable fluid temperature and pipe size,  
K = conductivity of alternate material at mean rating temperature indicated for the applicable fluid temperature (Btu · in/h · ft<sup>2</sup> · °F) and  
k = the upper value of the conductivity range listed in the table for the applicable fluid temperature.
- c. For direct-buried heating and hot water system piping, reduction of these thicknesses by 1½ inches shall be permitted (before thickness adjustment required in footnote b but not to thicknesses less than 1 inch).

**All piping associated with HVAC systems must be insulated according to Table C403.2.10.**

**C403.2.10.1 Protection of piping insulation.** Piping insulation exposed to weather shall be protected from damage, including that due to sunlight, moisture, equipment maintenance and wind, and shall provide shielding from solar radiation that can cause degradation of the material. Adhesive tape shall not be permitted.

**This code text is self-explanatory. No commentary is necessary.**

**C403.2.11 Mechanical systems commissioning and completion requirements.** Mechanical systems shall be commissioned and completed in accordance with Section C408.2.

**This code text is self-explanatory. No commentary is necessary.**

**C403.2.12 Air system design and control.** Each HVAC system having a total fan system motor nameplate horsepower (hp) exceeding 5 hp shall comply with the provisions of Sections C403.2.12.1 through C403.2.12.3.

**This code text is self-explanatory. No commentary is necessary.**

**C403.2.12.1 Allowable fan motor horsepower.** Each HVAC system at fan system design conditions shall not exceed the allowable *fan system motor nameplate hp* (Option 1) or *fan system bhp* (Option 2) as shown in Table C403.2.12.1(1). This includes supply fans, exhaust fans, return/relief fans, and fan-powered terminal units associated with systems providing heating or cooling capability. Single-zone variable air volume systems shall comply with the constant volume fan power limitation.


**Exceptions:**

1. Hospital, vivarium and laboratory systems that utilize flow control devices on exhaust or return to maintain space pressure relationships necessary for occupant health and safety or environmental control shall be permitted to use variable volume fan power limitation.
2. Individual exhaust fans with motor nameplate horsepower of 1 hp or less are exempt from the allowable fan horsepower requirement.

**This code text is self-explanatory. No commentary is necessary.**

230719- B.1 - REFRIGERATION FLEXIBLE ELASTOMERIC  
INSULATION - EE ENERGY CODE - SUCTION MAX 40 DEGREES = 1/2" &  
LIQUID -104 DEGREES = 1"

Fiber Free

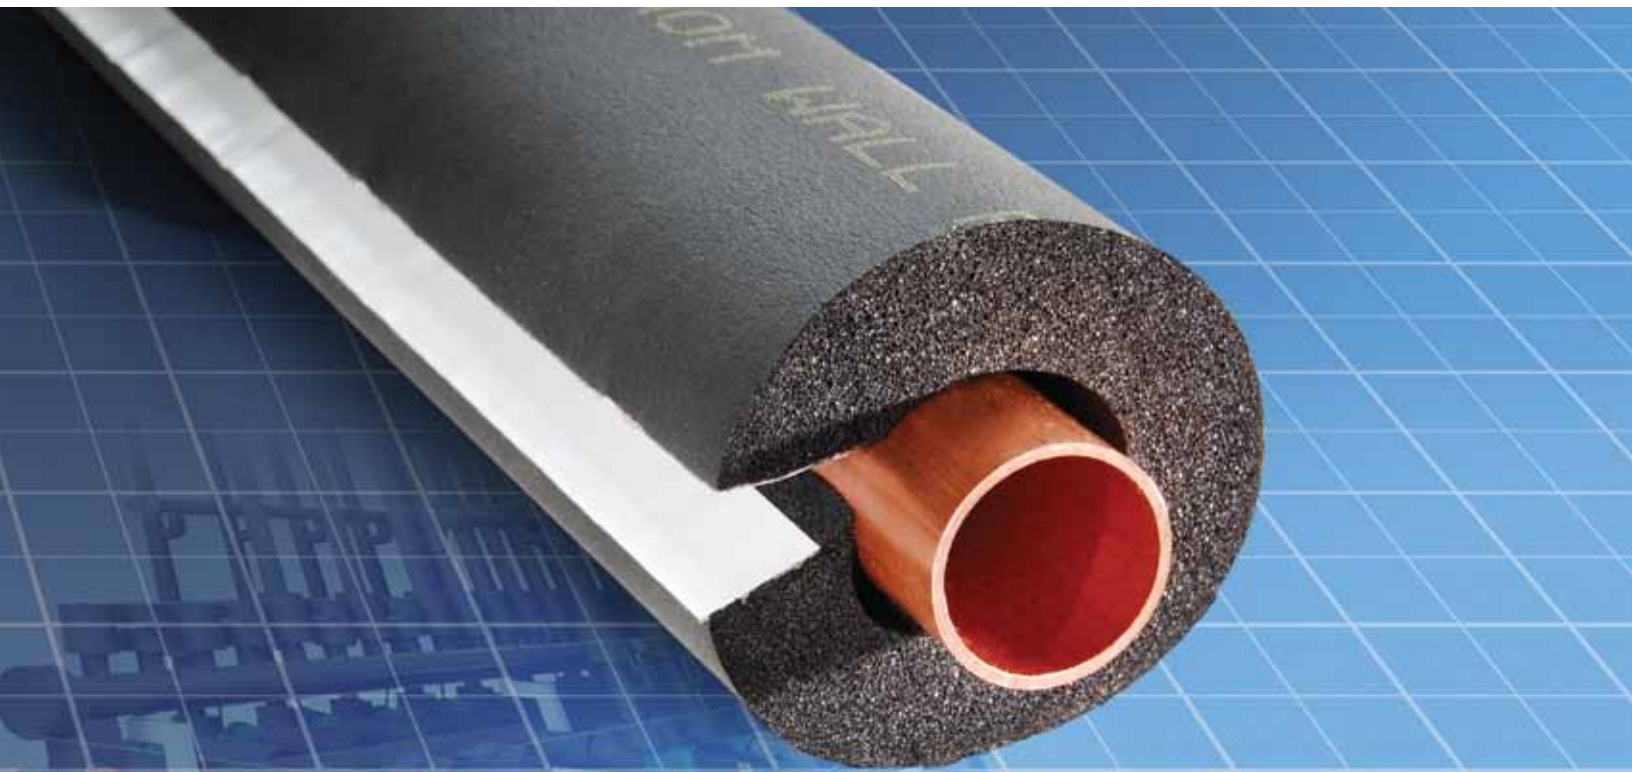

## AP/Armaflex® SS

Self-Seal Tube Insulation

**Superior Moisture Control, Mold Resistant – Faster!**



- Fiber Free, Closed Cell, Non-Wicking
- GREENGUARD Children and Schools Certified®
- Made with Microban® Antimicrobial Product Protection
- Thickness up to 1" Wall
- 25/50 Rated
- Self-Seal



# AP Armaflex SS Self-Seal Pipe (Tube) Insulation

**AP Armaflex SS Self-Seal Pipe (Tube) Insulation** saves labor and installed costs. It is the self-sealing version of the original closed cell, fiber-free elastomeric foam, the world's most recognized brand in flexible mechanical insulation.

- **Proven:** Fewer seams to seal, faster way to insulate chilled water and refrigeration lines
- **Mold resistant:** Made with Microban antimicrobial product protection
- **Indoor Air Quality-friendly:** Fiber-free, formaldehyde-free, low VOCs, nonparticulating. GREENGUARD Indoor Air Quality Certified®.
- **Durable:** No fragile vapor retarder

## Description

**AP Armaflex SS Self-Seal Pipe Insulation** is a 25/50-rated black flexible elastomeric thermal insulation. The expanded closed-cell structure makes it an efficient insulation. It is manufactured without the use of CFC's, HFC's or HCFC's. All AP Armaflex products are made with Microban® antimicrobial product protection for added defense against mold on the insulation.

- Nominal wall thicknesses of 3/8", 1/2", 3/4", 1" (10, 13, 19, and 25mm)
- Popular sizes up to 4" IPS

## Factory Mutual (FM) Approvals

AP Armaflex SS is certified through ongoing supervision by Factory Mutual Approvals to consistently provide actual values on these key performance criteria for mechanical system insulation:

- **Thermal Conductivity:** 0.25 BTU-in/hr. ft<sup>2</sup> °F
- **Water Vapor Transmission:** 0.05 perm-inch
- **Fire Rating:** will not contribute significantly to fire (simulated end-use testing)

As tested by ASTM E 84 "Method of Test for Surface Burning Characteristics for Building Materials" and CAN/ULC S-102, AP Armaflex SS Pipe Insulation wall thicknesses through 1" (25mm) has a flame-spread index of less than 25 and a smoke-developed index of less than 50.

*Note: Numerical flammability ratings alone may not define the performance of products under actual fire conditions. They are provided only for use in the selection of products to meet limits specified.*

## Uses

- Retards heat gain and controls condensation drip from chilled-water and refrigeration systems. Efficiently reduces heat flow for hot-water plumbing, liquid-heating and dual-temperature piping
- Acceptable in wall thicknesses through 1" (25mm) for use in air plenums and conforms to NFPA 90A and NFPA 90B requirements

The recommended temperature usage range for AP Armaflex SS Pipe Insulation is -297°F to +180°F (-183°C to +82°C). For use on cold pipes, thicknesses have been calculated to control condensation on the insulation outer surface, as shown in the table of thickness recommendations. AP Armaflex meets the energy code requirements of ASHRAE 90.1, International Energy Conservation Code (IECC) and other building codes.

## Application

AP Armaflex SS Pipe Insulation can be snapped over piping already connected. Fitting covers are fabricated from miter-cut tubes. Butt joints are to be sealed with one of our Armaflex adhesives: Armaflex 520, 520 Black or, where a low V.O.C. adhesive is required, 520 BLV. 520 Adhesives are contact adhesives; therefore, in all cases, both surfaces to be joined are coated with adhesive.

AP Armaflex SS is designed for installation above or below ground. For below ground applications, contact Armacell or see our Technical Bulletin No. 7 on our website, [www.armacell.com](http://www.armacell.com). Outdoors, a weather-resistant protective finish is to be applied and Armaflex WB Finish is recommended.

AP Armaflex normally requires no supplemental vapor-retarder protection but additional vapor-retarder protection may be necessary when installed on very-low temperature piping or exposure to continually high humidity conditions. Outdoors a protective finish is to be applied and Armaflex WB Finish is recommended. Armaflex insulation products must be installed according to "Installation of Armaflex Insulations" brochure. Proper installation is required to assure Armaflex insulation performance. Before starting, the temperature of the air and of the insulation should be between 40°F (4°C) and 100°F (38°C) at the time of installation.

*Note: Self-Seal Armaflex features an advanced pressure sensitive adhesive (PSA) system for tight bonds. However, any factory applied PSA is susceptible to losing tack and hence loss of adhesion properties if left unused for a prolonged period. For best results, Armacell recommends applying Armaflex self seal products within one year of lamination date.*

## Specification Compliance

**AP Armaflex SS Pipe Insulation developed to meet:**

ASTM C 534, Type I – Tubular Grade 1	ASTM G-21/C1338 ASTM G-22
ASTM E 84, NFPA 255, UL 723	ASTM D 1056, 2B1
CAN/ULC S102	MIL-P-15280J, FORM T
NFPA 90A, 90B	MIL-C-3133C (MIL STD 670B), Grade SBE 3
UL 181	MEA 96-85-M City of LA – RR 7642

ALL ARMACELL FACILITIES  
IN NORTH AMERICA ARE  
ISO 9001:2008 CERTIFIED.

AP Armaflex SS Self-Seal Tube Insulation

[www.armacell.us](http://www.armacell.us)

For the latest document, please refer to our website.

## Physical Properties

Specifications	Values	Test Method
<b>Thermal Conductivity,</b> <b>Btu • in./h • ft<sup>2</sup> • °F (W/mK)</b> 75°F Mean Temperature (24°C) 90°F Mean Temperature (32°C)	0.25 (0.036) 0.256 (0.037)	ASTM C 177 or C 518
<b>Water Vapor Permeability,</b> <b>Perm-in. [Kg/(s•m•Pa)]</b>	0.05 (0.725 x 10 <sup>-13</sup> )	ASTM E 96, Procedure A
<b>Flame Spread and Smoke</b> <b>Developed Index through</b> <b>1" (25mm)</b>	25/50	ASTM E 84 CAN/ULC S102**
<b>Mold Growth</b> <b>Fungi Resistance</b> <b>Bacterial Resistance</b>	UL181 ASTM G21/C1338 ASTM G22	Meets requirements Meets requirements Meets requirements
<b>Water Absorption, % by Volume</b>	0.2%	ASTM C 209
<b>Upper Use Limit</b> <sup>①</sup>	180°F (82°C)	—
<b>Lower Use Limit</b> <sup>②</sup>	-297°F (-183°C)*	—
<b>Ozone Resistance</b>	GOOD	—
<b>Sizes</b> <b>Wall thickness, (nominal)</b> <b>Inside diameter, tubular</b> <b>Length of sections, tubular</b>	3/8", 1/2", 3/4", 1" (10, 13, 19, 25mm) 5/8" ID to 4" IPS (15mm to 114mm) 6' (1.8m)	—


### Notes

① On the heating cycle, AP Armaflex SS Pipe Insulation will withstand temperatures as high as 220°F (105°C) intermittent exposure. For continuous exposure the temperature should be limited to 180°F (82°C).

② At temperatures below -20°F (-29°C), elastomeric insulation starts to become less flexible. However, this characteristic does not affect thermal efficiency or water vapor permeability of Armaflex insulation.

\* For applications of -40°F to -297°F (-40°C to -183°C), contact Armacell.

Performance approved through continuing supervision by Factory Mutual Approvals.

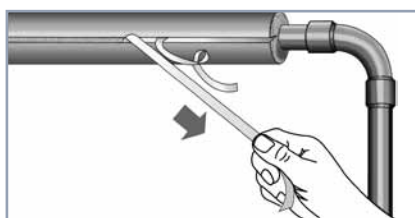

Peel the protective release strips from the adhesive surface in 8" and 12" increments *after* insulation is snapped over pipe. The protective release strips can be removed by gently pulling at an angle. Apply firm and even pressure along the entire longitudinal seam for proper seal.

**ARMACELL LLC**

TEL: 1 800 866-5638

FAX: 919 304-3847

info.us@armacell.com

www.armacell.us

7600 Oakwood Street Extension • Mebane, NC 27302



Armacell provides this information as a technical service. To the extent the information is derived from sources other than Armacell, Armacell is substantially, if not wholly, relying upon the other source(s) to provide accurate information. Information provided as a result of Armacell's own technical analysis and testing is accurate to the extent of our knowledge and ability, as of date of printing, using effective standardized methods and procedures. Each user of these products, or information, should perform their own tests to determine the safety, fitness and suitability of the products, or combination of products, for any foreseeable purposes, applications and uses by the user and by any third party to which the user may convey the products. Since Armacell cannot control the end use of this product, Armacell does not guarantee that the user will obtain the same results as published in this document. The data and information are provided as a technical service and are subject to change without notice.

The GREENGUARD Children & Schools Certified Mark is a registered certification mark used under license through the GREENGUARD Environmental Institute.

Microban is a registered trademark of Microban Products Company.