

7/12/2023 11:59:28 AM

ROOF PLAN GENERAL NOTES:

ALL DRAWINGS ARE GRAPHIC REPRESENTATIONS OF APPROXIMATE LOCATIONS OF MATERIALS. IT IS THE CONTRACTORS RESPONSIBILITY TO FIELD VERIFY ALL CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK. DIMENSIONS AND CONDITIONS ON THE ROOF PLAN AND DETAILS AREA APPROXIMATE AND MUST BE CONFIRMED BY THE CONTRACTOR. ONLY CERTAIN FASTENERS ARE SHOWN ON THE DRAWINGS, REFER TO SPECIFICATIONS FOR ADDITIONAL FASTENER REQUIREMENTS.

TEST THE EXISTING DRAIN LINES WITH A RUNNING HOSE FOR AT LEAST ONE HOUR PRIOR TO STARTING ANY OTHER WORK. PROVIDE A WRITTEN REPORT OF ANY CLOGGED LINES TO THE ARCHITECT AND OWNER. CLOGGED DRAIN LINES WILL BE CLEANED BY THE OWNER. COVER AND PROTECT ALL DRAIN OPENINGS AT THE BEGINNING OF EACH WORK DAY. REMOVE THE COVERS AT THE END OF EACH DAY AND BEFORE

PRECIPITATION OCCURS. PERFORM WHATEVER WORK IS REQUIRED TO RESTORE THE DRAIN LINES TO CLEAN, CLEAR, FREE FLOWING CONDITION AT THE COMPLETION OF THE THE CONTRACTOR SHALL BE RESPONSIBLE TO MAINTAIN WATER

TIGHTNESS AND PROVIDE PROTECTION AT ANY/ALL OPENINGS IN THE ROOF LEFT AT THE END OF EACH DAY. REPAIR ALL EXISTING EXHAUST FAN/VENTILATOR HOUSING TO BE WATERTIGHT.


NOT ALL NEW EQUIPMENT AND PIPE PENETRATIONS ARE SHOWN ON THE ROOF PLAN (SEE MECHANICAL DRAWINGS). INSTALL NEW PITCH POCKETS OR FIELD FLASHINGS AT ALL NEW EQUIPMENT AND PIPE PENETRATIONS. INSTALL NEW WALKWAY PADS WHERE SHOWN ON THE ROOF PLAN. ALL EXISTING PV PANELS, FRAMING HARDWARE, BALLASTING, AND ALL ASSOCIATED ITEMS TO BE REMOVED. REFER TO ELECTRICAL DRAWINGS

FOR ASSOCIATED ELECTRICAL REMOVALS (ALTERNATE 4) ALL EXISTING PV PANELS, FRAMING HARDWARE, BALLASTING, AND ALL ASSOCIATED ITEMS TO BE SALVAGED, STORED AND REINSTALLED, COORDINATE WITH ELECTRICAL DRAWINGS (ALTERNATE 5).

PROVIDE CRICKETS FOR WATER DIVERSION AT ALL CURBS, RAILS, ETC. WHICH RUN PERPENDICULAR TO THE SLOPE OF THE INSULATION/SLOPED ALL EXISTING MTL ROOF EDGES, COPINGS, SCUPPERS, AND FLASHINGS TO

REMAIN. PROTECT THROUGHTOUT CONSTRUCTION. INSTALL WALKWAY PADS TO ALL ROOFTOP EQUIPMENT. WALKWAY PAD SHOWN FOR REFERENCE ONLY. VERIFY IN FIELD ALL CONDITIONS AND LOCATIONS.

ROOF LEGEND

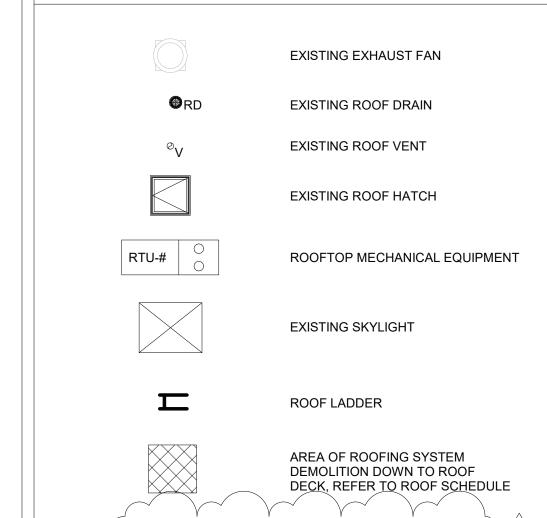

APPROXIMATE AREA OF WET INSULATION (1,918 SF, V.I.F.)

REFER TO GENERAL NOTES

EXISTING PV PANEL,

10 & 11



NEW YORK OKLAHOMA

ARCHITECT

KSQ Design 215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office

845.943.9601

www.ksq.design Owner

Nanuet Union Free School District 103 Church St, Nanuet, NY 10954 845.627.9880 office http://www.nanuetsd.org/

Structural Engineer Clapper Structural Engineering 160 Partition Street Saugerties, NY 12477

www.clapperstructural.com MEP Engineer Sage Engineering Associates, LLP 9 Columbia Circle Albany NY 12203 518.453.6091 office

518.453.6092 fax www.sagellp.com **Environmental Engineer Quest Environmental Solutions**

1376 Route 9 Wappingers Falls, NY 12590 845.298.6251 www.qualityenv.com

Construction Manager One Penn Plaza 54th Floor, Suite 5420 New York, NY 10119 646.908.6550 www.jacobs.com






NUFSD BOND **PROJECTS** PH3

☐ SED#50-01-08-03-0-003-035 (HIGH SCH00L)
■ SED#50-01-08-03-0-004-020 (BARR MIDDLE SCH00L)

High School 103 Church St Nanuet, NY 10954

Barr Middle School 50 Blauvelt Rd #1 Nanuet, NY 10954

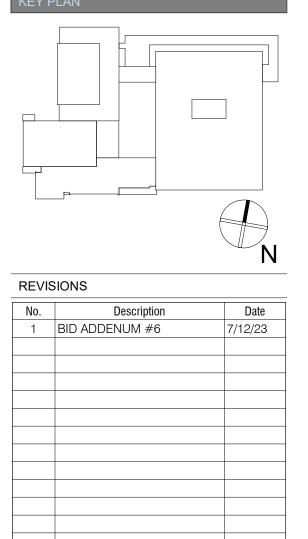


ISSUED: BID SET ISSUANCE

DATE: 6/6/2023

SCALE: As indicated SHEET NAME: OVERALL ROOF PLAN

SHEET NUMBER:

BM-A121

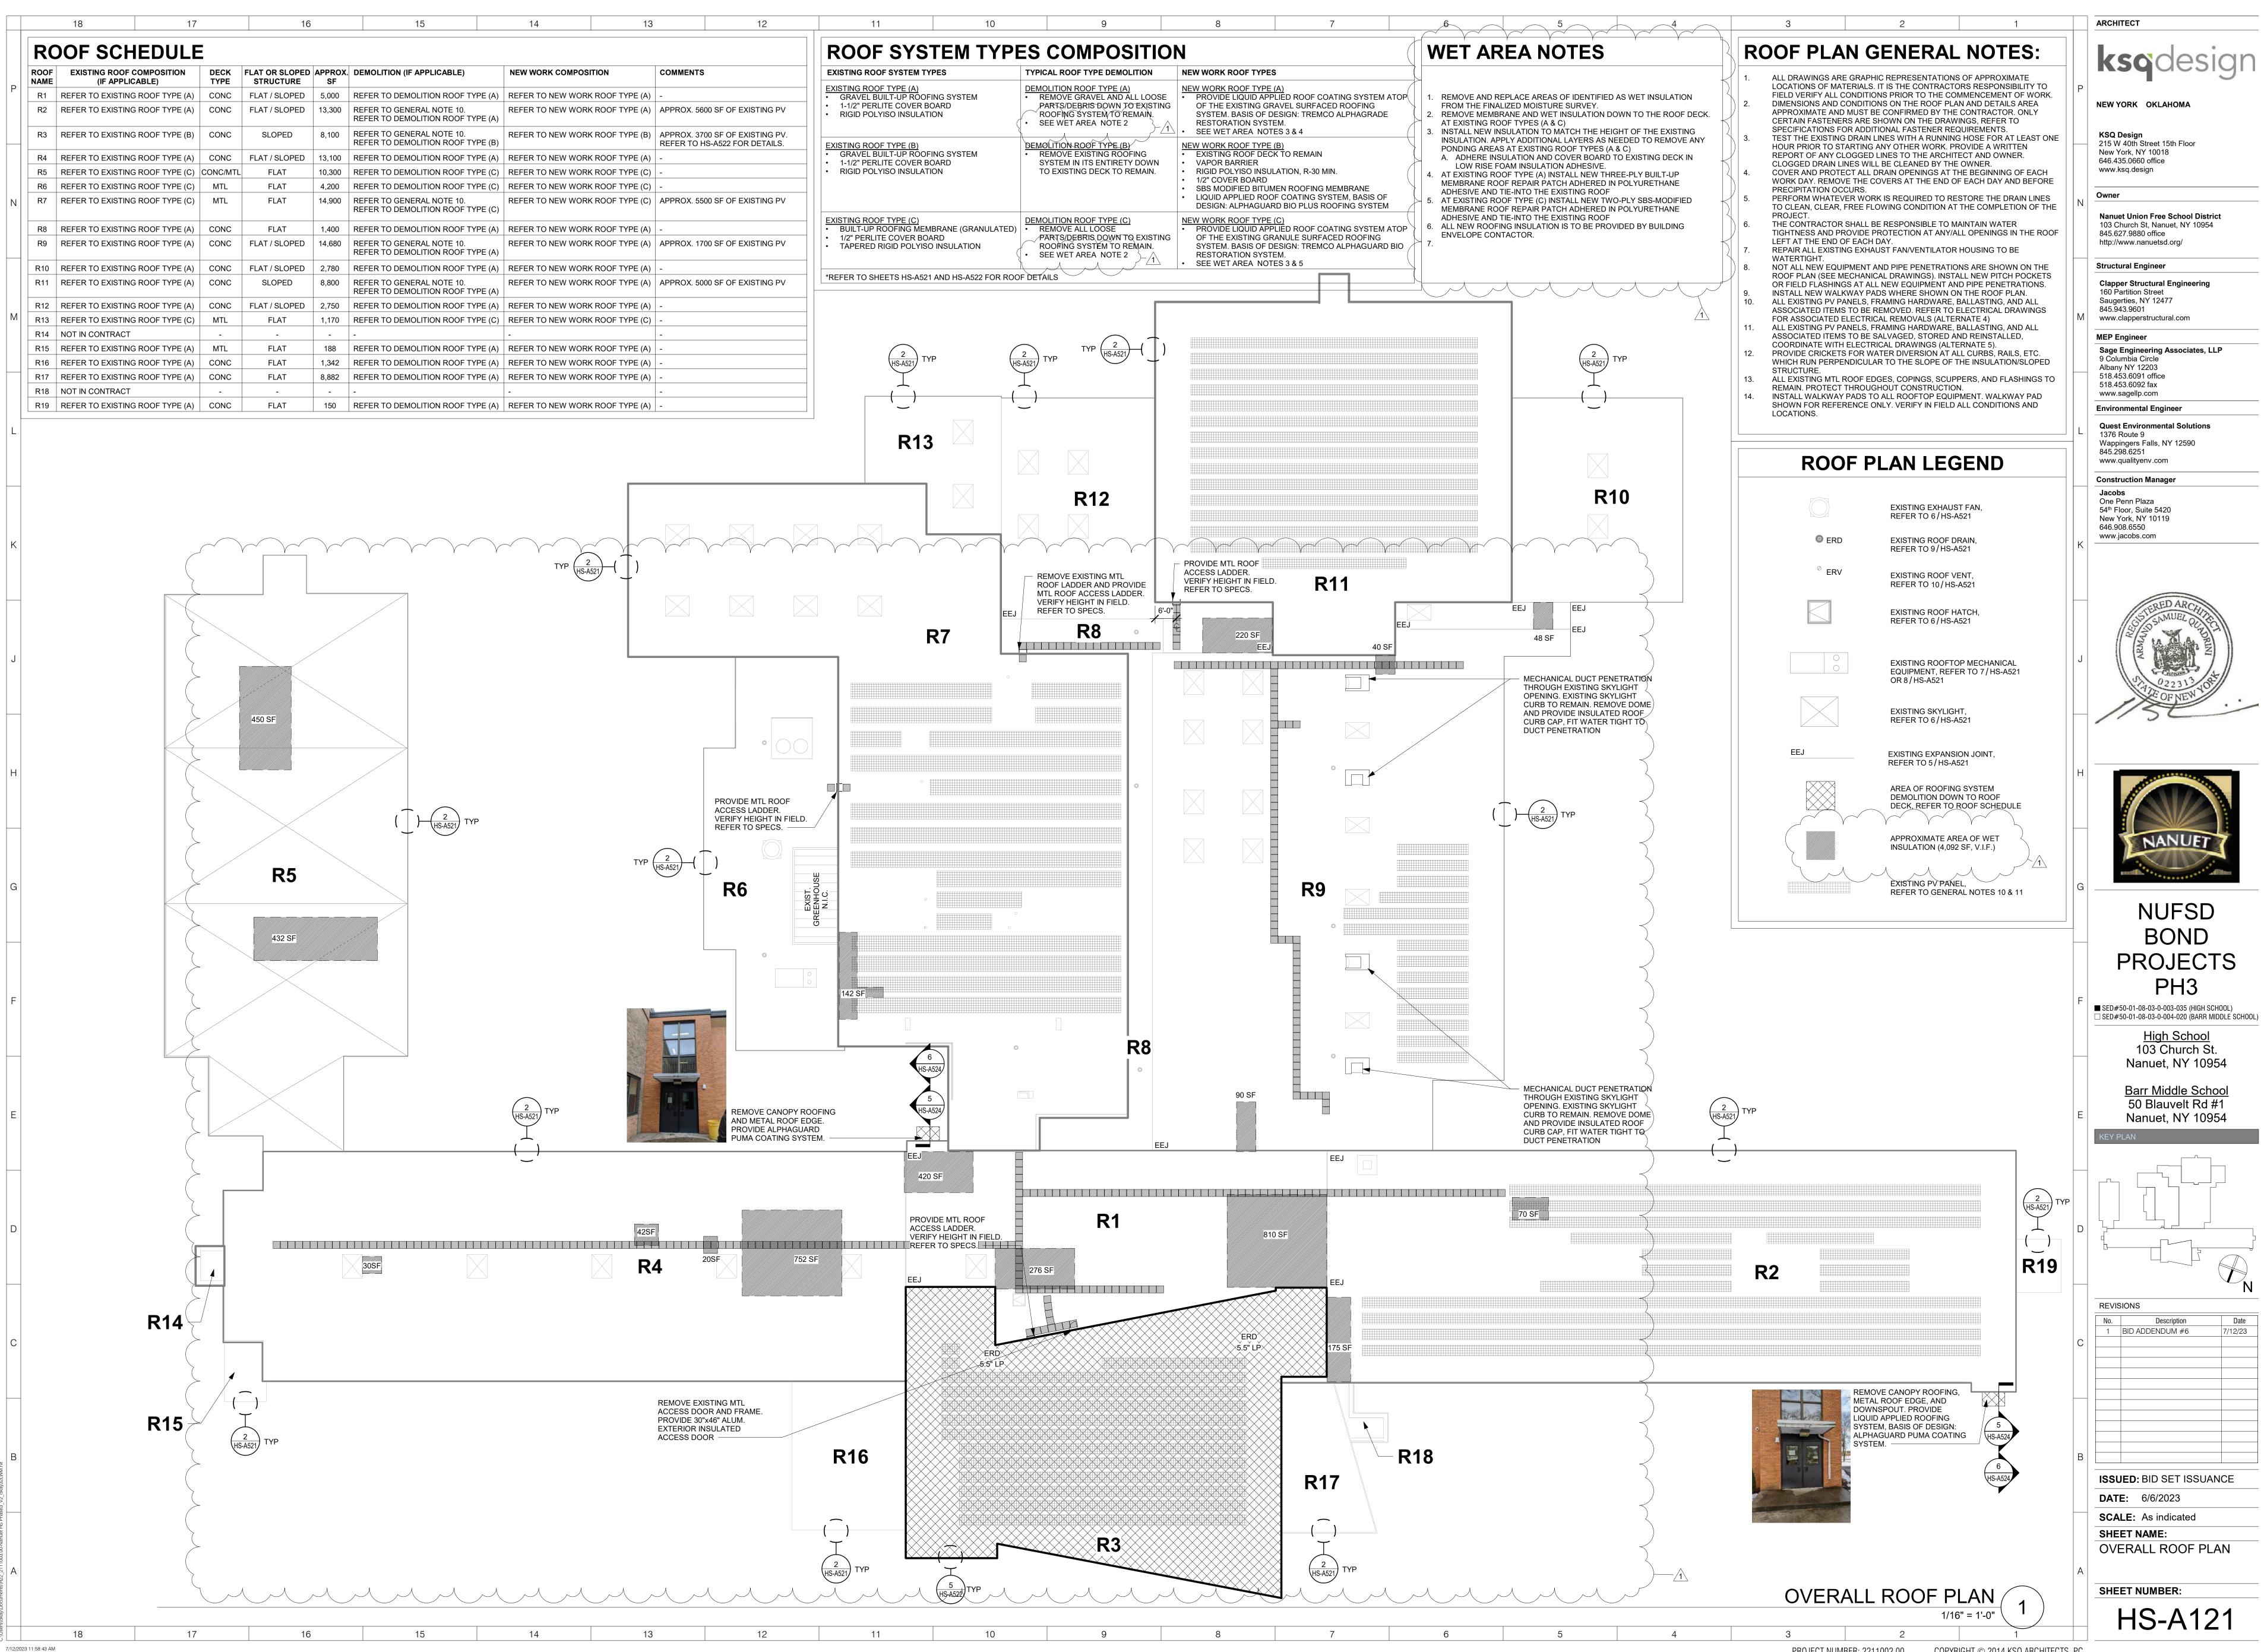





TO FLOOR LEVEL AND CAP. SECOND FLOOR TO SECOND FLOOR SP.ED. CLASSROOM 100 A TO FLOOR LEVEL SP.ED. 10"ø SA-CLASSROOM 102 A 5TH / 6TH GRADES CLASSROOM SP. ED. - 11/4" HWS DOWN GRADES CLASSROOM CLASSROOM TO FIN TUBE ENCLOSURE 106 **GREETERS** BOOTH 100B CLASSROOM 2" HWS¬ ← 1-1/2" HWS DOWN TO FLOOR /— 1-1/4" HWR UP TO SECOND FLOOR GENERAL OFFICE C122 1-1/4" HWS UP TO SECOND FLOOR LOUNGE 107 **PRICIPAL** TECH CLASSROOM WALL MOUNTED COPY ROOM 1-1/4" HWR DOWN TO FAN COIL (6) FLOOR LEVEL — TECH CLASSROOM - 1" HWR UP TO SECOND FLOOR CONDENSING UNIT 1" HWS UP TO SECOND FLOOR — TYPICAL 58"x12" **5TH GRADE** CLASSROOM 120 UV OA LOUVER ---TECH CLASSROOM 6 WALL MOUNTED COURTYARD 1 1/2" HWS---- 1-1/4" HWS UP TO SECOND FLOOR ____1 1/4" HWR 5TH GRADE FTR-PARTIAL FIRST FLOOR REMOVALS - NORTHEAST (A18) 1/8" = 1'-0"

7/11/2023 3:23:05 PM

 \mathcal{A}

REGARDING PNEUMATIC CONTROL SYSTEM REMOVAL WORK: CAP OPEN/OBSOLETE PNEUMATIC TUBING AT ALL LOCATIONS. REMOVE

OBSOLETE/DISCONNECTED PNEUMATIC TUBING WHERE EXPOSED TO VIEW. ABANDON IN-PLACE PNEUMATIC TUBING THAT IS CONCEALED OR IN

GENERAL NOTES:

OTHERWISE INACCESSIBLE AREAS.

- DISCONNECT AND REMOVE FLOOR MOUNTED UNIT VENTILATOR AT LOCATION SHOWN. DISCONNECT OUTSIDE AIR DUCT SLEEVE FROM REMOVED UNIT VENTILATOR AND MAINTAIN OUTSIDE AIR DUCT SLEEVE CONNECTED TO EXTERIOR OUTSIDE AIR LOUVER. DISCONNECT AND REMOVE HWS/HWR BRANCH PIPING TO REMOVED UNIT VENTILATOR HEATING COIL. DISCONNECT AND REMOVE HEATING COIL CONTROL VALVE, DAMPERS AND ALL ASSOCIATED UNIT VENTILATOR CONTROL WIRING, DDC CONTROLLER, SENSORS, RELAYS, GRAPHICS, PROGRAMMING, SEQUENCES OF OPERATIONS AND ASSOCIATED CONTROL DEVICES.
- DISCONNECT AND REMOVE SPACE TEMPERATURE SENSOR AT LOATION SHOWN. DISCONNECT AND REMOVE DDC PROGRAMMING FROM REMOVED UNIT VENTILATOR IN SPACE. REMOVE CONTROL WIRING BETWEEN UNIT VENTILATOR DDC CONTROLLER AND SPACE SENSOR.
- DISCONNECT AND REMOVE PERIMETER SHELVING/CABINET UNITS AT LOCATION SHOWN AND FIN TUBE RADIATION LOCATED WITHIN PIPING TUNNEL AT REAR OF SHELVING SYSTEM. DISCONNECT AND REMOVE HWS/R PIPING MAINS ROUTED WITHIN PIPING TUNNEL AT REAR OF UV SHELVING SYSTEMS.
- DISCONNECT AND REMOVE HORIZONTAL HWS/HWR PIPING ROUTED WITHIN UV SHELVING CABINET PIPING TUNNEL INCLUDING ASSOCIATED FIN TUBE RADIATION WITHIN THE TUNNEL SYSTEM. DISCONNECT AND REMOVE HWR BRANCH PIPING BACK TO DISCONNECTION POINT SHOWN AT BOTTOM HWR RISER ROUTED DOWN
- 5 DISCONNECT 1-1/2" HWS BETWEEN DISCONNECTION POINTS SHOWN FROM BOTTOM OF HWS RISER ROUTED DOWN TO FLOOR LEVEL TO UPSTREAM OF WALL PENETRATION ENTERING TECH CLASSROOM 108. DISCONNECT AND REMOVE HWS PIPING TO BOTTOM OF RISER AND CAP. DISCONNECT AND REMOVE 1" HWR PIPING FROM REMOVED UV HEATING COIL TO DISCONNECTION POINT SHOWN UPSTREAM OF WALL PENETRATION ENTERING TECH CLASSROOM 108.
- DISCONNECT AND REMOVE EXTERIOR GRADE MOUNTED CONDENSING UNIT, TWO WALL MOUNTED FAN COIL UNITS, TWO FAN COIL UNIT CONTROLLERS AND ALL ASSOCIATED REFRIGERANT SUCTION/LIQUID PIPING BETWEEN FAN COIL UNITS, CONDENSING UNIT AND CONDENSING UNIT SUPPORT PAD. REMOVE ALL ASSOCIATED CONTROL WIRING. DISPOSE OF REFRIGERANT WITHIN THE ENTIRE SYSTEM PER SECTION 608 OF THE ENVIRONMENTAL PROTECTION AGENCY'S CLEAN AIR ACT.
- 7) DISCONNECT AND REMOVE HORIZONTAL PIPING ENCLOSURE SYSTEMS WITHIN FACULTY LOUNGE 107.
- B DISCONNECT AND REMOVE HORIZONTAL PIPING ENCLOSURE SYSTEMS WITHIN TECH CLASSROOM 108 AT LOCATIONS SHOWN. MAINTAIN HWS/HWR PIPING MAINS ROUTED ALONG PERIMETER WALL BEHIND REMOVED ENCLOSURE UNITS.
- DISCONNECT AND REMOVE AIR HANDLING UNIT S-3 PENUMATIC OPERATOR DIAL AT LOCATION SHOWN INCLUDING ASSOCIATED PNEUMATIC TUBING. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE STAINLESS STEEL COVER PLATE OVER LOCATION OF REMOVED PNEUMATIC
- DISCONNECT AND REMOVE FIN TUBE RADIATION AND ASSOCIATED FIN TUBE ENCLOSURE UNITS AT ALL LOCATIONS SHOWN. DISCONNECT AND REMOVE HWS/R PIPING MAINS ROUTED THROUGH FIN TUBE ENCLOSURE TO DISCONNECTION POINTS SHOWN AT BASE OF ASSOCIATED HWS/R RISER DROPS AND CAP.
- DISCONNECT AND REMOVE SEMI-RECESSED, HORIZONTAL, DUCTED UNIT VENTILATOR AT LOCATION SHOWN. DISCONNECT UV FROM REAR INLET OA PLENUM. MAINTAIN OA PLENUM FOR RECONNECTION TO REPLACEMENT UNIT VENTILATOR AS SHOWN ON DRAWING MS M-111. DISCONNECT AND REMOVE HEATING COIL CONTROL VALVE, DAMPERS, DAMPER ACTUATORS AND ALL ASSOCIATED UNIT VENTILATOR CONTROL WIRING, DDC CONTROLLER, SENSORS, RELAYS, GRAPHICS, PROGRAMMING, SEQUENCES OF OPERATIONS AND ASSOCIATED CONTROL DEVICES.
- (12) DISCONNECT AND REMOVE HORIZONTAL, CONCEALED RECTANGULAR SA DUCTWORK FROM OUTLET OF REMOVED HORIZONTAL UNIT VENTILATOR. DISCONNECT AND MAINTAIN 10" ROUND SA TAPS CONNECTED TO THE TOP OF REMOVED HORIZONTAL SA OUTLET DUCTWORK.
- (13) DISCONNECT AND REMOVE SPACE TEMPERATURE SENSOR AT LOCATION SHOWN. MAINTAIN CONTROL WIRING AT WALL LOCATION FOR REPLACEMENT SPACE TEMPERATURE SENSOR AS SHOWN ON DRAWING MS-M111.
- DISCONNECT AND REMOVE VERTICAL HWS/R PIPING FROM REMOVED FLOOR FIN TUBE ENCLOSURE SYSTEM TO REMOVED UV HEATING COIL. DISCONNECT AND REMOVE ASSOCIATED VERTICAL PIPING ENCLOSURE UNIT CONCEALING THE HWS/R VERTICAL PIPING ROUTED FROM FLOOR TO CEILING. DISCONNECT AND REMOVE HWS/R PIPING ROUTED TO HORIZONTAL UV HEATING COIL INCLUDING ASSOCIATED CONTROL VALVES AND HYDRONIC ACCESSORIES.

NEW YORK OKLAHOMA

ARCHITECT

KSQ Design 215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office www.ksq.design

Nanuet Union Free School District 103 Church St, Nanuet, NY 10954 845.627.9880 office

http://www.nanuetsd.org/

Structural Engineer Clapper Structural Engineering 160 Partition Street

845.943.9601

Saugerties, NY 12477 www.clapperstructural.com

MEP Engineer Sage Engineering Associates, LLP 9 Columbia Circle

Albany NY 12203 518.453.6091 office 518.453.6092 fax www.sagellp.com **Environmental Engineer**

Quest Environmental Solutions 1376 Route 9 Wappingers Falls, NY 12590 845.298.6251

www.qualityenv.com **Construction Manager** One Penn Plaza 54th Floor, Suite 5420

New York, NY 10119

646.908.6550 www.jacobs.com





NUFSD BOND **PROJECTS** PH3

☐ SED#50-01-08-03-0-003-035 (HIGH SCH00L)
■ SED#50-01-08-03-0-004-020 (BARR MIDDLE SCH00L)

High School 103 Church St Nanuet, NY 10954

Barr Middle School 50 Blauvelt Rd #1 Nanuet, NY 10954

BID ADDENDUM #6

ISSUED: BID SET ISSUANCE

DATE: 06/06/2023 **SCALE:** 1/8" = 1'-0"

SHEET NAME: PARTIAL FIRST FLOOR **REMOVALS** -NORTHEAST

SHEET NUMBER: BM-M104 58

 \cdots GENERAL NOTES: DISCONNECT AND REMOVE FLOOR MOUNTED UNIT VENTILATOR AT LOCATION SHOWN. DISCONNECT OUTSIDE AIR DUCT SLEEVE FROM REMOVED UNIT REGARDING PNEUMATIC CONTROL SYSTEM REMOVAL WORK: CAP OPEN/OBSOLETE PNEUMATIC TUBING AT ALL LOCATIONS. REMOVE OBSOLETE/DISCONNECTED PNEUMATIC TUBING WHERE EXPOSED TO VIEW. ABANDON IN-PLACE PNEUMATIC TUBING THAT IS CONCEALED OR IN VENTILATOR AND MAINTAIN OUTSIDE AIR DUCT SLEEVE CONNECTED TO EXTERIOR OUTSIDE AIR LOUVER. DISCONNECT AND REMOVE HWS/HWR BRANCH OTHERWISE INACCESSIBLE AREAS. PIPING TO REMOVED UNIT VENTILATOR HEATING COIL. DISCONNECT AND REMOVE HEATING COIL CONTROL VALVE, DAMPERS AND ALL ASSOCIATED UNIT VENTILATOR CONTROL WIRING, DDC CONTROLLER, SENSORS, RELAYS, GRAPHICS, PROGRAMMING, SEQUENCES OF OPERATIONS AND ASSOCIATED DISCONNECT AND REMOVE SPACE TEMPERATURE SENSOR AT LOATION SHOWN. DISCONNECT AND REMOVE DDC PROGRAMMING FROM REMOVED UNIT VENTILATOR IN SPACE. REMOVE CONTROL WIRING BETWEEN UNIT VENTILATOR DDC CONTROLLER AND SPACE SENSOR. DISCONNECT AND REMOVE PERIMETER SHELVING/CABINET UNITS AT LOCATION SHOWN AND FIN TUBE RADIATION LOCATED WITHIN PIPING TUNNEL AT REAR OF SHELVING SYSTEM. DISCONNECT AND REMOVE HORIZONTAL PIPING ENCLOSURE UNITS AT LOCATIONS SHOWN INCLUDING ASSOCIATED FIN TUBE RADIATION WITHIN THE PIPING www.ksq.design ENCLOSURE SYSTEM. DISCONNECT AND REMOVE HWS/HWR BRANCH PIPING WITHIN FIN TUBE ENCLOSURE SYSTEM BACK TO DISCONNECTION POINT SHOWN. DISCONNECT AND REMOVE HWS TO BOTTOM OF RISER ROUTED TO FLOOR LEVEL AND CAP AT DISCONNECTION POINT. Owner DISCONNECT AND REMOVE FLOOR MOUNTED UNIT VENTILATOR AT LOCATION SHOWN. DISCONNECT OUTSIDE AIR DUCT SLEEVE FROM REMOVED UNIT VENTILATOR AND MAINTAIN OUTSIDE AIR DUCT SLEEVE CONNECTED TO EXTERIOR OUTSIDE AIR LOUVER. DISCONNECT AND REMOVE HWS/HWR BRANCH PIPING TO REMOVED UNIT VENTILATOR HEATING COIL BACK TO BOTTOM OF HWS/R RISERS WITHIN ADJACENT VERTICAL CHASE. DISCONNECT AND REMOVE HEATING COIL CONTROL VALVE, DAMPERS AND ALL ASSOCIATED UNIT VENTILATOR CONTROL WIRING, DDC CONTROLLER, SENSORS, RELAYS, GRAPHICS, PROGRAMMING, SEQUENCES OF OPERATIONS AND ASSOCIATED CONTROL DEVICES. (6) DISCONNECT AND REMOVE AIR HANDLING UNIT S-4 PENUMATIC OPERATOR DIAL AT LOCATION SHOWN INCLUDING ASSOCIATED PNEUMATIC TUBING. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE STAINLESS STEEL COVER PLATE OVER LOCATION OF REMOVED PNEUMATIC OPERATOR DIAL. DISCONNECT AND REMOVE PNEUMATIC CONTROL PANEL INCLUDING ALL PNEUMATIC ON/OFF SWITCHES AND PNEUMATIC OPERATOR DIALS FROM REMOVED PNEUMATIC CONTROLS SERVING EXHAUST FANS AND AIR HANDLING UNIT S-1. REMOVE PNEUMATIC TUBING FROM CONTROL PANEL BACK TO ASSOCIATED PNEUMATIC PIPING MAIN AND CAP. REMOVE LINE VOLTAGE POWER FROM REMOVED PANEL BACK TO ASSOCIATED PANELBOARD. REMOVE ALL LOW VOLTAGE www.clapperstructural.com CONTROL WIRING FROM PANEL BACK TO ASSOCIATED SOURCE. (8) DISCONNECT AND REMOVE TWO PNEUMATIC THERMOSTATS AT LOCATIONS SHOWN. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE STAINLESS STEEL COVER PLATE OVER LOCATION OF ONE THERMOSTAT AND REUSE SECOND LOCATION FOR REPLACEMENT SPACE TEMPERATURE SENSOR AS SHOWN ON DRAWING MS M-112. 9 DISCONNECT AND REMOVE GREASE HOOD EXHAUST FAN EF-3 PNEUMATIC OPERATOR DIAL AT LOCATION SHOWN INCLUDING ASSOCIATED PNEUMATIC TUBING. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE STAINLESS STEEL COVER PLATE OVER LOCATION OF REMOVED PNEUMATIC OPERATOR DIAL. (10) DISCONNECT AND REMOVE HORIZONTAL PIPING ENCLOSURE UNITS AT LOCATIONS SHOWN INCLUDING ASSOCIATED HWS/HWR BRANCH PIPING WITHIN FIN TUBE ENCLOSURE SYSTEM BETWEEN DISCONNECTION POINTS SHOWN. DISCONNECT AND REMOVE HWR PIPING TO BOTTOM OF RISER TO FLOOR LEVEL AND CAP AT DISCONNECTION POINT. DISCONNECT AND REMOVE HWS/R PIPING ROUTED WITHIN HORIZONTAL ENCLOSURE SYSTEMS TO WALL PENETRATION POINT BETWEEN STORAGE 123 AND CLASSROOM 114, AND CAP HWS/R PIPING AT WALL PENETRATION. (11) DISCONNECT AND REMOVE 1" HWS/R PIPING TO BOTTOM OF HWS/R RISERS AND CAP AT DISCONNECTION POINTS SHOWN. (12) DISCONNECT AND REMOVE HWS BRANCH PIPING TO DISCONNECTION POINT SHOWN JUST UPSTREAM OF PENETRATION INTO VERTICAL PIPING CHASE. (13) DISCONNECT AND REMOVE HWR BRANCH PIPING TO DISCONNECTION POINT SHOWN JUST UPSTREAM OF PENETRATION INTO VERTICAL PIPING CHASE. - 1-1/4" HWS/R DOWN TO 5TH GRADE CLASSROOM TYPICAL 58"x12" UV OA LOUVER -SP.ED. REL. SERVICE 2 1/2" HWS---1 STAGE 111 MULTIPURPOSE / CAFETERIA 108 FABRICATION CLASSROOM DOWN TO FLOOR LEVEL 5TH GRADE CLASSEROOM 116.5 110 1-1/4" HWS UP TO SECOND FLOOR — 1-1/4" HWS DOWN TO FLOOR LEVEL - 1-1/4" HWR UP TO SECOND FLOOR 44"x20" SA-- 1-1/2" HWR DOWN TO FLOOR LEVEL ^{_}2" HWR 1 1/4" HWS-VIDEO PRODUCTION-110A CLASSROOM 5TH GRADE CLASSROOM 114.5 RECEIVING CUSTODIAL 119 5TH GRADE CLASSROOM 48"x24" CAFETERIA SP.ED. CLASSROOM 48"x18" GREASE HOOD EA UP —— CLASSROOM SHEETROCK PIPING CHASE RECESSED CABINET UNIT HEATER ~1 1/4" HWS 🔏 1-1/4" HWR DOWN TO FLOOR LEVEL ——— 1" HWR DOWN TO FLOOR — 1-1/4" HWS DOWN
TO FLOOR

1" HWS UP TO
SECOND FLOOR — 1" HWR UP TO - 1" HWS DOWN TO FLOOR FIN TUBE
ENCLOSURE SECOND FLOOR 1" HWS UP — PARTIAL FIRST FLOOR REMOVALS - SOUTHEAST SOUTHEAST PROJECT NUMBER: 2111002.00 COPYRIGHT © 2014 KSQ ARCHITECTS, PC 7/11/2023 3:23:08 PM

NEW YORK OKLAHOMA

ARCHITECT

KSQ Design 215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office

Nanuet Union Free School District 103 Church St, Nanuet, NY 10954 845.627.9880 office http://www.nanuetsd.org/

Structural Engineer

Clapper Structural Engineering 160 Partition Street Saugerties, NY 12477 845.943.9601


MEP Engineer Sage Engineering Associates, LLP 9 Columbia Circle

Albany NY 12203 518.453.6091 office 518.453.6092 fax www.sagellp.com **Environmental Engineer**

Quest Environmental Solutions 1376 Route 9 Wappingers Falls, NY 12590 845.298.6251

www.qualityenv.com

Construction Manager One Penn Plaza 54th Floor, Suite 5420 New York, NY 10119 646.908.6550 www.jacobs.com





NUFSD BOND **PROJECTS** PH3

☐ SED#50-01-08-03-0-003-035 (HIGH SCH00L)
■ SED#50-01-08-03-0-004-020 (BARR MIDDLE SCH00L)

High School 103 Church St. Nanuet, NY 10954

Barr Middle School 50 Blauvelt Rd #1 Nanuet, NY 10954

REVISIONS BID ADDENDUM #6

ISSUED: BID SET ISSUANCE

DATE: 06/06/2023

SCALE: 1/8" = 1'-0" SHEET NAME: PARTIAL FIRST FLOOR **REMOVALS** -

SHEET NUMBER:

ARCHITECT $\overline{}$ GENERAL NOTES: KEYED NOTES: DISCONNECT AND REMOVE BASEMENT AIR HANDLING UNIT S-8 PENUMATIC OPERATOR DIAL AT LOCATION SHOWN INCLUDING ASSOCIATED PNEUMATIC TUBING. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE STAINLESS STEEL COVER PLATE OVER LOCATION OF REMOVED REGARDING PNEUMATIC CONTROL SYSTEM REMOVAL WORK: CAP OPEN/OBSOLETE PNEUMATIC TUBING AT ALL LOCATIONS. REMOVE OBSOLETE/DISCONNECTED PNEUMATIC TUBING WHERE EXPOSED TO VIEW. ABANDON IN-PLACE PNEUMATIC TUBING THAT IS CONCEALED OR IN OTHERWISE INACCESSIBLE AREAS. DISCONNECT AND REMOVE BASEMENT AIR HANDLING UNIT S-7 PENUMATIC OPERATOR DIAL AT LOCATION SHOWN INCLUDING ASSOCIATED PNEUMATIC TURING REMOVE PNEUMATIC TURING BACK TO PNEUMATIC DIRING MAIN AND CAR PROVIDE STAIN FOR STEEL ASSOCIATED PNEUMATIC DIRING MAIN AND CAR PROVIDE STAIN FOR STEEL ASSOCIATED PNEUMATIC NEW YORK OKLAHOMA TUBING. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE STAINLESS STEEL COVER PLATE OVER LOCATION OF REMOVED PNEUMATIC OPERATOR DIAL. KSQ Design ① DISCONNECT AND REMOVE BASEMENT AIR HANDLING UNIT S-6 PENUMATIC OPERATOR DIAL AT LOCATION SHOWN INCLUDING ASSOCIATED PNEUMATIC TUBING. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE STAINLESS STEEL COVER PLATE OVER LOCATION OF REMOVED 215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office www.ksq.design Owner 845.627.9880 office http://www.nanuetsd.org/ Structural Engineer 160 Partition Street Saugerties, NY 12477 845.943.9601 www.clapperstructural.com MEP Engineer 9 Columbia Circle Albany NY 12203 518.453.6091 office 518.453.6092 fax 16"x16" EA UP TO www.sagellp.com EF-22 ON ROOF — **Environmental Engineer** CUH-A 1376 Route 9 **BOYS LOCKER** ROOM 845.298.6251 www.qualityenv.com Construction Manager _____ 20"x20" EA UP TO One Penn Plaza EF-21 ON ROOF — 54th Floor, Suite 5420 New York, NY 10119 646.908.6550 www.jacobs.com - 1-1/4" HWS/R DOWN TO BASEMENT SECURE VESTIBULE— 100A __4" HWS ^{_}4" HWR ENTRY VESTIBULE C107 5 / 6 GRADES GYMNASIUM Nanuet, NY 10954 Barr Middle School 1-1/4" HWS/R DOWN TO BASEMENT GIRLS LOCKER 1 BID ADDENDUM #6 16"x16" EA UP TO EF-20 ON ROOF 20"x20" EA UP TO EF-19 ON ROOF — **DATE:** 06/06/2023 **SCALE:** 1/8" = 1'-0" SHEET NAME: REMOVALS - NORTHWEST SHEET NUMBER: PARTIAL FIRST FLOOR REMOVALS - NORTHWEST

1/8" = 1'-0" PROJECT NUMBER: 2111002.00 COPYRIGHT © 2014 KSQ ARCHITECTS, PC 7/11/2023 3:23:10 PM

Nanuet Union Free School District 103 Church St, Nanuet, NY 10954

Clapper Structural Engineering

Sage Engineering Associates, LLP

Quest Environmental Solutions Wappingers Falls, NY 12590






NUFSD BOND PROJECTS PH3

☐ SED#50-01-08-03-0-003-035 (HIGH SCH00L)
■ SED#50-01-08-03-0-004-020 (BARR MIDDLE SCH00L)

High School 103 Church St.

50 Blauvelt Rd #1 Nanuet, NY 10954



ISSUED: BID SET ISSUANCE

PARTIAL FIRST FLOOR


BM-M106

GENERAL NOTES: REGARDING PNEUMATIC CONTROL SYSTEM REMOVAL WORK: CAP OPEN/OBSOLETE PNEUMATIC TUBING AT ALL LOCATIONS. REMOVE OBSOLETE/DISCONNECTED PNEUMATIC TUBING WHERE EXPOSED TO VIEW. ABANDON IN-PLACE PNEUMATIC TUBING THAT IS CONCEALED OR IN OTHERWISE INACCESSIBLE AREAS.

 \mathcal{L}

- DISCONNECT AND REMOVE FLOOR MOUNTED UNIT VENTILATOR AT LOCATION SHOWN. DISCONNECT OUTSIDE AIR DUCT SLEEVE FROM REMOVED UNIT VENTILATOR AND MAINTAIN OUTSIDE AIR DUCT SLEEVE CONNECTED TO EXTERIOR OUTSIDE AIR LOUVER. DISCONNECT AND REMOVE HWS/HWR BRANCH PIPING TO REMOVED UNIT VENTILATOR HEATING COIL. DISCONNECT AND REMOVE HEATING COIL CONTROL VALVE, DAMPERS AND ALL ASSOCIATED UNIT VENTILATOR CONTROL WIRING, DDC CONTROLLER, SENSORS, RELAYS, GRAPHICS, PROGRAMMING, SEQUENCES OF OPERATIONS AND ASSOCIATED CONTROL DEVICES.
- DISCONNECT AND REMOVE SPACE TEMPERATURE SENSOR AT LOATION SHOWN. DISCONNECT AND REMOVE DDC PROGRAMMING FROM REMOVED UNIT VENTILATOR IN SPACE. REMOVE CONTROL WIRING BETWEEN UNIT VENTILATOR DDC CONTROLLER AND SPACE SENSOR.
- DISCONNECT AND REMOVE 1" HWS/HWR PIPING ROUTED WITHIN PIPING TUNNEL BEHIND UNIT VENTILATORS AND CABINET SHELVING SYSTEMS BACK TO DISCONNECTION POINTS SHOWN AT POINT OF RISER PENETRATION THROUGH FLOOR AND CAP.

- DISCONNECT AND REMOVE FLOOR MOUNTED UNIT VENTILATOR AT LOCATION SHOWN. DISCONNECT AND REMOVE OUTSIDE AIR DUCT SLEEVE FROM REMOVED DISCONNECT AND REMOVE FLOOR MOUNTED UNIT VENTILATOR AT LOCATION SHOWN. DISCONNECT AND REMOVE OUTSIDE AIR DOCT SLEEVE FROM REMOVED UNIT VENTILATOR CONNECTED TO EXTERIOR OUTSIDE AIR LOUVER. PROVIDE A 1" THICK, ALUMINUM FACED GLASS FIBER BOARD PANEL OVER THE INTERIOR FACE
- HEATING COIL CONTROL VALVE, DAMPERS AND ALL ASSOCIATED UNIT VENTILATOR CONTROL WIRING, SENSORS, RELAYS AND CONTROL DEVICES.
- DISCONNECT AND REMOVE PNEUMATIC DAMPER, SENSORS AND RELAYS FROM EA RISER UP TO ROOFTOP EXHAUST FAN. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE SHEETMETAL SLEEVE AT LOCATION OF REMOVED DAMPER TO MAINTAIN SEALED FA DISEBULE TUROUGH POOF PNEUMATIC PIPING MAIN AND CAP. PROVIDE SHEETMETAL SLEEVE AT LOCATION OF REMOVED DAMPER TO MAINTAIN SEALED EA RISER UP THROUGH ROOF
- DISCONNECT AND REMOVE SPACE TEMPERATURE SENSOR AT LOATION SHOWN. DISCONNECT AND REMOVE DDC PROGRAMMING FROM REMOVED UNIT VENTILATOR IN SPACE. REMOVE CONTROL WIRING BETWEEN REMOVED UNIT VENTILATOR DDC CONTROLLER AND SPACE SENSOR.

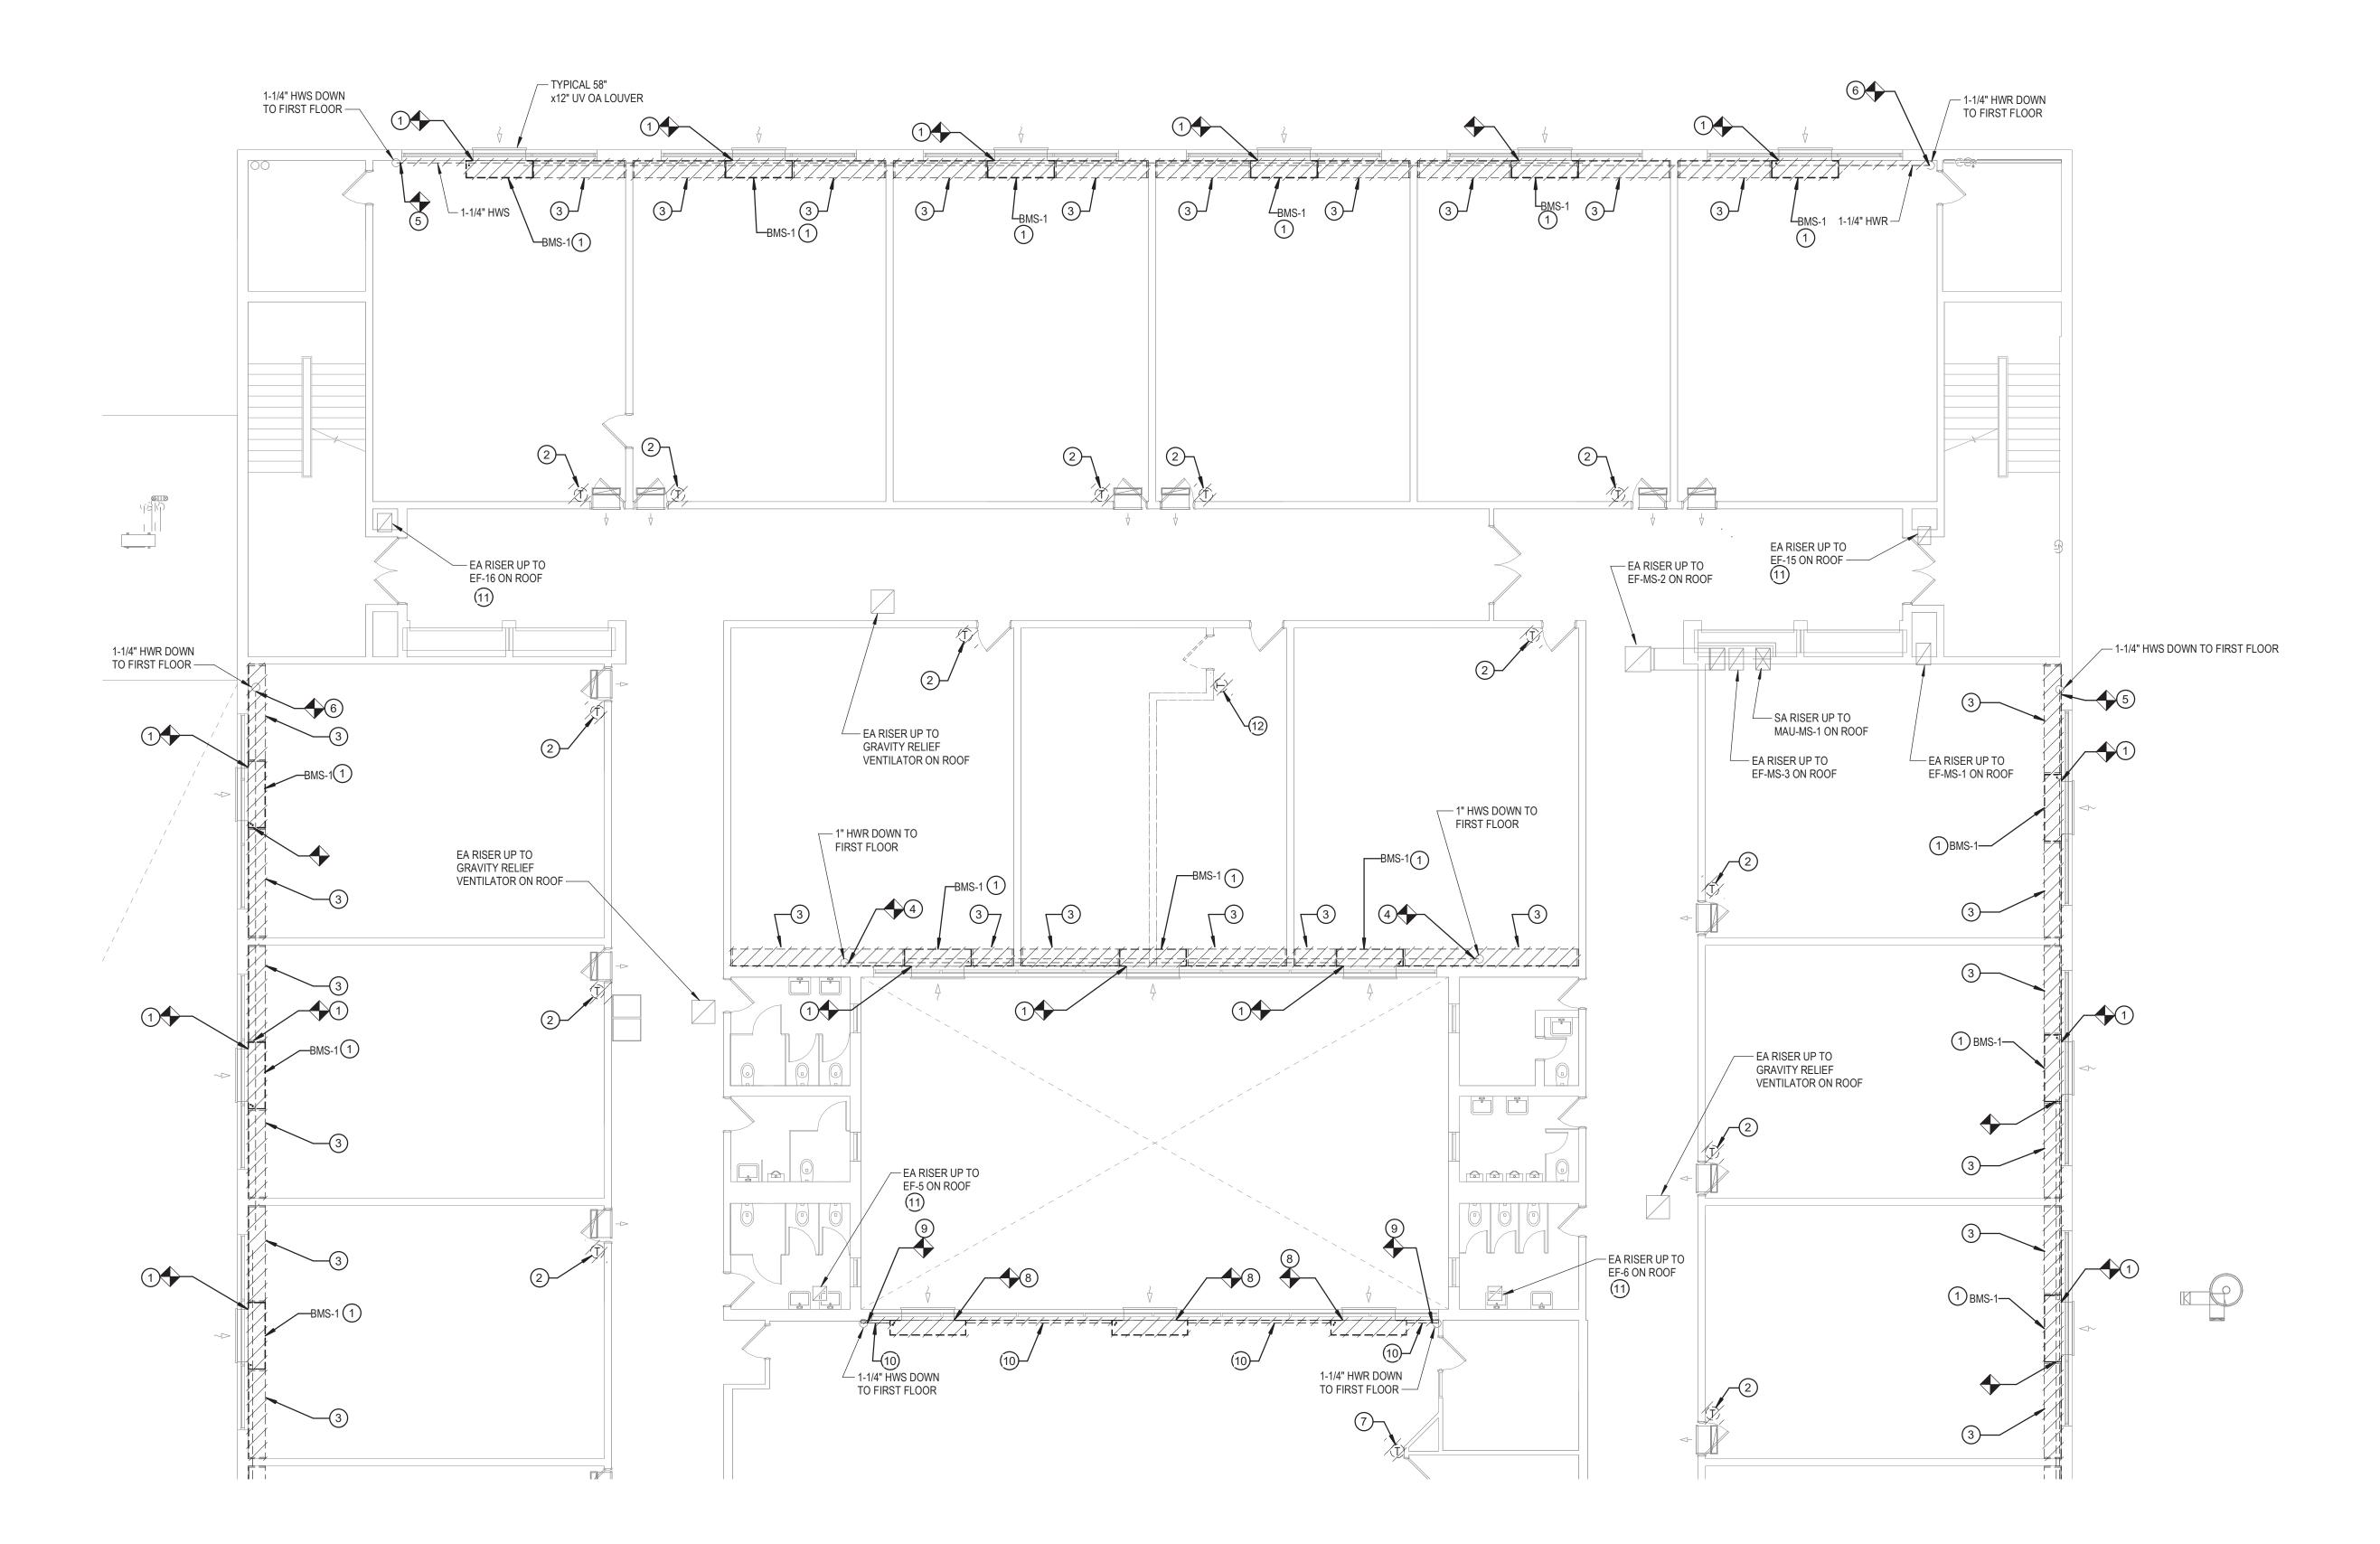

PARTIAL SECOND FLOOR REMOVALS -

NORTHEAST

7/11/2023 3:23:12 PM

KEYED NOTES:

3 DISCONNECT AND REMOVE PERIMETER SHELVING/CABINET UNITS AT LOCATION SHOWN AND FIN TUBE RADIATION LOCATED WITHIN PIPING TUNNEL AT REAR OF SHELVING SYSTEM.

DISCONNECT AND REMOVE HWS/HWR ROUTED BEHIND REMOVE UNIT VENTILATORS AND CABINET SHELVING SYSTEMS. REMOVE HWS BACK TO FLOOR PENETRATION AND CAP AROVE FLOOR PENETRATION AND CAP ABOVE FLOOR.

6 DISCONNECT AND REMOVE HWS/HWR ROUTED BEHIND REMOVE UNIT VENTILATORS AND CABINET SHELVING SYSTEMS. REMOVE HWR BACK TO FLOOR PENETRATION AND CAP ABOVE FLOOR.

DISCONNECT AND REMOVE TEMPERATURE SENSOR AT LOCATION SHOWN. DISCONNECT AND REMOVE DDC PROGRAMMING FROM REMOVED UNIT VENTILATORS IN SPACE. REMOVE CONTROL WIRING BETWEEN REMOVED UNIT VENTILATOR DDC CONTROLLER AND SPACE SENSOR.

OF THE EXTERIOR OPENING. DISCONNECT AND REMOVE HWS/HWR BRANCH PIPING TO REMOVED UNIT VENTILATOR HEATING COIL. DISCONNECT AND REMOVE

9 DISCONNECT AND REMOVE 1-1/4" HWS/HWR PIPING LOCATED BETWEEN RISERS TO DISCONNECTION POINTS SHOWN ABOVE FLOOR PENETRATIONS AND CAP.

DISCONNECT AND REMOVE HORIZONTAL PIPING ENCLOSURES BETWEEN REMOVED UNIT VENTILATORS AT LOCATIONS SHOWN INCLUDING ASSOCIATED HWS/R PIPING ROUTED WITHIN THE ENCLOSURE UNITS PIPING ROUTED WITHIN THE ENCLOSURE UNITS.

PENETRATION.

ARCHITECT

KSQ Design

www.ksq.design

845.627.9880 office http://www.nanuetsd.org/

Structural Engineer

160 Partition Street

MEP Engineer

9 Columbia Circle

Albany NY 12203 518.453.6091 office

518.453.6092 fax

www.sagellp.com

1376 Route 9

845.298.6251 www.qualityenv.com

Environmental Engineer

Construction Manager

One Penn Plaza 54th Floor, Suite 5420 New York, NY 10119 646.908.6550 www.jacobs.com

Quest Environmental Solutions

Wappingers Falls, NY 12590

Saugerties, NY 12477 845.943.9601

www.clapperstructural.com

Owner

NEW YORK OKLAHOMA

215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office

Nanuet Union Free School District

103 Church St, Nanuet, NY 10954

Clapper Structural Engineering

Sage Engineering Associates, LLP




NUFSD BOND **PROJECTS** PH3

☐ SED#50-01-08-03-0-003-035 (HIGH SCH00L)
■ SED#50-01-08-03-0-004-020 (BARR MIDDLE SCH00L)

High School 103 Church St. Nanuet, NY 10954

Barr Middle School 50 Blauvelt Rd #1 Nanuet, NY 10954



REVI	SIONS	
No.	Description	Da
1	BID ADDENDUM #6	07/12
		1

ISSUED: BID SET ISSUANCE

DATE: 06/06/2023

SCALE: 1/8" = 1'-0" SHEET NAME: PARTIAL SECOND FLOOR **REMOVALS** -

NORTHEAST SHEET NUMBER: BM-M107

ARCHITECT $\overline{}$ GENERAL NOTES: KEYED NOTES: DISCONNECT AND REMOVE FLOOR MOUNTED UNIT VENTILATOR AT LOCATION SHOWN. DISCONNECT OUTSIDE AIR DUCT SLEEVE FROM REMOVED UNIT VENTILATOR AND MAINTAIN OUTSIDE AIR DUCT SLEEVE CONNECTED TO EXTERIOR OUTSIDE AIR LOUVER. DISCONNECT AND REMOVE HWS/HWR BRANCH 1. REGARDING PNEUMATIC CONTROL SYSTEM REMOVAL WORK: CAP OPEN/OBSOLETE PNEUMATIC TUBING AT ALL LOCATIONS. REMOVE OBSOLETE/DISCONNECTED PNEUMATIC TUBING WHERE EXPOSED TO VIEW. ABANDON IN-PLACE PNEUMATIC TUBING THAT IS CONCEALED OR IN OTHERWISE INACCESSIBLE AREAS. PIPING TO REMOVED UNIT VENTILATOR HEATING COIL. DISCONNECT AND REMOVE HEATING COIL CONTROL VALVE, DAMPERS AND ALL ASSOCIATED UNIT VENTILATOR CONTROL WIRING, DDC CONTROLLER, SENSORS, RELAYS, GRAPHICS, PROGRAMMING, SEQUENCES OF OPERATIONS AND ASSOCIATED 2 DISCONNECT AND REMOVE SPACE TEMPERATURE SENSOR AT LOATION SHOWN. DISCONNECT AND REMOVE DDC PROGRAMMING FROM REMOVED UNIT VENTILATOR IN SPACE. REMOVE CONTROL WIRING BETWEEN UNIT VENTILATOR DDC CONTROLLER AND SPACE SENSOR. DISCONNECT AND REMOVE PERIMETER SHELVING/CABINET UNITS AT LOCATION SHOWN AND FIN TUBE RADIATION LOCATED WITHIN PIPING TUNNEL AT REAR OF SHELVING SYSTEM. www.ksq.design DISCONNECT AND REMOVE HWS/HWR ROUTED BEHIND REMOVE UNIT VENTILATORS AND CABINET SHELVING SYSTEMS. REMOVE HWS BACK TO FLOOR PENETRATION AND CAP ABOVE FLOOR. DISCONNECT AND REMOVE ABANDONED EXHAUST AIR DUCTWORK AT LOCATION SHOWN. DISCONNECT AND REMOVE PNEUMATIC DAMPER, SENSORS AND RELAYS FROM 16"x16" ABANDONED EA RISER. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. 6) DISCONNECT AND REMOVE HORIZONTAL PIPING ENCLOSURE UNITS AT LOCATIONS SHOWN. DISCONNECT AND REMOVE EA BRANCH AND ASSOCIATED EA REGISTER SERVING COMPUTER SERVER ROOM BACK TO DISCONNECTION POINT SHOWN AND CAP. SERVER ROOM VENTILATION SHALL BE PROVIDED BY DEDICATED SERVER ROOM ROOFTOP EXHAUST FAN. http://www.nanuetsd.org/ DISCONNECT AND REMOVE PNEUMATIC DAMPER, SENSORS AND RELAYS FROM EA RISER UP TO EF-8 ON ROOF. DISCONNECT AND REMOVE EF-8 PENUMATIC OPERATOR DIAL AT LOCATION SHOWN INCLUDING ASSOCIATED PNEUMATIC TUBING. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE STAINLESS STEEL COVER PLATE OVER LOCATION OF REMOVED PNEUMATIC OPERATOR DIAL. PROVIDE SHEETMETAL SLEEVE AT LOCATION OF REMOVED DAMPER TO MAINTAIN SEALED EA RISER UP THROUGH ROOF PENETRATION. DISCONNECT AND REMOVE PNEUMATIC DAMPER, SENSORS AND RELAYS FROM EA RISER UP TO EF-10 ON ROOF. DISCONNECT AND REMOVE EF-8 PENUMATIC OPERATOR DIAL AT LOCATION SHOWN INCLUDING ASSOCIATED PNEUMATIC TUBING. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE STAINLESS STEEL COVER PLATE OVER LOCATION OF REMOVED PNEUMATIC OPERATOR DIAL. PROVIDE SHEETMETAL SLEEVE AT LOCATION OF REMOVED DAMPER TO MAINTAIN SEALED EA RISER UP THROUGH ROOF PENETRATION. DISCONNECT AND REMOVE PNEUMATIC DAMPER, SENSORS AND RELAYS FROM EA RISER UP TO ROOFTOP EXHAUST FAN. REMOVE PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN AND CAP. PROVIDE SHEETMETAL SLEEVE AT LOCATION OF REMOVED DAMPER TO MAINTAIN SEALED EA RISER UP THROUGH ROOF PENETRATION. 518.453.6092 fax DISCONNECT AND REMOVE HWS/HWR ROUTED BEHIND REMOVE UNIT VENTILATORS AND CABINET SHELVING SYSTEMS. REMOVE HWR BACK TO FLOOR PENETRATION AND CAP ABOVE FLOOR. **Construction Manager** 646.908.6550 www.jacobs.com 110J SMALL INST. RM 241D 7TH GRADE CLASSROOM — EA RISER UP TO GRAVITY RELIEF VENTILATOR ON ROOF 218 EA RISER UP TO
GRAVITY RELIEF
VENTILATOR ON ROOF SMALL INST. RM 241C PRINT/COPY AREA 241B TYPICAL 58"x12" UV OA LOUVER — 7TH GRADE CLASSROOM 220 CLASSROOM 26"x26" EA UP TO EF-10 ON ROOF 1-1/4" HWS DOWN — ___ 12"x18" EA DOWN ____ 1-1/4" HWR DOWN TO FIRST FLOOR —18"x12" EA /--18"x12" EA ⊢EA RISER UP TO 16"x16"— [`]—18"x12" EA SERVER ROOM EXHAUST FAN ON ROOF — 18"x18" EA UP TO EF-11 ON ROOF EA UP TO BOYS TOILET EF-7 ON ROOF — COMP. SERVER ── 26"x26" EA UP TO EF-8 ON ROOF EA RISER UP TO
ABANDONED
EF-2 ON ROOF 8TH GRADE CLASSROOM - SERVER ROOM EXHAUST FAN THERMOSTAT EF-1 ON ROOF COMPUTER CLASSROOM SCIENCE LAB SCIENCE LAB SCIENCE LAB EA RISER UP TO ----- 15"x15" EA UP TO EF-4 ON ROOF KITCHEN HOOD EF-3 ON ROOF BMS-21 BMS-2 1 __BMS-2 1 1" HWR DOWN TO FIRST FLOOR 1" HWS DOWN TO FIRST FLOOR **DATE:** 06/06/2023 PARTIAL SECOND FLOOR REMOVALS -SOUTHEAST SHEET NUMBER: PROJECT NUMBER: 2111002.00 COPYRIGHT © 2014 KSQ ARCHITECTS, PC 7/11/2023 3:23:14 PM

NEW YORK OKLAHOMA

KSQ Design 215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office

Nanuet Union Free School District 103 Church St, Nanuet, NY 10954 845.627.9880 office

Structural Engineer

Clapper Structural Engineering 160 Partition Street Saugerties, NY 12477

845.943.9601

www.clapperstructural.com MEP Engineer

Sage Engineering Associates, LLP 9 Columbia Circle Albany NY 12203 518.453.6091 office

www.sagellp.com **Environmental Engineer** Quest Environmental Solutions

1376 Route 9 Wappingers Falls, NY 12590 845.298.6251 www.qualityenv.com

One Penn Plaza 54th Floor, Suite 5420 New York, NY 10119





NUFSD BOND **PROJECTS** PH3

☐ SED#50-01-08-03-0-003-035 (HIGH SCH00L)
■ SED#50-01-08-03-0-004-020 (BARR MIDDLE SCH00L)

High School 103 Church St. Nanuet, NY 10954


Barr Middle School 50 Blauvelt Rd #1 Nanuet, NY 10954

BID ADDENDUM #6

ISSUED: BID SET ISSUANCE

SCALE: 1/8" = 1'-0"

SHEET NAME: PARTIAL SECOND FLOOR REMOVALS -SOUTHEAST

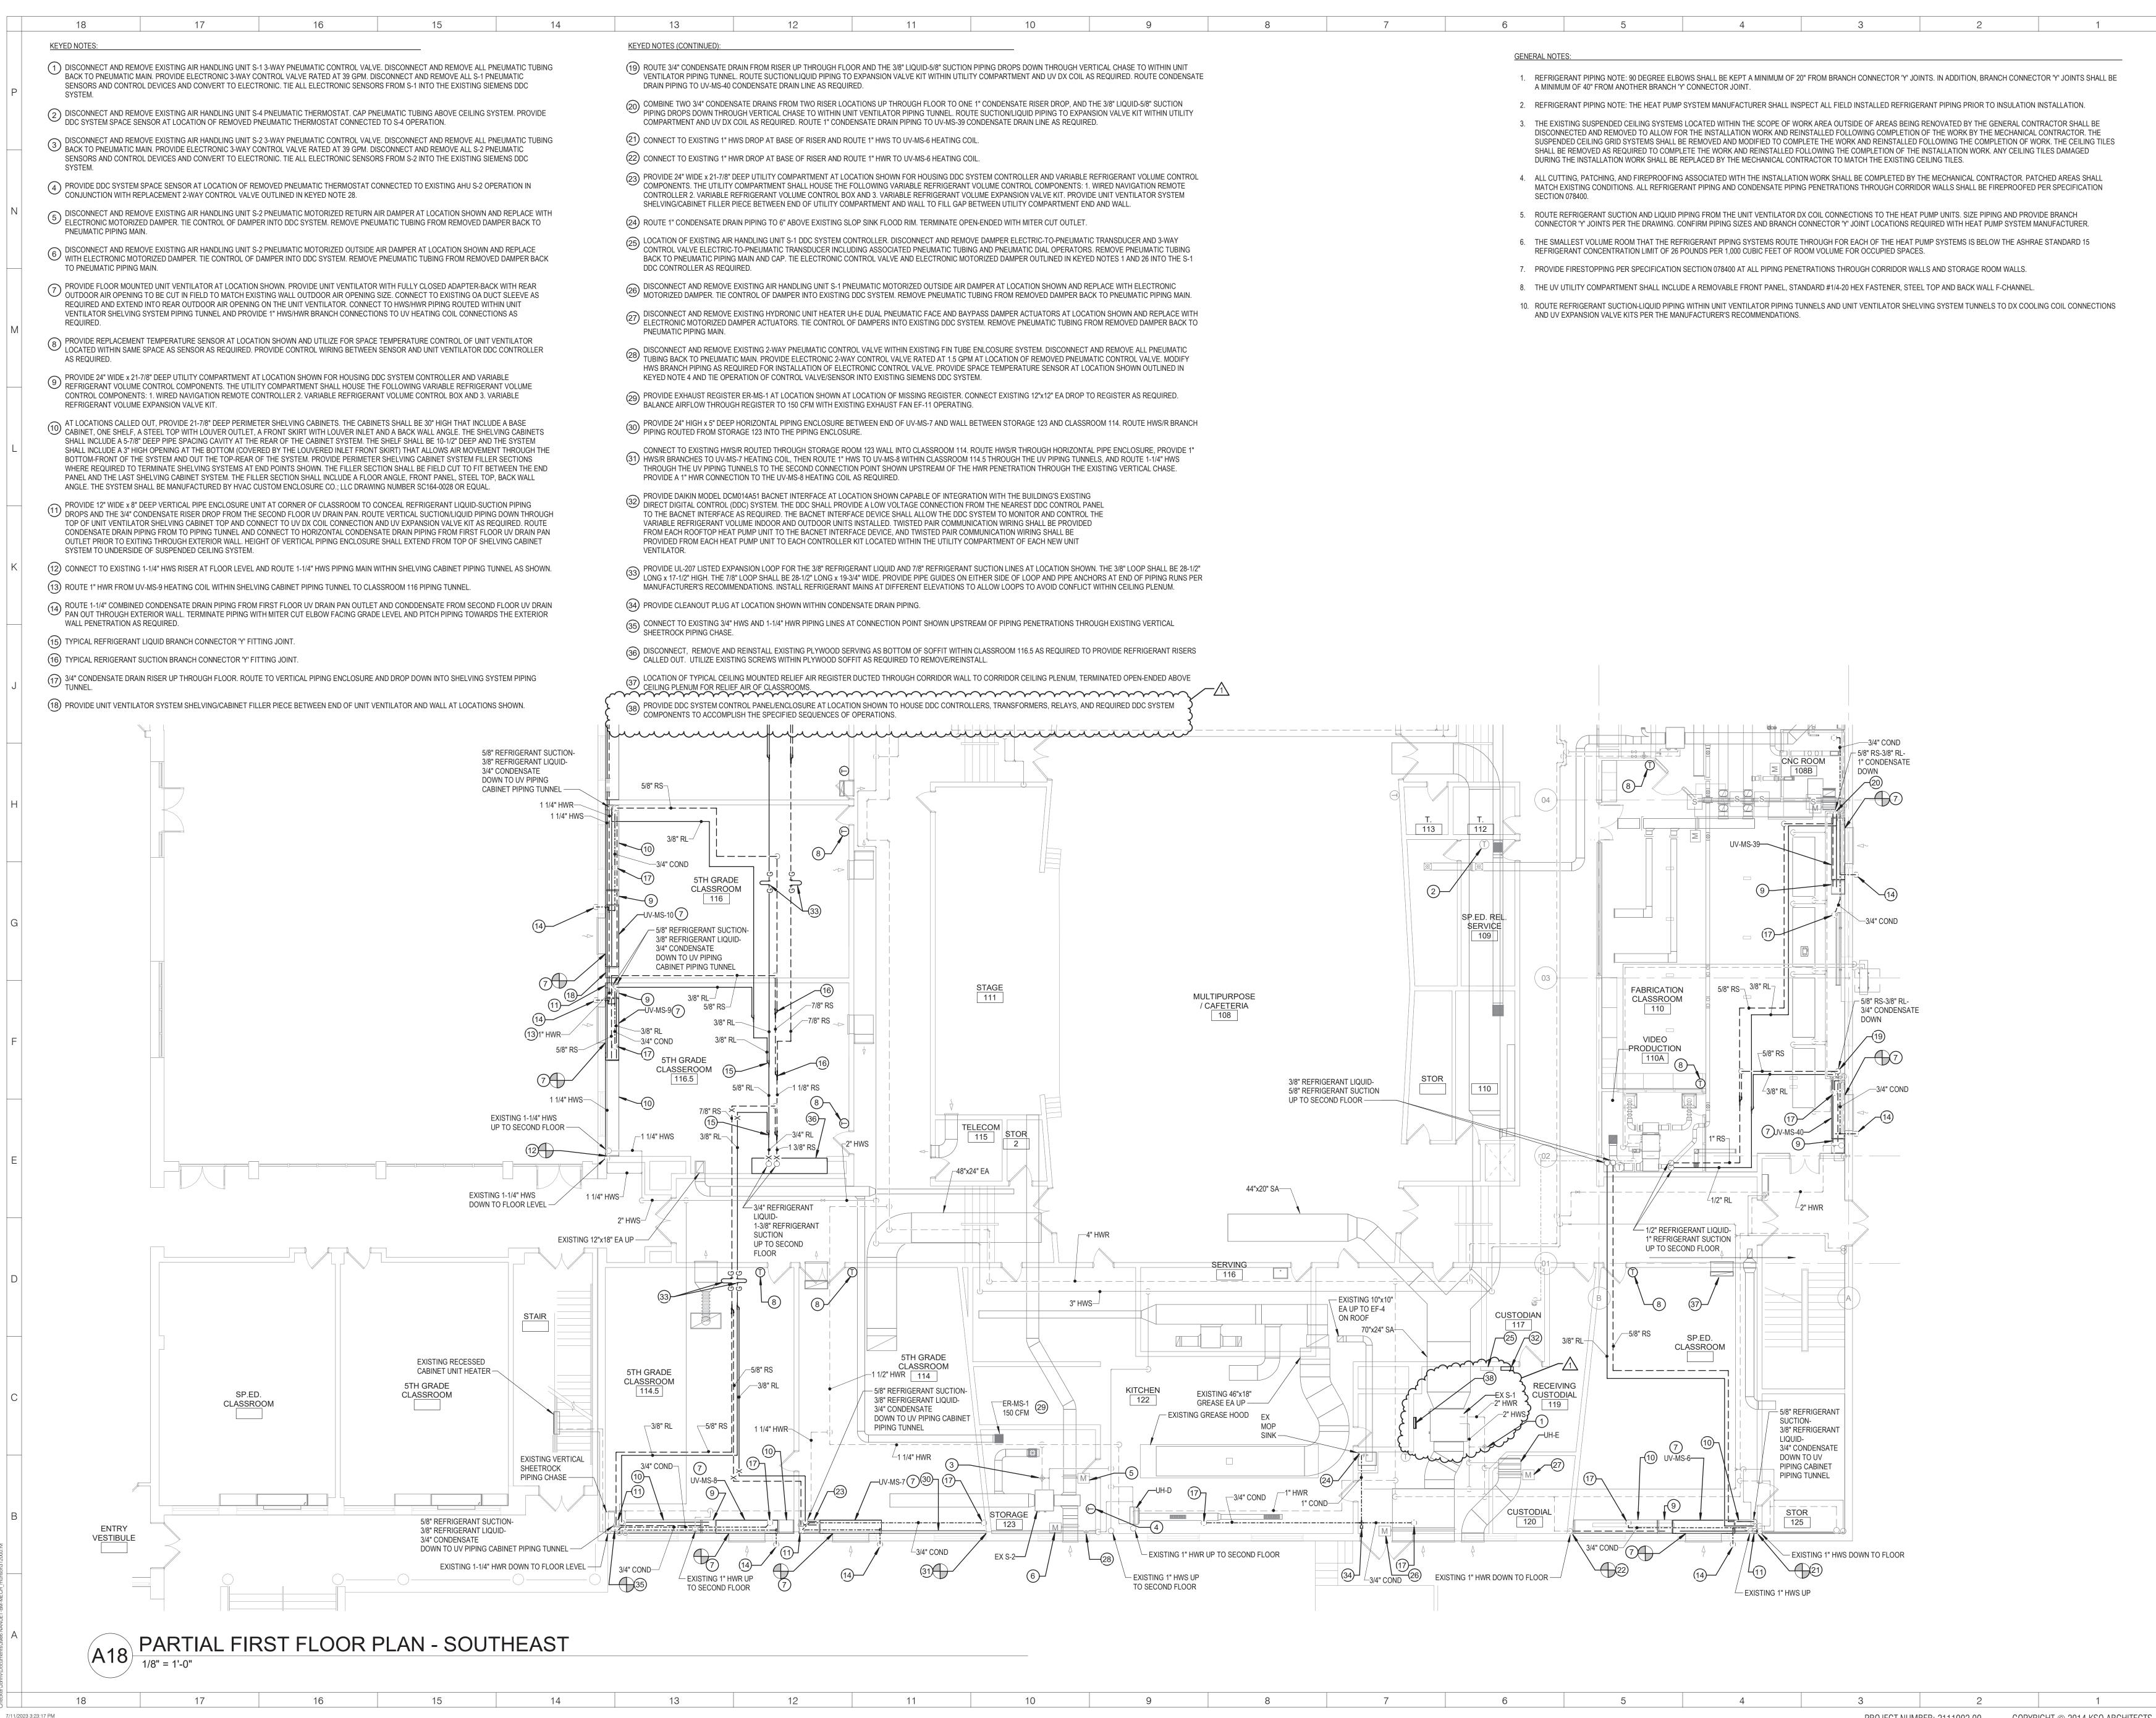

NEW YORK OKLAHOMA

ARCHITECT

215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office www.ksq.design

Nanuet Union Free School District 103 Church St, Nanuet, NY 10954 845.627.9880 office http://www.nanuetsd.org/

Structural Engineer

Clapper Structural Engineering 160 Partition Street Saugerties, NY 12477 845.943.9601


www.clapperstructural.com

MEP Engineer Sage Engineering Associates, LLP 9 Columbia Circle 518.453.6091 office 518.453.6092 fax www.sagellp.com

Environmental Engineer Quest Environmental Solutions 1376 Route 9 Wappingers Falls, NY 12590

845.298.6251 www.qualityenv.com Construction Manager

One Penn Plaza 54th Floor, Suite 5420 New York, NY 10119 646.908.6550 www.jacobs.com





NUFSD BOND **PROJECTS** PH3

☐ SED#50-01-08-03-0-003-035 (HIGH SCHOOL) ■ SED#50-01-08-03-0-004-020 (BARR MIDDLE SCHOOL)

> High School 103 Church St Nanuet, NY 10954

Barr Middle School 50 Blauvelt Rd #1 Nanuet, NY 10954

REVISIONS BID ADDENDUM #6

ISSUED: BID SET ISSUANCE

DATE: 06/06/2023 **SCALE:** 1/8" = 1'-0"

SHEET NAME: PARTIAL FIRST FLOOR PLAN - SOUTHEAST

SHEET NUMBER:

BM-M112

KEYED NOTES: **GENERAL NOTES:** 1) PROVIDE FLOOR MOUNTED UNIT VENTILATOR AT LOCATION SHOWN. PROVIDE UNIT VENTILATOR WITH FULLY CLOSED ADAPTER-BACK WITH REAR OUTDOOR AIR OPENING TO BE 1. REFRIGERANT PIPING NOTE: 90 DEGREE ELBOWS SHALL BE KEPT A MINIMUM OF 20" FROM BRANCH CONNECTOR 'Y' JOINTS. IN ADDITION, BRANCH CONNECTOR 'Y' JOINTS SHALL BE CUT IN FIELD TO MATCH EXISTING WALL OUTDOOR AIR OPENING SIZE. CONNECT TO EXISTING OA DUCT SLEEVE AS REQUIRED AND EXTEND INTO REAR OUTDOOR AIR OPENING A MINIMUM OF 40" FROM ANOTHER BRANCH 'Y' CONNECTOR JOINT. ON THE UNIT VENTILATOR. CONNECT TO HWS/HWR PIPING ROUTED WITHIN UNIT VENTILATOR SHELVING SYSTEM PIPING TUNNEL AND PROVIDE 1" HWS/HWR BRANCH CONNECTIONS TO UV HEATING COIL CONNECTIONS AS REQUIRED. 2. REFRIGERANT PIPING NOTE: THE HEAT PUMP SYSTEM MANUFACTURER SHALL INSPECT ALL FIELD INSTALLED REFRIGERANT PIPING PRIOR TO INSULATION INSTALLATION. 2 PROVIDE REPLACEMENT TEMPERATURE SENSOR AT LOCATION SHOWN AND UTILIZE FOR SPACE TEMPERATURE CONTROL OF UNIT VENTILATOR AS REQUIRED. PROVIDE 3. THE EXISTING SUSPENDED CEILING SYSTEMS LOCATED WITHIN THE SCOPE OF WORK AREA OUTSIDE OF AREAS BEING RENOVATED BY THE GENERAL CONTRACTOR SHALL BE CONTROL WIRING BETWEEN SENSOR AND UNIT VENTILATOR DDC CONTROLLER AS REQUIRED. DISCONNECTED AND REMOVED TO ALLOW FOR THE INSTALLATION WORK AND REINSTALLED FOLLOWING COMPLETION OF THE WORK BY THE MECHANICAL CONTRACTOR. THE SUSPENDED CEILING GRID SYSTEMS SHALL BE REMOVED AND MODIFIED TO COMPLETE THE WORK AND REINSTALLED FOLLOWING THE COMPLETION OF WORK. THE CEILING TILES SHALL BE REMOVED AS REQUIRED TO COMPLETE THE WORK AND REINSTALLED FOLLOWING THE COMPLETION OF THE INSTALLATION WORK. ANY CEILING TILES DAMAGED PROVIDE 24" WIDE x 21-7/8" DEEP UTILITY COMPARTMENT AT LOCATION SHOWN FOR HOUSING DDC SYSTEM CONTROLLER AND VARIABLE REFRIGERANT VOLUME CONTROL COMPONENTS. THE UTILITY COMPARTMENT SHALL HOUSE THE FOLLOWING VARIABLE REFRIGERANT VOLUME CONTROL COMPONENTS: 1. WIRED NAVIGATION REMOTE DURING THE INSTALLATION WORK SHALL BE REPLACED BY THE MECHANICAL CONTRACTOR TO MATCH THE EXISTING CEILING TILES. CONTROLLER 2. VARIABLE REFRIGERANT VOLUME CONTROL BOX AND 3. VARIABLE REFRIGERANT VOLUME EXPANSION VALVE KIT. 4. ALL CUTTING, PATCHING, AND FIREPROOFING ASSOCIATED WITH THE INSTALLATION WORK SHALL BE COMPLETED BY THE MECHANICAL CONTRACTOR. PATCHED AREAS SHALL 4 AT LOCATIONS CALLED OUT, PROVIDE 21-7/8" DEEP PERIMETER SHELVING CABINETS. THE CABINETS SHALL BE 30" HIGH THAT INCLUDE A BASE CABINET, ONE SHELF, A STEEL TOP WITH LOUVER OUTLET, A FRONT SKIRT WITH LOUVER INLET AND A BACK WALL ANGLE. THE SHELVING CABINETS SHALL INCLUDE A 5-7/8" DEEP PIPE SPACING CAVITY AT THE REAR MATCH EXISTING CONDITIONS. ALL REFRIGERANT PIPING AND CONDENSATE PIPING PENETRATIONS THROUGH CORRIDOR WALLS SHALL BE FIREPROOFED PER SPECIFICATION SECTION 078400. OF THE CABINET SYSTEM. THE SHELF SHALL BE 10-1/2" DEEP AND THE SYSTEM SHALL INCLUDE A 3" HIGH OPENING AT THE BOTTOM (COVERED BY THE LOUVERED INLET FRONT SKIRT) THAT ALLOWS AIR MOVEMENT THROUGH THE BOTTOM-FRONT OF THE SYSTEM AND OUT THE TOP-REAR OF THE SYSTEM. PROVIDE PERIMETER SHELVING CABINET 5. ROUTE REFRIGERANT SUCTION AND LIQUID PIPING FROM THE UNIT VENTILATOR DX COIL CONNECTIONS TO THE HEAT PUMP UNITS, SIZE PIPING AND PROVIDE BRANCH SYSTEM FILLER SECTIONS WHERE REQUIRED TO TERMINATE SHELVING SYSTEMS AT END POINTS SHOWN. THE FILLER SECTION SHALL BE FIELD CUT TO FIT BETWEEN THE END CONNECTOR 'Y' JOINTS PER THE DRAWING. CONFIRM PIPING SIZES AND BRANCH CONNECTOR 'Y' JOINT LOCATIONS REQUIRED WITH HEAT PUMP SYSTEM MANUFACTURER. PANEL AND THE LAST SHELVING CABINET SYSTEM. THE FILLER SECTION SHALL INCLUDE A FLOOR ANGLE, FRONT PANEL, STEEL TOP, BACK WALL ANGLE. THE SYSTEM SHALL BE 6. ROUTE REFRIGERANT PIPING THROUGH THE ROOF TO THE ROOF MOUNTED HEAT PUMP SYSTEMS. PROVIDE A PIPE CURB AND SIDE REFRIGERANT PIPIPNG OUTLET PORTAL AT MANUFACTURED BY HVAC CUSTOM ENCLOSURE CO.; LLC DRAWING NUMBER SC164-0028 OR EQUAL. PROVIDE END CAPS ON SHELVING CABINETS WHERE SYSTEMS TERMINATE SHORT OF A WALL SYSTEM AND CONNECT TO A HORIZONTAL PIPING ENCLOSURE SYSTEM. THE ROOF PENETRATION OF EACH HEAT PUMP SYSTEM. 🥽 PROVIDE 12" WIDE x 8" DEEP VERTICAL PIPE ENCLOSURE UNIT AT CORNER OF CLASSROOM TO CONCEAL REFRIGERANT LIQUID-SUCTION PIPING DROPS. ROUTE VERTICAL PIPING 7. THE SMALLEST VOLUME ROOM THAT THE REFRIGERANT PIPING SYSTEMS ROUTE THROUGH FOR EACH OF THE HEAT PUMP SYSTEMS IS BELOW THE ASHRAE STANDARD 15 🕘 DOWN THROUGH TOP OF UNIT VENTILATOR SHELVING CABINET TOP AND CONNECT TO UV DX COIL CONNECTION AND UV EXPANSION VALVE KIT AS REQUIRED. HEIGHT OF REFRIGERANT CONCENTRATION LIMIT OF 26 POUNDS PER 1,000 CUBIC FEET OF ROOM VOLUME FOR OCCUPIED SPACES. VERTICAL PIPING ENCLOSURE SHALL EXTEND FROM TOP OF SHELVING CABINET SYSTEM TO UNDERSIDE OF SUSPENDED CEILING SYSTEM. 8. PROVIDE FIRESTOPPING PER SPECIFICATION SECTION 078400 AT ALL PIPING PENETRATIONS THROUGH CORRIDOR WALLS AND STORAGE ROOM WALLS. (6) CONNECT TO EXISTING 1-1/4" HWS RISER ABOVE FLOOR PENETRATION LOCATION AND ROUTE 1-1/4" HWS PIPING MAIN WITHIN SHELVING CABINET PIPING TUNNEL AS SHOWN. 9. THE UV UTILITY COMPARTMENT SHALL INCLUDE A REMOVABLE FRONT PANEL, STANDARD #1/4-20 HEX FASTENER, STEEL TOP AND BACK WALL F-CHANNEL. (7) ROUTE 1" HWR FROM UV-MS-33 HEATING COIL WITHIN SHELVING CABINET PIPING TUNNEL TO CLASSROOM 234 PIPING TUNNEL. 10. ROUTE REFRIGERANT SUCTION-LIQUID PIPING WITHIN UNIT VENTILATOR PIPING TUNNELS AND UNIT VENTILATOR SHELVING SYSTEM TUNNELS TO DX COOLING COIL CONNECTIONS CONNECT TO EXISTING 1-1/4" HWR RISER ABOVE FLOOR PENETRATION AND ROUTE 1-1/4" HWR PIPING WITHIN UV AND UV SHELVING CABINET SYSTEM PIPING TUNNELS. PROVIDE AND UV EXPANSION VALVE KITS PER THE MANUFACTURER'S RECOMMENDATIONS. 1" HWR BRANCHES TO UV HEATING COILS AT EACH UV LOCATION. PROVIDE 1" HWS CONNECTION TO EACH UV HEATING COIL AND ROUTE HWS PIPING WITHIN UV AND UV SHELVING CABINET SYSTEM PIPING TUNNEL AS SHOWN. (9) ROUTE 3/4" CONDENSATE DRAIN PIPING FROM UV DRAIN PAN OUTLET DOWN THROUGH FLOOR TO FIRST FLOOR CEILING PLENUM. (10) TYPICAL REFRIGERANT LIQUID BRANCH CONNECTOR 'Y' FITTING JOINT. (11) TYPICAL RERIGERANT SUCTION BRANCH CONNECTOR 'Y' FITTING JOINT. (12) CONNECT TO EXISTING 1" HWS RISER ABOVE FLOOR PENETRATION LOCATION AND ROUTE 1" HWS PIPING MAIN WITHIN SHELVING CABINET PIPING TUNNEL AS SHOWN. PROVIDE 8" WIDE x 8" DEEP VERTICAL PIPE ENCLOSURE UNIT AT CORNER OF CLASSROOM TO CONCEAL REFRIGERANT LIQUID-SUCTION PIPING DROPS. ROUTE VERTICAL PIPING DOWN THROUGH TOP OF UNIT VENTILATOR SHELVING CABINET TOP AND CONNECT TO UV DX COIL CONNECTION AND UV EXPANSION VALVE KIT AS REQUIRED. HEIGHT OF VERTICAL PIPING ENCLOSURE SHALL EXTEND FROM TOP OF SHELVING CABINET SYSTEM TO UNDERSIDE OF SUSPENDED CEILING SYSTEM. CONNECT TO EXISTING 1" HWR RISER ABOVE FLOOR PENETRATION AND ROUTE 1" HWR PIPING WITHIN UV AND UV SHELVING CABINET SYSTEM PIPING TUNNELS. PROVIDE 1" HWR BRANCHES TO UV HEATING COILS AT EACH UV LOCATION. PROVIDE 1" HWS CONNECTION TO EACH UV HEATING COIL AND ROUTE HWS PIPING WITHIN UV AND UV SHELVING CABINET SYSTEM PIPING TUNNEL AS SHOWN. PROVIDE 1" EXPANSION COMPENSATORS ON THE HWS/HWR PIPING MAINS ROUTED WITHIN THE UNIT VENTILATOR PIPING TUNNEL AT LOCATION SHOWN. THE COMPENSATORS 15) SHALL BE 12.5" LONG. PROVIDE ANCHORS ON EACH END OF BOTH THE HWS/R RUNS AND PROVIDE PIPE GUIDES WITHIN 14 PIPE DIAMETERS OF THE COMPENSATORS ON BOTH THE PROVIDE 5" DEEP x 24" HIGH HORIZONTAL PIPING ENCLOSURE UNITS AT LOCATIONS SHOWN TO CONCEAL PIPING ROUTED TO UNIT VENTILATORS. ALIGN TOP OF ENCLOSURE UNITS WITH TOP OF UNIT VENTILATOR CABINETS. > PROVIDE MOTORIZED DAMPER WITHIN EXISTING EA DUCT RISER. MODIFY EA RISER AS REQUIRED FOR DAMPER INSTALLATION. TIE CONTROL OF DAMPER TO OPERATION OF PROVIDE MOTORIZED DAMPER WITHIN EXISTING EA DUCT RISER. MODIFY EA RISER AS REQUIRED FOR DAMPER INSTALLATION. TIE CONTROL OF DAMPER TO OPERATION OF ROOFTOP EXHAUST FAN CONNECTED TO EA RISER. PROVIDE CONTROL RELAY TO EXISTING EXHAUST FAN AND TIE OPERATION OF EXHAUST FAN TO DDC SYSTEM. 19 DISCONNECT AND REMOVE EXISTING 2-WAY PNEUMATIC CONTROL VALVE WITHIN EXISTING FIN TUBE ENLCOSURE SYSTEM. DISCONNECT AND REMOVE ALL PNEUMATIC TUBING BACK TO PNEUMATIC MAIN. PROVIDE ELECTRONIC 2-WAY CONTROL VALVE RATED AT 1.5 GPM AT LOCATION OF REMOVED PNEUMATIC CONTROL VALVE. MODIFY HWS BRANCH PIPING AS REQUIRED FOR INSTALLATION OF ELECTRONIC CONTROL VALVE. PROVIDE SPACE TEMPERATURE SENSOR AT LOCATION SHOWN AND TIE OPERATION OF CONTROL VALVE/SENSOR INTO EXISTING SIEMENS DDC SYSTEM. PROVIDE UL-207 LISTED EXPANSION LOOP FOR THE 1/2" REFRIGERANT LIQUID AND 1-1/8" REFRIGERANT SUCTION LINES AT LOCATION SHOWN. THE 1/2" LOOP SHALL BE 28-1/2" (20) LONG x 17-1/2" HIGH. THE 1-1/8" LOOP SHALL BE 30" LONG x 23" WIDE. PROVIDE PIPE GUIDES ON EITHER SIDE OF LOOP AND PIPE ANCHORS AT END OF PIPING RUNS PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE UL-207 LISTED EXPANSION LOOP FOR THE 3/8" REFRIGERANT LIQUID AND 7/8" REFRIGERANT SUCTION LINES AT LOCATION SHOWN. THE 3/8" LOOP SHALL BE 28-1/2" LONG x 17-1/2" HIGH. THE 7/8" LOOP SHALL BE 28-1/2" LONG x 19-3/4" WIDE. PROVIDE PIPE GUIDES ON EITHER SIDE OF LOOP AND PIPE ANCHORS AT END OF PIPING RUNS PER MANUFACTURER'S RECOMMENDATIONS. DICATION OF TYPICAL CEILING MOUNTED RELIEF AIR REGISTER DUCTED THROUGH CORRIDOR WALL TO CORRIDOR CEILING PLENUM, TERMINATED OPEN-ENDED ABOVE CEILING NOTIFIED DOCS SYSTEM CONTROL PANEL/ENCLOSURE AT LOCATION SHOWN TO HOUSE DDC CONTROLLERS. TRANSFORMERS. RELAYS, AND REQUIRED DDC SYSTEM COMPONENTS Manage Ma RM 241D 7TH GRADE CLASSROOM 218 1) UV-MS-26-- EXISTING EA RISER UP TO **GRAVITY RELIEF** VENTILATOR ON ROOF SMALL INST EXISTING EA RISER UP TO GRAVITY RELIEF 241C VENTILATOR ON ROOF 1 1/4" HWR-7)1" HWR— 5/8" REFRIGERANT SUCTION-_______ 3/8" REFRIGERANT LIQUID PRINT/COPY DOWN TO UV PIPING CABINET PIPING TUNNEL 241B (1) UV-MS-27— 5/8" RL-MEDIA ROOM 1" RS-3/4" REFRIGERANT LIQUID-1-3/8" REFRIGERANT SUCTION 5/8" RS r----7TH GRADE - EXISTING 26"x26" EA UP TO (17) - 3/8" REFRIGERANT DOWN TO FIRST FLOOR CEILING -CLASSROOM EF-MS-10 ON ROOF 5/8" REFRIGERANT 3/4" REFRIGERANT LIQUID------SUCTION - 5/8" REFRIGERANT LIQUID-1-3/8" REFRIGERANT SUCTION DOWN TO FIRST FLOOR 1-3/8" REFRIGERANT UP TO HEAT PUMP HP-MS-7 ON ROOF -3/8" RL-SUCTION UP TO HEAT PUMP HP-MS-9 ON ROOF EXISTING 1-1/4" HWS DOWN -- EXISTING 1-1/4" HWR DOWN TO FIRST FLOOR [∠]5/8" RL - 1/2" REFRIGERANT 5/8" REFRIGERANT SUCTION-┌1/2" RL 🖌 —1 3/8" RS 3/8" REFRIGERANT LIQUID 1" REFRIGERANT DOWN TO UV PIPING CABINET PIPING TUNNEL -SUCTION 12"x18" EA DOWN ---DOWN TO FIRST ▎┍X╺╾┈╶┈┈┈┈┈┈┈┈ FLOOR CEILING -------EXISTING EA UP TO 3/4" REFRIGERANT LIQUID-EF-7 ON ROOF ----1-3/8" REFRIGERANT SUCTION UP TO HEAT PUMP HP-MS-8 ON ROOF 1 — EXISTING 18"x18" EA UP TO EF-11 ON ROOF 8TH GRADE — EXISTING 26"x26" EA UP TO (17) - EXISTING EA RISER UP TO CLASSROOM — EXISTING 15"x15" EA UP TO EF-MS-8 ON ROOF EF-MS-23 ON ROOF 242 EF-4 ON ROOF SCIENCE LAB SCIENCE LAB SCIENCE LAB CLASSROOM EXISTING EA RISER SCIENCE LAB KITCHEN HOOD 5/8" RS-EF-3 ON ROOF — - 5/8" REFRIGERANT SUCTION-| **-----**- 5/8" REFRIGERANT SUCTION-3/8" REFRIGERANT LIQUID 3/8" REFRIGERANT LIQUID DOWN TO UV PIPING CABINET DOWN TO UV PIPING CABINET PIPING TUNNFI --UV-MS-30(1) EXISTING 1" HWS DOWN TO FIRST FLOOR - EXISTING 1" HWR DOWN - 5/8" REFRIGERANT SUCTION-L(13) TO FIRST FLOOR 3/8" REFRIGERANT LIQUID TO FIRST FLOOR - 5/8" REFRIGERANT SUCTION-DOWN TO UV PIPING CABINET 3/8" REFRIGERANT LIQUID EXISTING FTR ---PIPING TUNNEL - EXISTING 1" HWS DOWN DOWN TO UV PIPING CABINET TO FIRST FLOOR PIPING TUNNEL PARTIAL SECOND FLOOR PLAN - SOUTHEAST

7/11/2023 3:23:18 PM

ksadesid

NEW YORK OKLAHOMA

P

ARCHITECT

KSQ Design
215 W 40th Street 15th Floor
New York, NY 10018
646.435.0660 office
www.ksq.design

Owner

Nanuet Union Free School District 103 Church St, Nanuet, NY 10954 845.627.9880 office http://www.nanuetsd.org/

Structural Engineer

Clapper Structural Engineering 160 Partition Street Saugerties, NY 12477 845.943.9601

MEP Engineer

Sage Engineering Associates, LLP
9 Columbia Circle

www.clapperstructural.com

9 Columbia Circle
Albany NY 12203
518.453.6091 office
518.453.6092 fax
www.sagellp.com

Environmental Engineer

Quest Environmental Solutions 1376 Route 9 Wappingers Falls, NY 12590 845.298.6251 www.qualityenv.com

Construction Manager
Jacobs
One Penn Plaza

54th Floor, Suite 5420 New York, NY 10119

646.908.6550

www.jacobs.com

TICEN OF NEW YORK & BEEN AS BE




NUFSD BOND PROJECTS PH3

☐ SED#50-01-08-03-0-003-035 (HIGH SCHOOL)
■ SED#50-01-08-03-0-004-020 (BARR MIDDLE SCHOOL)

High School 103 Church St. Nanuet, NY 10954

Barr Middle School 50 Blauvelt Rd #1 Nanuet, NY 10954



1 BID ADDENDUM #6 07/12/

ISSUED: BID SET ISSUANCE


DATE: 06/06/2023 SCALE: 1/8" = 1'-0"

SHEET NAME:

PARTIAL SECOND FLOOR
PLAN - SOUTHEAST


SHEET NUMBER:

BM-M115

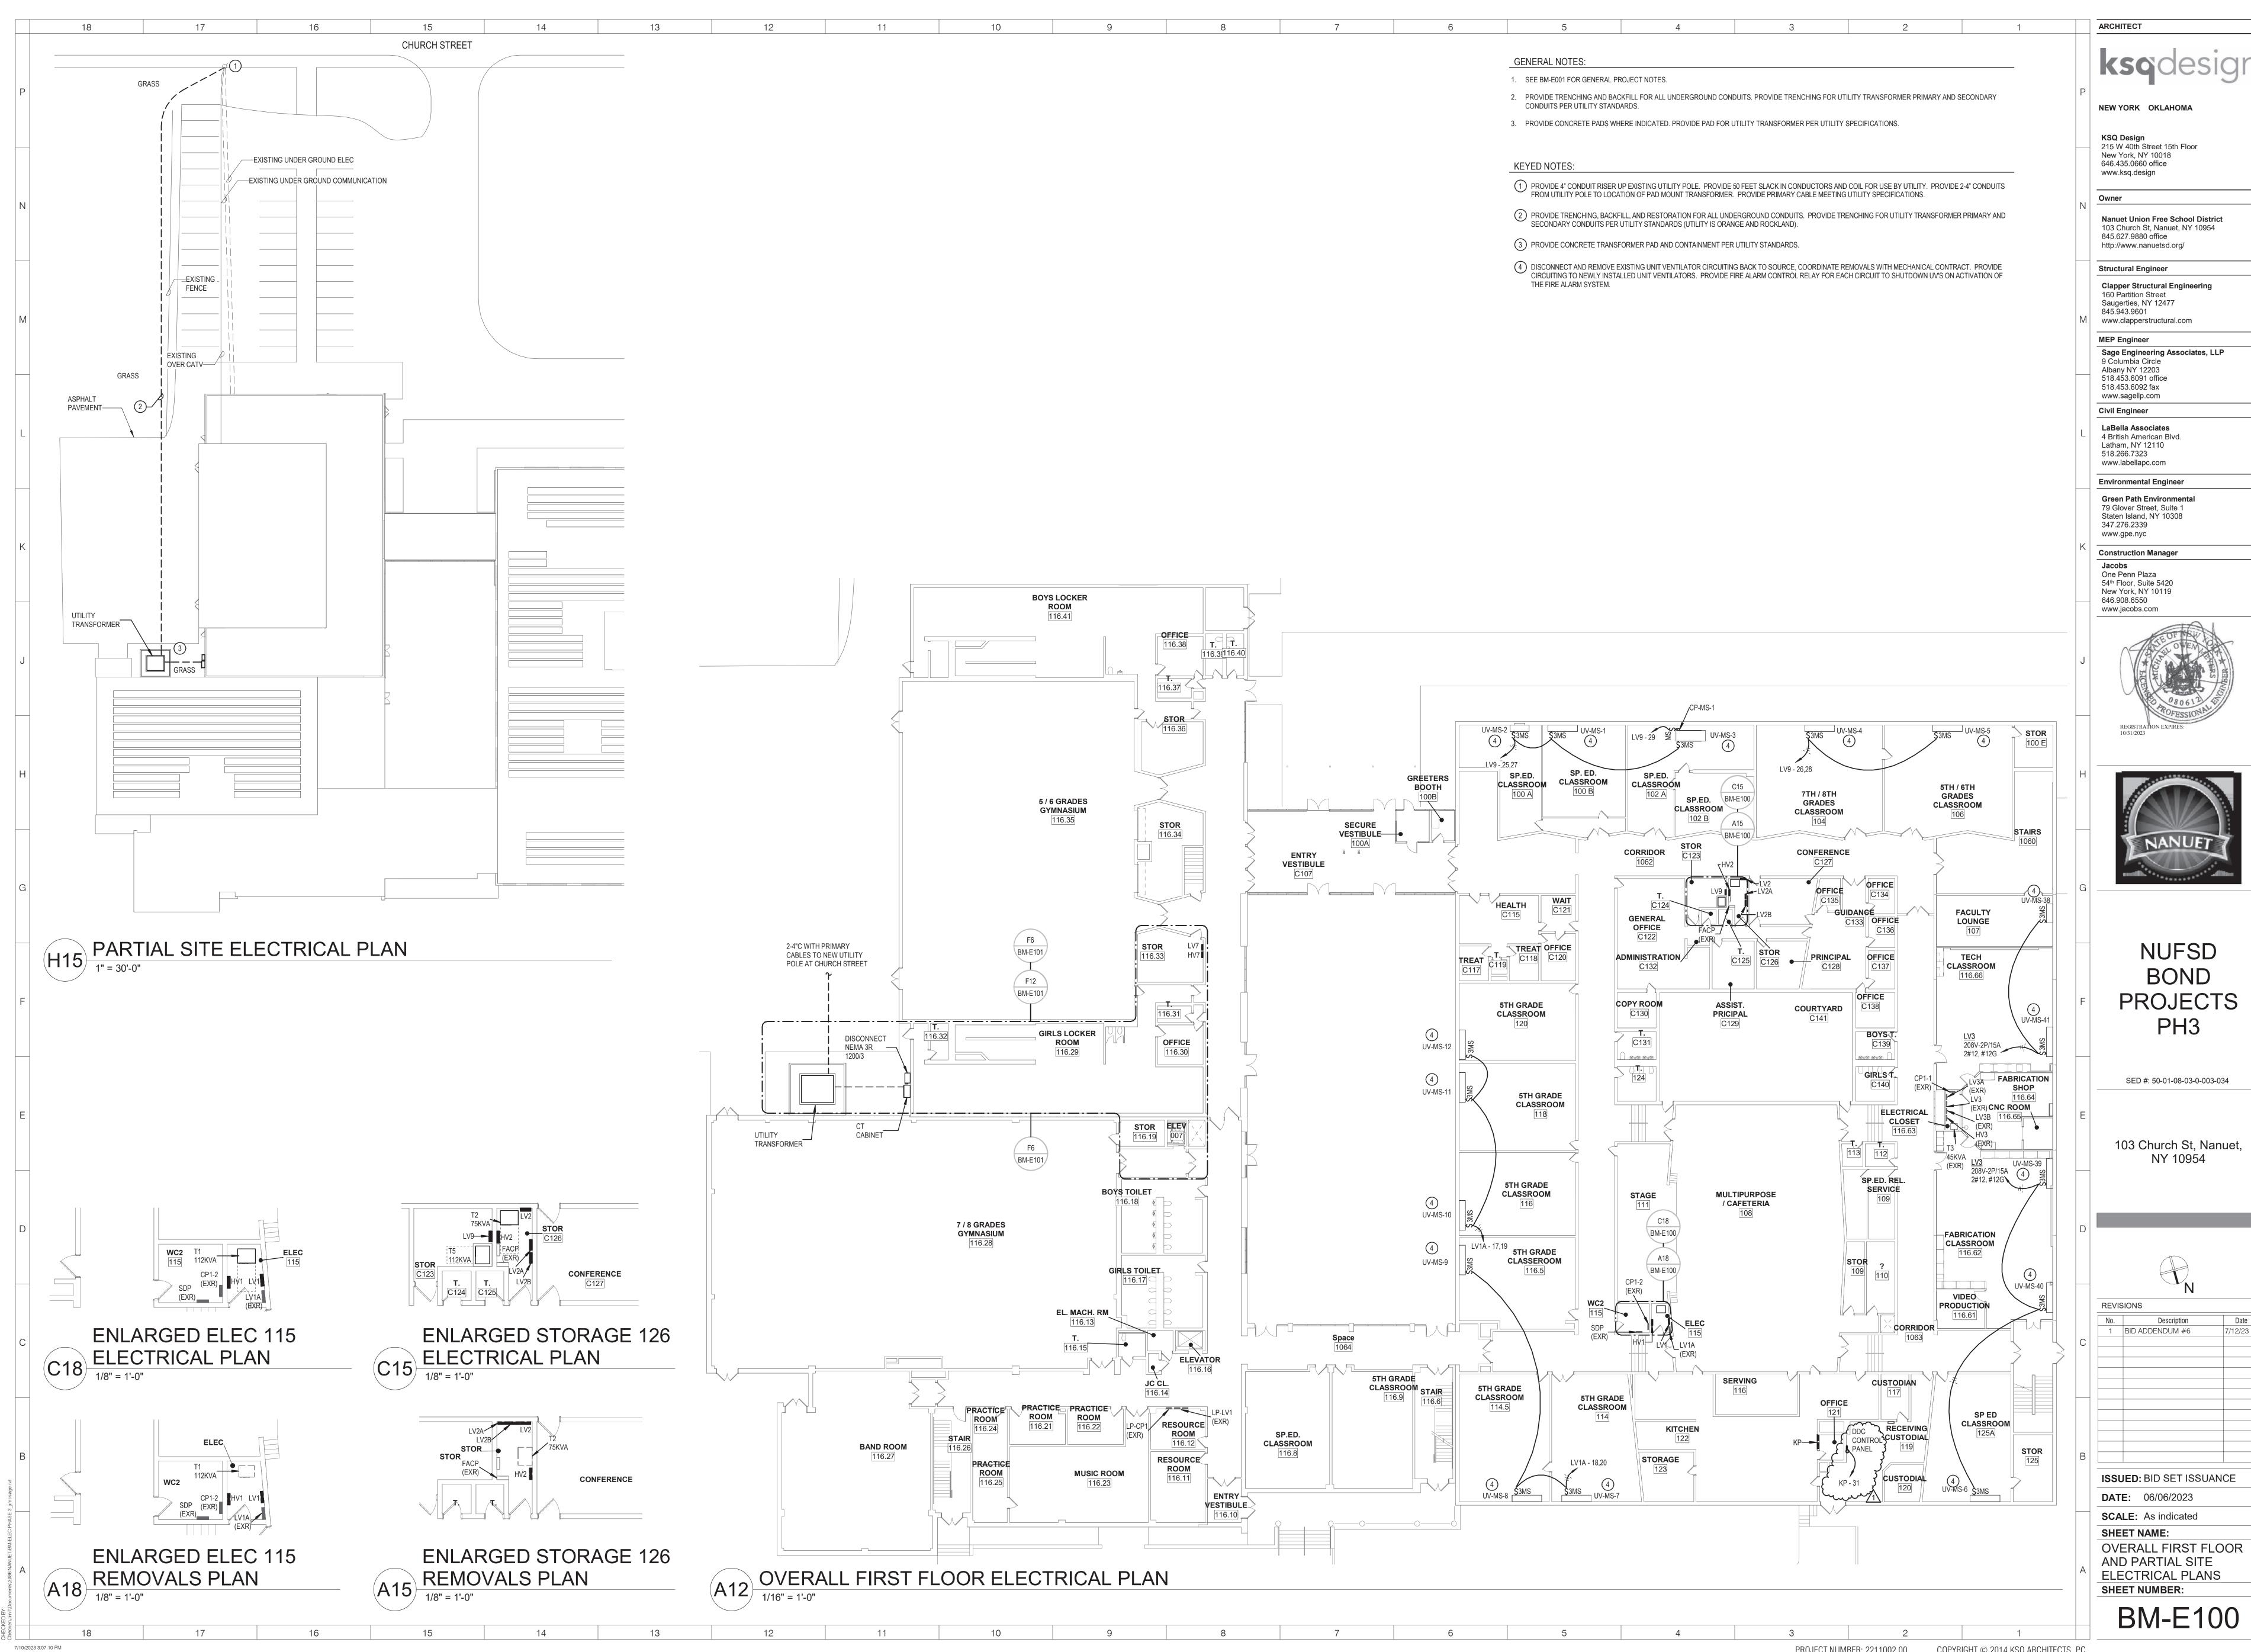






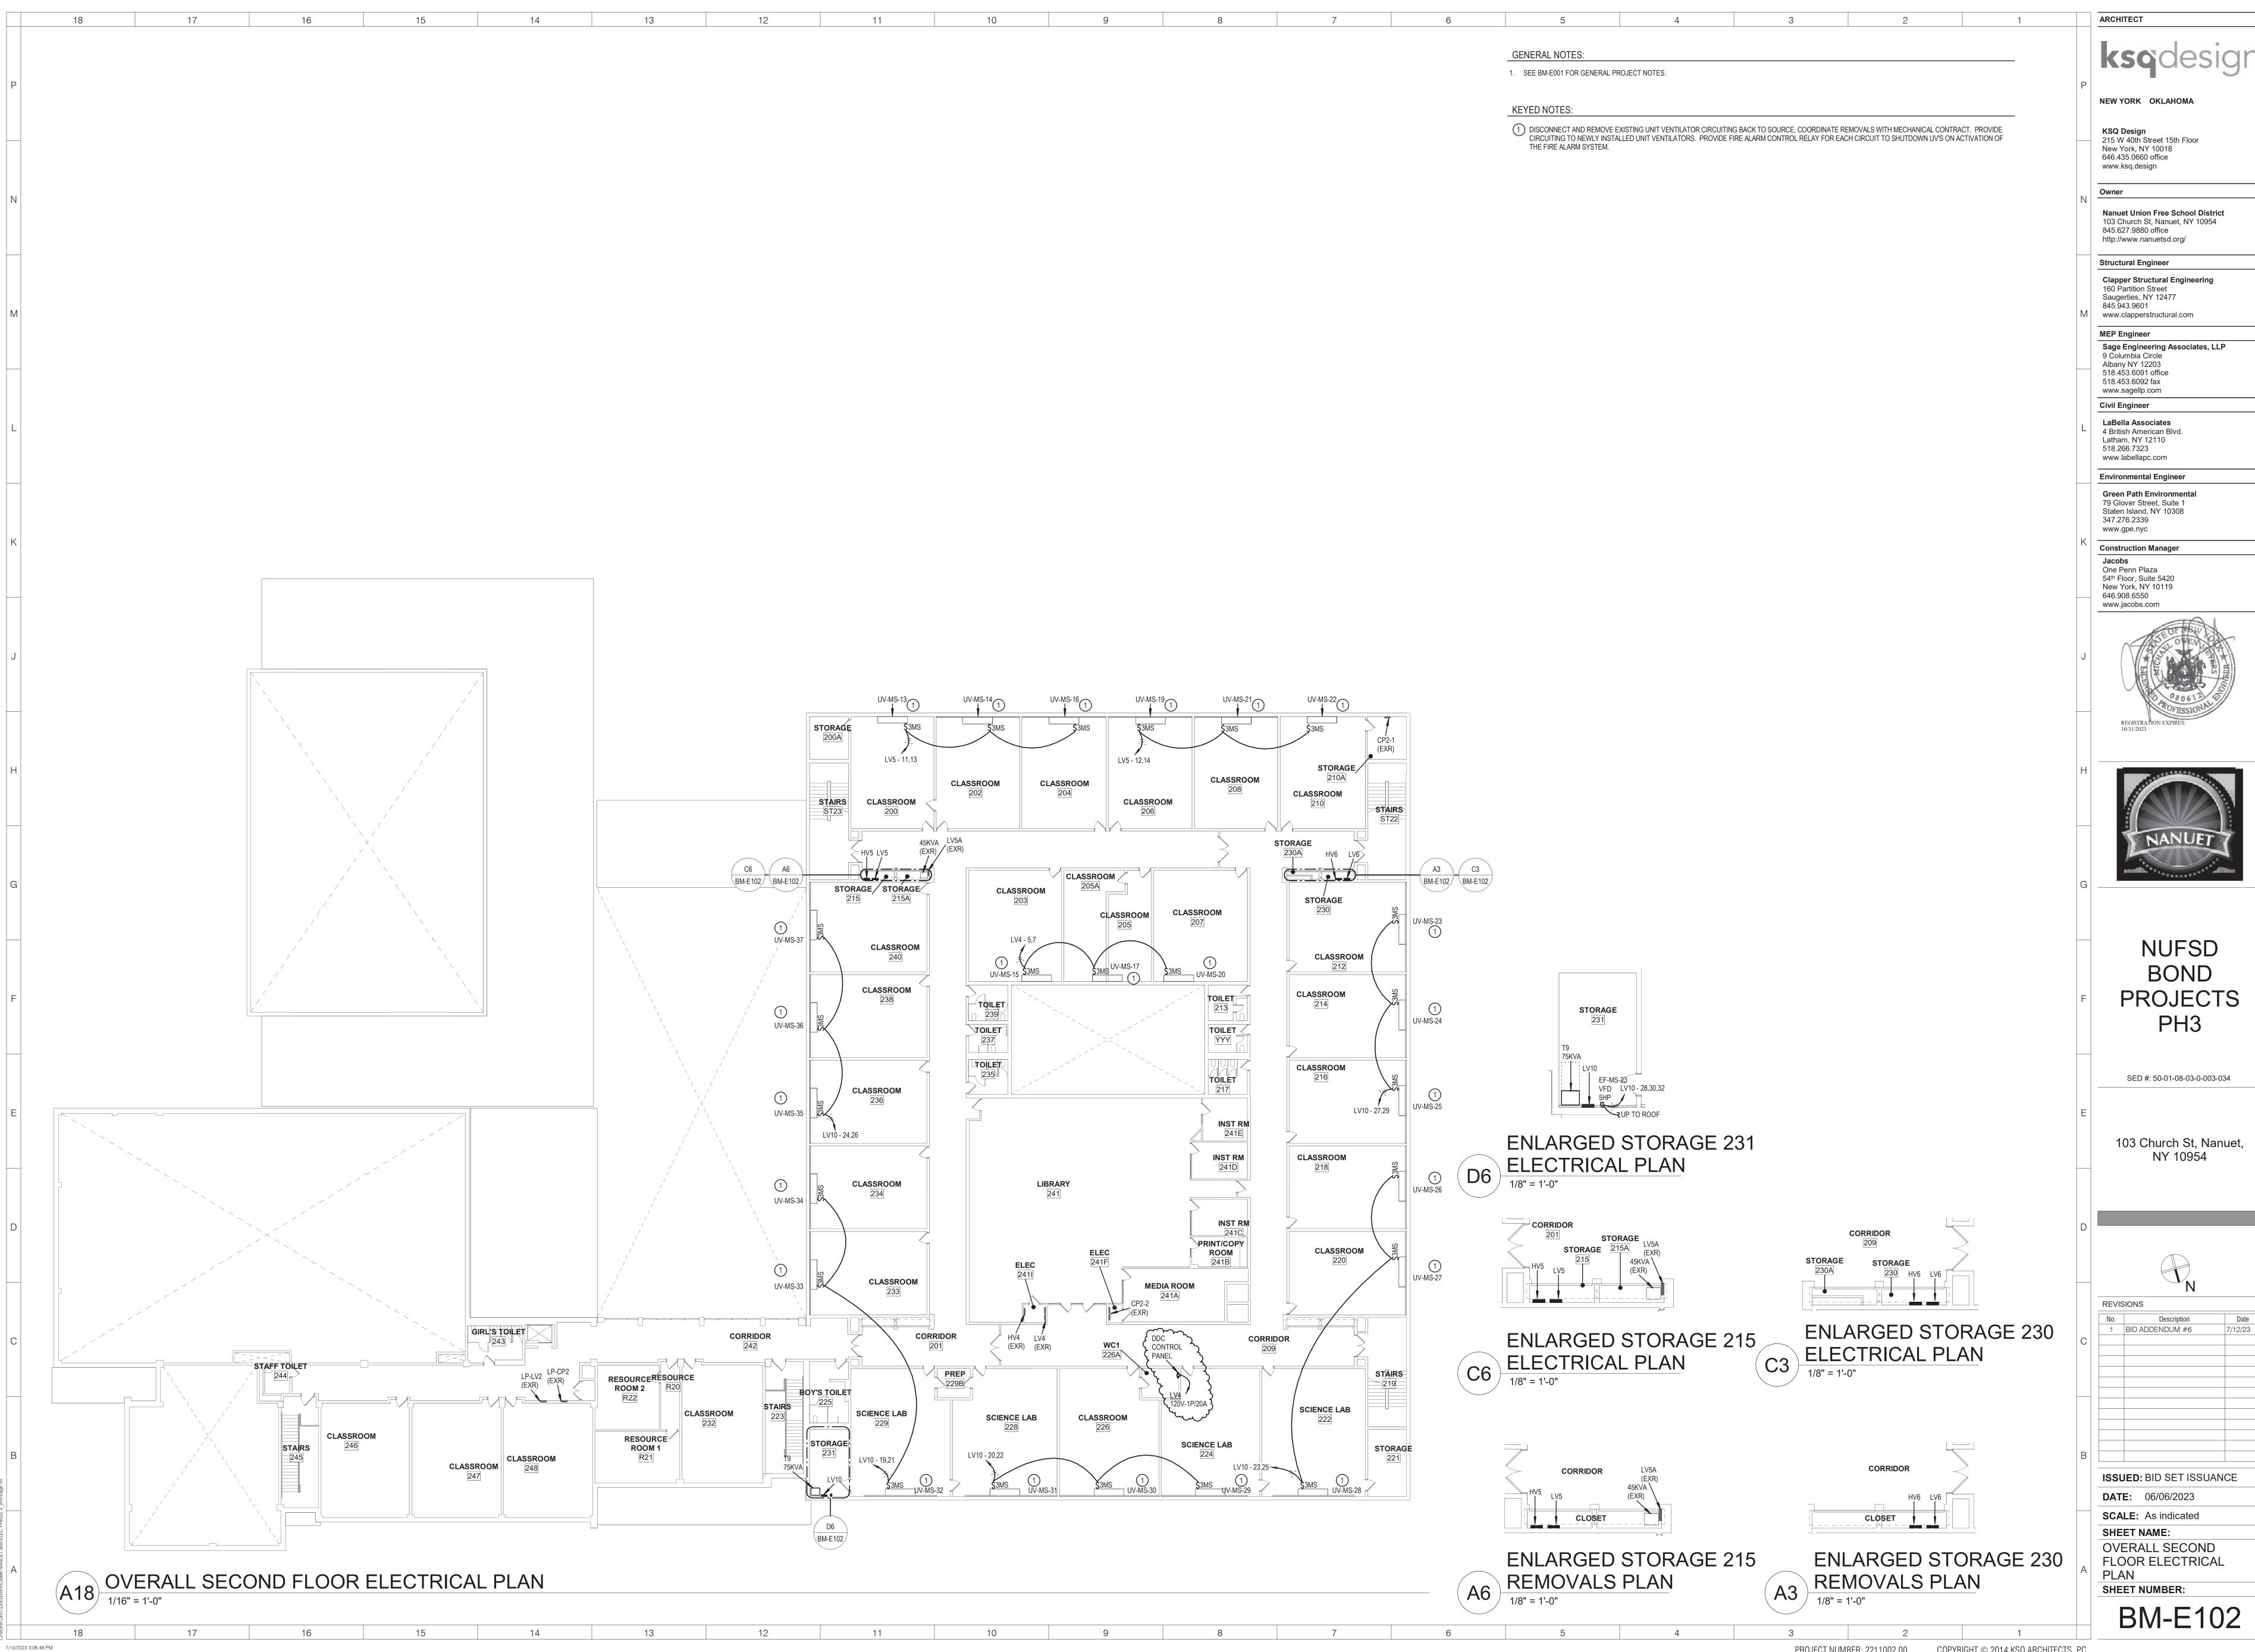









NO.	TES:																
CKT	DESCRIPTION	LOAD	WIRE	BKR	R P	Α	В	С	Α	В	С	Р	BKR	WIRE	LOAD	DESCRIPTION	C
1	WINDOW AC RM 115B			20	2	0			0			2	20			WINDOW AC RM 118	
3	-			-			0			0		-					
5	WINDOW AC RM 116A			20	2			0			0	2	20			WINDOW AC RM 120	
7	-			-		0			0			-					
9	WINDOW AC RM 114			20	2		0										
11	-			-				0									
13																	
15																	
17	UNIT VENTILATOR Room 120, 118, 116	2371	2#12, #12G	15	2			1186			1186	2	15	2#12, #12G	2371	UNIT VENTILATOR Room 114, 114.5, 116.5	
						1186			1186								- 2

MIN AIC RATING: 10,000

LOCATION:

2-SECTION PANEL SCHEDULE

KITCHEN 122

AMPS RMS SYM

NO.	TES:																
125	A SUB-FEED BREAKER DISHWASHER BOOSTER																
					_							_					
СКТ	DESCRIPTION	LOAD	WIRE	BKR	Р	Α	В	С	А	В	С	Р	BKR	WIRE	LOAD	DESCRIPTION	
1	REFRIGERATOR			20	1	0			0			1	20			ICE FREEZER	
3	RECEPT SERVING AREA			20	1		0			0		1	20			RECEPT SERVING AREA	
5	RECEPT SERVING AREA			20	1			0			0	1	20			RECEPT SERVING AREA	
7	MIXER			20	1	0			0			1	20			RECEPT SERVING AREA	
9	WORK TABLE			20	1		0			0		1	20			HOT FOOD COUNTER	
11	RECEPT WORK TABLE			20	1			0			0	1	20			SPARE	
13	COLD FOOD COUNTER			20	1	0			0			1	20			SPARE	
15	RECEPT BAKERS TABLE			20	1		0			0		1	20			CASH REGISTER	
17	ICE CREAM AND MILK CABINET			20	1			0			0	1	20			RECEPT SERVING AREA	
19	SPARE			20	1	0			0			1	20			RECEPT SERVING AREA	
21	BLOWER REFIGERATOR			20	1		0			0		1	20			FREEZER LIGHTS	
23	HOOD LIGHTS			20	1			0			0	1	20			REFIGERATOR LIGHTS	
25	UPRIGHT REFIGERATOR			20	1	0			0			1	20			RECEPTS COMPUTER RM 226	
27	ICE MACHINE			20	1		0			0		1	20			RECEPTS COMPUTER RM 226	
29		+	~~~~	- 28-	14	~	\sim	~~	~	\	0	1	20			HOT FOOD COUNTER TEACHER RM	
31	DDC PANEL RECEIVING CUSTODIAL 119	500	#12	.20	1	500			.0	3		2	20			SPARE	
93		700		* ******	4		\sim			0							
35					П						0	2	20			BUCK FREEZER	
37	[3] FRONT WALK-IN FREEZER/REFRIGERATOR			20	2	0			0								
39					-1		0			0		2	20			SPARE	
41	[5] SPARE			20	2			0			0						
43						0			0			2	20			[8] MIXER	
45	[7] FREEZER COMPRESSOR			20	2		0			0							
47								0			0	2	20			[10] EXISTING LOAD (NG)	
49	[11] DISH WASHER			20	2	0			0								
51							0			0		2	20			[12] HOT FOOD TABLE EAST SIDE	
53	[13] SPARE			20	2			0			0	-					
55						0			0			2	20			[14] HOT FOOD TABLE	
57										0							
59		T			П							Т	\Box				

NA	ME:	HV2							P	A	IEL	S	Cł	1	ΞD	ULE				
MOUN	ITING:	SURFACE	VOLTS:		480Y/277				PH	IASE:			3				WIRE:	4		
MAIN	RATING:	200 A	MCB:		200 A				MII	N AIC F	RATING	G:	14,	000			AMPS	RMS SYM		
OTHE	R:								LO	CATIO	N:		STO	OR (C126					
СКТ		DESCRIPTION		LOAD	WIRE	BKR	Р	Α	В	С	А	В	С	Р	BKR	WIRE	LOAD	DE:	SCRIPTION	СКТ
1 S	UPPLY FAN 3 CC	PY ROOM OFFICE				20	3	0			0			1	20			LGT ROOM 102		2
3									0			0		1	20			LGT ROOM 100		4
5							<u> </u>			0			0	1	20			LGT ROOM 104		6
7 L	GT ROOM 118-12	0				20	1	0			0			1	20			LGT ROOM 104-106		8
9 L	GT HEALTH ROO	M				20	1		0			0		1	20			LGT OFFICE AREA		10
11 L	GT CORRIDOR A	REA				20	1			0			0	1	20			LGT GUIDANCE AREA		12
13 L	GT CORRIDOR 13	36				20	1	0			2371			3	125	SEE RISER	4742	LV2 VIA XFMR T-2		14
15 L	GT ROOM 118, 12	0				20	1		0			2371								16
17							\Box						0							18
19 L'	V5A VIA XFMR			0	SEE RISER	50	3	0			0			3	60	SEE RISER	0	HV5		20
						$\overline{}$	-								-					
21							<u> </u>		0			0								22

N	AME:	LV2						F	PAI	NEI	S	Ch	1	ΞD	ULE			
MOL	JNTING:	SURFACE	VOLTS:	208Y/120				Pl	HASE:			3				WIRE	: 4	_
MAIN	N RATING:	400 A	MCB:	300 A				М	IN AIC	RATIN	G:	10,0	000			AMPS	RMS SYM	
ОТН	IER:							LC	CATIC	N:		STO	OR	C126				
NO	TES:																	
СКТ		DESCRIPTION	LOA	D WIRE	BKI	R P	А	В	С	А	В	С	Р	BKR	WIRE	LOAD	DESCRIPTION	T
1	LGT EXTERIOR O	CANOPY			20	1	0			0			1	20			LGT VAULT, TOILET, STORAGE	†
$\overline{}$	LGT EXTERIOR O		-		20	_	-	0			0		1	20			LGT TOILET	t
_	LGT EXTERIOR O		-		20	_		Ť	0			0	1	20			LGT VAULT, TOILET, STORAGE	t
7	LGT EXTERIOR E	BUILDING	-		20	_	0			0			1	20			EXISTING LOAD	t
_	LGT EXTERIOR E				20	$\overline{}$		0			0		1	20			STAGE AMPLIFIER	†
_	RECEPT NURSES		-		20	_			0			0	1	20			SOUND SYSTEM	†
13	RECEPT ROOM 1	20 AND EMAN			20	_	0			0			1	20			RECEPT CONF ROOM, GUIDENCE, LIB	Ť
15	RECEPT VC, COF	RRIDOR 111			20	1		0			0		1	20			RECEPT GUIDENCE	Ť
17	RECEPT PRINCIP	PAL, VICE PRINCIPAL			20	1			0			0	1	20			RECEPTS VC, CORR 142	Ť
19	RECEPT GENER	AL OFFICE			20	1	0			0			1	20			EMERG UNIT ROOM 106A	Ť
21	FLOOR RECEPT	GENERAL OFFICE	-	-	20	1		0			0		1	20			SPARE	Ť
23	VC CORRIDOR 13	36	-	-	20	1			0			0	1	20			SPARE	Ť
25	SPARE		-	-	20	1	0			0			1	20			SPARE	Ť
27	EMERG UNIT RO	OM 100	-	-	20	1		0			0		1	20			SPARE	Ť
29	TELEPHONE PO	WER	-	-	20	1			0			0	1	20			SPARE	Ť
31	AIR COND GENE	RAL OFFICE	-	-	20	2	0			0			2	20			A/C GUIDENCE 220V 32 AND 34	Ť
33			-	-	Π-	1-		0			0		-	1-1				Ť
35	AIR COND VICE I	PRINCIPAL OFFICE	-	-	20	2			0			0	2	20			AIR COND PRINCIPAL OFFICE	Ť
37			-	-	Π-	1-	0			0			-	1-1				Ť
39	LV2A		0	SEE RISER	200	3		0			2371		3	125	SEE RISER	4742	LV5	Ť
41			-	-		1			0			0						Ť
43			-	-	-	1	0			2371								Ť
45	LV2B		0	SEE RISER	100	3		0					Г	П				Ť
47			-	-	-	1			0				Τ	П				T
					_	$\overline{}$	0	_	_				_	_				+

NAME:	LV2A						P	AN	1EI	S	Ch	11	ED	ULE			
MOUNTING:	SURFACE	VOLTS:	208Y/120				PH	IASE:			3				WIRE:	4	
MAIN RATING:	200 A	MCB:	:				MII	N AIC F	RATINO	3:	10,0	000			AMPS	RMS SYM	
OTHER:							10	CATIO	N.				C126				
NOTES:							1-0	0/1110	11.			<u> </u>	0 120				
СКТ	DESCRIPTION	LO	AD WIRE	BKR	Р	А	В	С	А	В	С	Р	BKR	WIRE	LOAD	DESCRIPTION	СКТ
1 RECEPT ROO	OM 100			20	1	0			0			1	20			RECEPT ROOM 102	2
3 RECEPT ROC	DM 100			20	1		0			0		1	20			RECEPT ROOM 102	4
5 RECEPT ROC	M 100		-	20	1			0			0	1	20			RECEPT ROOM 102	6
7 RECEPT ROC	M 100	-	-	20	1	0			0			1	20			RECEPT ROOM 102	8
9 RECEPT ROC	DM 100			20	1		0			0		1	20			RECEPT ROOM 102	10
11 RECEPT ROC	DM 100	-	-	20	1			0			0	1	20			RECEPT ROOM 102	12
13 RANGE/OVEN	ROOM 100	-	-	0	2	0			0			1	20			RECEPT ROOM 104-106	14
15		-		-			0			0		1	20			RECEPT ROOM 104-106	16
17 RANGE/OVEN	ROOM 100		-	0	2			0			0	1	20			RECEPT ROOM 104-106	18
19		-	-			0			0			1	20			SPARE	20
21 SPARE		-	-	0	1	ĺ	0			0		1	20			SPARE	22
23 TOP RANGE F	ROOM 100		-	0	2			0			0	2	0			TOP RANGE ROOM 102	24
25		-	-	T	I-T	0			0								26
27 COPY MACHII	NE	-	-	0	2		0			0		2	100		-	AC SUB PANEL (LV5A)	28
29								0			0		-		-		30
31 KILN ROOM 1	06	-	-	0	2	0			0			2	0		-	KILN ROOM 104	32
33							0			0				-			34
35 RANGE ROOM	И 100			0	2			0			0	2	0			RANGE ROOM 102	36
37						0			0			-					38
39																	40
41																	42

NAM	IE: LV2B						F	PAN	IEI	S	Cł	H	ΞD	ULE			
MOUNTING	G: SURFACE VOLTS	:	208Y/120				PH	HASE:			3				WIRE:	: 4	
MAIN RATII	NG: 100 A MCB:		100 A				МІ	N AIC I	RATIN	G:	10,	000			AMPS	RMS SYM	
OTHER:							_	CATIC					C126				
СКТ	DESCRIPTION	LOAD	WIRE	BKF	R P	А	В	С	А	В	С	Р	BKR	WIRE	LOAD	DESCRIPTION	СКТ
1 UNIT VI	ENTS ROOMS 234-240	—		20	1	0			0			1	20		-	UNIT VENTS ROOMS 200-204	2
3 UNIT VI	ENTS ROOMS 226-232	-	-	20	1		0			0		1	20		-	UNIT VENTS ROOMS 206-210	4
5 UNIT VI	ENTS ROOMS 224-224	-	-	20	1			0			0	1	20		-	UNIT VENTS ROOMS 203,205,207,212	6
7 UNIT VI	ENTS ROOMS 120,118,112	-	-	20	1	0			0			1	20		-	UNIT VENTS ROOMS 214-220	8
9 UNIT VI	ENTS ROOMS 114-116 AND KITCHEN STORAGE	-	-	20	1		0			0		1	20		-	SPARE	10
11 RANGE	HOODS ROOM 100	-		20	1			0			0	1	20		-	UNIT VENTS ROOMS 100-106	12
13 SPARE			-	20	1	0			0			1	20			HAND DRYERS	14
15 SPARE				20	1		0			0		1	20			HAND DRYERS	16
17 HAND D	DRYERS			20	1			0			0	1	20			HAND DRYERS	18
19 AIR CO	NDITIONERS	T	-	20	1	0			0			1	20			SPARE	20
21 AIR CO	NDITIONERS	T	-	20	1		0			0		1	20			PHONE SYSTEM	22
23 RANGE	HOODS ROOM 108-110	T		20	1		Ì	0			0	1	20		T	JOHNSON PROGRAM CLOCK FOR HEATING SYSTEM	24

N/	AME:	HV5						P	PAN	IEL	S	CH	HED	ULE				
MOU	JNTING:	SURFACE	VOLTS:		480Y/277			PH	HASE:			3			WIRE		4	
MAIN	N RATING:	60 A	MCB:					MI	N AIC R	RATING	3:	14,0	000		AMPS	RMS SYM		
OTH	ER:	:						LC	CATIO	N:		STC	DRAGE 2	215				
CKT		DESCRIPTION		LOAD	WIRF	BKR F) _A	Тв		A	R	С	P BKR	WIRE	LOAD		DESCRIPTION	СК
		DESCRIPTION		LOAD	WIRE	BKR F	А	В	С	А	В	С	P BKR	WIRE	LOAD		DESCRIPTION	ск
\rightarrow	LGT STORAGE 20			LOAD	WIRE 	20 1	A 0	В	С	A 0	В	С	1 20	WIRE 	LOAD	LGT RM 238, 240	DESCRIPTION	CK 2
1 3	LGT CORR 220	00				\perp	0 A	B 0	С		B 0	С	1 20 1 20			LGT RM 234, 236	DESCRIPTION	
1 3		00				20 1	A 0	В	C 0		B 0	C 0	1 20				DESCRIPTION	
1 3 5	LGT CORR 220	00			 	20 1	A 0 0 0	B 0	C 0		B 0	C 0	1 20 1 20			LGT RM 234, 236	DESCRIPTION	2
1 3 5 7	LGT CORR 220 LGT RM 203, 205	00			 	20 1 20 1 20 1	0	B 0 0	C 0	0	B 0	C 0	1 20 1 20 1 20			LGT RM 234, 236 LGT RM 200, 202	DESCRIPTION	2 4 6

OTH	ER:						L(CATIC	N:		STO	ORA	GE 2	15			
NO.	ΓES:						-										
CIZT	DECODIDATION	LOAD	WIRE	DIAD	_		В		_		С		DIAD	WIRE	LOAD	DECODIDATION	
CKT	DESCRIPTION	LOAD	WIKE	BKR		A	B		A	В			BKR	WIKE	LOAD	DESCRIPTION	С
1	RECEPTS RM 200			20	1	0			0			1	20			RECEPTS RM 204	
3	RECEPTS RM 236			20	1		0			0		1	20			RECEPTS RM 203	
5	RECEPTS RM 234			20	1			0			0	1	20			RECEPTS RM 240/CORRIDOR	
7	HAND DRYERS			20	1	0			0			1	20			EMERGENCY LIGHTING	
9	HAND DRYERS			20	1		0			0		1	20			EXHAUST FAN 15-16	1
11	UNIT VENTILATOR Room 200, 202, 204	2371	2#12, #12G	15	2			1186			1186	2	15	2#12, #12G	2371	UNIT VENTILATOR Room 206, 208, 210	1
13		-	-		-	1186			1186				1			-	1
15	SPARE			20	1		0			0		1	20			SPARE	1
17	SPARE			20	1			0			0	1	20			SPARE	1
19	SPARE			20	1	0			0			1	20			SPARE	2
		† 			1 .	_		_	_	1		1			 		

PANEL SCHEDULE

AMPS RMS SYM

MIN AIC RATING: 10,000

NAME: LV5

MAIN RATING: 125 A

SURFACE

VOLTS: 208Y/120

NEW YORK OKLAHOMA

ARCHITECT

KSQ Design 215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office www.ksq.design

Owner

Nanuet Union Free School District 103 Church St, Nanuet, NY 10954 845.627.9880 office http://www.nanuetsd.org/

Structural Engineer

Clapper Structural Engineering 160 Partition Street Saugerties, NY 12477

845.943.9601 www.clapperstructural.com

MEP Engineer Sage Engineering Associates, LLP 9 Columbia Circle Albany NY 12203 518.453.6091 office 518.453.6092 fax

Civil Engineer LaBella Associates 4 British American Blvd. Latham, NY 12110

www.sagellp.com

518.266.7323 www.labellapc.com **Environmental Engineer Green Path Environmental**

79 Glover Street, Suite 1 Staten Island, NY 10308

347.276.2339 www.gpe.nyc Construction Manager

Jacobs One Penn Plaza 54th Floor, Suite 5420 New York, NY 10119 646.908.6550 www.jacobs.com





NUFSD BOND **PROJECTS** PH3

SED #: 50-01-08-03-0-003-034

103 Church St, Nanuet, NY 10954

ONS	
	Description

ISSUED: BID SET ISSUANCE

DATE: 06/06/2023 **SCALE:** As indicated

SHEET NAME: PANEL SCHEDULES

SHEET NUMBER:


BM-E501

NAME: KP

MOUNTING: SURFACE
MAIN RATING: 200 A

VOLTS: 208Y/120

200 A

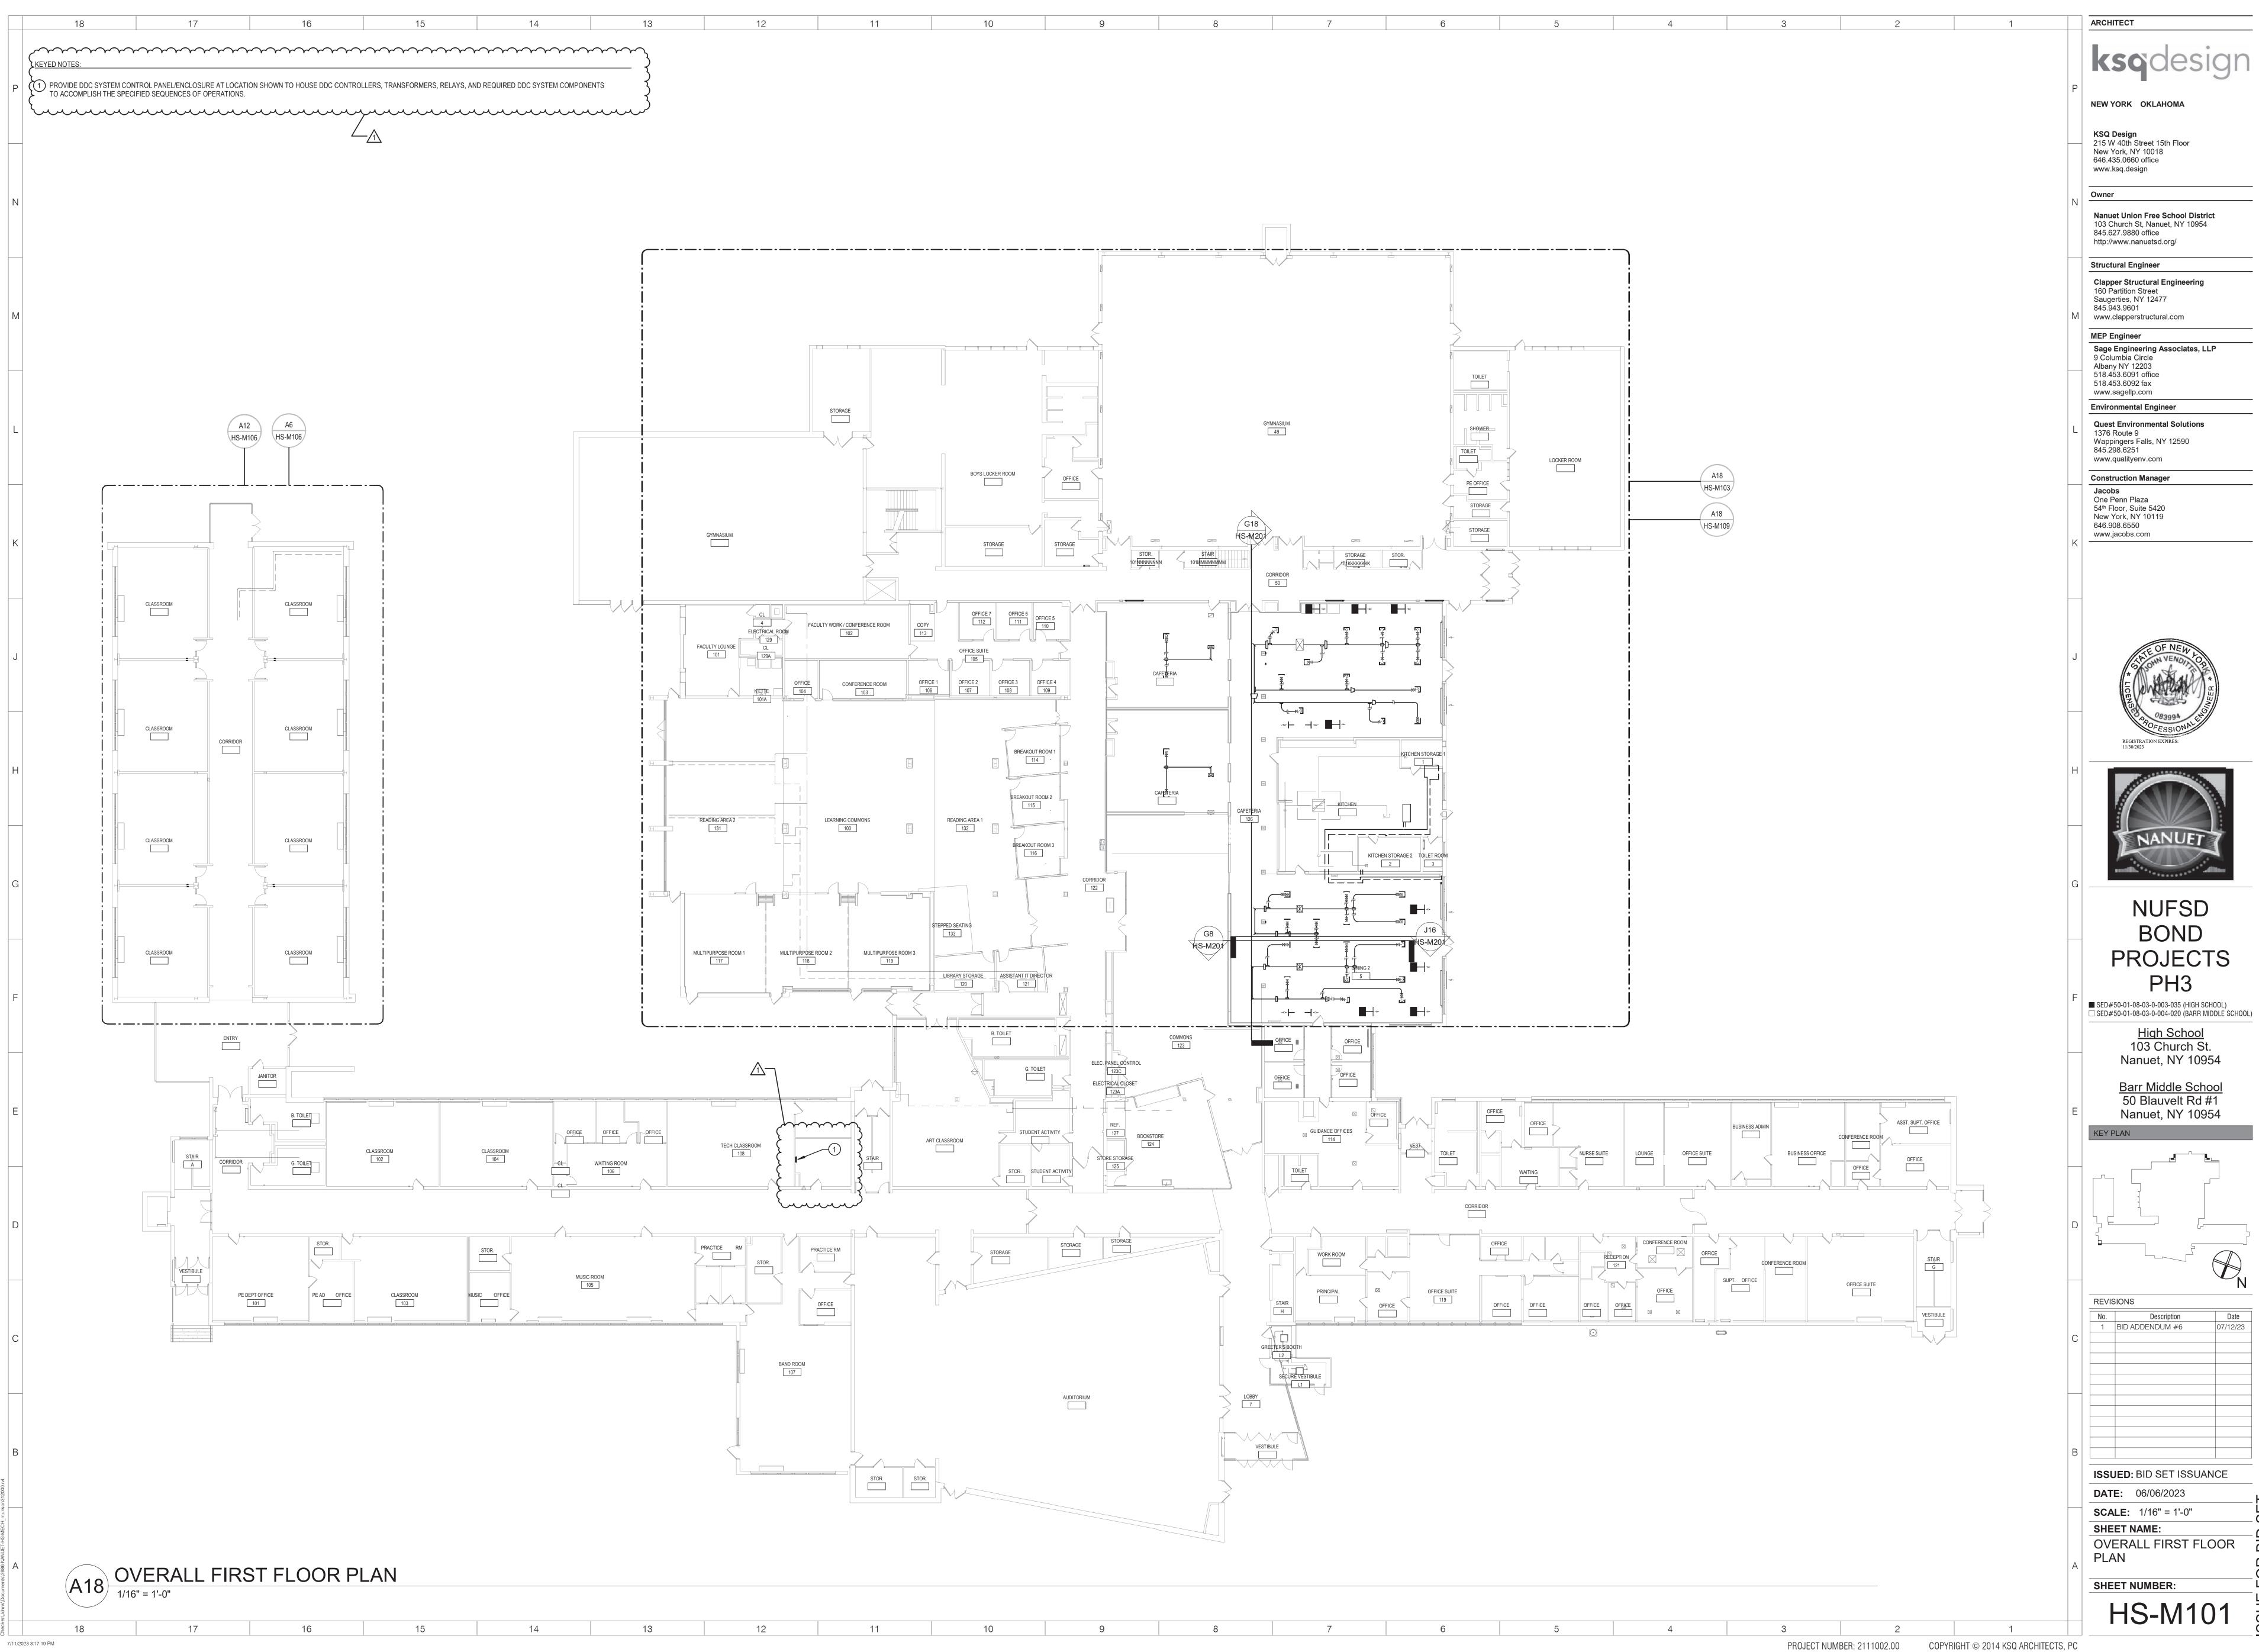







D	

OVERALL FIRST FLOOR

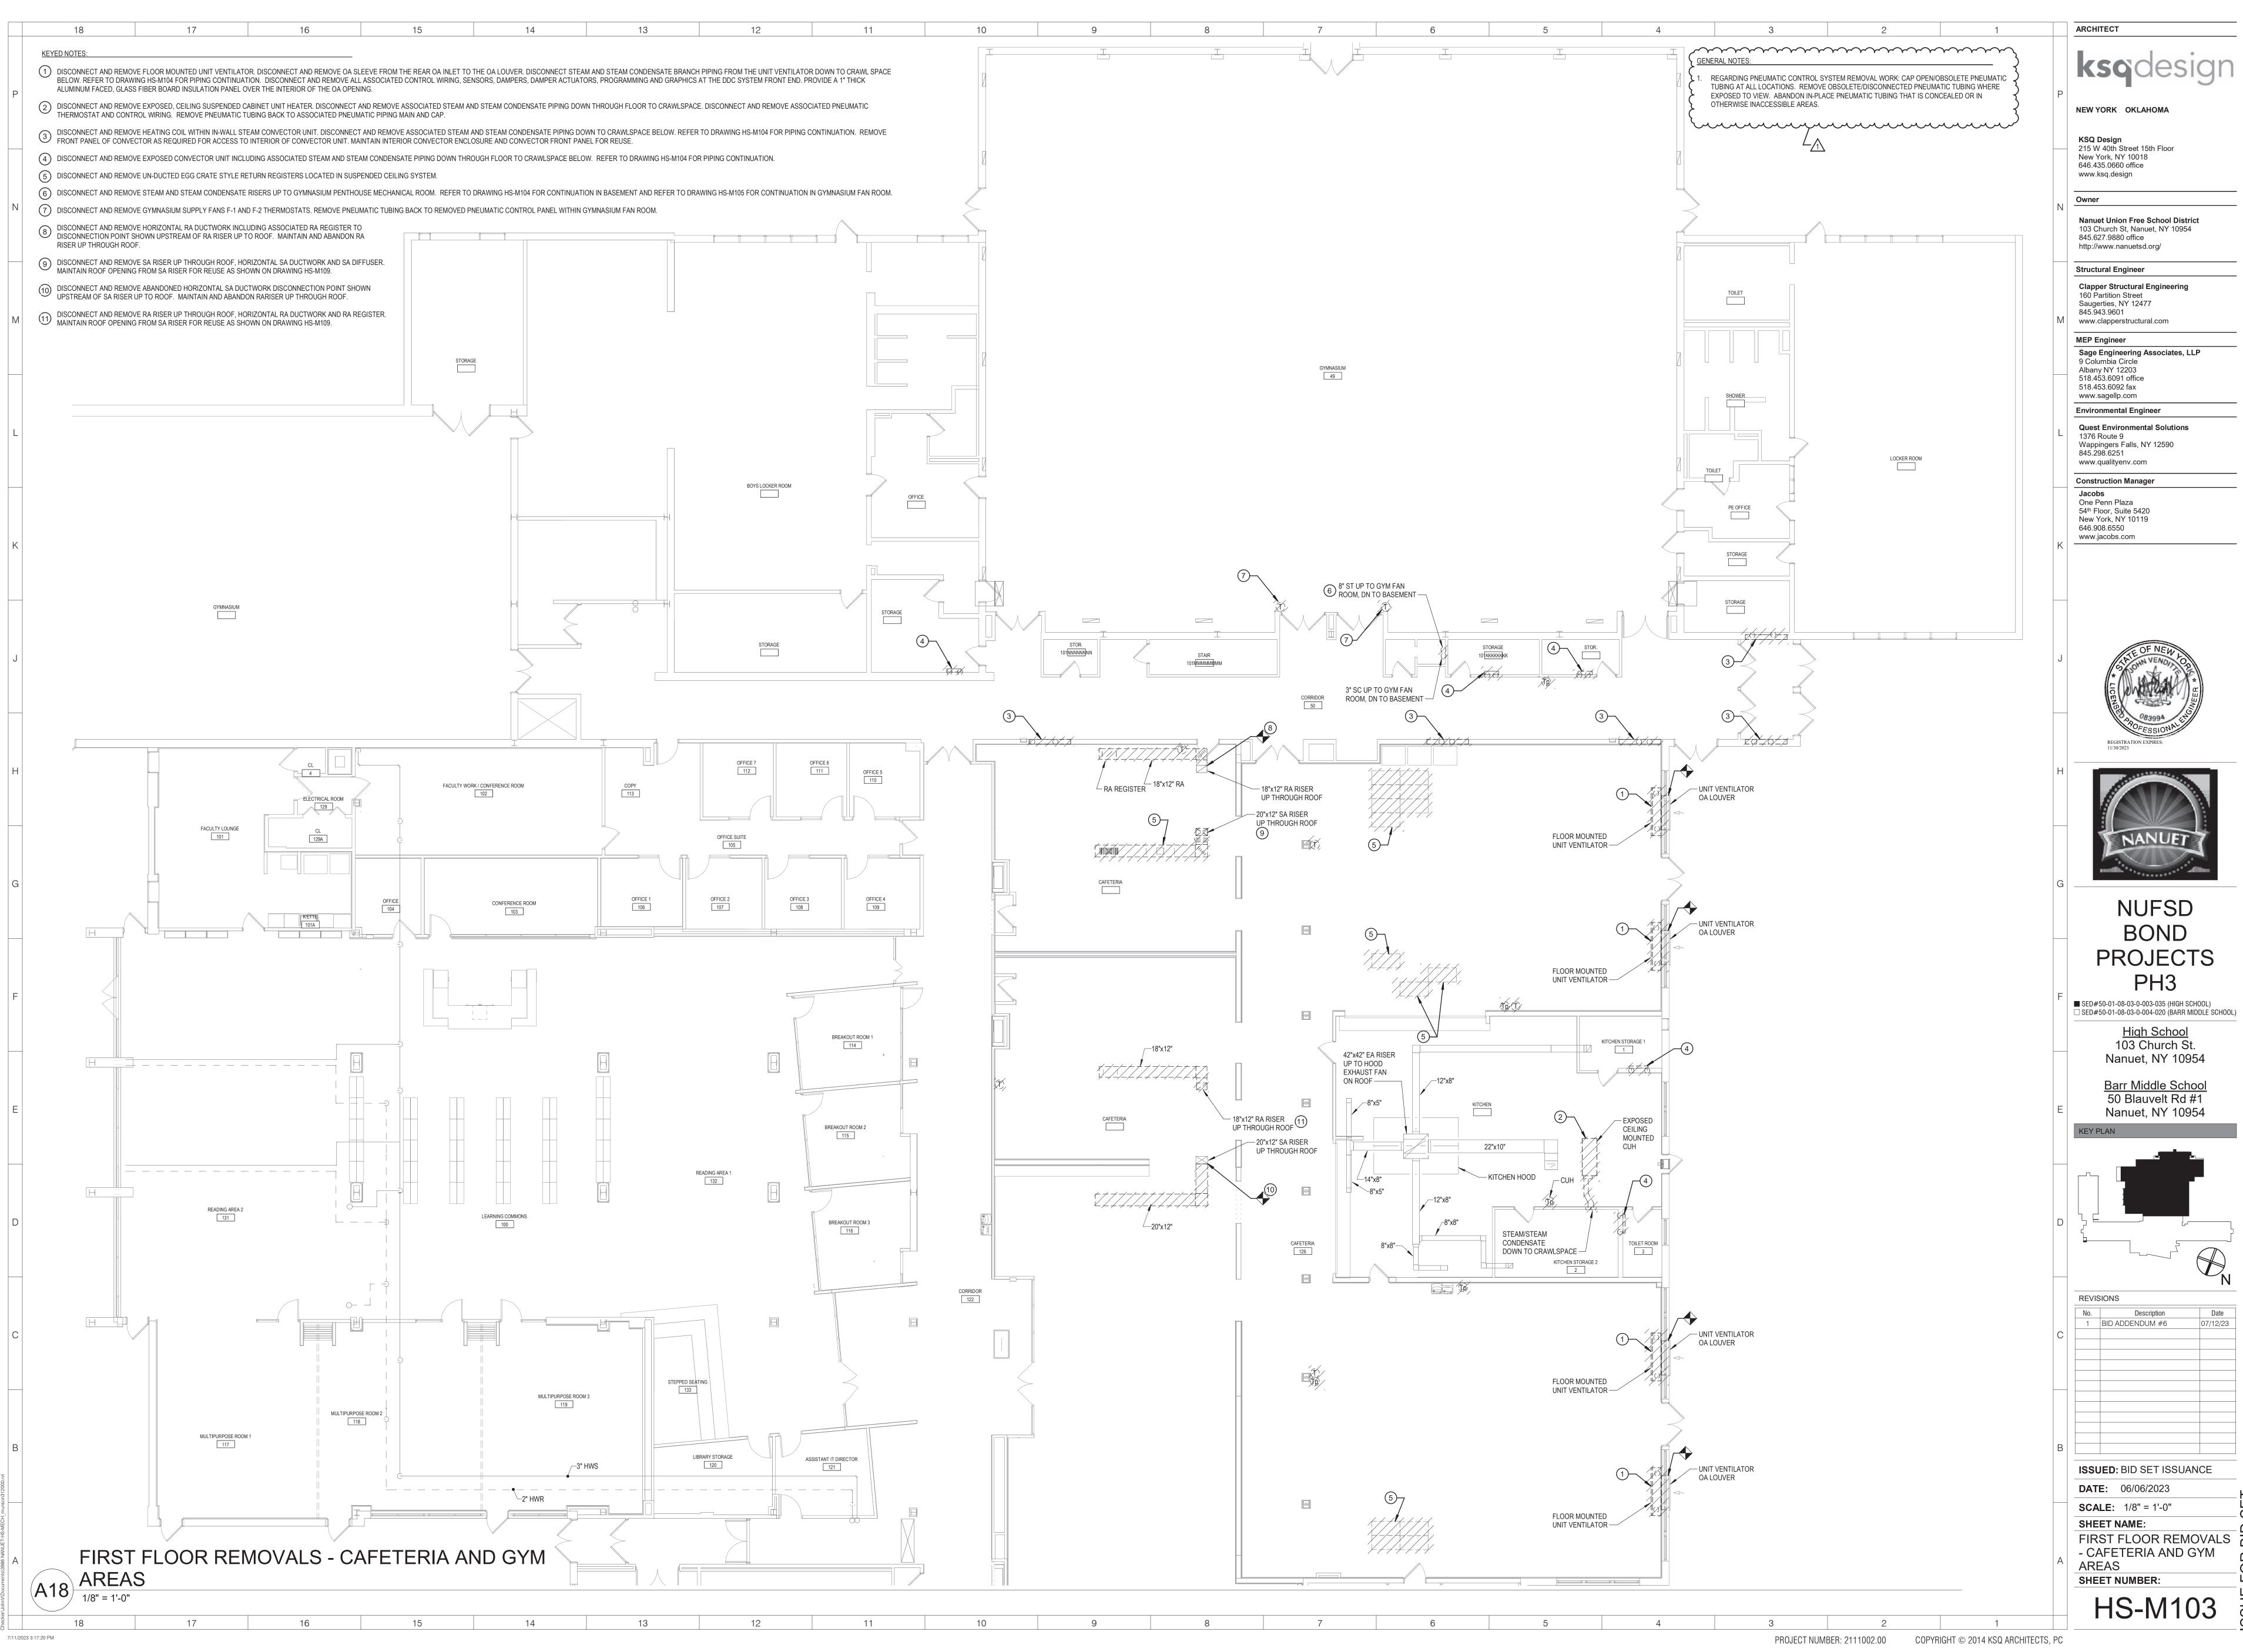



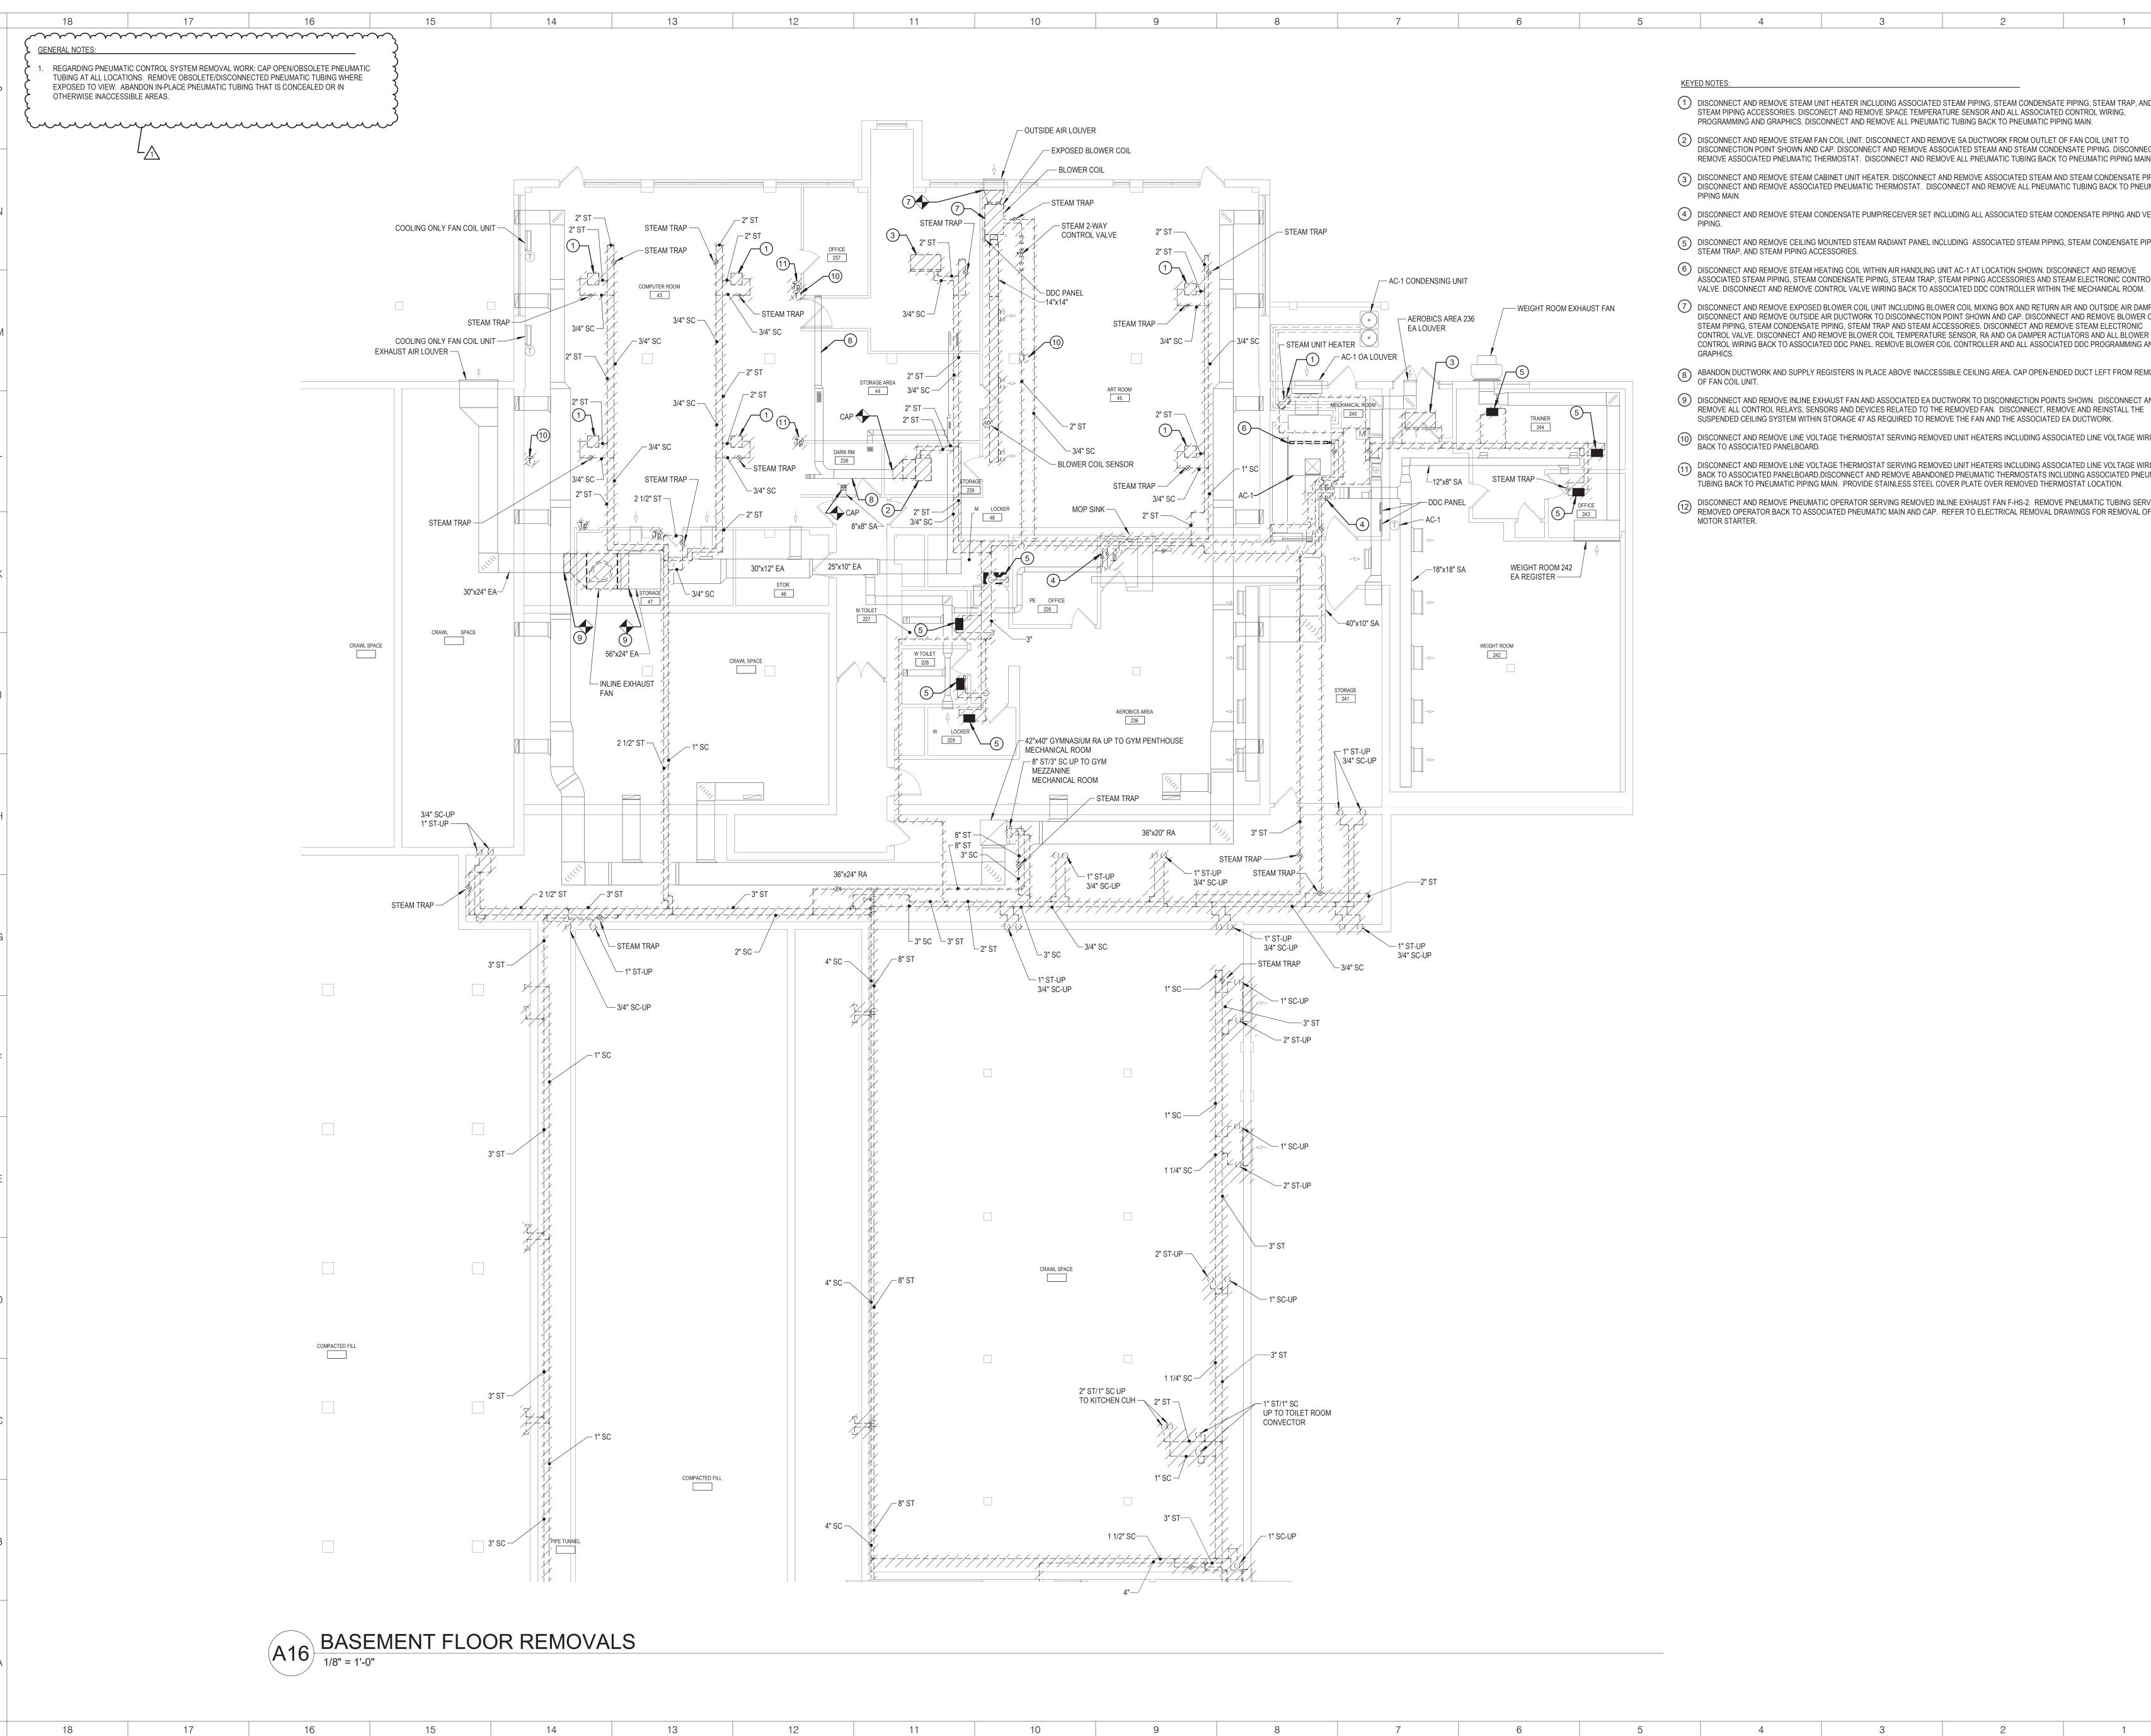

7/11/2023 3:17:21 PM

- 1) DISCONNECT AND REMOVE STEAM UNIT HEATER INCLUDING ASSOCIATED STEAM PIPING, STEAM CONDENSATE PIPING, STEAM TRAP, AND STEAM PIPING ACCESSORIES. DISCONECT AND REMOVE SPACE TEMPERATURE SENSOR AND ALL ASSOCIATED CONTROL WIRING, PROGRAMMING AND GRAPHICS. DISCONNECT AND REMOVE ALL PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN.
- (2) DISCONNECT AND REMOVE STEAM FAN COIL UNIT. DISCONNECT AND REMOVE SA DUCTWORK FROM OUTLET OF FAN COIL UNIT TO DISCONNECTION POINT SHOWN AND CAP. DISCONNECT AND REMOVE ASSOCIATED STEAM AND STEAM CONDENSATE PIPING. DISCONNECT AND REMOVE ASSOCIATED PNEUMATIC THERMOSTAT. DISCONNECT AND REMOVE ALL PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN.
- (3) DISCONNECT AND REMOVE STEAM CABINET UNIT HEATER. DISCONNECT AND REMOVE ASSOCIATED STEAM AND STEAM CONDENSATE PIPING. DISCONNECT AND REMOVE ASSOCIATED PNEUMATIC THERMOSTAT. DISCONNECT AND REMOVE ALL PNEUMATIC TUBING BACK TO PNEUMATIC
- DISCONNECT AND REMOVE STEAM CONDENSATE PUMP/RECEIVER SET INCLUDING ALL ASSOCIATED STEAM CONDENSATE PIPING AND VENT
- DISCONNECT AND REMOVE CEILING MOUNTED STEAM RADIANT PANEL INCLUDING ASSOCIATED STEAM PIPING, STEAM CONDENSATE PIPING, STEAM TRAP, AND STEAM PIPING ACCESSORIES.
- (6) DISCONNECT AND REMOVE STEAM HEATING COIL WITHIN AIR HANDLING UNIT AC-1 AT LOCATION SHOWN. DISCONNECT AND REMOVE ASSOCIATED STEAM PIPING, STEAM CONDENSATE PIPING, STEAM TRAP, STEAM PIPING ACCESSORIES AND STEAM ELECTRONIC CONTROL
- 7 DISCONNECT AND REMOVE EXPOSED BLOWER COIL UNIT INCLUDING BLOWER COIL MIXING BOX AND RETURN AIR AND OUTSIDE AIR DAMPERS. DISCONNECT AND REMOVE OUTSIDE AIR DUCTWORK TO DISCONNECTION POINT SHOWN AND CAP. DISCONNECT AND REMOVE BLOWER COIL STEAM PIPING, STEAM CONDENSATE PIPING, STEAM TRAP AND STEAM ACCESSORIES, DISCONNECT AND REMOVE STEAM ELECTRONIC CONTROL VALVE. DISCONNECT AND REMOVE BLOWER COIL TEMPERATURE SENSOR, RA AND OA DAMPER ACTUATORS AND ALL BLOWER COIL CONTROL WIRING BACK TO ASSOCIATED DDC PANEL. REMOVE BLOWER COIL CONTROLLER AND ALL ASSOCIATED DDC PROGRAMMING AND
- ABANDON DUCTWORK AND SUPPLY REGISTERS IN PLACE ABOVE INACCESSIBLE CEILING AREA. CAP OPEN-ENDED DUCT LEFT FROM REMOVAL OF FAN COIL UNIT.
- (9) DISCONNECT AND REMOVE INLINE EXHAUST FAN AND ASSOCIATED EA DUCTWORK TO DISCONNECTION POINTS SHOWN. DISCONNECT AND REMOVE ALL CONTROL RELAYS, SENSORS AND DEVICES RELATED TO THE REMOVED FAN. DISCONNECT, REMOVE AND REINSTALL THE SUSPENDED CEILING SYSTEM WITHIN STORAGE 47 AS REQUIRED TO REMOVE THE FAN AND THE ASSOCIATED EA DUCTWORK.
- DISCONNECT AND REMOVE LINE VOLTAGE THERMOSTAT SERVING REMOVED UNIT HEATERS INCLUDING ASSOCIATED LINE VOLTAGE WIRING BACK TO ASSOCIATED PANELBOARD.
- DISCONNECT AND REMOVE LINE VOLTAGE THERMOSTAT SERVING REMOVED UNIT HEATERS INCLUDING ASSOCIATED LINE VOLTAGE WIRING BACK TO ASSOCIATED PANELBOARD.DISCONNECT AND REMOVE ABANDONED PNEUMATIC THERMOSTATS INCLUDING ASSOCIATED PNEUMATIC TUBING BACK TO PNEUMATIC PIPING MAIN. PROVIDE STAINLESS STEEL COVER PLATE OVER REMOVED THERMOSTAT LOCATION.
- DISCONNECT AND REMOVE PNEUMATIC OPERATOR SERVING REMOVED INLINE EXHAUST FAN F-HS-2. REMOVE PNEUMATIC TUBING SERVING REMOVED OPERATOR BACK TO ASSOCIATED PNEUMATIC MAIN AND CAP. REFER TO ELECTRICAL REMOVAL DRAWINGS FOR REMOVAL OF F-HS-2

NEW YORK OKLAHOMA

ARCHITECT

KSQ Design 215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office

www.ksq.design

Owner

Nanuet Union Free School District 103 Church St, Nanuet, NY 10954 845.627.9880 office

http://www.nanuetsd.org/ Structural Engineer

Clapper Structural Engineering 160 Partition Street

845.943.9601 www.clapperstructural.com

Saugerties, NY 12477

MEP Engineer Sage Engineering Associates, LLP 9 Columbia Circle Albany NY 12203

518.453.6091 office 518.453.6092 fax www.sagellp.com **Environmental Engineer**

Quest Environmental Solutions 1376 Route 9 Wappingers Falls, NY 12590

845.298.6251 www.qualityenv.com **Construction Manager**

One Penn Plaza 54th Floor, Suite 5420 New York, NY 10119 646.908.6550 www.jacobs.com



NUFSD BOND **PROJECTS**

PH3 ■ SED#50-01-08-03-0-003-035 (HIGH SCH00L)

□ SED#50-01-08-03-0-004-020 (BARR MIDDLE SCH00L)

High School 103 Church St. Nanuet, NY 10954


Barr Middle School 50 Blauvelt Rd #1 Nanuet, NY 10954


ISSUED: BID SET ISSUANCE

DATE: 06/06/2023 **SCALE**: 1/8" = 1'-0"

SHEET NAME: BASEMENT HVAC REMOVALS

SHEET NUMBER: HS-M104

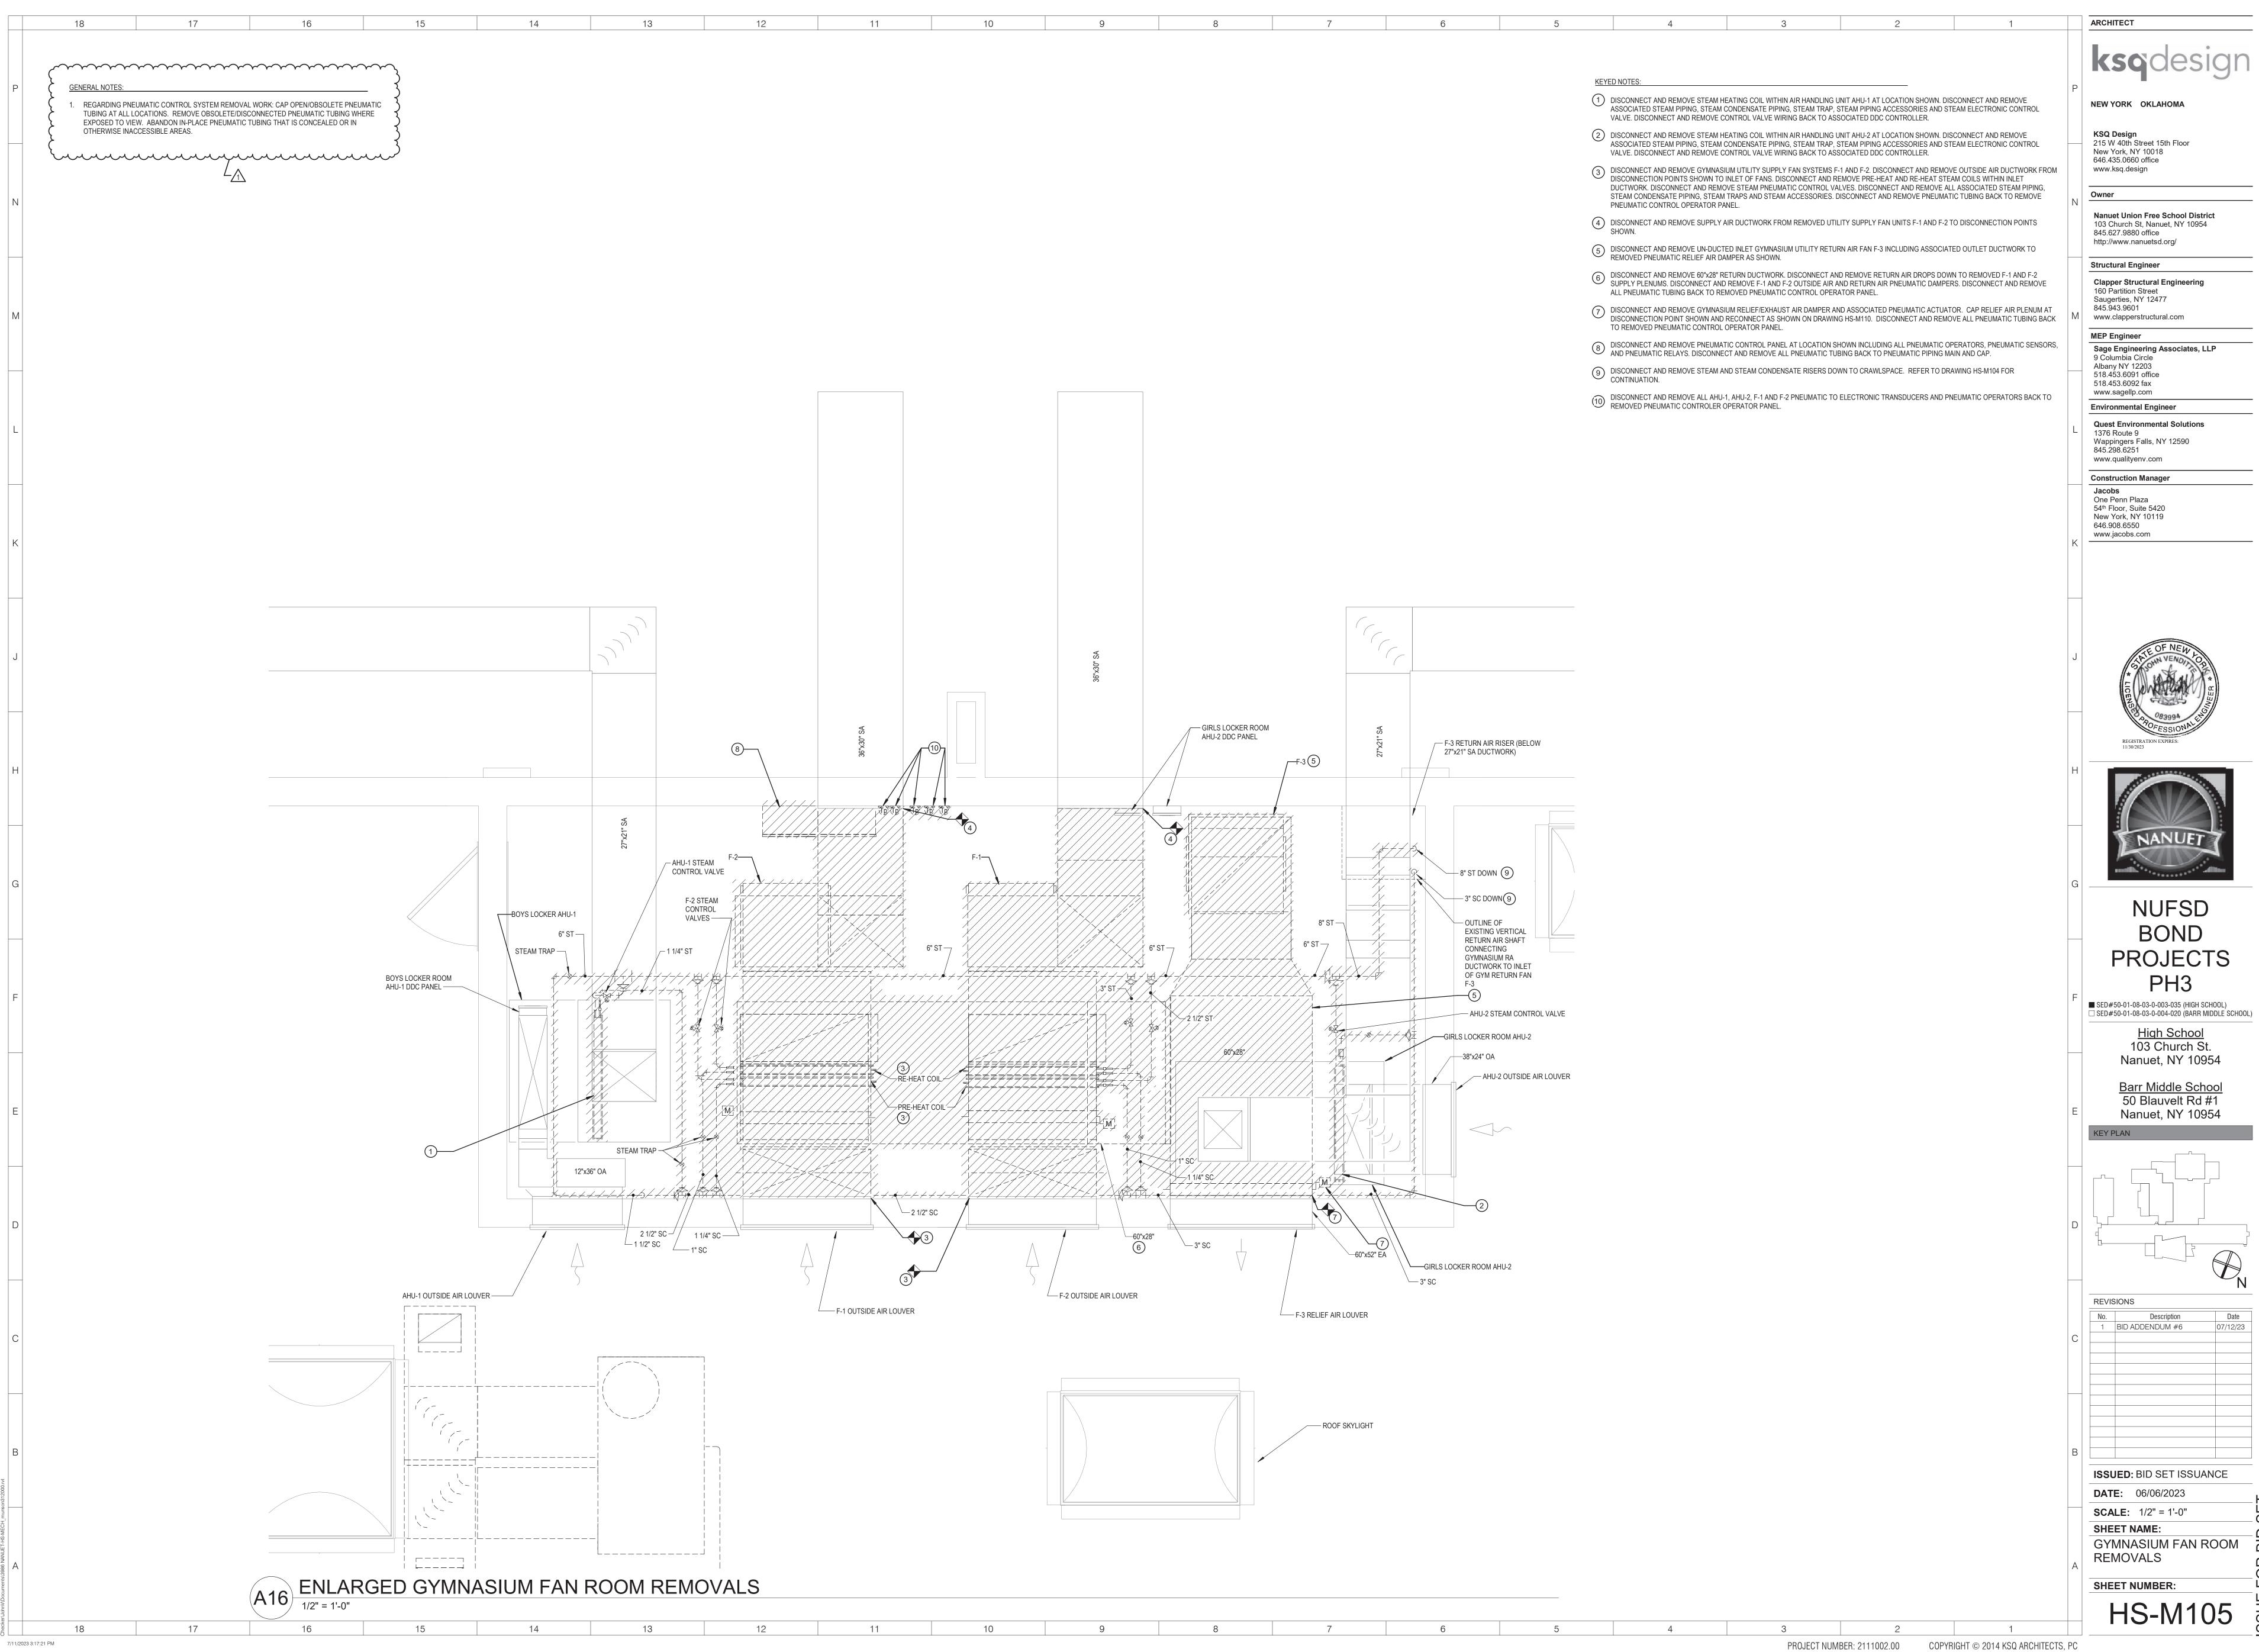







PROJECTS

Barr Middle School



		DID / DDLIADOWI // O	01/12/
)			
3			

HS-M105

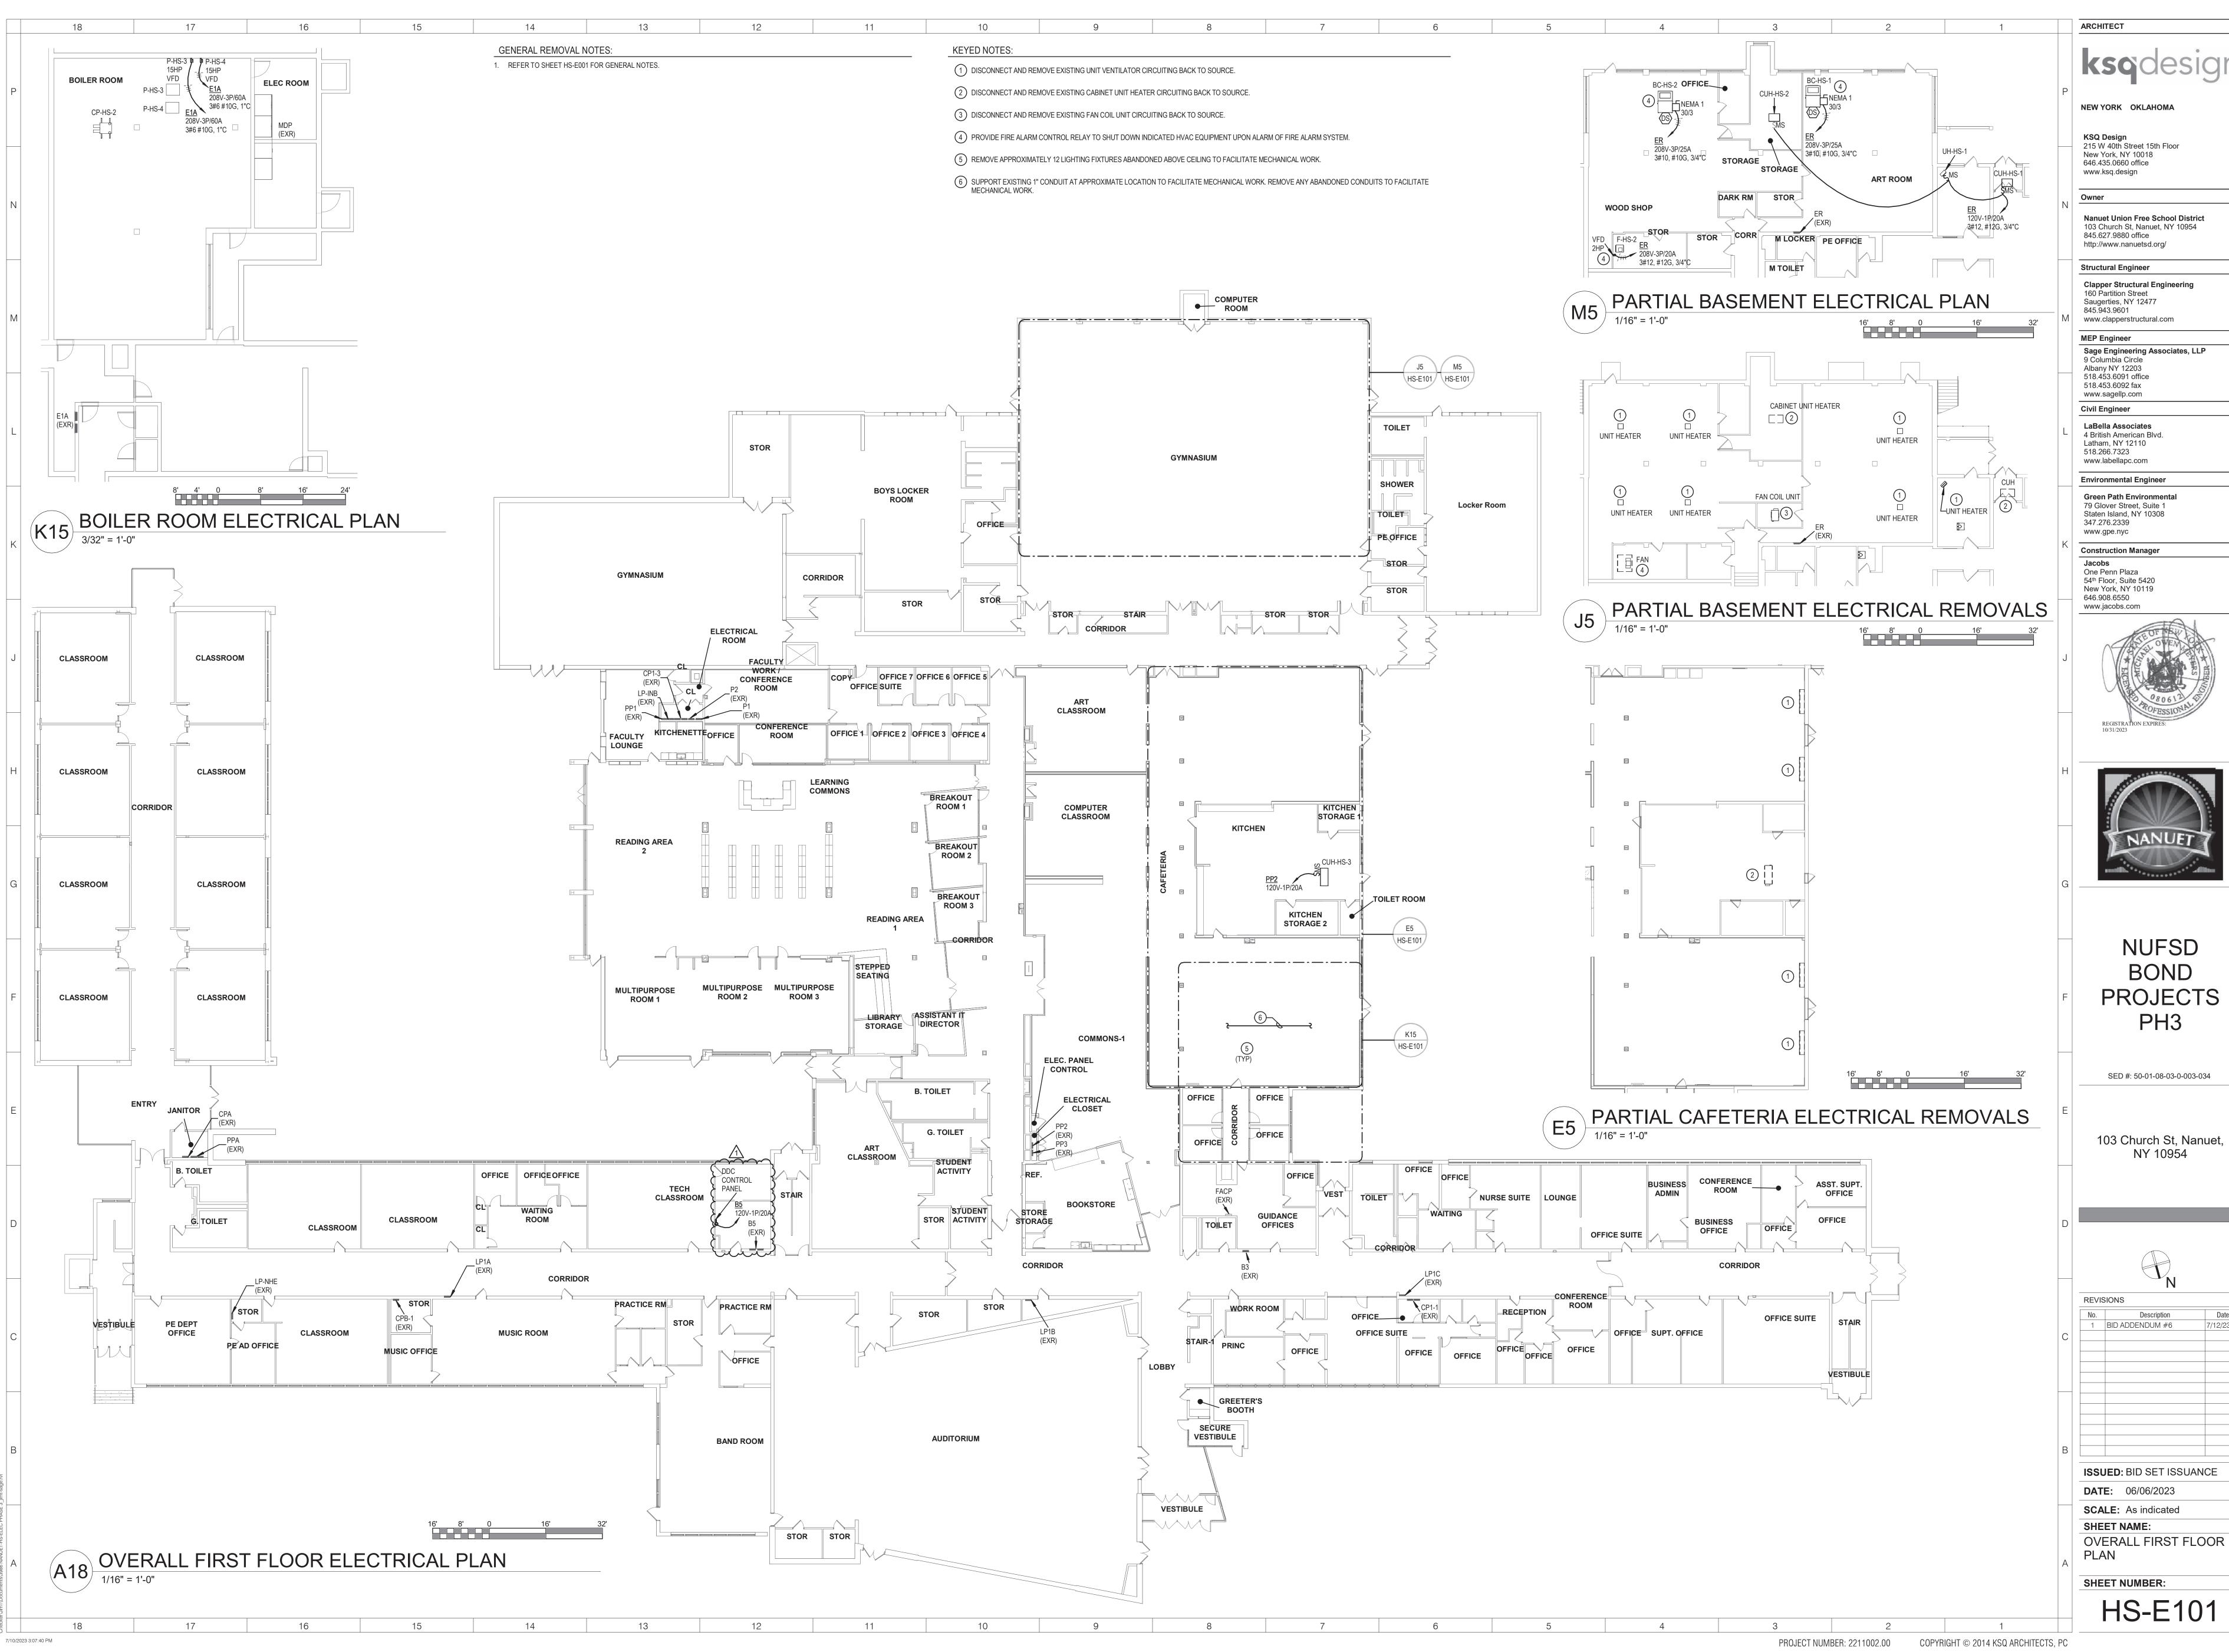



	N		
REVIS	SIONS		
No.	Description	Date	
1	BID ADDENDUM #6	7/12/23	
ISSU	IED: BID SET ISSUAN	CE	
DAT	E: 06/06/2023	06/06/2023	
SCA	LE: As indicated		
SHE	ET NAME:		



7/11/2023 3:48:17 PM



