

REGISTERED ARCHITECT
THOMAS M. RITZENTHALER
023344
STATE OF NEW YORK

QuES&T - ASBESTOS ABATEMENT DESIGNER


DRAWING LIST - VOLUME 2

GENERAL DRAWINGS	
G001	SYMBOLS, ABBREVIATIONS, AND MISC
G101	OVERALL FLOOR PLANS
ASBESTOS ABATEMENT	
AA100	ASBESTOS ABATEMENT NOTES
AA101	ENLARGED BOILER ROOM ABATEMENT PLAN
ARCHITECTURAL DRAWINGS	
A601	ENLARGED PLANS
MECHANICAL GENERAL DRAWINGS	
M001	MECHANICAL LEGENDS AND ABBREVIATIONS
MECHANICAL DEMOLITION DRAWINGS	
MD101	MECHANICAL REMOVALS PLAN
MECHANICAL DRAWING	
M101	MECHANICAL NEW WORK PLAN
M301	PIPING SCHEMATIC
ELECTRICAL GENERAL DRAWING	
E001	ELECTRICAL LEGEND AND ABBREVIATIONS
ELECTRICAL DRAWINGS	
E101	ELECTRICAL PLAN

STATE EDUCATION DEPARTMENT PROJECT CONTROL NUMBER:
BOILER REPLACEMENT PROJECT 50-03-04-03-0-006-017

THE DESIGN OF THIS PROJECT CONFORMS TO APPLICABLE PROVISIONS OF THE NEW YORK STATE UNIFORM FIRE PREVENTION AND BUILDING CODE, THE NEW YORK STATE ENERGY CONSERVATION CONSTRUCTION CODE, AND THE MANUAL OF PLANNING STANDARDS OF THE NEW YORK STATE EDUCATION DEPARTMENT.


CSArch PROJECT NO. 226-2302.00

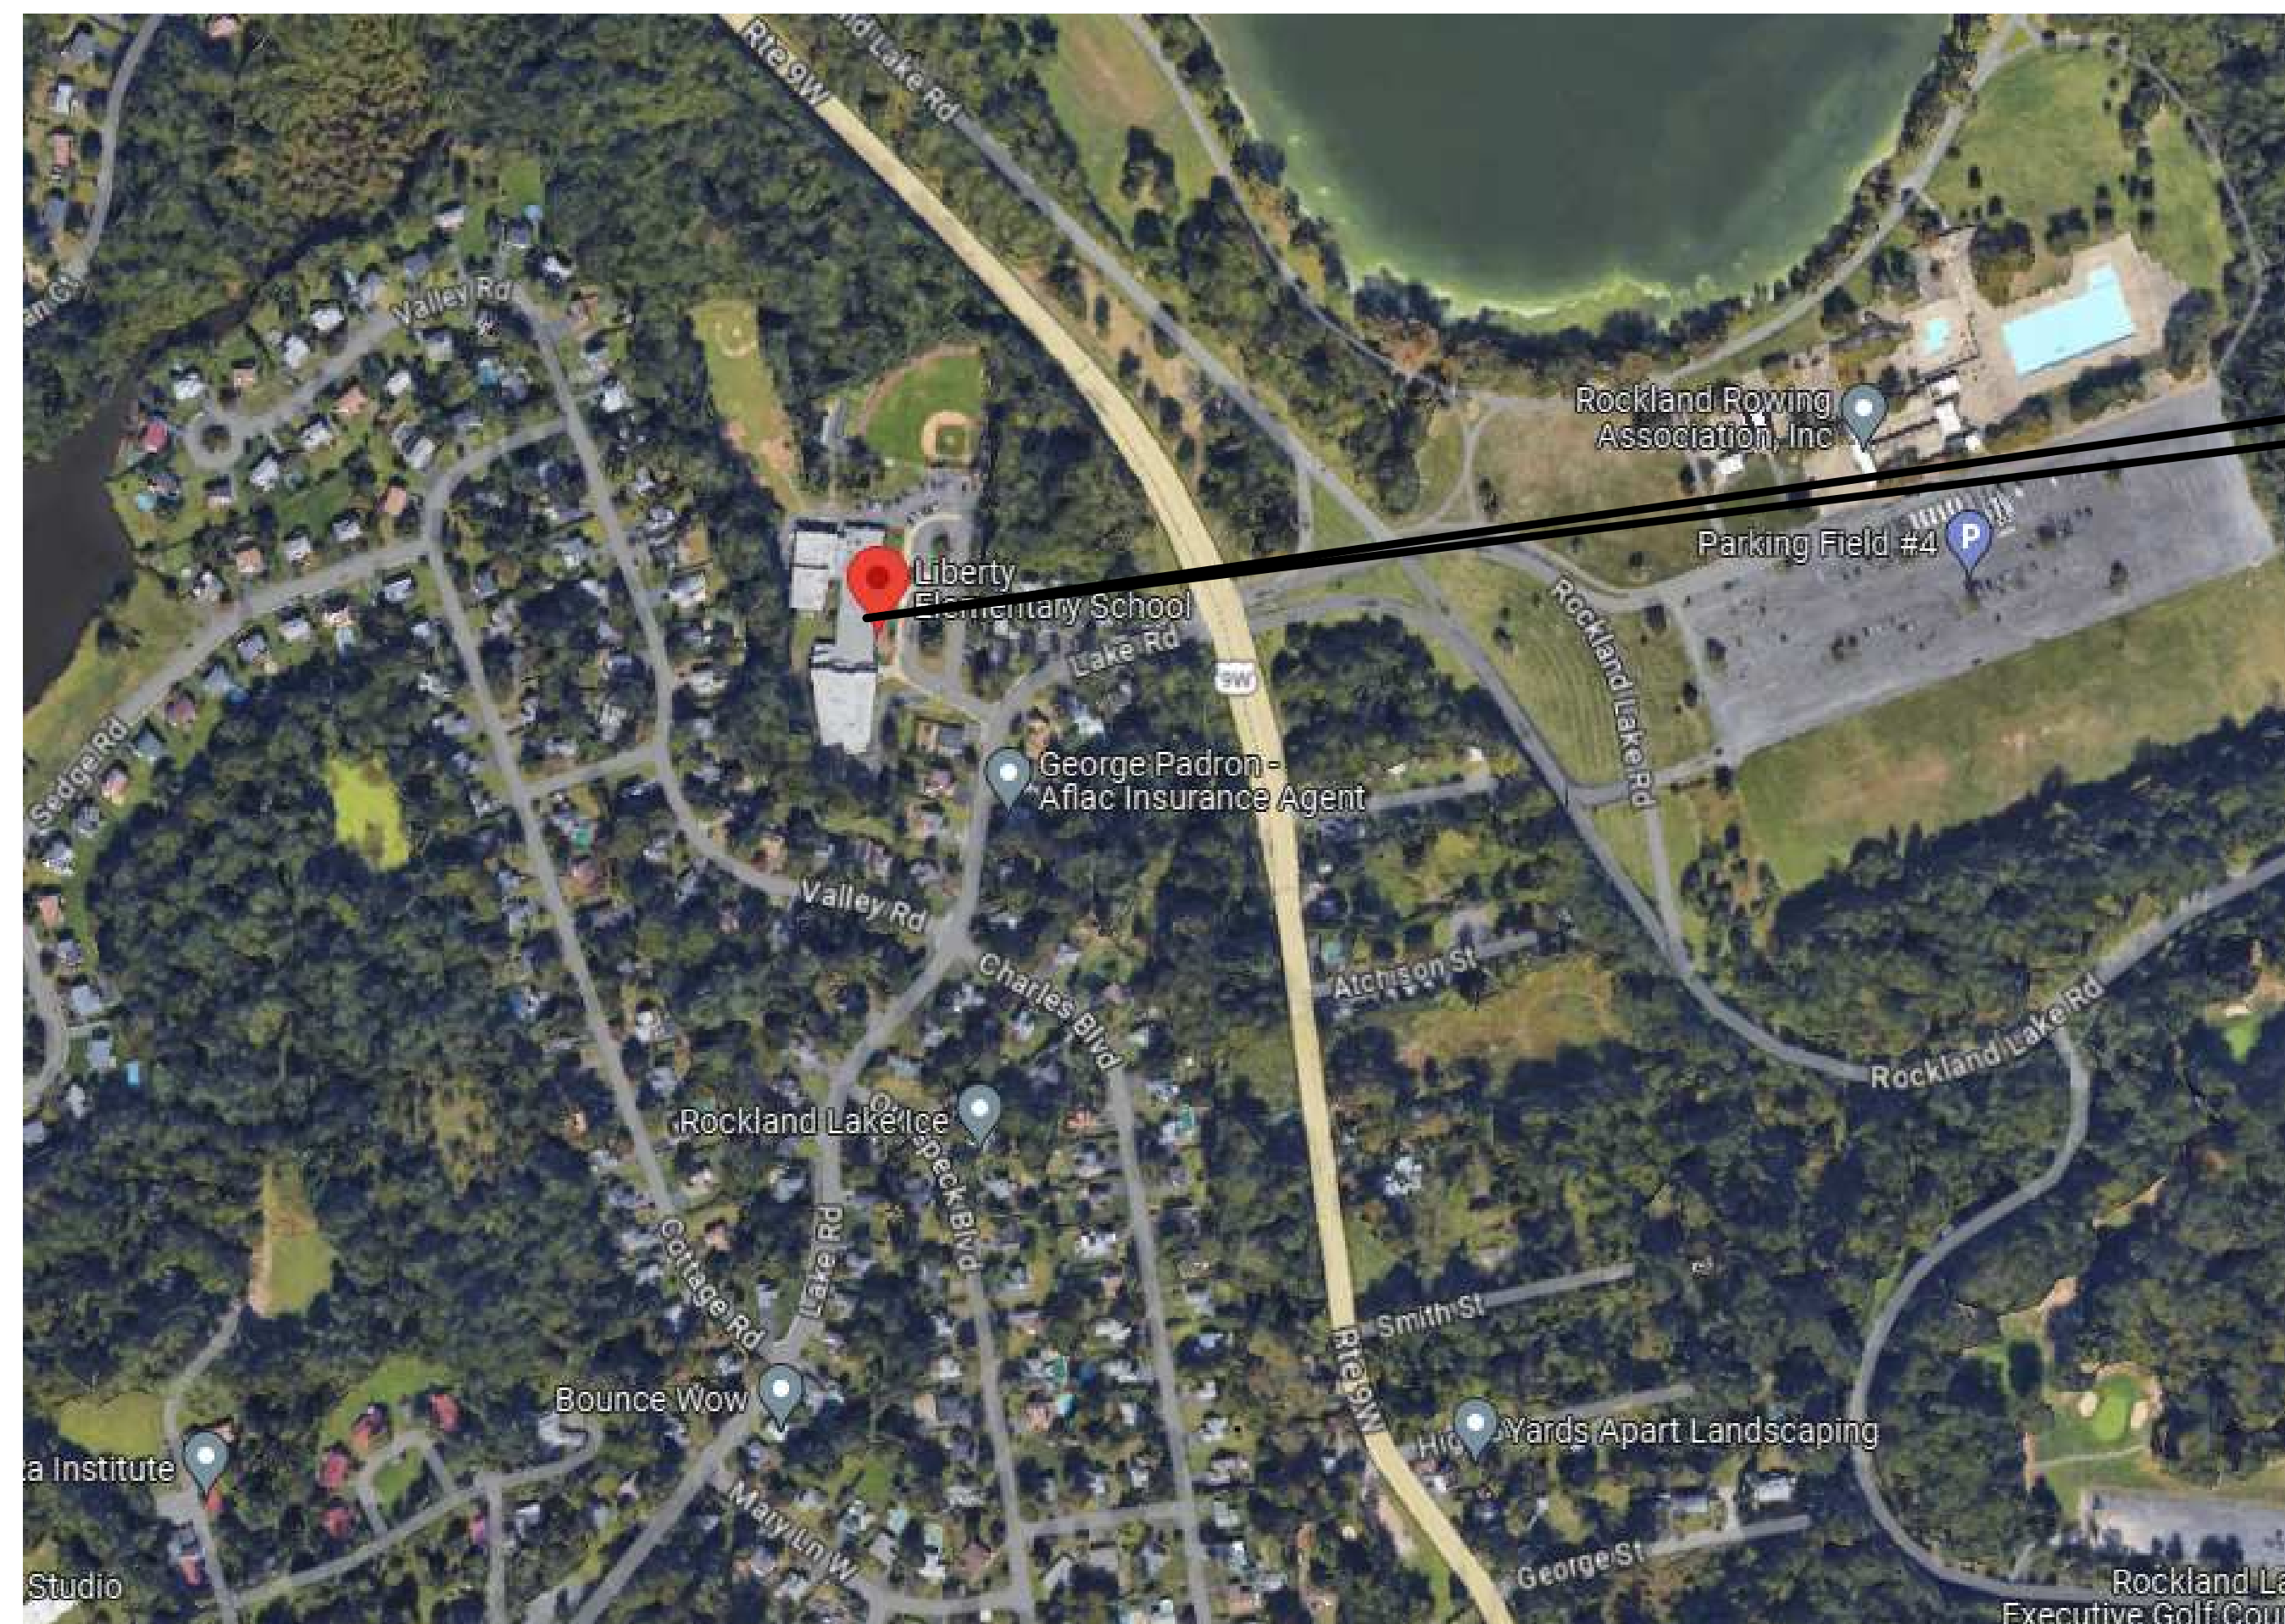

LIBERTY ELEMENTARY SCHOOL,
142 LAKE RD, VALLEY COTTAGE, NY
10989

VICINITY MAP

NTS



VOLUME 2 OF 3

ABBREVIATIONS

ABBREVIATION	DESCRIPTION
ADA	AMERICANS WITH DISABILITIES ACT
ADD	ADDENDUM
ADMIN	ADMINISTRATIVE
AFF	ABOVE FINISHED FLOOR
ALT	ALTERNATE
APPROX	APPROXIMATE
ARCH	ARCHITECT / ARCHITECTURAL
AV	AUDIO VISUAL
BLDG	BUILDING
BOT OR B/	BOTTOM OF
BSMT	BASEMENT
C-J	CONTROL / CONSTRUCTION JOINT
CL	CENTERLINE
CLG	CEILING
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
COL	COLUMN
CONG	CONCRETE
CONF	CONFERENCE
CONT	CONTINUOUS
CONTR	CONTRACTOR
COORD	COORDINATE
CORR	CORRIDOR
DEMO	DEMOLITION
DET	DETAIL
DIA	DIAMETER
DN	DOWN
DWG	DRAWING
ED	EDUCATION
EIFS	EXTERIOR INSULATION FINISH SYSTEM
ELECT	ELECTRIC / ELECTRICAL
ELEV	ELEVATION
EPDM	ETHYLENE PROPYLENE DIENE MONOMER
EQ	EQUAL
EQUIP	EQUIPMENT
EXST	EXISTING
EJ	EXPANSION JOINT
EXT	EXTERIOR
FIN	FINISH
FIN FL	FINISH FLOOR
FIXT	FIXTURE
FLR	FLOOR
FRF	FIRE-RETARDANT-TREATED MATERIAL
FTS	FOOTING
G	GROUND
GA	GAUGE
GAL	GALLON(S)
GALV	GALVANIZE(D)
GC	GENERAL CONTRACTOR
GWB	GYPSUM WALL BOARD
GWBs	GYPSUM WALL BOARD SOFFIT
HM	HOLLOW METAL
HORIZ	HORIZONTAL
HR	HOUR
HT	HEIGHT
HTG	HEATING
HVAC	HEATING/VENTILATING/AIR CONDITIONING
ID	INSIDE DIMENSION
IN	INCH
INT	INTERIOR
JAN	JANITOR
JC	JANITOR'S CLOSET
JST	JOIST
JT	JOINT
LAB	LABORATORY
LB	POUND
LN	LINEAR
LVL	LEVEL
MAN	MANUAL
MAS	MASONRY
MAX	MAXIMUM
MDF	MEDIUM DENSITY FIBERBOARD
MECH	MECHANICAL
MEZZ	MEZZANINE
MFR	MANUFACTURER
MD	MODUL
MIN	MINIMUM
MISC	MISCELLANEOUS
MO	MASONRY OPENING
MTL	METAL
NA	NOT APPLICABLE
NC	NOT IN CONTRACT
NOM	NOMINAL
NTS	NOT TO SCALE
OC	ON CENTER
OD	OUTSIDE DIAMETER
OH	OVERHEAD
OPT	OPTIONAL
OVR	OVERALL
OZ	OUNCE
PERIM	PERIMETER
PLAM	PLASTIC LAMINATE
PLBG	PLUMBING
PLAS	PLASTER
PLYMD	PLYWOOD
PNL	PANEL
PNT	PAINT
POLYISO	POLYISOCYANURATE
PPT	PRESSURE PRESERVATIVE TREATED
PR	PAIR
PREP	PREPARATORY
PTN	PARTITION
PVC	POLYVINYL CHLORIDE
RAD	RADIUS
REQD	REQUIRED
RM	ROOM
RND	ROUND
RO	ROUGH OPENING
SCH	SCHEDULED
SECT	SECTION
SF	SQUARE FEET
SH	SIMILAR
SPEC	SPECIFICATION
SQ	SQUARE
SS	STAINLESS STEEL
STC	SOUND TRANSMISSION GLASS
STD	STANDARD
STL	STEEL
STOR	STORAGE
STRUCT	STRUCTURAL / STRUCTURE
SUSP	SUSPENDED
SAC	SUSPENDED ACOUSTICAL CELING
T&B	TOP AND BOTTOM
T&G	TONGUE AND GROOVE
TECH	TECHNOLOGY
TEMP	TEMPORARY
TMFD	TEMPERED
TOM	TOP OF MASONRY
TOS	TOP OF STEEL
TYP	TYPICAL
UL	UNDERWRITERS LABORATORY
UNO	UNLESS NOTED OTHERWISE
VERT	VERTICAL
VEST	VESTIBULE
VIF	VERIFY IN FIELD
W/	WITH
W/O	WITHOUT
WD	WOOD
WPT	WOOD PRESERVED-TREATED MATERIAL
WST	WEIGHT
YD	YARD

ARCHITECTURAL LEGEND

MATERIAL INDICATIONS	
	EARTH
	GRANULAR FILL
	BRICK
	CONCRETE MASONRY UNIT
	CONCRETE
	GROUT
	ROUGH WOOD BLOCKING
	SHIM
	FINISH WOOD
	PLYWOOD
	SHEATHING
	RIGID INSULATION
	BATT INSULATION
	SPRAY FOAM INSULATION
	EPS INSULATION
	STEEL


DIMENSIONING CONVENTIONS



SYMBOLS

	CLASSROOM	ROOM NAME
	1001	ROOM NUMBER
	000 S.F.	AREA OF ROOM
	A100	DOOR NUMBER, REFER TO A100 DRAWINGS
	1	WINDOW TAG, REFER TO A100 DRAWINGS
	<BLT>	BORROWED LIGHT NUMBER, REFER TO A100 DRAWINGS
	51	STOREFRONT / CURTAIN WALL NUMBER, REFER TO A100 DRAWINGS
	1	COLUMN GRID DESIGNATION
	1	PARTITION TAG, REFER TO A100 DRAWINGS
	1	HOUR RATING OF PARTITION
	1	ADDITIONAL NOTES FOR PARTITION
	1	REVISION NUMBER
	1	KEY NOTE, NEW WORK
	1	KEY NOTE, DEMOLITION WORK
	10'-0"	ELEVATION TAG
	3	HANDICAPPED ACCESSIBLE ELEMENT OR FIXTURE
	101	ROOM NAME
	101	INTERIOR FINISH TAG, REFER TO AF100 DRAWINGS
	101	BASE FINISH
	101	FLOOR FINISH

DETAIL INDICATOR LEGEND

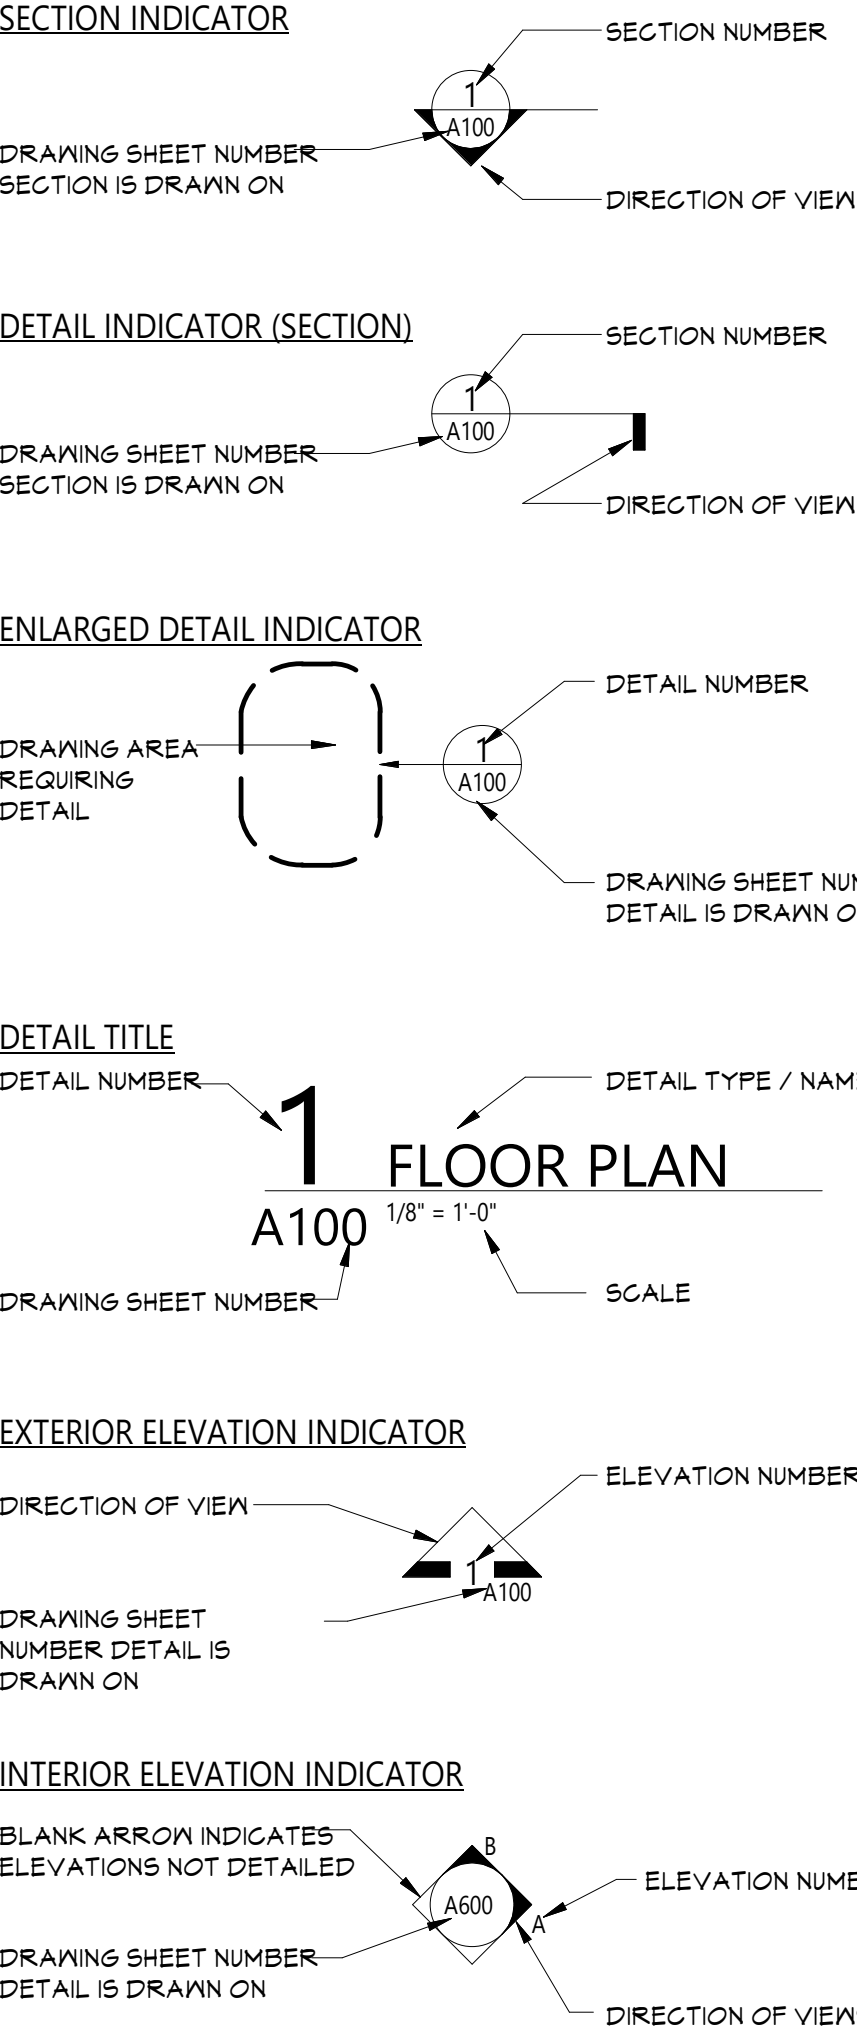

PLAN GRAPHICS LEGEND	
	EXISTING CONSTRUCTION TO REMAIN
	EXISTING CONSTRUCTION TO BE REMOVED
	NEW CONCRETE MASONRY WALL
	NEW METAL STUD WALL
	NEW BRICK VENEER
	EXISTING DOOR TO REMAIN
	EXISTING DOOR TO BE REMOVED
	NEW DOOR
FINISHED DOOR OPENINGS SHALL BE LOCATED AS INDICATED BELOW UNO. DIMENSIONS SHOWN ARE CLEAR DIMENSIONS FROM INSIDE OF FRAME TO WALL FINISH.	
GENERAL NOTES	
1. DIMENSIONS ARE GIVEN THIS (UNLESS NOTED OTHERWISE) A. TO FACE OF MASONRY WALL B. TO FACE OF METAL STUD C. TO COLUMN CENTERLINES D. TO FINISH FACE OF SOFFIT OR CEILING E. FACE OF EXISTING CONSTRUCTION	
2. DO NOT SCALE DRAWINGS. IF A DIMENSION IS NOT SHOWN, BRING IT TO THE ATTENTION OF THE ARCHITECT FOR VERIFICATION BEFORE PROCEEDING WITH THE ASSOCIATED WORK	
3. WALLS ON COLUMN LINES ARE CENTERED, UNO	
4. ALL DIMENSIONS RELATED TO EXISTING CONDITIONS SHALL BE VERIFIED IN FIELD. CONTRACTOR TO NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO BEGINNING WORK IN THAT AREA.	
5. LAYOUT OF TOILET FIXTURES AND ACCESSIBILITY CLEARANCES ARE SHOWN AS CLEAR DIMENSION. CONTRACTORS ARE REQUIRED TO COORDINATE LAYOUTS OF PARTITIONS, UTILITY CONNECTIONS, AND THICKNESS OF FINISHES TO ALLOW THESE CLEAR DIMENSIONS.	
6. ALL ELEVATIONS (X'-X") ARE REFERENCE FROM FIRST FLOOR ELEVATION	
7. ALL WOOD BLOCKING WITHIN 2'-0" OF GRADE SHALL BE PRESSURE TREATED	
8. ALL FLOOR PENETRATIONS SHALL BE SMOKE-SEALED AND / OR FIRE STOPPED. COORDINATE WITH W DWGS FOR SMOKE / FIRE DAMPER REQUIREMENTS.	
9. FOR INTERIOR PARTITION TYPES, REFER TO DRAWING A101	
10. FOR DOOR SCHEDULE, REFER TO DRAWING A101	
11. FOR FINISH SCHEDULE, REFER TO DRAWING AF101	
12. ALL EXPOSED SURFACES OF NEW PARTITIONS AND SOFFITS ARE TO BE FINISHED.	
13. PROVIDE PATCH TO MATCH EXISTING FINISHES AT ALL WALL REMOVAL AREAS, COORDINATE WITH DEMOLITION DRAWINGS AND SPECIFICATIONS.	
14. FOR ALL MATERIAL TESTING, REFER TO SPECIFICATION DIVISION 000220	
15. ALL CONSTRUCTION SHOWN IS NEW UNLESS NOTED OTHERWISE	

CSARCH

40 Beaver St., Albany, New York 12207-1511
518-463-8866 www.csarchpc.com

Consultant

NYACK UFSD
LIBERTY ELEMENTARY SCHOOL
BOILER REPLACEMENT PROJECT

REV	DATE	DESCRIPTION

Drawn By: _____

Checked By: _____

Proj. #: 50-03-04-83-0-006-017

CSArch Proj. #: 236-2302-00


Issued for Bid: 12/16/2024

Sheet Title
SYMBOLS,
ABBREVIATIONS,
AND MISC


Sheet No.
LES
G001

CONSTRUCTION DOCUMENTS

C:\Users\collura\Documents\216-2102_Liberty_ES_collura\VAE.rvt

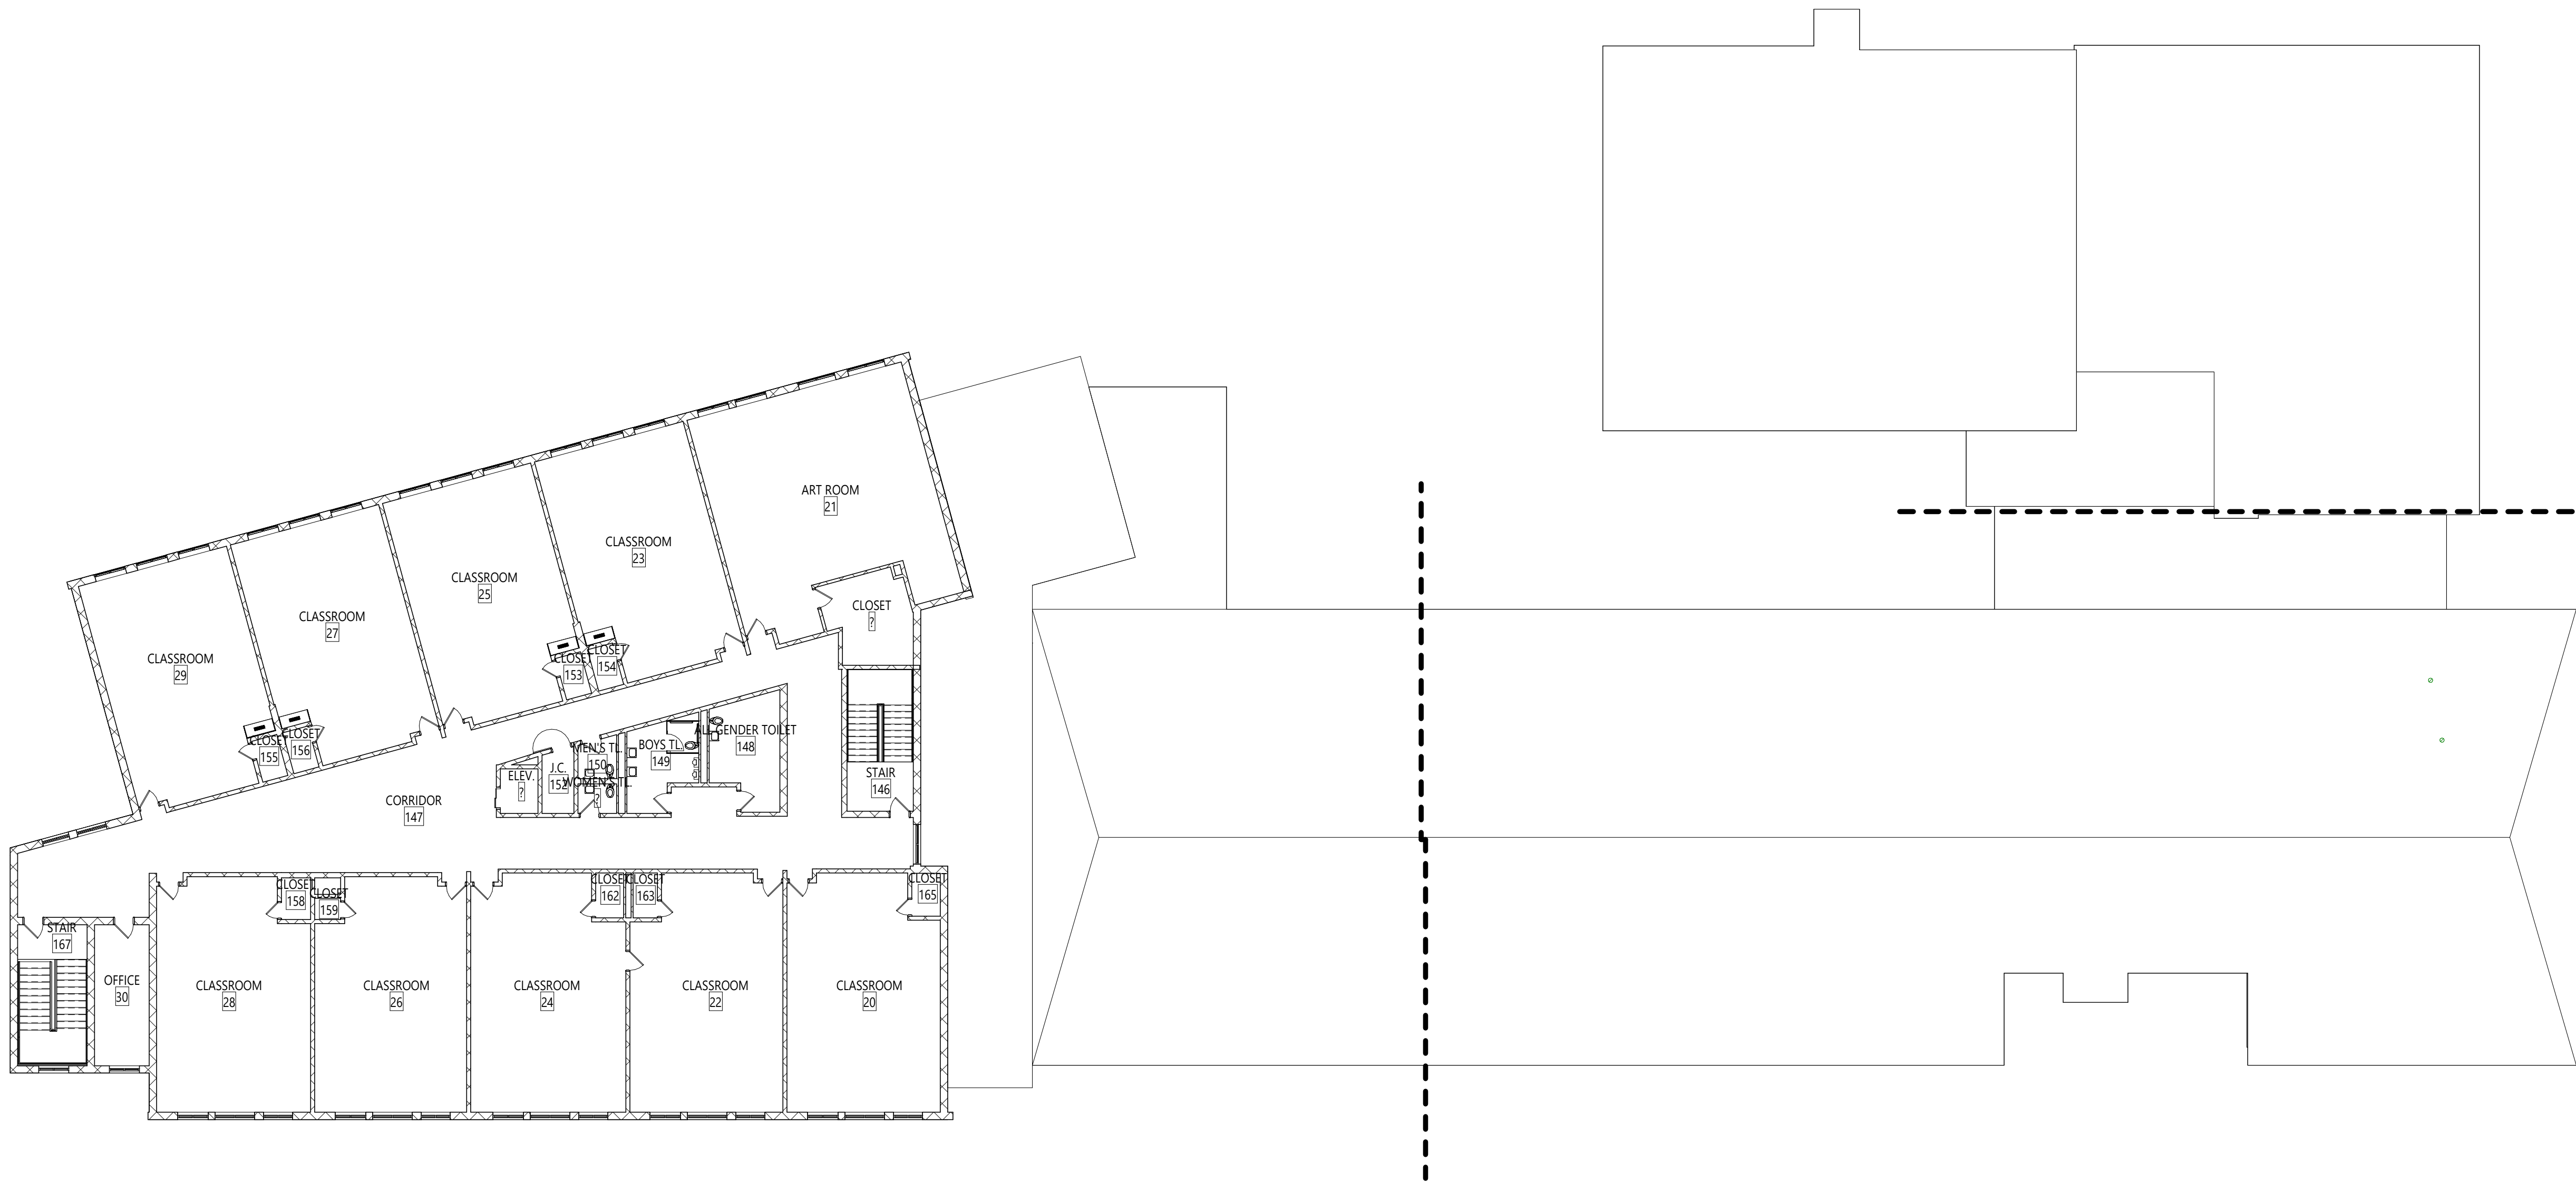

2 OVERALL SECOND FLOOR PLAN
G101 1/16" = 1'-0"

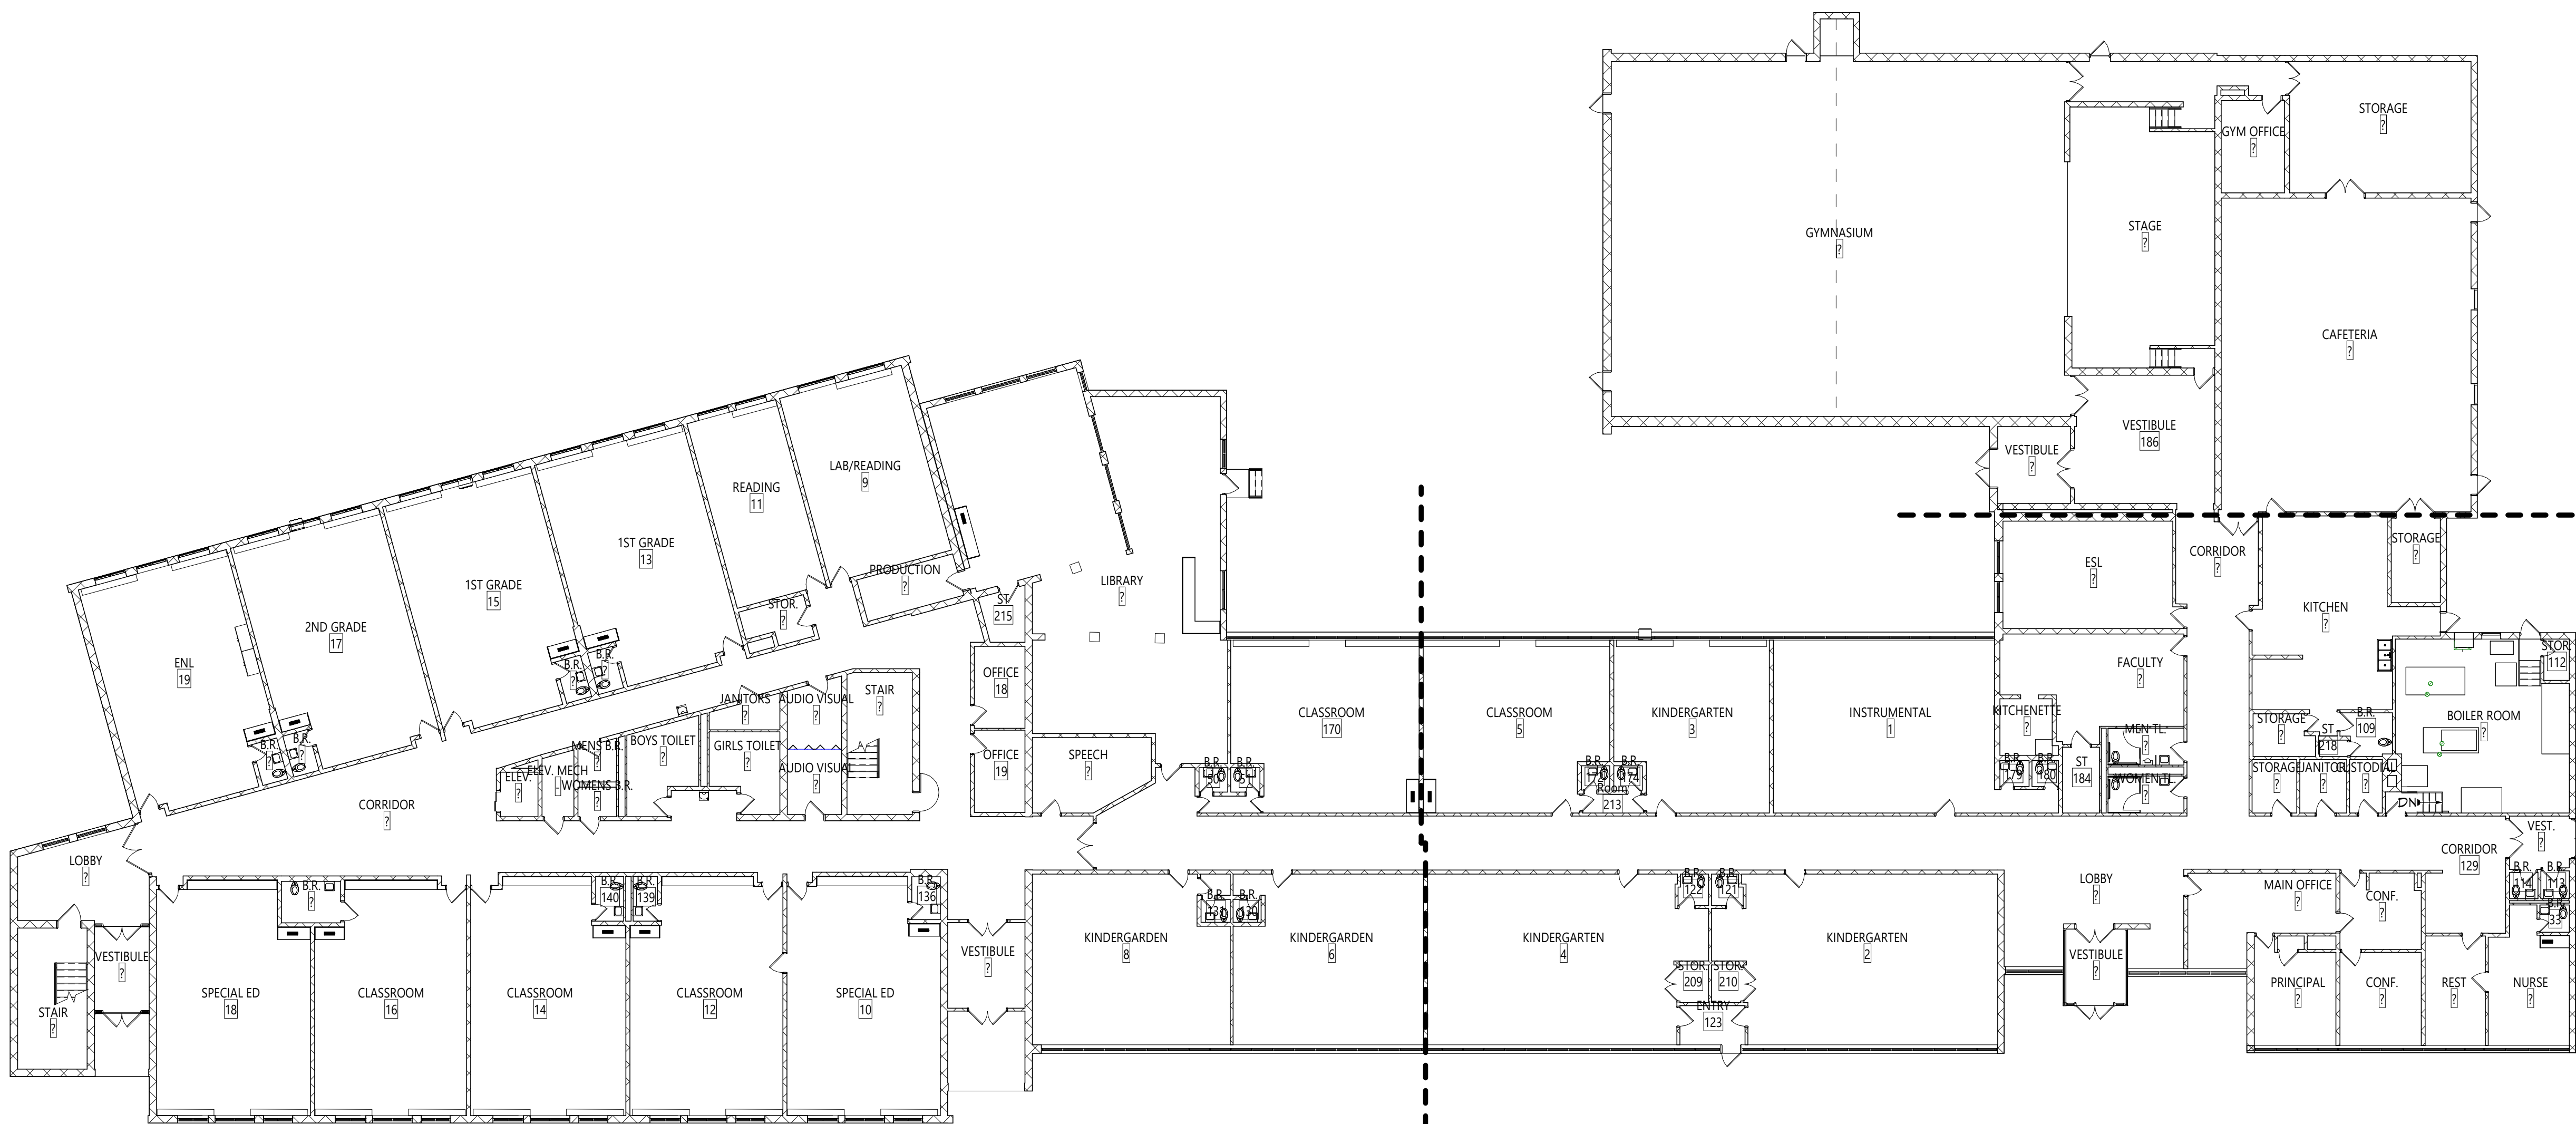

1 OVERALL FIRST FLOOR PLAN
G101 1/16" = 1'-0"

GENERAL NOTES

1. REFER TO SHEET G001 FOR ADDITIONAL GENERAL NOTES.
2. REFER TO A800 SERIES DRAWINGS FOR ENLARGED FLOOR AND ROOF PLANS, DETAILS, ADDITIONAL DIMENSIONS AND DETAILED INFORMATION.

40 Beaver St., Albany, New York 12207-1511
518-483-8806 www.csarch.com

CSARCH

Consultant

NYACK UFSD
LIBERTY ELEMENTARY SCHOOL
BOILER REPLACEMENT PROJECT

Project Title





DATE	DESCRIPTION

Drawn By:	Author
Checked By:	Checker
Proj. #:	50-03-04-83-0-006-017
CSArch Proj. #:	236-2302.00
Issued for Bid:	12/16/2024

Sheet Title

KEY PLAN

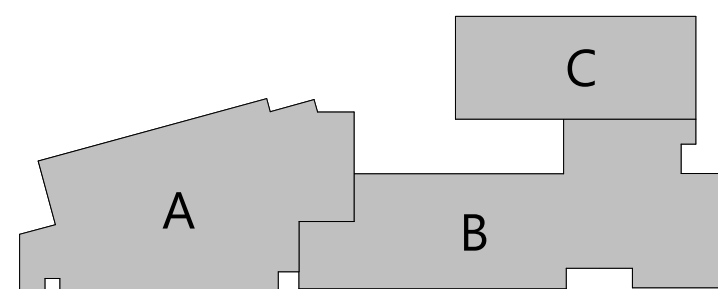


COPYRIGHT © ALL RIGHTS RESERVED

OVERALL FLOOR PLANS

Sheet No.

LES
G101

CONSTRUCTION DOCUMENTS

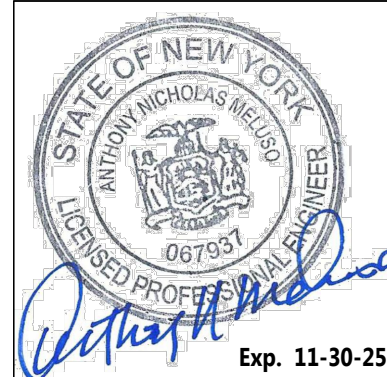

	DATE	DESCRIPTION

Drawn By:	AM
Checked By:	RL
Proj. #:	50-03-04-03-0-006-01
CSArch Proj. #:	226-2302.0
Issued for Bid:	12/16/202

Sheet Title

ASBESTOS
ABATEMENT
NOTES

Sheet No

LES
AA000

CONSTRUCTION DOCUMENTS

ASBESTOS ABATEMENT NOTES

PRE-ABATEMENT WORK NOTES:

1. THESE DRAWINGS HAVE BEEN PREPARED UTILIZING THE OWNERS' ORIGINAL CONSTRUCTION DOCUMENTS IN ORDER TO ILLUSTRATE THE EXISTING CONDITIONS OF THE SITE AND STRUCTURES THEREIN. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ACTUAL VERIFICATION OF ALL EXISTING CONDITIONS IN THE FIELD.
2. THE CONTRACTOR SHALL DETERMINE EXACT FINAL LOCATIONS OF PERSONNEL AND WASTE DECONTAMINATION ENCLOSURES, PICK UP AREA FOR REFUSE AND ASBESTOS DEBRIS. THESE LOCATIONS SHALL BE REVIEWED AND PROPERLY APPROVED BY THE OWNER PRIOR TO COMMENCEMENT OF WORK. THIS CONTRACTOR SHALL ESTABLISH, LABEL AND MAINTAIN PROPER EXITS AND WAYS OF EGRESS WITHIN EACH WORK AREA FOR NORMAL AND EMERGENCY USE BY WORKERS DURING ALL ABATEMENT ACTIVITIES.
3. THE CONTRACTOR, PRIOR TO BIDDING SHALL BE RESPONSIBLE TO BECOME COMPLETELY FAMILIAR WITH ALL ASPECTS OF THE PROJECT, INCLUDING, BUT NOT LIMITED TO, ALL DEMOLITION AND CONSTRUCTION WORK AS SHOWN IN THE COMPLETE SET OF DRAWINGS AND IN THE PROJECT MANUAL / SPECIFICATIONS AND ASBESTOS SURVEY REPORTS IN ORDER THAT THE FULL SCOPE OF WORK WHICH MAY ENCOMPASS ASBESTOS CONTAINING MATERIALS IS UNDERSTOOD AND ACCOUNTED FOR BY THE CONTRACTOR IN UNDERTAKING THIS PROJECT. A COPY OF THE ASBESTOS SURVEY REPORT CAN BE REQUESTED FROM THE OWNERS' ENVIRONMENTAL CONSULTANT AND WILL BE AVAILABLE AT THE PRE-BID MEETING. ADDITIONAL REPORT REQUESTS MUST BE SUBMITTED IN WRITING SEVEN CALENDAR DAYS IN ADVANCE OF THE BID OPENING.
4. PRIOR TO ABATEMENT ALL CONTRACTORS WILL SURVEY EXISTING CONDITIONS IN THE ABATEMENT AND GENERAL WORK AREAS. ITEMS / MATERIALS, ETC., DAMAGED OR NON-FUNCTIONAL SHALL BE LISTED, NOTED, PHOTOGRAPHED AND REVIEWED WITH THE PROJECT INSPECTOR. ALL OTHER ITEMS / MATERIALS SHALL BE REVIEWED WITH THE PROJECT INSPECTOR. ALL OTHER ITEMS / MATERIALS SHALL BE ASSUMED TO BE IN GOOD CONDITION AND WORKING ORDER. IT SHALL BE THE RESPONSIBILITY OF THE ABATEMENT CONTRACTOR TO MAINTAIN ALL MATERIALS, ITEMS, EQUIPMENT, SYSTEMS, ETC. IN THEIR ORIGINAL CONDITION AND RETURN TO OWNER/GENERAL CONTRACTOR, ETC., IN SAME CONDITION AT THE END OF THIS CONTRACT.


ASBESTOS REMOVAL GENERAL NOTES:


3. ASBESTOS ABATEMENT INDICATED ON THESE DRAWINGS SHALL BE PERFORMED BY A NYS DEPARTMENT OF LABOR LICENSED ASBESTOS ABATEMENT CONTRACTOR, WHO SHALL VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND QUANTITIES PRIOR TO BID.
2. THE CONTRACTOR SHALL PERFORM ALL CONTRACT WORK IN ACCORDANCE WITH CONTRACT SPECIFICATIONS, NEW YORK STATE DEPARTMENT OF LABOR (NYS/DOL) INDUSTRIAL HEALTH CODE RULE 56, OSHA, NESHAPS, AHERA, NYSDEC AND ALL OTHER APPLICABLE CODES.
3. THE CONTRACTOR SHALL MAINTAIN THE SITE AS NEAT AS POSSIBLE AND ORDERLY DURING (THE COURSE OF) THE WORK. ALL LOOSE DEBRIS WHICH MAY (BECOME WINDBORNE) BLOW OFF THE SITE, SHALL BE COLLECTED AND DISPOSED OF PROPERLY BY THE CONTRACTOR ON A DAILY BASIS AS PART OF THE PROJECT WORK.
4. THE CONTRACTOR SHALL PROVIDE BARRIERS AROUND THE WORK AREAS IN ORDER TO ENSURE SAFE PASSAGE BY ANY PERSON. THESE BARRIERS SHALL ALSO SERVE TO KEEP ALL UNAUTHORIZED PERSONS OUT OF THE PROJECT AREA FOR THE DURATION OF THE WORK.
5. VARIANCES: CONTRACTOR SHALL PAY FOR AND OBTAIN ANY NECESSARY SITE SPECIFIC VARIANCES.
6. THE CONTRACTOR SHALL MAINTAIN SECURITY IN THE BUILDING AND THE WORK AREAS AT ALL TIMES.
7. PROJECT STAGING, STORAGE, SCHEDULING AND ACCESS SHALL BE COORDINATED WITH AND APPROVED BY THE ARCHITECT, CONSTRUCTION MANAGER AND OWNER PRIOR TO PROCEEDING WITH WORK.
8. SHOULD IT BECOME NECESSARY, THE CONTRACTOR SHALL COORDINATE SHUT DOWN AND LOCK OUT / TAG OUT OF THE ELECTRICAL POWER FROM THE OWNERS' POWER, WITH OWNERS' REPRESENTATIVE, PRIOR TO THE COMMENCEMENT OF WORK.
9. ALL TEMPORARY POWER TO THE WORK AREA SHALL BE BROUGHT IN FROM OUTSIDE THE WORK AREA BY ABATEMENT CONTRACTOR / GC THROUGH A GROUND-FAULT CIRCUIT INTERRUPTER AT THE SOURCE.
10. CONTRACTOR SHALL COORDINATE CONNECTION OF WATER SERVICE FOR DECONTAMINATION PURPOSES WITH OWNERS' REPRESENTATIVE. WATER FOR DECONTAMINATION UNITS IS AVAILABLE FROM THE OWNER.
11. THE OWNER OR OWNERS' REPRESENTATIVE IS RESPONSIBLE TO CONTRACT FOR NYS/DOL PROJECTS MONITORING / AIR SAMPLING TECHNICIAN SERVICES AS REQUIRED.
12. CONTRACTOR TO PROVIDE A COPY OF SAFETY DATA SHEETS (SDS'S) FOR ANY CHEMICAL AGENTS TO BE USED DURING THE ASBESTOS ABATEMENT TO THE PROJECT MONITOR AND THE OWNERS'S REPRESENTATIVE.
13. CONTRACTOR SHALL REQUEST AND RECEIVE PROJECT MONITOR AND OWNERS' REPRESENTATIVES APPROVAL OF ALL WORK BEFORE ANY ABATEMENT IS UNDERTAKEN.
14. UNDER NO CIRCUMSTANCES SHALL CONTAMINATED WASTE WATER BE DISCHARGED THROUGH A SYSTEM WITHOUT FILTERING. THE MAXIMUM FILTER SIZE OPENING SHALL BE CAPABLE OF RETAINING A 5.0 MICRON PARTICLE SIZE COLLECTION CAPABILITY.
15. DRAWINGS ATTEMPT TO INDICATE THE GENERAL SCOPE OF EXISTING CONDITIONS AND ITEMS AFFECTED BY THE ABATEMENT WORK. CONTRACTOR SHALL EXAMINE THE WORK AREA PRIOR TO FORMULATING HIS BID SHALL INCLUDE FIELD VARIATIONS FROM THOSE SHOWN WITHIN THE GENERAL INTENT OF THE WORK.
16. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF ALL ASBESTOS CONTAINING MATERIALS CONTAINED WITHIN AND GENERATED FROM THE ABATEMENT PROJECT AND ASSOCIATED WITH ALL PROJECT WORK, IN COMPLIANCE WITH ALL APPLICABLE LAWS, RULES REGULATIONS AND ALL REQUIREMENTS OF ALL AUTHORITIES HAVING JURISDICTION.
17. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF ALL ASBESTOS CONTAINING MATERIALS CONTAINED WITHIN AND GENERATED FROM THE PROJECT AND ASSOCIATED WITH ALL PROJECT WORK, IN THE MOST EFFICIENT AND COST EFFECTIVE METHOD POSSIBLE, WHICH ALSO COMPLIES WITH THE REQUIREMENTS LISTED ABOVE.

POST ABATEMENT WORK NOTES:


1. PROVIDE ALL APPLICABLE CODE RULE 56 PROCEDURES, CLEAN UP AND ADDITIONAL TESTING AS REQUIRED.
2. AFTER FINAL CLEARANCE HAS BEEN ATTAINED, THE ABATEMENT CONTRACTOR, TOGETHER WITH THE PROJECT INSPECTOR AND OWNERS REPRESENTATIVE WILL SURVEY FINAL CONDITIONS IN THE ABATEMENT AND GENERAL WORK AREAS. ITEMS / MATERIALS, ETC., DAMAGED OR NON-FUNCTIONAL SHALL BE LISTED, NOTED, PHOTOGRAPHED AND REVIEWED WITH THE PROJECT INSPECTOR. ALL OTHER ITEMS / MATERIALS SHALL BE REVIEWED WITH THE PROJECT INSPECTOR. ALL OTHER ITEMS / MATERIALS NOT NOTED, SHALL BE ASSUMED TO BE IN GOOD CONDITION AND WORKING ORDER. IT SHALL BE THE RESPONSIBILITY OF THE ABATEMENT CONTRACTOR TO MAINTAIN ALL MATERIALS, ITEMS, EQUIPMENT, SYSTEMS, ETC. IN THEIR ORIGINAL CONDITION AND RETURN TO OWNER/GENERAL CONTRACTOR, ETC., IN SAME CONDITION AT THE END OF THIS CONTRACT. ANY NEW DAMAGE OR MISSING EQUIPMENT SHALL BE NOTED AND THE COST OFFSET FROM THE CONTRACT.
3. REMOVE ALL TEMPORARY ENCLOSURES, BARRIERS, ETC. REINSTALL ITEMS/WORK PREVIOUSLY REMOVED. ALL TAPE AND ADHESIVE RESIDUALS TO BE REMOVED.
4. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO ENSURE AGAINST DAMAGE TO THE EXISTING WORK TO REMAIN IN PLACE. ANY DAMAGE TO SUCH WORK SHALL BE REPAIRED OR REPLACED TO THE SATISFACTION OF THE ARCHITECT AND OWNER AT NO ADDITIONAL COST TO THE CONTRACT.
5. AT COMPLETION OF THE ABATEMENT WORK, A CONDITION SURVEY SHALL BE DONE BY ALL CONTRACTORS AND PROJECT INSPECTOR (SEE NOTE 2.) ANY VARIATION (I.E. DAMAGE BY THE CONTRACTOR) SHALL BE REPAIRED / RESTORED BY THE ABATEMENT CONTRACTOR.
6. THE CONTRACTOR SHALL, UPON COMPLETION OF THE REMOVAL, PROVIDE WRITTEN DOCUMENTATION (INCLUDING ALL APPROPRIATE THIRD PARTY TESTING RESULTS) THAT THE PROJECT WORK AREAS ARE COMPLETELY FREE OF ALL ASBESTOS CONTAINING MATERIALS (CONTEMPLATED FOR REMOVAL UNDER THIS PROJECT, OR PHASE) AT FINAL CLEARANCE.
7. THE CONTRACTOR SHALL PROVIDE RECORDS OF ALL ASBESTOS CONTAINING MATERIALS REMOVED FROM THE SITE, INCLUDING THE COMPOSITION AND VOLUMES OF DISPOSED MATERIALS AND THE FINAL DISPOSAL SITE(S).

KEY PLAN

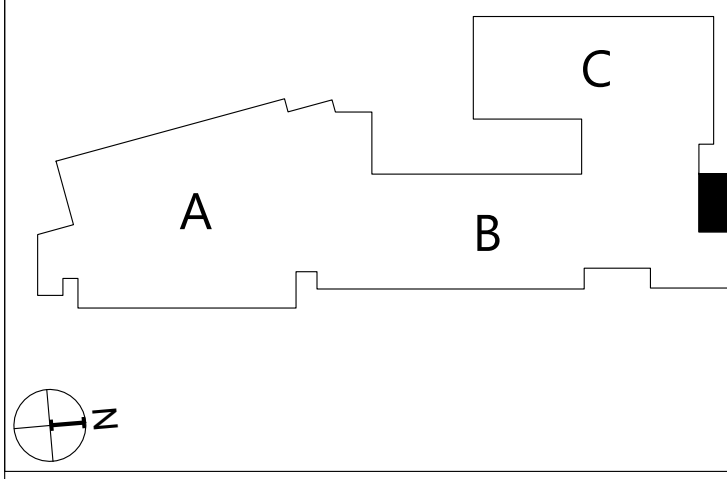

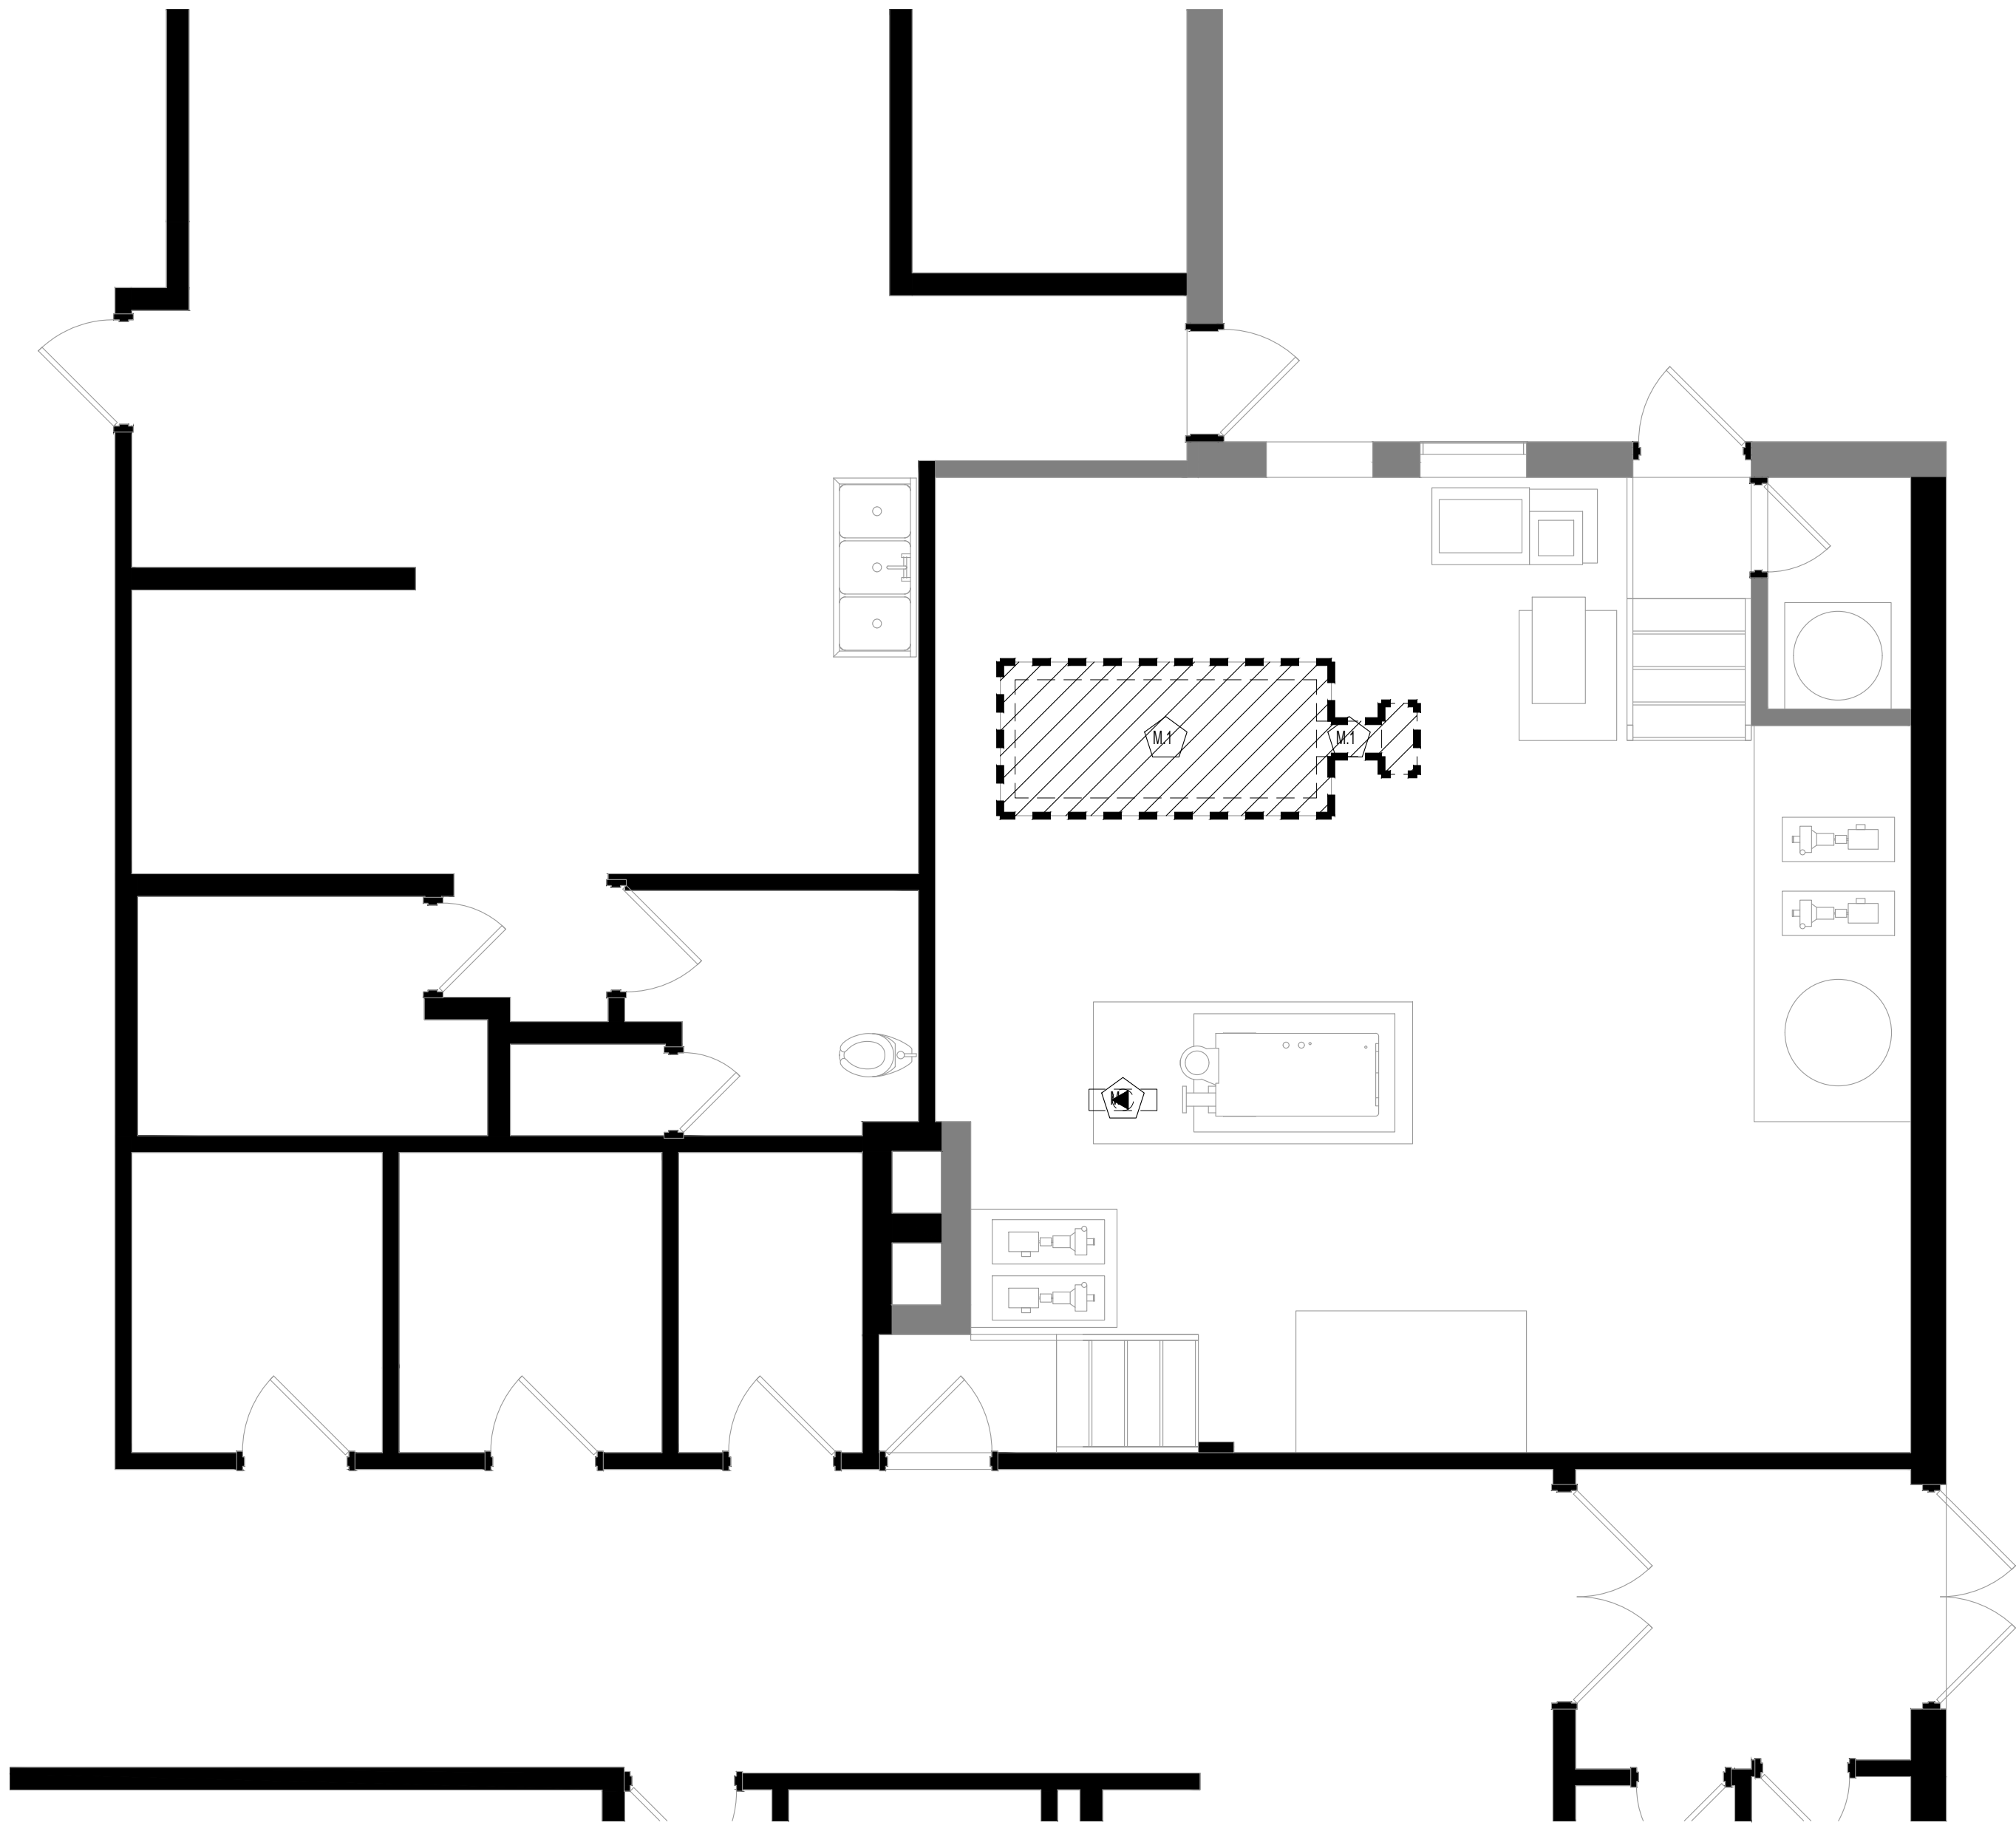


ASBESTOS ABATEMENT LEGEND

 PRESUMED ASBESTOS CONTAINING (PACM) BOILER INTERIORS TO BE REMOVED AND DISPOSED BY ASBESTOS CONTRACTOR.

REFER TO ASBESTOS ABATEMENT SPECIFICATION 020800 - 3.17 FOR A MORE DETAILED DESCRIPTION OF THE ABATEMENT WORK REQUIREMENTS .


1 BOILER ROOM ENLARGED ABATEMENT PLAN
A601 1/4" = 1'-0"

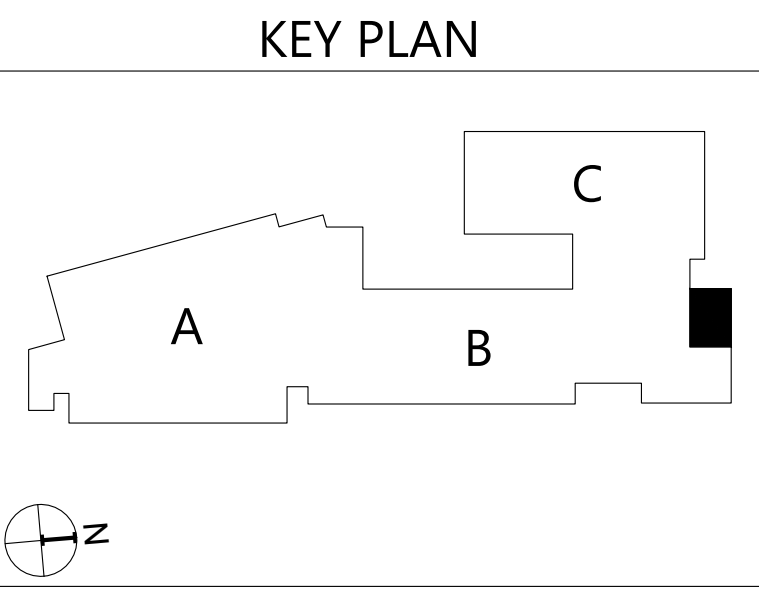

Consultant
QUALITY ENVIRONMENTAL
SOLUTIONS & TECHNOLOGIES,
INC.
1077 ROUTE 9
WAPPINGERS FALLS, NY 12590
TEL (845)298-6031

NYACK UFSD
LIBERTY ELEMENTARY SCHOOL
BOILER REPLACEMENT PROJECT

Project Title

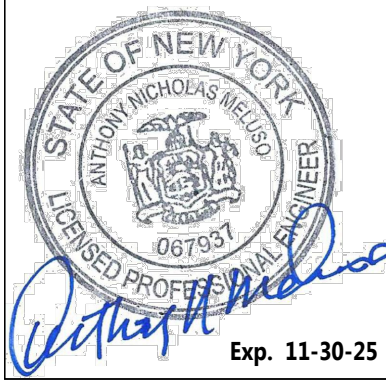


Drawn By: AM
Checked By: RL
Proj. #: 50-03-04-03-0-006-017
CSArch Proj. #: 226-2302.00
Issued for Bid: 12/16/2020

Sheet Title
ENLARGED
BOILER ROOM
ABATEMENT
PLANS


Sheet No.
LES
AA101

CONSTRUCTION DOCUMENTS


C:\Users\collura\Documents\245-2302_Liberty_ES_collura\A601.rvt

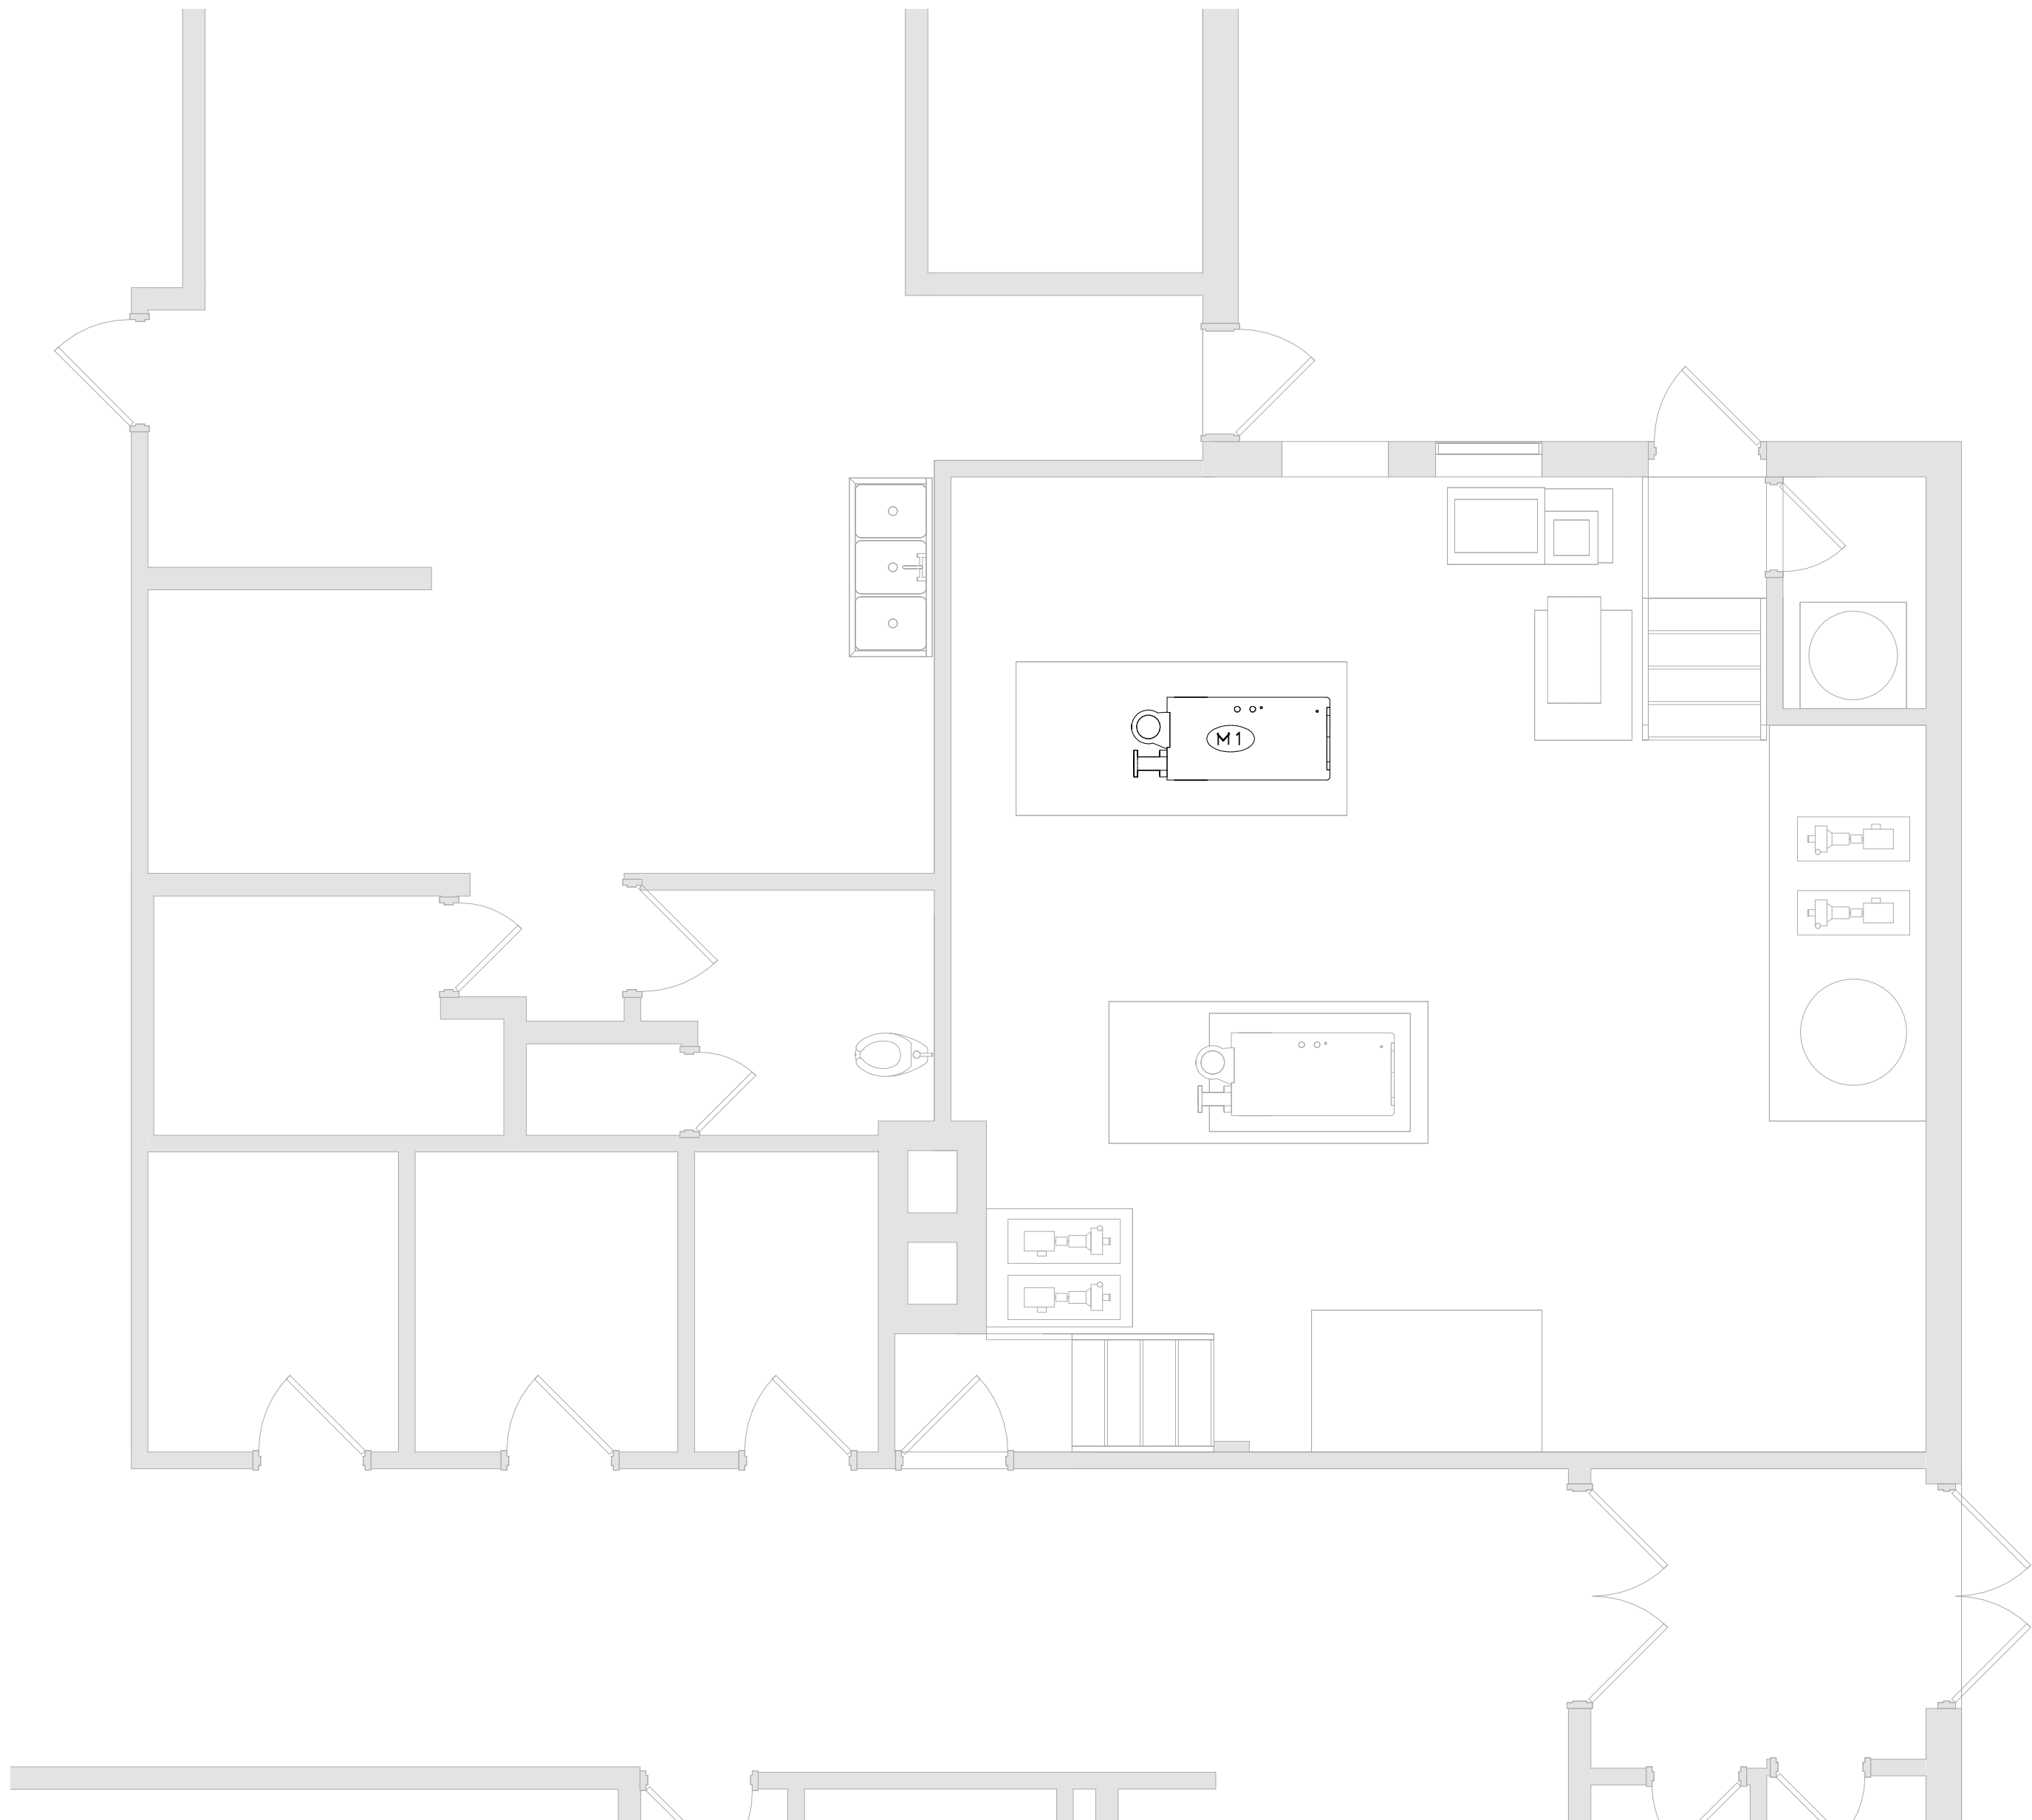


2 BOILER ROOM NEW WORK FLOOR PLAN
A601 1/4" = 1'-0"

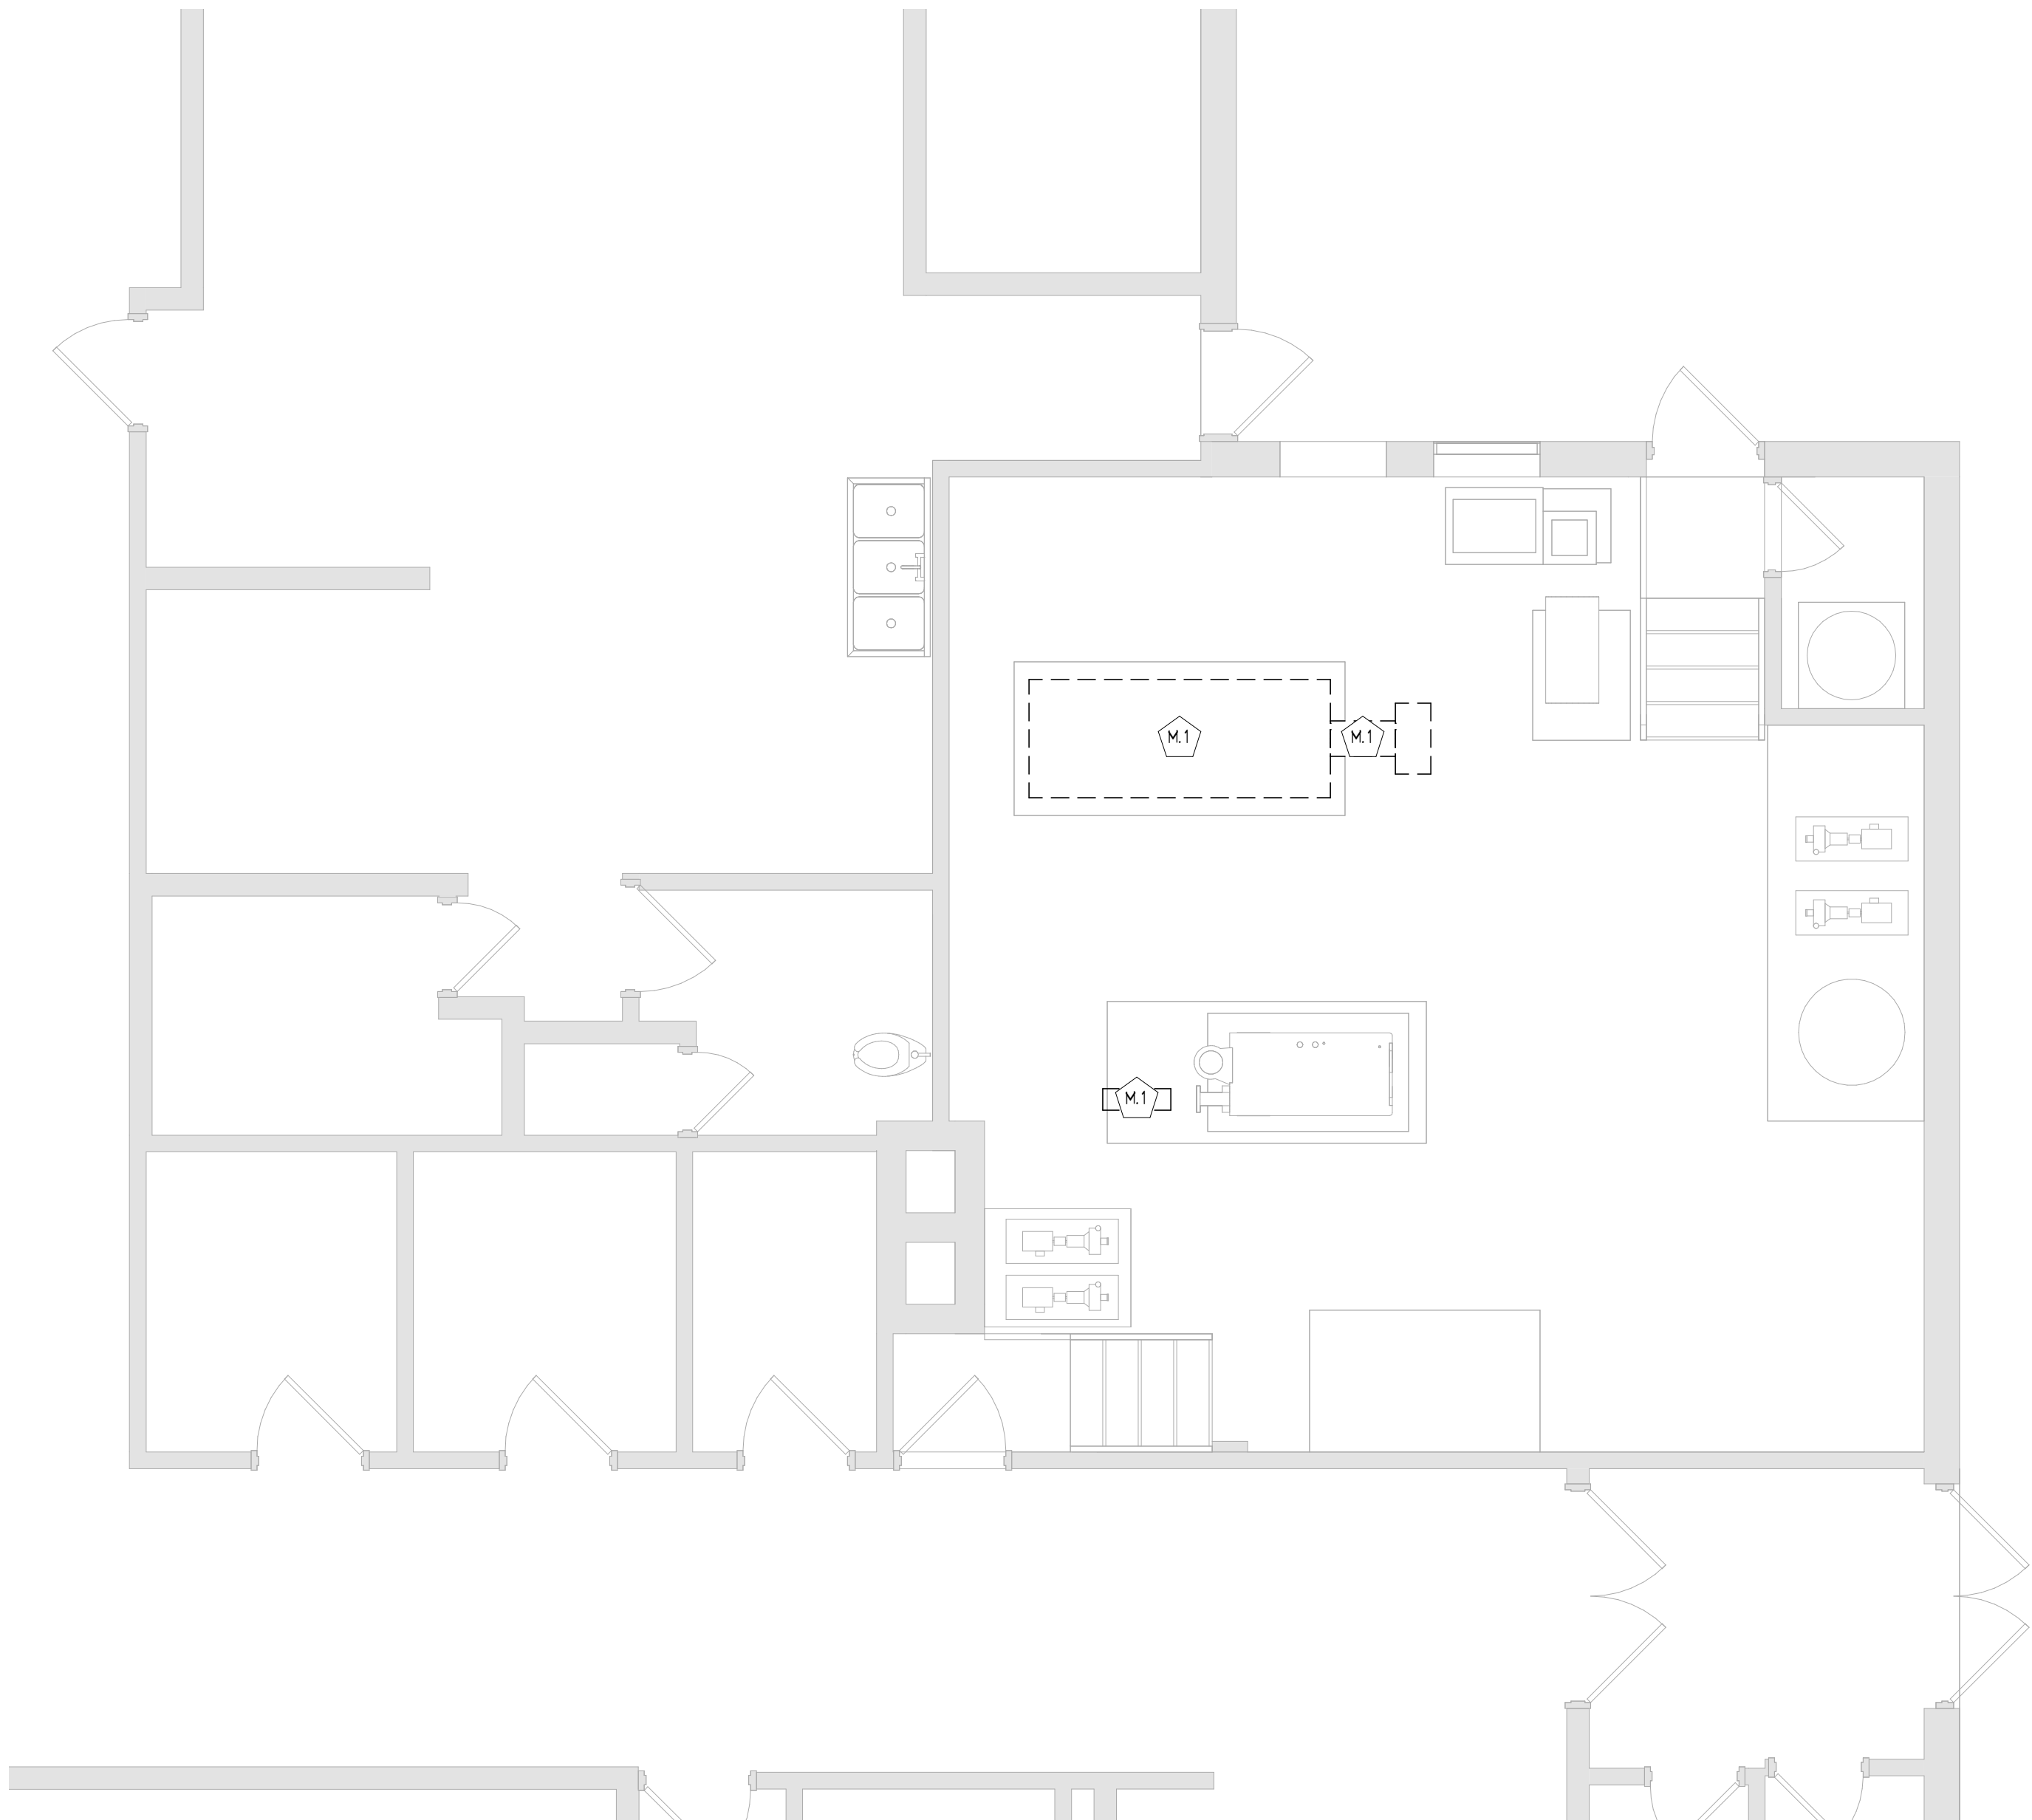

1 BOILER ROOM DEMOLITION FLOOR PLAN
A601 1/4" = 1'-0"

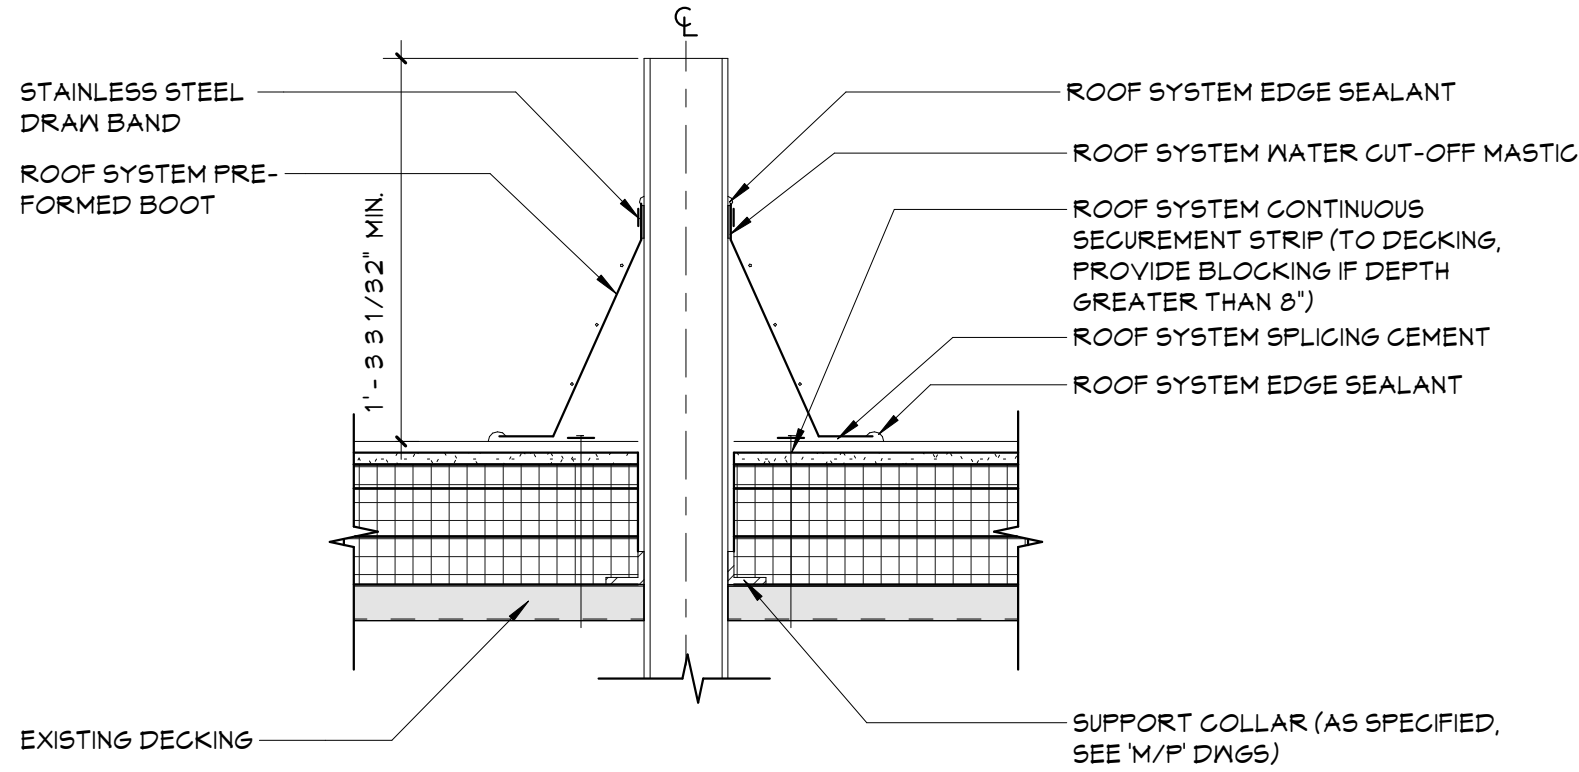

4 VENT PIPE DETAIL
A601 1 1/2" = 1'-0"

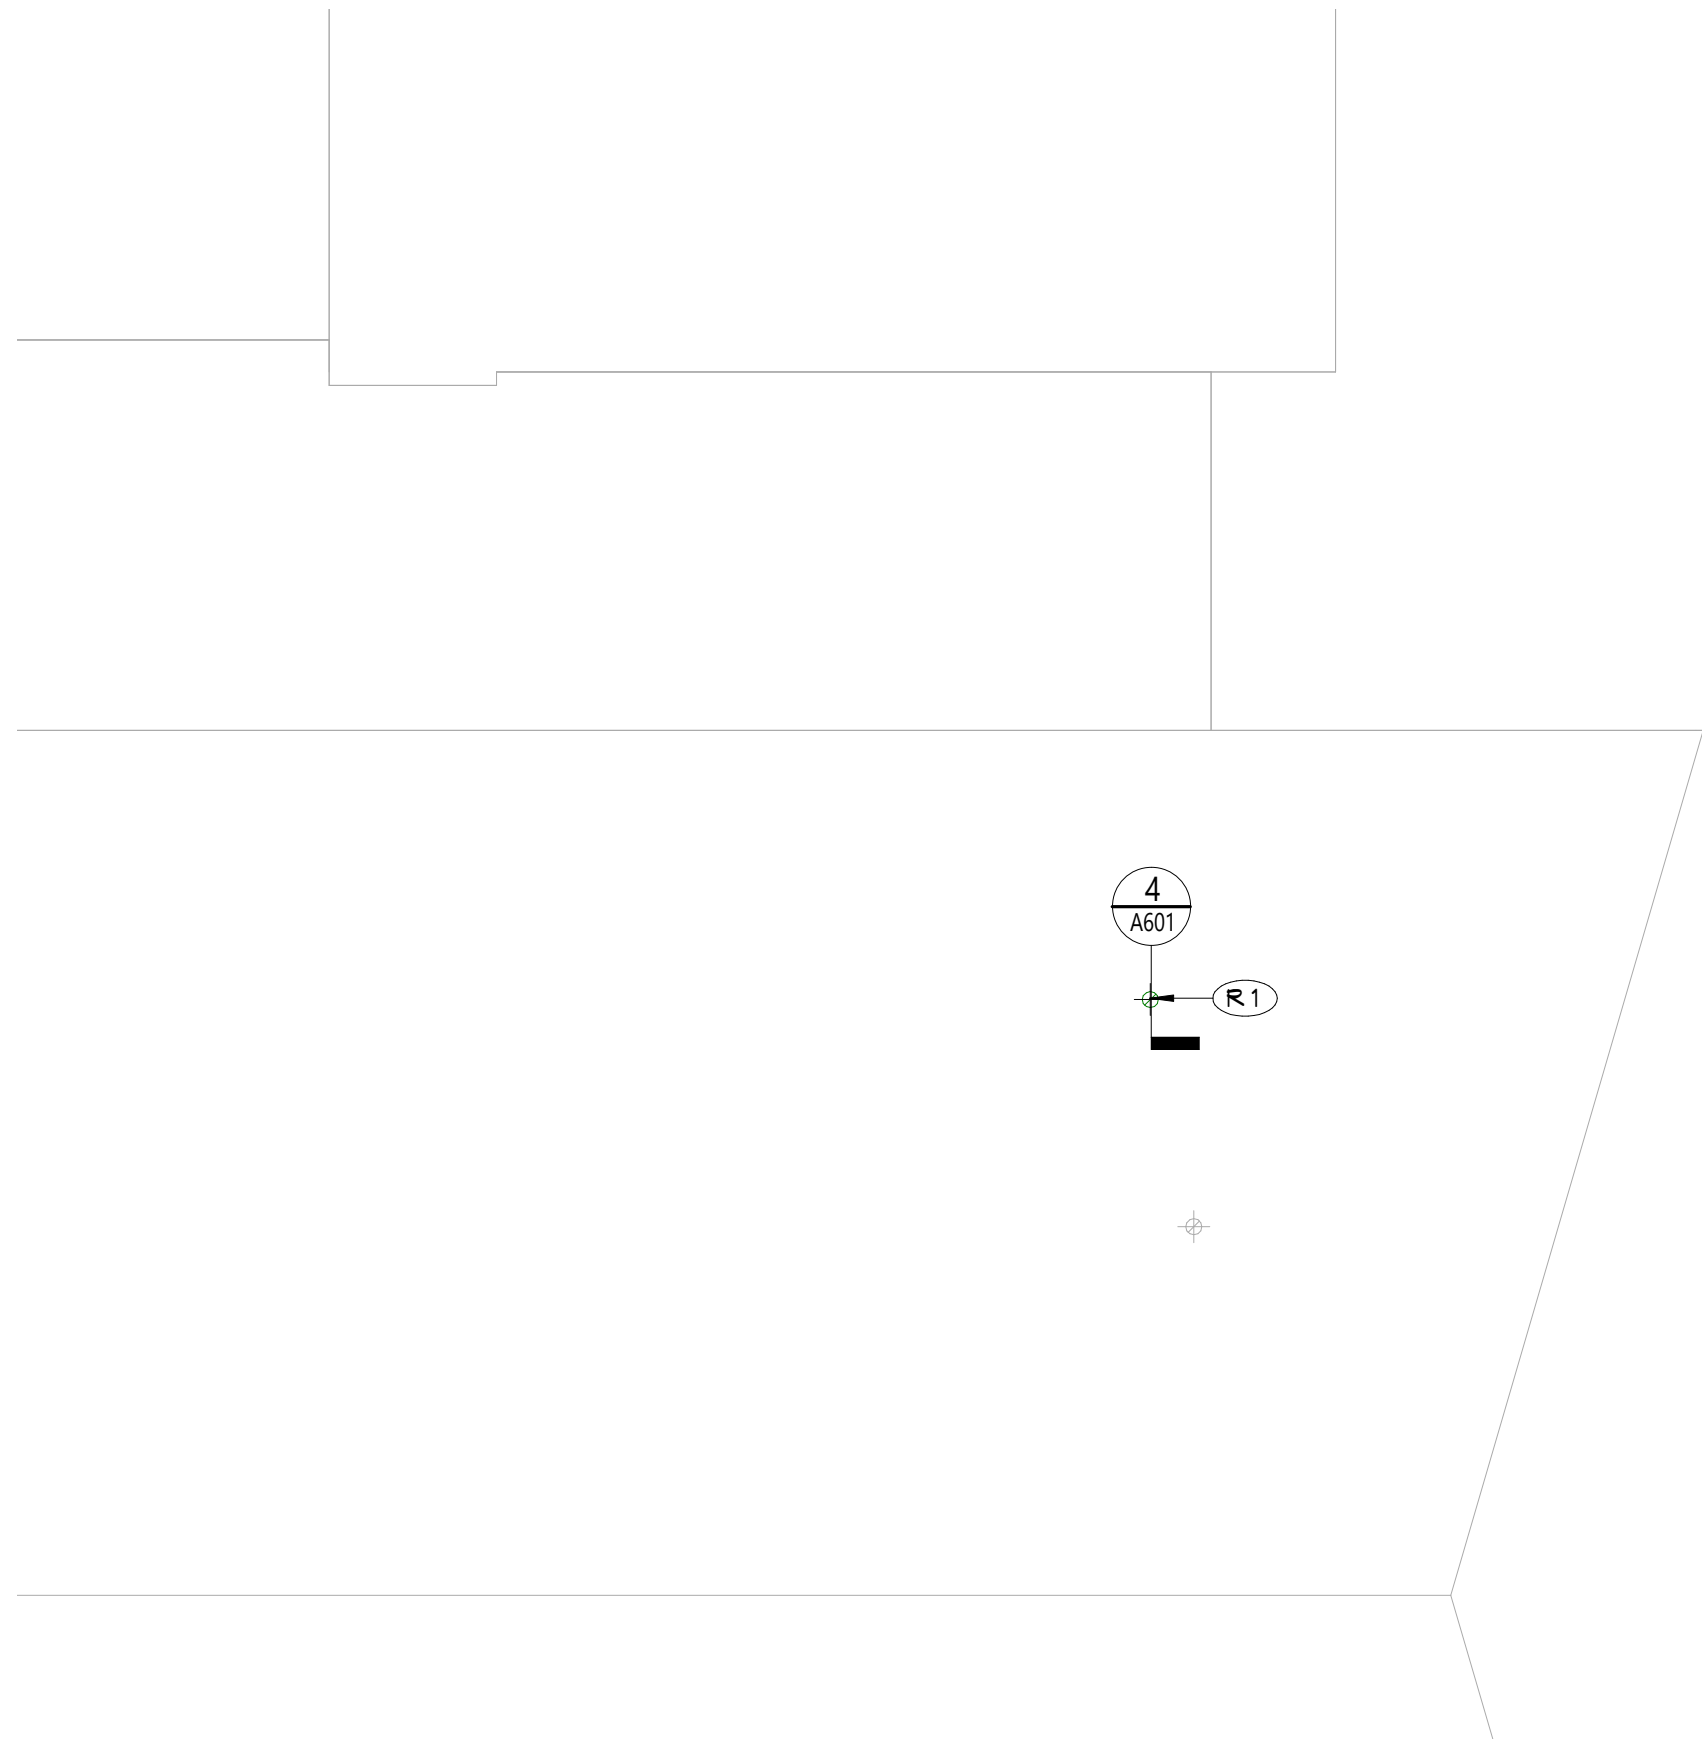

3 ENLARGED BOILER ROOF PLAN
A601 1/8" = 1'-0"

GENERAL NOTES

1. REFER TO SHEET G001 FOR ADDITIONAL GENERAL NOTES.
2. REFER TO A600 SERIES DRAWINGS FOR ENLARGED FLOOR AND ROOF PLANS, DETAILS, ADDITIONAL DIMENSIONS AND DETAILED INFORMATION.

ROOF GENERAL NOTES

1. ALL EXISTING ROOF DRAINS TO REMAIN, UNO.
2. REFER TO ROOF SCAN REPORT FOR LOCATION OF WET INSULATION / ROOFING. REMOVE ALL WET INSULATION / ROOFING AND PATCH WITH NEW ROOFING IN KIND TO MATCH EXISTING THICKNESS IN THAT AREA.
3. REFER TO ROOF SCAN REPORT FOR CORES TAKEN IN EXISTING ROOFING.
4. CURB SIZES SHOWN REFLECT PENETRATING DUCT SIZE. CURB SIZE MAY VARY. REFER TO MECHANICAL DRAWINGS, COORDINATE ACTUAL SIZE OF CURBS IN APPROVED SUBMITTALS.
5. NEW ROOF AND ROOF INSULATION FASTENERS TO ENGAGE HIGH POINT OF STEEL DECK FLUTES.
6. PROVIDE MINIMUM 1 1/2" RIGID INSULATION AT NEW FLAT ROOF AREAS, TAPER INSULATION TO HEIGHTS INDICATED.


ROOF LEGEND

- RD ROOF DRAIN, REFER TO PLUMBING DRAWINGS
- SD SECONDARY DRAIN, REFER TO PLUMBING DRAWINGS
- SC ROOF SCUPPER
- VP VENT PIPE, REFER TO PLUMBING DRAWINGS
- MP ROOF PENETRATIONS, REFER TO MECHANICAL DRAWINGS
- AH ROOF ACCESS HATCH
- INDICATES DIRECTION OF SLOPE AT 1/4" PER FOOT MINIMUM, UNO
- RL ROOF LADDER
- EJ EXPANSION JOINT

KEYNOTES

#	DESCRIPTION
M 1	MECHANICAL INSTALLATION, REFER TO 'M' DRAWINGS
M 1	MECHANICAL REMOVAL, REFER TO 'M' DRAWINGS
R 1	PROVIDE A NEW CUT OUT OF THE EXISTING ROOF SYSTEM AND DECK TO SUPPORT A NEW BOILER VENT PIPE PENETRATION, REFER TO DETAIL FOR MORE INFORMATION

KEY PLAN

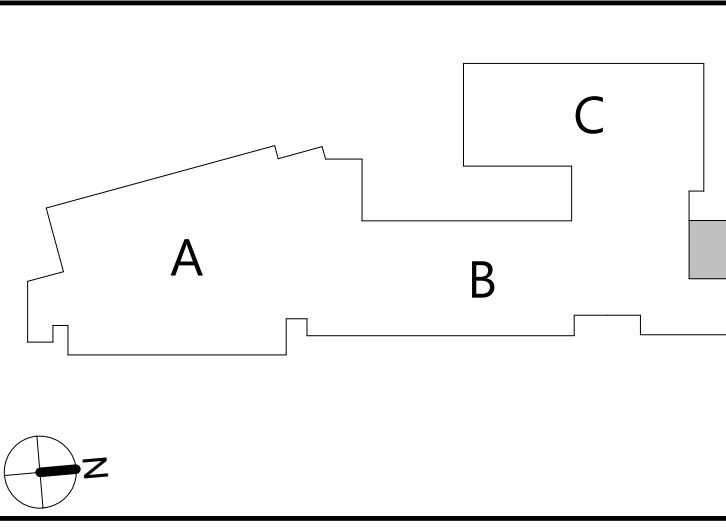

COPYRIGHT © ALL RIGHTS RESERVED

40 Beaver St., Albany, New York 12207-1511
518-463-8866 www.csarch.com

CSARCH

Consultant

NYACK UFSD
LIBERTY ELEMENTARY SCHOOL
BOILER REPLACEMENT PROJECT

Project Title



REV	DATE	DESCRIPTION

Drawn By:	Author
Checked By:	Checker
Proj. #:	50-03-04-83-0-006-017
CSArch Proj. #:	236-2302.00
Issued for Bid:	12/16/2024

Sheet Title

ENLARGED
PLANS


Sheet No.

LES
A601


CONSTRUCTION DOCUMENTS

C:\NEWIT Local Files\2300189\00_R22_Library ES MEP Model_mjaguirre@gpnet.com.rvt


SHEETMETAL LEGEND

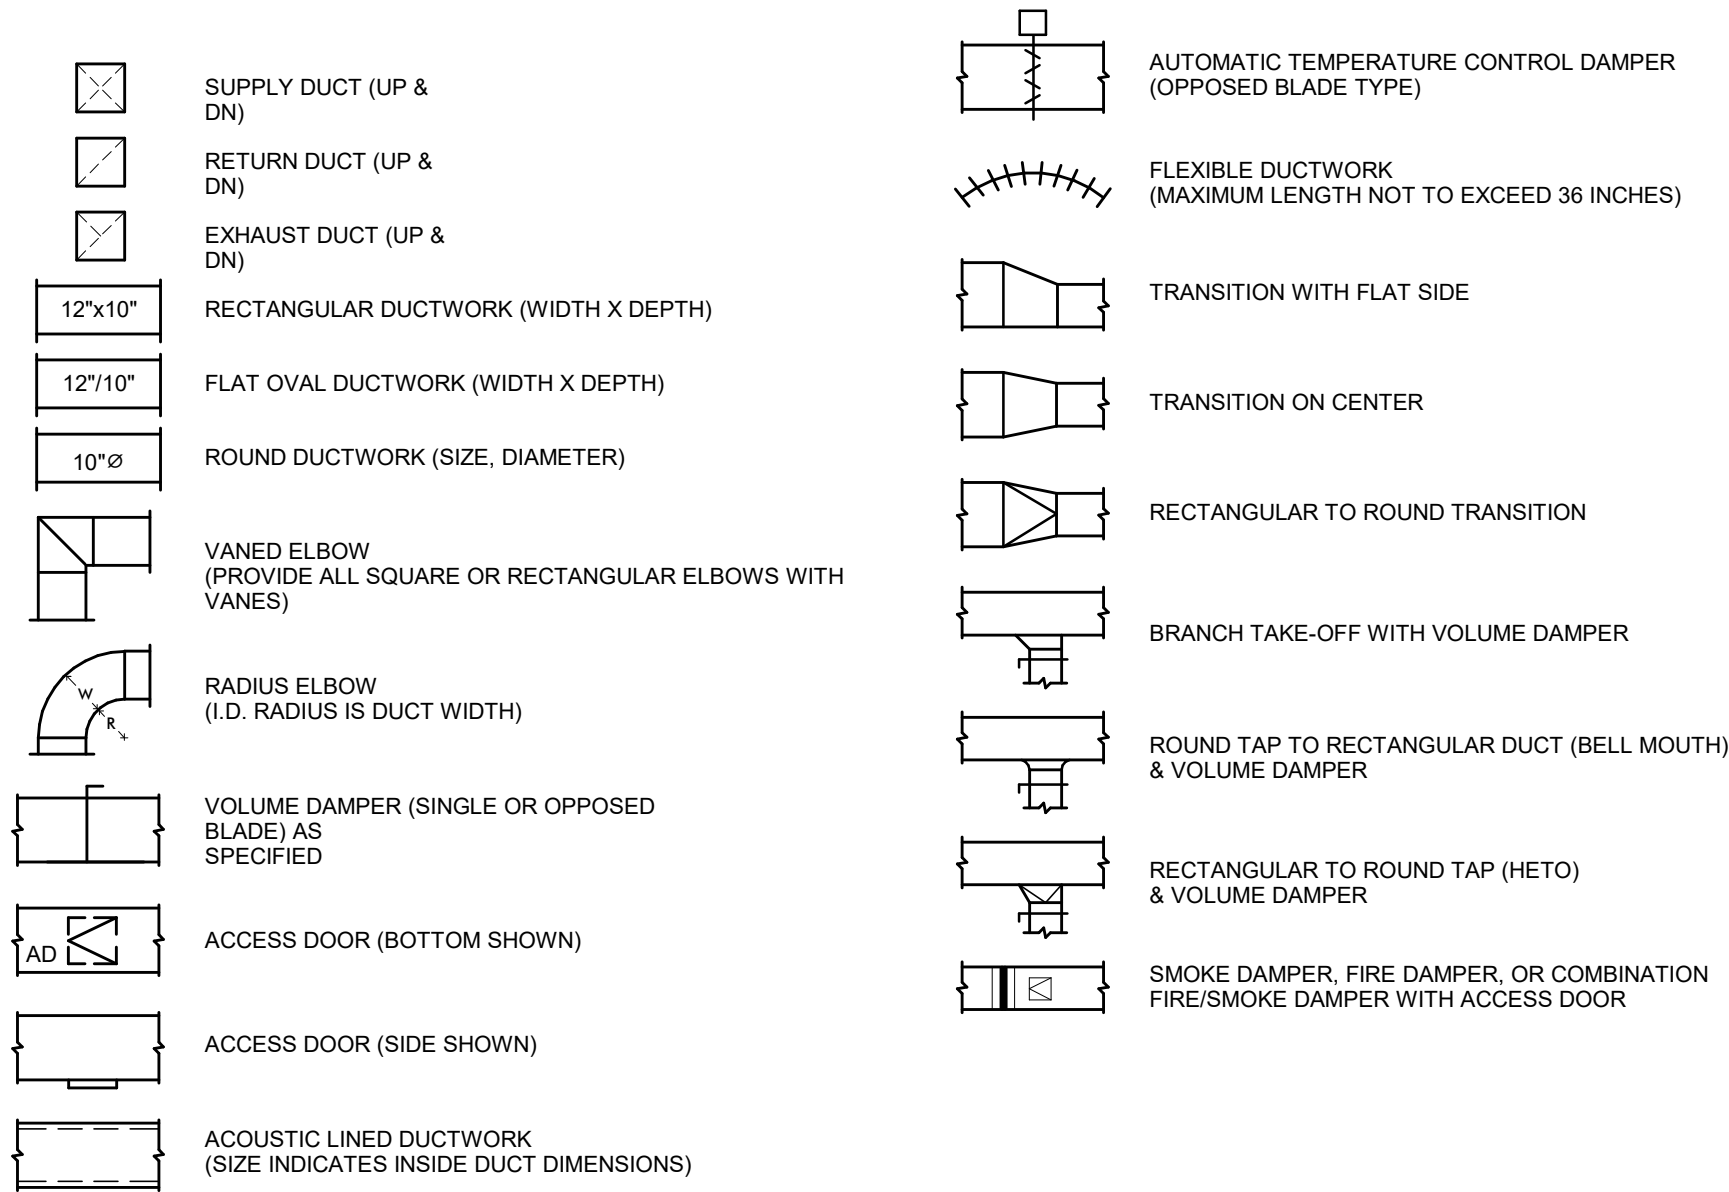

PIPING LEGEND

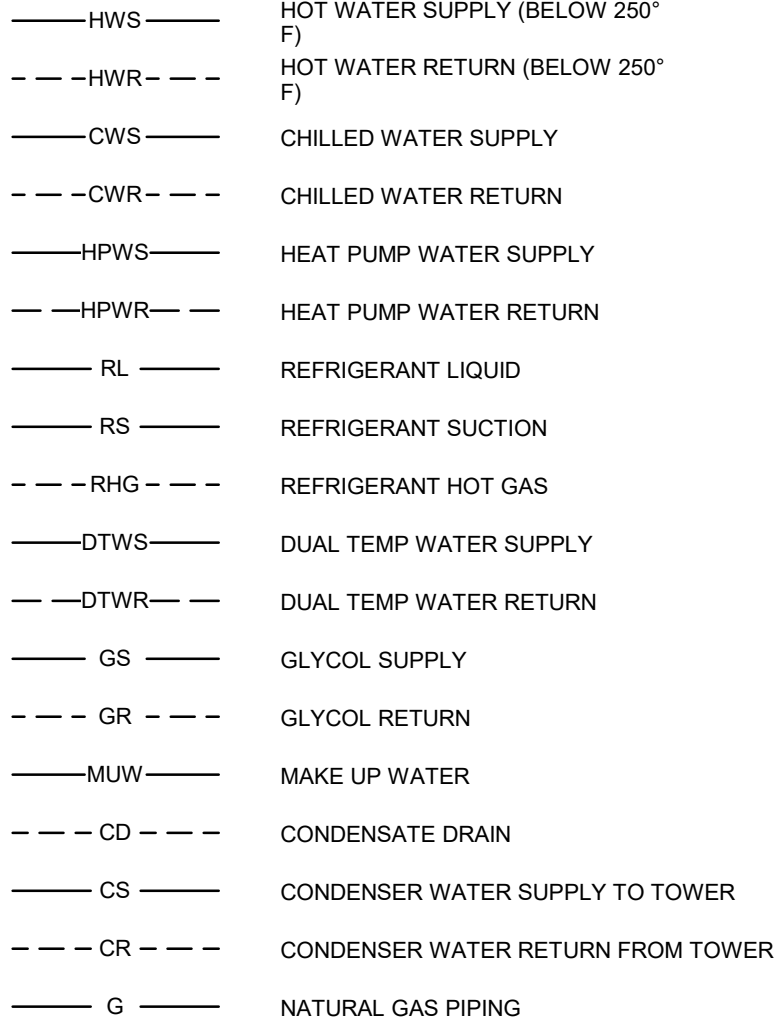



VALVE LEGEND

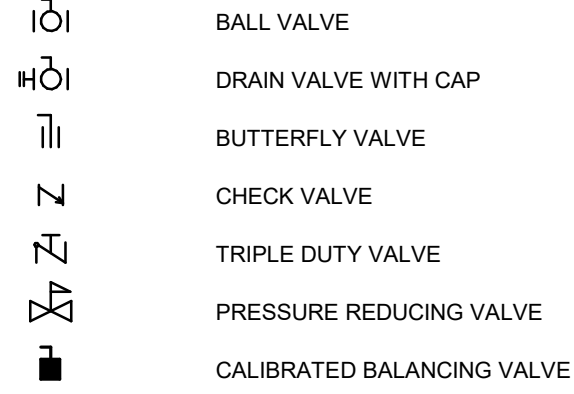

ABBREVIATION LEGEND

ABBREVIATION	DESCRIPTION
AD	ACCESS DOOR
AF	AIR FILTER
AFF	ABOVE FINISHED FLOOR
AHU	AIR HANDLING UNIT
APD	AIR PRESSURE DROP
AV	AUTOMATIC AIR VENT
BTUH	BRITISH THERMAL UNITS PER HOUR
CD	CEILING DIFFUSER
CEF	CEILING EXHAUST FAN
CFM	CUBIC FEET PER MINUTE
CMS	COMBINATION MOTOR STARTER
CO	CLEAN OUT
CONT	CONTINUED
CR	CEILING RETURN
CUH	CABINET UNIT HEATER
D	DECIBELS
DB	DRY BULB TEMPERATURE
DIA	DIAMETER
DPT	DEW POINT TEMPERATURE
E	EXISTING
EA	EXHAUST AIR
EAT	ENTERING AIR TEMPERATURE
EC	ELECTRICAL CONTRACTOR
EF	EXHAUST FAN
EFT	ENTERING FLUID TEMPERATURE
EG	EXHAUST GRILLE
EHC	ELECTRIC HEATING COIL
ER	EXHAUST REGISTER
ET	EXPANSION TANK
EWI	ENTERING WATER TEMPERATURE
EX	EXISTING
FCU	FAN COIL UNIT
FD	FIRE DAMPER
FD/SD	COMBINATION FIRE/SMOKE DAMPER
FF	FINAL FILTER
FL	FLOOR
FPM	FEET PER MINUTE
FT	FEET
G	GALLONS
GAL	GALLONS PER MINUTE
GPM	GLYCOL SUPPLY
GR	GRAVITY ROOF VENTILATION
GRV	GLYCOL SUPPLY
GS	GLYCOL SUPPLY
H	HEIGHT
HC	HEATING COIL
HGT	HEIGHT
HP	HORSEPOWER OR HEAT PUMP
HX	HEAT EXCHANGER
IN	INCH
KW	KILOWATT
L	LEAVING AIR TEMPERATURE
LAT	LEAVING AIR TEMPERATURE
LB/HR	POUNDS PER HOUR
LD	LINEAR DIFFUSER
LFT	LEAVING FLUID TEMPERATURE
LWT	LEAVING WATER TEMPERATURE
M	MAXIMUM
MAX	MAXIMUM
MBH	ONE THOUSAND BRITISH THERMAL UNITS PER HOUR
MC	MECHANICAL CONTRACTOR
MD	MOTORIZED DAMPER
MIN	MINIMUM
N	NOMINAL
NIC	NOT IN CONTRACT
NOM	NOMINAL
OA	OUTSIDE AIR
P	PUMP
PC	PUMPED CONDENSATE
PD	PRESSURE DROP
PRV	PRESSURE REDUCING VALVE OR POWER ROOF VENTILATOR
PSIG	POUND PER SQUARE INCH - GAUGE
R	RETURN AIR
RA	RETURN AIR
RF	RETURN FAN
RG	RETURN GRILLE
RM	ROOM
RPM	REVOLUTIONS PER MINUTE
RR	RETURN REGISTER
RTU	ROOF-TOP UNIT
S	SUPPLY AIR
SA	SUPPLY AIR
SD	SMOKE DAMPER
SF	SUPPLY FAN
SP	STATIC PRESSURE
SR	SUPPLY REGISTER
T	TRANSFER OPENING
TO	TRANSFER OPENING
U	UNIT VENTILATOR
UNO	UNLESS NOTED OTHERWISE
UV	UNIT VENTILATOR
V	VENTILATION AIR
VA	VARIABLE AIR VOLUME
VAV	VARIABLE AIR VOLUME
VD	VOLUME DAMPER
VFD	VARIABLE FREQUENCY DRIVE
W	WET BULB TEMPERATURE
WB	WET BULB TEMPERATURE
WG	WATER GAUGE
WMS	WIRE MESH SCREEN
WPD	WATER PRESSURE DROP

SPECIALTY LEGEND

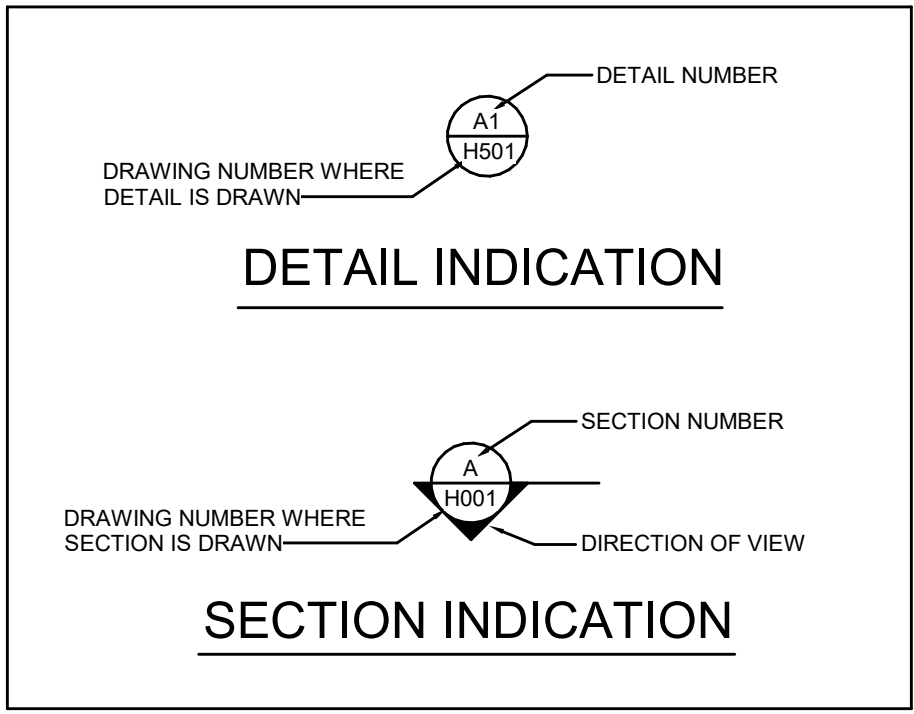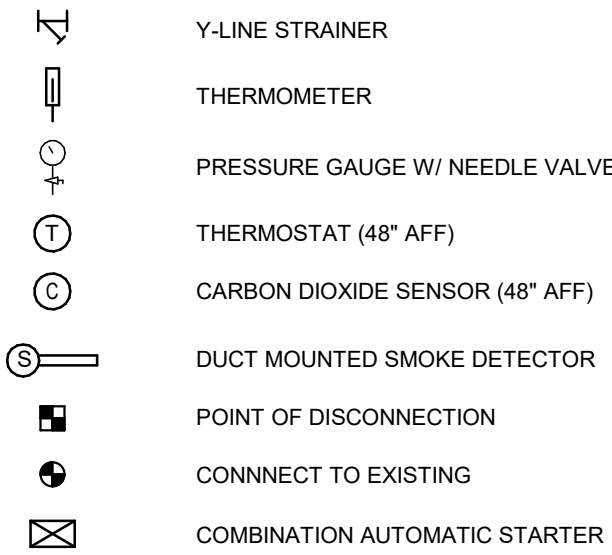

ENERGY CONSERVATION CODE COMPLIANCE STATEMENT.

TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGMENT THE PLANS AND SPECIFICATIONS COMPLY WITH THE LATEST EDITION OF THE ENERGY CONSERVATION CODE OF NEW YORK STATE.

THE HVAC SYSTEM WAS DESIGNED IN ACCORDANCE WITH THE 2020 NEW YORK STATE ENERGY CONSERVATION CODE CHAPTER 4 (COMMERCIAL ENERGY EFFICIENCY), ACCEPTABLE PRACTICE FOR COMMERCIAL BUILDINGS METHOD, THE HEAT AND COOLING LOAD CALCULATIONS WERE PERFORMED IN ACCORDANCE WITH ASHRAE HANDBOOK OF FUNDAMENTALS CHAPTER 17 AND 18, AND APPROPRIATE EXTERIOR DESIGN ZONE CONDITIONS.

BOILER SCHEDULE

TAG	LOCATION	SERVICE	FUEL	GAS PRESSURE MAX. / MIN. (IN. WC)	INPUT (MBH)	NET OUTPUT (MBH)	THERMAL EFFICIENCY	MAX. PRESSURE RATING (PSIG)	RELIEF VALVE SETTING (PSIG)	ELECTRICAL			MANUFACTURER			REMARKS
										VOLTS	PHASE	FLA	AERCO	LOCHINVAR	PATTERSON KELLY	
B-2-LES	BOILER ROOM	BUILDING HEAT	NAT. GAS	14 / 4	3000	2790	94.6	160	60	208	3	10	BMK-3000	ACC. MFG.	ACC. MFG.	1,2,3,4,5,6,7,8,9


REMARKS: 1) PROVIDE CONDENSATE NEUTRALIZATION KIT; JIM ALCALINE TECHNOLOGIES NBT-610. EACH BOILER TO BE PIPE INDEPENDENTLY TO FLOOR DRAIN.
2) PROVIDE EXTERNAL GAS REGULATOR APPROVED FOR VENTLESS INSTALLATION; PIETRO FIORENTINI GOVERNOR.
3) PROVIDE SAFETY RELIEF VALVE.
4) PROVIDE WITH TWO (2) MANUAL RESET LOW-WATER CUTOFFS, MAIN AND AUXILIARY.
5) BOILER CERTIFIED FOR ASME CSO-1.
6) PROVIDE VENTING SUPPLIER TO PROVIDE CALCULATIONS VERIFYING VENTING SYSTEM DESIGN IS COMPATIBLE WITH BOILERS.
7) BOILER PUMPS TO BE STARTED/STOPPED AND SPEED MODULATED TO MATCH BOILER FIRING RATE TO CONTROL BOILER TEMPERATURE RISE ACROSS OPERATING RANGE.
8) PROVIDE BACnet BMS INTERFACE.
9) BOILER TO BE PROVIDED TO FIT WITHIN A 28" OPENING.

PUMP SCHEDULE

TAG	LOCATION	SERVICE	TYPE	GPM	HEAD (FT)	FLUID	ELECTRICAL			STARTER	MANUFACTURERS	REMARKS	
							H.P.	RPM	VOLTS		PH.		TYPE
EX CP-1	BOILER ROOM	BOILER EXB-1-LES	INLINE	260	30	WATER	3	1760	208	3	'B'	KV3007	1
EX CP-2	BOILER ROOM	BOILER B-2-LES	INLINE	260	30	WATER	3	1760	208	3	'B'	KV3007	1


REMARKS: 1) EXISTING PUMP TO BE REUSED. REPLACE MOTOR AS REQUIRED TO ACCOMMODATE NEW VFD.

- CONCRETE PAD
- 6"x6-W2.9 x W2.9 WWF
- TOP OF SLAB
- CLEAN AND SCORE FLOOR SLAB
- #4 BAR DOWELS 3" EMBEDMENT INTO SLAB, GROUT FILL AROUND DOWEL MIN. (4) PER PAD. REFER TO SCHEDULE FOR LOCATION

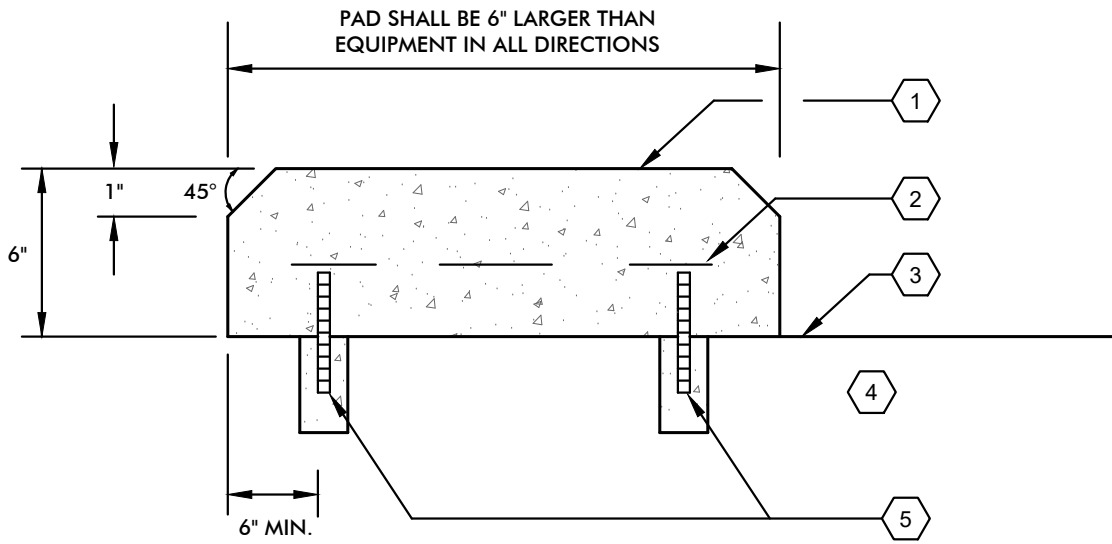


1 CONCRETE PAD DETAIL
SCALE: NONE

- PIPE
- PIPE INSULATION
- PIPE INSULATION SHIELD
- HIGH DENSITY FILLER PIECE
- PIPE INSULATION PROTECTION SADDLE
- HANGER ROD
- SECURING NUTS WITH WASHERS
- FOR ALL PIPES UNDER 2" IN SIZE USE 1-1/2"x1-1/2"x1/4" ANGLE. ALL PIPES 2" IN SIZE AND LARGER USE 3"x2"x1/4" ANGLE

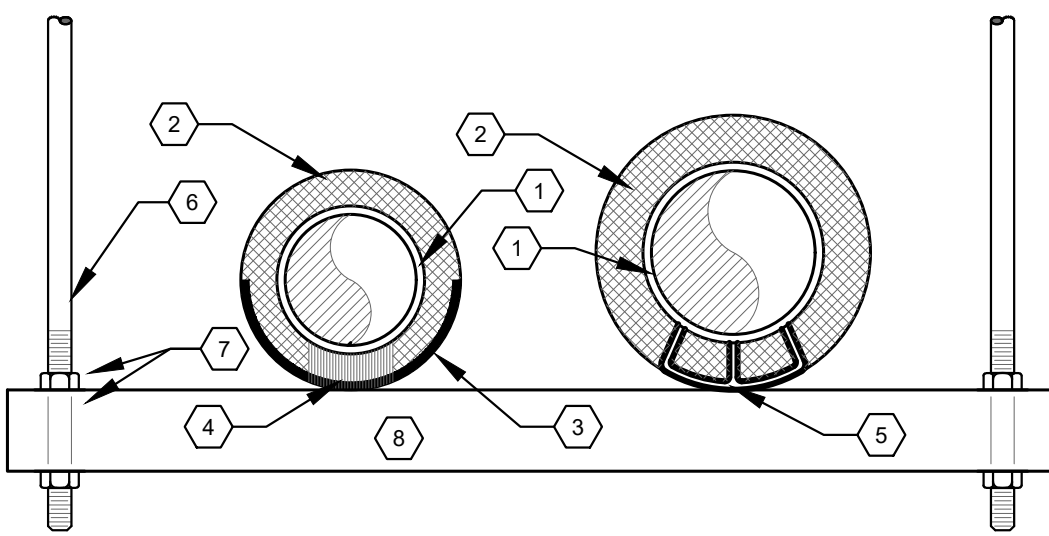

2 TYPICAL TRAPEZE SUPPORT
SCALE: NONE

- PIPE
- PIPE INSULATION
- PIPE INSULATION SHIELD
- HIGH DENSITY FILLER PIECE
- CLEVIS PIPE HANGER
- HANGER ROD
- SECURING NUTS WITH WASHERS

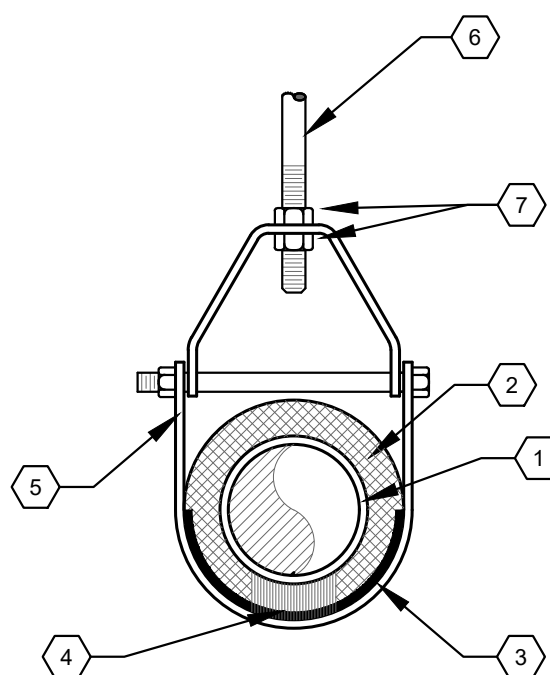


3 TYPICAL CLEVIS HANGER
SCALE: NONE

19 Front St., Newburgh, New York 12550-7601
845-561-1317 www.csarch.com



NYACK UFSD LIBERTY ELEMENTARY SCHOOL BOILER REPLACEMENT PROJECT

Project Title

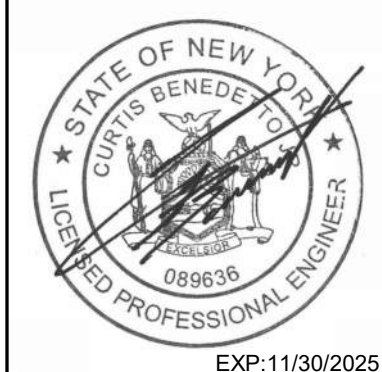

DATE	DESCRIPTION

Drawn By: PM
Checked By: JM
Proj. #: 50-03-04-03-0-006-017
CSArch Proj. #: 226-2302.00
Issued for Bid: 12/16/2024

Sheet Title


MECHANICAL
LEGENDS AND
ABBREVIATIONS

Sheet No.

LES
M001


CONSTRUCTION DOCUMENTS

COPYRIGHT © ALL RIGHTS RESERVED




1. DISCONNECT AND REMOVE EXISTING BOILER AND BURNER. REMOVE THE FUEL LINE INCLUDING ASSOCIATED WATER PIPING, VALVES, INSULATION, CONTROLS AND WIRING. GAS TRAIN, FUEL OIL, CONDENSATE PIPING AND SUPPORTS. EXISTING CONNECTING BACK TO REMAIN AND BE REUSED.
2. DISCONNECT AND REMOVE EXISTING BOILER CIRC. PUMP COMPLETE INCLUDING ASSOCIATED PIPING, INSULATION, CONTROLS, HANGERS AND SUPPORTS. SALVAGE PUMP FOR REUSE.
3. DISCONNECT AND REMOVE EXISTING BREECING COMPLETE INCLUDING EXISTING FITTINGS, INSULATION, HANGERS AND SUPPORTS.
4. DISCONNECT AND REMOVE EXISTING PIPING BACK TO POINT-OF-DISCONNECTION INCLUDING ASSOCIATED VALVES, INSULATION, CONTROL SENSORS, HANGERS AND SUPPORTS.
5. EXISTING AIR SEPARATOR TO REMAIN AND BE REUSED.
6. EXISTING EXPANSION TANK TO REMAIN AND BE REUSED.
7. EXISTING BACKFLOW PREVENTER AND PRESSURE REDUCING VALVE (PRV & P) TO REMAIN AND BE REUSED.
8. DISCONNECT AND REMOVE EXISTING GAS PIPING BACK TO POINT OF DISCONNECTION INCLUDING ALL ASSOCIATED VALVES, CONTROLS, VENT PIPING, HANGERS AND SUPPORTS.
9. DISCONNECT AND REMOVE EXISTING 3-WAY VALVE INCLUDING ALL ASSOCIATED LOCAL PIPING TO POINT-OF-DISCONNECTION INCLUDING INSULATION, CONTROL, HANGERS AND SUPPORTS.
10. EXISTING EMERGENCY BOILER SHUTDOWN CONTROL BY OTHERS.
11. DISCONNECT AND REMOVE EXISTING ABANDONED FUEL OIL LINE INCLUDING ASSOCIATED GAS PIPING, VALVES, FILTERS, CONTROLS, HANGERS AND SUPPORTS. REMOVE EXISTING CONDENSATE PIPING AND SUPPORTS AND COME.



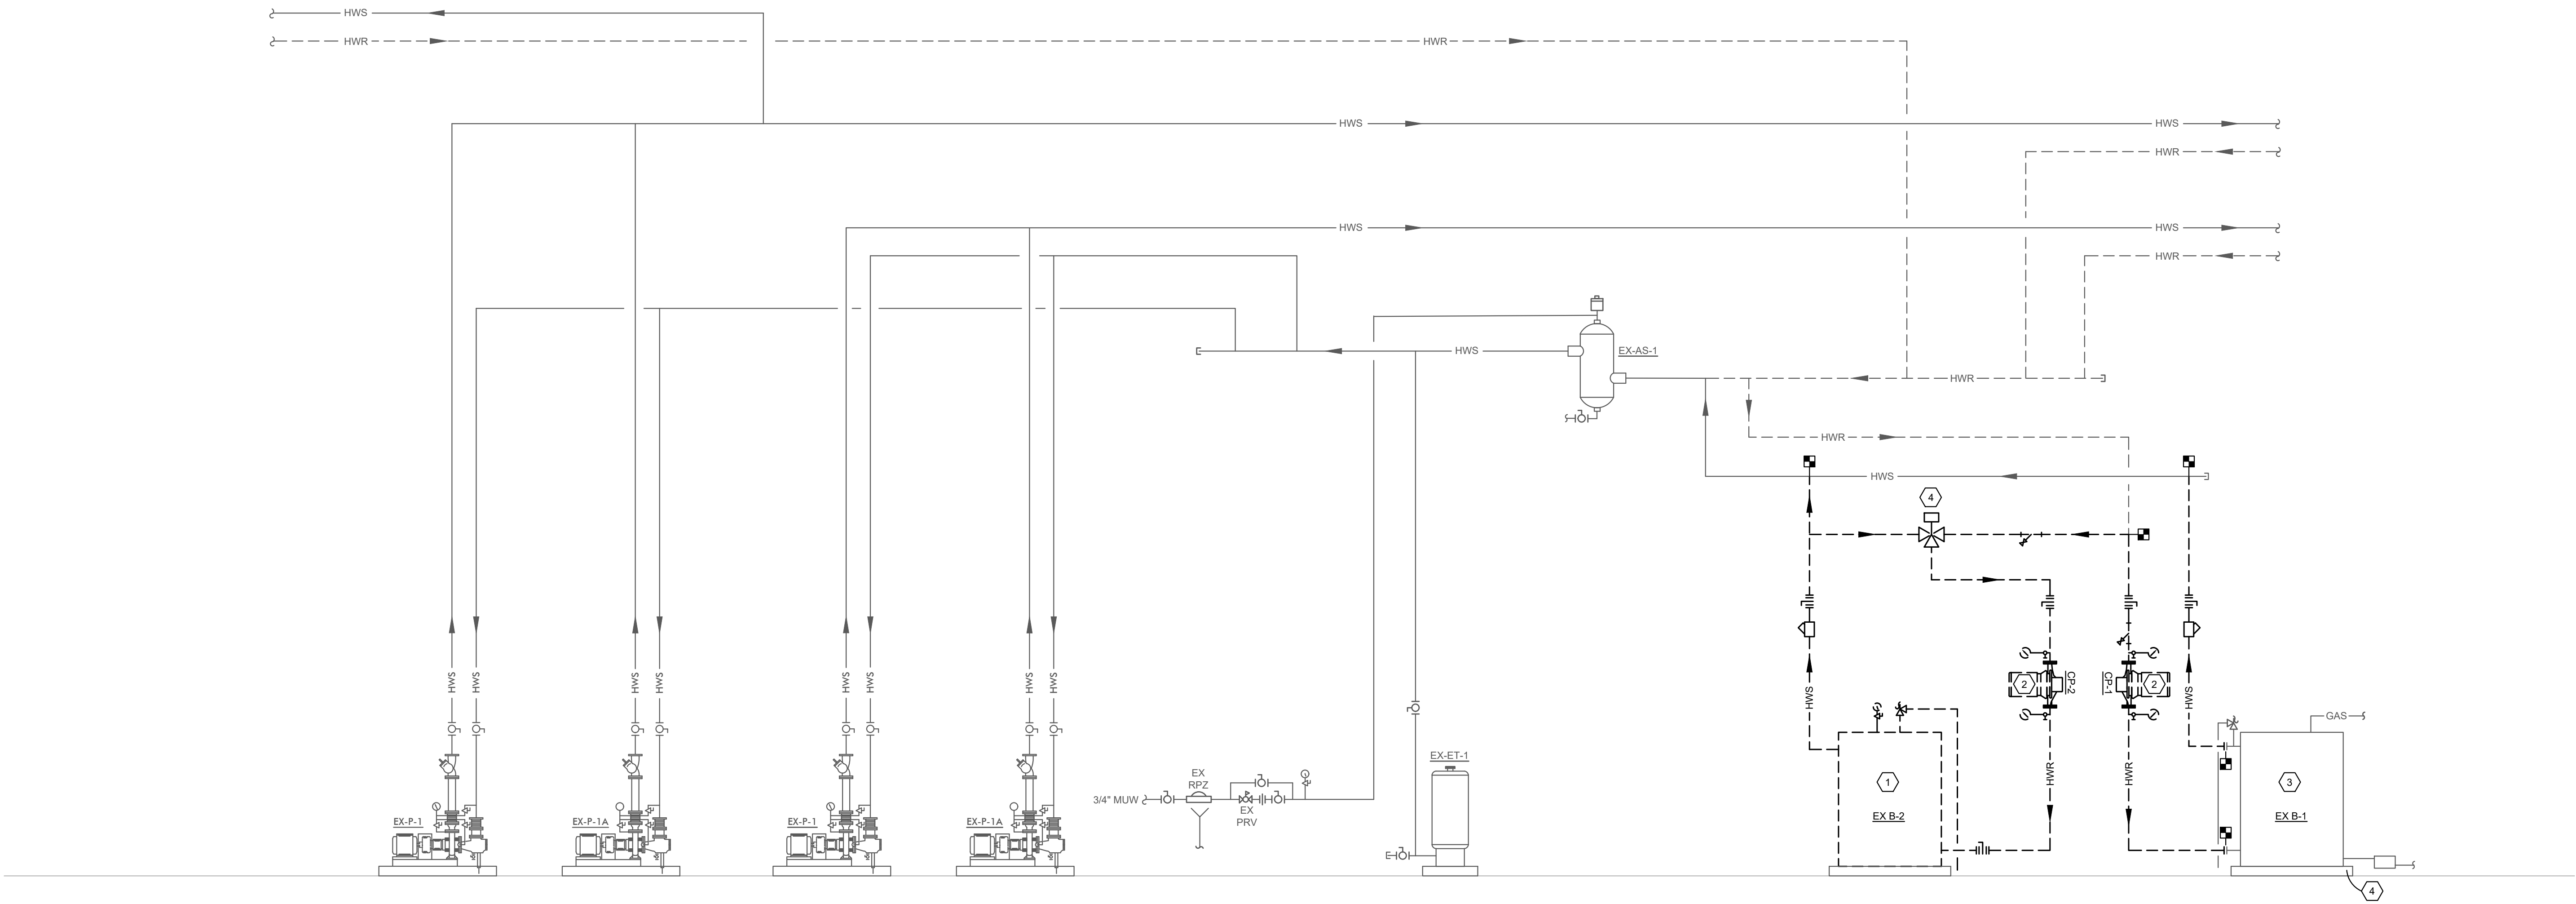

1 M301 BOILER PIPING SCHEMATIC - REMOVAL
SCALE: NONE

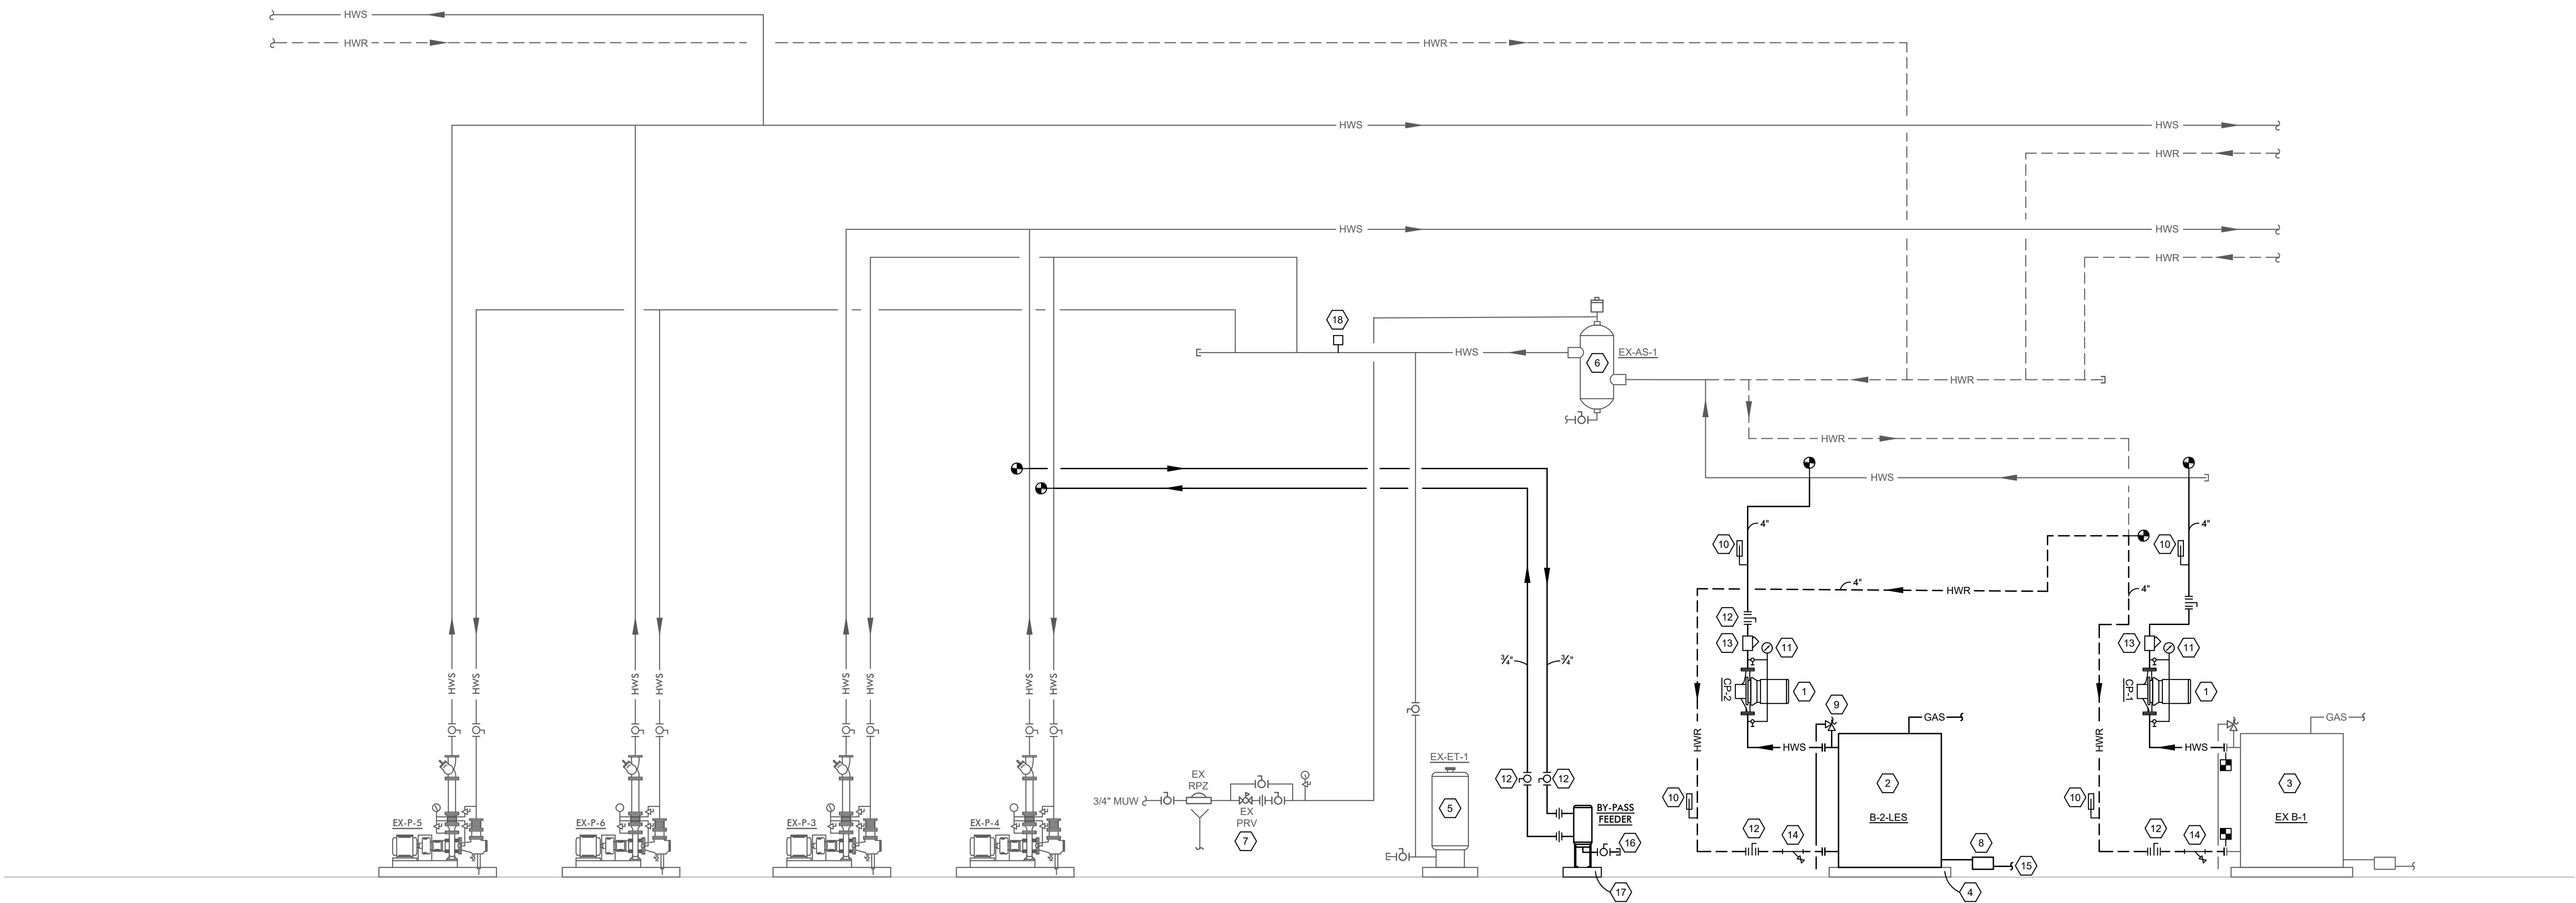

1 M301 BOILER PIPING SCHEMATIC - NEW
SCALE: NONE

KEYED REMOVAL NOTES:

- 1 DISCONNECT AND REMOVE EXISTING BOILER AND BURNER COMPLETE INCLUDING ASSOCIATED HEATING HOT WATER PIPING, VALVES, INSULATION, CONTROLS AND WIRING, GAS TRAIN, FUEL OIL PIPING, HANGERS AND SUPPORTS. REMOVE EXISTING CONCRETE PAD COMPLETE.
- 2 DISCONNECT AND REMOVE EXISTING BOILER CIRC. PUMP COMPLETE INCLUDING ASSOCIATED PIPING, VALVES, INSULATION, CONTROLS, HANGERS AND SUPPORTS. SALVAGE PUMP FOR REUSE. TACO KV3007, 3HP, 208V/3PH.
- 3 EXISTING BOILER TO REMAIN AND BE REPIPE.
- 4 DISCONNECT AND REMOVE EXISTING 3-WAY VALVE INCLUDING ALL ASSOCIATED LOCAL PIPING TO POINT-OF-DISCONNECTION, VALVE, INSULATION, CONTROL, HANGERS AND SUPPORTS.

KEYED NOTES:

- 1 NEW LOCATION OF EXISTING PUMP
- 2 NEW BOILER
- 3 EXISTING BOILER
- 4 CONCRETE HOUSEKEEPING PAD; MODIFY AS REQUIRED TO ACCOMMODATE CONDENSATE TRAP AND NEUTRALIZATION KIT
- 5 EXISTING EXPANSION TANK (SET PRECHARGE TO 20 PSI)
- 6 EXISTING AIR SEPARATOR
- 7 EXISTING PRESSURE REDUCING VALVE (SET TO 15 PSI)
- 8 CONDENSATE DRAIN TRAP AND NEUTRALIZATION KIT
- 9 SAFETY RELIEF VALVE
- 10 THERMOMETER
- 11 PRESSURE GAUGE
- 12 SHUT-OFF VALVE
- 13 TRIPLE DUTY VALVE
- 14 STRAINER W/ BLOWDOWN
- 15 PIPE FULL SIZE TO FLOOR DRAIN
- 16 DRAIN VALVE
- 17 CONCRETE PAD
- 18 EMS WATER TEMPERATURE SENSOR

120V

120V

BOILER CIRCUIT

BOILER #1

BOILER #2

SPARE

SPARE

120V

NC CONTACT IN GAS SENSOR ALARM PANEL

N

RELAY - SQUARE "D" CLASS 8501 CATALOG #BX-40 IN NEMA 1 ENCLOSURE. MOUNT NEXT TO POWER PANEL.

1

E001

TYPICAL BOILER EMERGENCY SHUTDOWN WIRING DIAGRAM

1/8" = 1'-0"

C:\Users\frap\Documents\2300189\00_022_Liberty ES MEP Model_Frap\2B\MEP.rvt

Branch Panel: A

(EXISTING PANEL)

Location: BOILER ROOM

Supply From:

Mounting: Surface

Enclosure: Type 1

Volts: 120/208 Wye

Phases: 3

Wires: 4

A.I.C. Rating: 10 KAIC

Mains Type: MLO

Mains Rating: 100 A

Notes:

CK T	LOAD DESCRIPTION	WIRE SIZE	TRIP	POLES	A	B	C	POLES	TRIP	WIRE SIZE	LOAD DESCRIPTION	CK T
1	AC-RM 2	-	20 A	1	0.0 kVA	0.0 kVA			3	20 A	AIR COMPRESSOR	2
3	AC-RM 3	-	20 A	1		0.0 kVA	0.0 kVA		--	--	--	4
5	SC-RM 4	-	20 A	1			0.0 kVA	0.0 kVA	--	--	--	6
7	AC-RM 5	-	20 A	1	0.0 kVA	0.0 kVA			1	20 A	SERVER OUTLETS	8
9	GAS DETECTION CONTROL PANEL	#12	20 A	1		0.5 kVA	--	--	1	--	SPACE	10
11	SPACE	--	--	1			--	--	1	--	SPACE	12
13	SPACE	--	--	1	--	--			1	--	SPACE	14
15	SPACE	--	--	1		--	--		1	--	SPACE	16
17	SPACE	--	--	1			--	--	1	--	SPACE	18
19	SPACE	--	--	1	--	--			1	--	SPACE	20
21	SPACE	--	--	1		--	--		1	--	SPACE	22
23	SPACE	--	--	1			--	--	1	--	SPACE	24

Branch Panel: BR

(EXISTING PANEL)

Location: BOILER ROOM

Supply From:

Mounting: Surface

Enclosure: Type 1

Volts: 120/208 Wye

Phases: 3

Wires: 4

A.I.C. Rating: 22 KAIC

Mains Type: M.O

Mains Rating: 200 A

Notes:

CK T	LOAD DESCRIPTION	WIRE SIZE	TRIP	POLES	A	B	C	POLES	TRIP	WIRE SIZE	LOAD DESCRIPTION	CK T
1	EXIT LIGHTS	-	20 A	1	0.0 kVA	0.0 kVA			1	20 A	FIRE ALARM PANEL	2
3	OUTSIDE LIGHTS	-	20 A	1		0.0 kVA	0.0 kVA		1	20 A	FIRE RELAY	4
5	EMG LTG	-	20 A	1			0.0 kVA	0.0 kVA	1	20 A	FIRE ALARM DIALER	6
7	EXIT LIGHTS	-	20 A	1	0.0 kVA	0.0 kVA			1	20 A	TELEPHONE OUTLET	8
9	OLD MASTER CLOCK	-	20 A	1		0.0 kVA	0.0 kVA		1	20 A	MASTER CLOCK	10
11	BOILER RM LIGHTS	-	20 A	1			0.0 kVA	0.0 kVA	1	20 A	OLD SOUND SYSTEM	12
13	GAS BURNER CIR#1	-	20 A	1	0.0 kVA	0.0 kVA			1	20 A	CIRC PUMP #1	14
15	POWER CONTROL	-	20 A	1		0.0 kVA	0.0 kVA		1	20 A	CIRC PUMP #2	16
17	DRYER OUTLET	-	20 A	1			0.0 kVA	0.0 kVA	1	20 A	JOHNSON CONTROL	18
19	PUMP #4	-	20 A	3	0.0 kVA	0.0 kVA			3	20 A	NEW BOILER #1	20
21	--	--	--	--		0.0 kVA	0.0 kVA		--	--	--	22
23	--	--	--	--			0.0 kVA	0.0 kVA	--	--	--	24
25	PUMP #3	-	20 A	3	0.0 kVA	0.0 kVA			3	20 A	HSB BOILER	26
27	--	--	--	--		0.0 kVA	0.0 kVA		--	--	--	28
29	--	--	--	--			0.0 kVA	0.0 kVA	--	--	--	30
31	PUMP #6	-	20 A	3	0.0 kVA	0.0 kVA			3	100 A	TELE OUTLETS	32
33	--	--	--	--		0.0 kVA	0.0 kVA		--	--	--	34
35	--	--	--	--			0.0 kVA	0.0 kVA	--	--	--	36
37	PUMP #5	-	20 A	3	0.0 kVA	0.0 kVA			3	20 A	NEW BOILER	38
39	--	--	--	--		0.0 kVA	0.0 kVA		--	--	--	40
41	--	--	--	--			0.0 kVA	0.0 kVA	--	--	--	42

Branch Panel: DP

(EXISTING PANEL)

Location: BOILER ROOM

Supply From:

Mounting: Surface

Enclosure: Type 1

Volts: 120/208 Wye

Phases: 3

Wires: 4

A.I.C. Rating: 22 KAIC

Mains Type: MLO

Mains Rating: 225 A

Notes:

CK T	LOAD DESCRIPTION	WIRE SIZE	TRIP	POLES	A	B	C	POLES	TRIP	WIRE SIZE	LOAD DESCRIPTION	CK T
1	NO TAG	-	60 A	2	0.0 kVA	0.0 kVA			2	30 A	MAIN OFFICE AC	2
3	--	--	--	--		0.0 kVA	0.0 kVA		--	--	--	4
5	SECURITY VEST HEAT	-	20 A	2			0.0 kVA	0.0 kVA	2	20 A	MAIN OFFICE AC	6
7	--	--	--	--	0.0 kVA	0.0 kVA			--	--	--	8
9	NO TAG	-	20 A	1		0.0 kVA	0.0 kVA		1	20 A	NO TAG	10
11	DOORBELL	-	20 A	1			0.0 kVA	0.0 kVA	1	20 A	OUTSIDE LIGHTS VIA TIME CLOCK	12
13	SPARE	-	20 A	1	0.0 kVA	0.0 kVA			1	20 A	OUTSIDE LIGHTS VIA TIME CLOCK	14
15	LTG METOR RM	-	20 A	1		0.0 kVA	0.0 kVA		1	20 A	EXHAUST FAN	16
17	SECURITY PANEL	-	20 A	1			0.0 kVA	0.0 kVA	1	20 A	NO TAG	18
19	CLASS RM FAN RECEPT	-	20 A	1	0.0 kVA	0.0 kVA			1	20 A	IT RM RECEPT	20
21	HWH	-	20 A	1		0.0 kVA	0.0 kVA		1	20 A	SECURITY VEST RECEPT	22
23	CIRC PUMP	-	20 A	1			0.0 kVA	0.0 kVA	1	20 A	NO TAG	24
25	WALK IN COOLER	-	20 A	2	0.0 kVA	0.0 kVA			1	20 A	COOLER LTG	26
27	--	--	--	--		0.0 kVA	0.0 kVA		1	20 A	NO TAG	28
29	EF-1	-	20 A	3			0.0 kVA	0.0 kVA	3	20 A	NO TAG	30
31	--	--	--	--	0.0 kVA	0.0 kVA			--	--	--	32
33	--	--	--	--		0.0 kVA	0.0 kVA		--	--	--	34
35	AIRCO BOILER	-	30 A	3			0.0 kVA	0.0 kVA	3	20 A	NO TAG	36
37	--	--	--	--	0.0 kVA	0.0 kVA			--	--	--	38
39	--	--	--	--		0.0 kVA	0.0 kVA		--	--	--	40
41	SPACE	--	--	1					1	--	SPACE	42

1
E101 1/4" = 1'-0"

2
E101 1/4" = 1'-0"

GENERAL NOTES


- A. LIGHT/GRAY LINES: ELECTRICAL ITEMS SHOWN WITH LIGHT/GRAY LINES ARE EXISTING TO REMAIN, UNLESS INDICATED OTHERWISE.
- B. BLACK/SOLID LINES: INDICATE NEW ELECTRICAL ITEMS.

KEYED NOTES - REMOVALS

- (R1) DISCONNECT AND REMOVE ALL ELECTRICAL SERVICES TO BOILER AND REMOVE ALL CONDUIT AND WIRING BACK TO SOURCE.
- (R2) DISCONNECT AND REMOVE ALL ELECTRICAL SERVICES BACK TO SOURCE FROM FUEL PUMP SET.
- (R3) PROVIDE SURFACE WALL MOUNTED 6" ABOVE TOP OF DOOR FRAME COMBINATION EMERGENCY / EXIT LIGHT SIMILAR TO LITHONIA ALUMINUM-LED-P-ARM, WIRE TO ROOM LIGHTING CIRCUIT AHEAD OF ALL SWITCHES.
- (R4) DISCONNECT, REMOVE AND REPLACE INCANDESCENT PENDANT LIGHT FIXTURE WITH LED INDUSTRIAL STRIP FIXTURE SIMILAR TO LITHONIA IXL1D-L24-SMR-3500LM-FST-INVOLT-30K-60CR-WH-WG224-25PRG.
- (R5) DISCONNECT AND REMOVE CIRCUIT CONDUIT AND WIRING SERVING PUMP, BACK TO STARTER/DISCONNECT SWITCH.
- (R6) REMOVE AND REPLACE BOILER EMERGENCY SHUT DOWN SWITCHES, SEE DETAIL E101. INTERCEPT EMERGENCY BOILER SHUT DOWN CIRCUIT CONDUIT AT BOILER TO BE REPLACED, CUT BACK AND MAINTAIN TO ALLOW FOR BOILER TO BE REPLACED. ONCE NEW BOILERS HAS BEEN INSTALLED SPLICE AND EXTEND CONDUIT AND WIRING (MATCHING) EXISTING SIZE, TYPE AND QUANTITIES) AND CONNECT TO EACH NEW BOILER SHUT DOWN TERMINALS.
- (R7) DISCONNECT AND REMOVE PUMP STARTER, CUT BACK ALL ELECTRICAL SERVICES TO ALLOW FOR REMOVAL AND MAINTAIN.

KEYED NOTES - NEW WORK

- (N1) INTEREPT AND EXTEND EXISTING BOILER CIRCUIT RETAINED FROM REMOVALS AND CONNECT TO BOILER.
- (N2) OBTAIN PUMP COMBINATION MOTOR STARTER FROM MC AND INSTALL AND WIRE AS INDICATED. EXTEND EXISTING ELECTRICAL SERVICES RETAINED FROM REMOVALS AND RECONNECT TO NEW COMBINATION MOTOR STARTER.
- (N3) PROVIDE 1P-20AMP BRANCH BREAKER IN EXISTING SPARE SPACE #6 IN PANEL "A". BREAKER SHALL BE GE TYPE "THQL".
- (N4) PROVIDE GAS DETECTOR WITH REMOTE SENSOR (METHANE) SIMILAR TO RC SYSTEMS #SENSMART3200 WITH POWER SUPPLY #10-0314. WIRE REMOTE SENSOR TO DETECTOR WITH 4#183 SHIELDED CABLE IN 1/2". PROVIDE FIRE ALARM RELAY TO MONITOR ALARM STATUS OF GAS DETECTOR. UPON GAS DETECTOR ALARM FIRE ALARM CONTROL PANEL SHALL ANNUNCIATE A TROUBLE CONDITION AND SHALL INDICATE "BOILER ROOM GAS ALARM" ON DISPLAY PANEL.

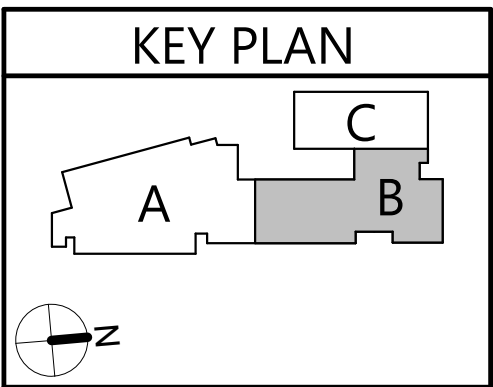


19 Front St., Newburgh, New York 12550-7601
845-561-1317 www.csarch.com



NYACK UFSD
LIBERTY ELEMENTARY SCHOOL
BOILER REPLACEMENT PROJECT

Project Title

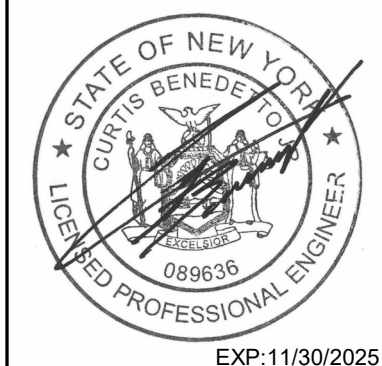

DATE	DESCRIPTION

Drawn By: RS
Checked By: CB/MA
Proj. #: 50-03-04-03-0-006-017
CSArch Proj. #: 226-2302-00
Issued for Bid: 12/16/2024

Sheet Title

ELECTRICAL
PLAN

Sheet No.

LES
E101

CONSTRUCTION DOCUMENTS

COPYRIGHT © ALL RIGHTS RESERVED